

Annual Groundwater Monitoring and Corrective Action Report

Indiana Michigan Power Company

Rockport Plant

Bottom Ash Pond CCR Units

Rockport, Indiana

January 31, 2026

Prepared by:

American Electric Power Service Corporation

1 Riverside Plaza

Columbus, Ohio 43215



An **AEP** Company

Table of Contents

I	Overview	1
II.	Groundwater Monitoring Well Locations and Identification Numbers	3
III.	Monitoring Wells Installed or Decommissioned	3
IV.	Groundwater Quality Data and Static Water Elevation Data, With Flow Rates and Flow Directions	3
V.	Groundwater Quality Data Statistical Analysis	3
VI.	Alternate Source Demonstrations	4
VII.	Discussion About Transition Between Monitoring Requirements or Alternate Monitoring Frequency	5
VIII.	Other Information Required	5
IX.	Description of Any Problems Encountered and Actions Taken	5
X.	A Projection of Key Activities for the Upcoming Year	5

Appendix 1: Groundwater Data Tables and Figures

Appendix 2: Statistical Analyses

Appendix 3: Alternative Source Demonstrations

Appendix 4: Notices for Monitoring Program Transitions

Appendix 5: Well Installation/Decommissioning Logs

Abbreviations:

ASD - Alternate Source Demonstration

CCR – Coal Combustion Residual

GWPS - Groundwater protection standards

SSI - Statistically Significant Increase

SSL - Statistically Significant Level

I Overview

This *Annual Groundwater Monitoring and Corrective Action Report* (Report) has been prepared to report the status of activities for the preceding year at the bottom ash pond (BAP) CCR unit at Indiana Michigan Power Company's (I&M) Rockport Plant. The Indiana Michigan Power Company is wholly owned subsidiary of American Electric Power Company (AEP). The USEPA's CCR rules require that the Annual Groundwater Monitoring and Corrective Action Report covering the previous year's groundwater monitoring activities be posted to the operating record no later than January 31, 2026.

In general, the following activities were completed:

- At the start of the current annual reporting period, the BAP was operating under the assessment monitoring program.
- At the end of the current annual reporting period, the BAP was operating under the assessment monitoring program.
- The BAP initiated assessment monitoring on April 15, 2018.
- Data and statistical analysis that was not available for the previous reporting period indicates that during the November 2024 semi-annual sampling event :
 - The following Appendix III parameters exceeded background concentrations:
 - Boron at wells MW-1002, MW-1603S, MW-1604I, MW-1604S, and MW-1605S
 - Calcium at wells MW-1602I and MW-1603D
 - Chloride at well MW-1602D and MW-1605S
 - Fluoride at wells MW-1002, MW-1603S, and MW-1604S
 - Sulfate at wells MW-1002, MW-1602I, MW-1603D, MW-1603I, MW-1603S, MW-1604I, MW-1604S, MW-1605I, and MW-1605S
 - TDS at wells MW-1002, MW-1602I, MW-1603D, MW-1603I, MW-1604I, MW-1604S, MW-1605I and MW-1605S
 - There were no exceedances of Appendix IV parameters
 - Statistical analysis for the November 2024 sampling event was completed in March 2025
- During the May 2025 semi-annual sampling event:
 - The following Appendix III parameters exceeded background concentrations:
 - Boron at wells MW-1002, MW-1603S, MW-1604I, MW-1604S, MW-1605I, and MW-1605S
 - Calcium at wells MW-1602I and MW-1603D

- Chloride at well MW-1602D
- Fluoride at wells MW-1002, MW-1603S, and MW-1604S
- Sulfate at wells MW-1602I, MW-1603D, MW-1603I, MW-1603S, MW-1604I, MW-1604S, MW-1605I and MW-1605S
- TDS at wells MW-1002, MW-1602I, MW-1603D, MW-1603I, MW-1603S, MW-1604I, MW-1604S, MW-1605I, and MW-1605S
- There were no exceedances of Appendix IV parameters
- Statistical analysis of the May 2025 sampling event was completed in September 2025
- The November 2025 semi-annual sampling event data are still undergoing statistical analysis.
- Because either there were no Appendix IV SSLs or because an alternate source for the Appendix IV SSL(s) was identified, but no alternative source for the Appendix III SSI(s) was identified, the BAP remained in assessment monitoring.

The major components of this annual report, to the extent applicable at this time, are presented in sections that follow:

- A map/aerial photograph showing the BAP CCR management units, all CCR groundwater monitoring wells, and monitoring well identification numbers (Attached in **Appendix 1**);
- All of the monitoring data collected, including the rate and direction of groundwater flow, plus a summary showing the number of samples collected per monitoring well, the dates the samples were collected, and whether the sample was collected as part of background, detection monitoring, or assessment monitoring programs (Attached in **Appendix 1**);
- Statistical comparison of monitoring data to determine if there have been significant increase over background concentrations (Attached in **Appendix 2**, where applicable);
- A discussion of whether any alternate source demonstrations were performed, and the conclusions (Attached in **Appendix 3**, where applicable);
- A summary of any transition between monitoring programs, or an alternate monitoring frequency, for example the date and circumstances for transitioning from detection monitoring to assessment monitoring, in addition to identifying the constituents detected at a statistically significant increase over background concentrations (Notices Attached in **Appendix 4**, where applicable);
- Identification of any monitoring wells that were installed, or decommissioned during the preceding year, along with a statement as to why that happened (Attached in **Appendix 5**, where applicable); and
- Other information required to be included in the annual report such as alternate source demonstration or assessment of corrective measures, if applicable.

In addition, this report summarizes key actions completed, and where applicable, describes any problems encountered and actions taken to resolve those problems. The report includes a projection of key activities for the upcoming year.

II. Groundwater Monitoring Well Locations and Identification Numbers

The CCR monitoring wells are listed as follows (S=shallow, I=intermediate, and D=deep):

- Twelve Upgradient Wells: MW-1600(S, I, D); MW-1601(S, I, D); MW-1701(S, I, D); and MW-1702(S, I, D).
- Fifteen Downgradient Wells: MW-1002, MW-1602(I, D); MW-1603(S, I, D); MW-1604(S, I, D); MW-1605(S, I, D); and MW-1606(S, I, D).

Rather than separate groundwater monitoring systems for the East and West bottom ash ponds, the groundwater network monitors both of the bottom ash ponds as a single unit as allowed by 40 CFR 257.91(d). A figure that depicts the PE-certified groundwater monitoring network, the monitoring well locations, and their corresponding identification numbers is provided in **Appendix 1**.

III. Monitoring Wells Installed or Decommissioned

There were no new groundwater monitoring wells installed or decommissioned during 2025. The network design, as summarized in the *Groundwater Monitoring Network Design Report* (2019) and as posted at the CCR website for Rockport Plant's Bottom Ash Ponds, did not change. That design report, viewable on the AEP CCR web site, discusses the facility location, the hydrogeological setting, the hydrostratigraphic units, the uppermost aquifer, downgradient monitoring well locations and the upgradient monitoring well locations.

IV. Groundwater Quality Data and Static Water Elevation Data, With Flow Rates and Flow Directions

Appendix 1 contains tables showing the groundwater quality data collected during the establishment of background quality, detection and assessment monitoring. Static water elevation data from each monitoring event also are shown in **Appendix 1**, along with the groundwater velocity calculations, groundwater flow direction and potentiometric maps developed after each sampling event.

The sampling event conducted in March 2025 satisfies the requirement of 257.95(b).

V. Groundwater Quality Data Statistical Analysis

- **Appendix 2** contains the statistical analysis reports. Data and statistical analysis that was not available for the previous reporting period indicates that during the November 2024 semi-annual sampling event:
 - The following Appendix III parameters exceeded background concentrations:
 - Boron at wells MW-1002, MW-1603S, MW-1604I, MW-1604S, and MW-1605S
 - Calcium at wells MW-1602I and MW-1603D

- Chloride at well MW-1602D and MW-1605S
 - Fluoride at wells MW-1002, MW-1603S, and MW-1604S
 - Sulfate at wells MW-1002, MW-1602I, MW-1603D, MW-1603I, MW-1603S, MW-1604I, MW-1604S, MW-1605I, and MW-1605S
 - TDS at wells MW-1002, MW-1602I, MW-1603D, MW-1603I, MW-1604I, MW-1604S, MW-1605I and MW-1605S
- There were no exceedances of Appendix IV parameters
- Statistical analysis for the November 2024 sampling event was completed in March 2025 and is included in **Appendix 2**.
- During the May 2025 semi-annual sampling event:
 - The following Appendix III parameters exceeded background concentrations:
 - Boron at wells MW-1002, MW-1603S, MW-1604I, MW-1604S, MW-1605I, and MW-1605S
 - Calcium at wells MW-1602I and MW-1603D
 - Chloride at well MW-1602D
 - Fluoride at wells MW-1002, MW-1603S, and MW-1604S
 - Sulfate at wells MW-1602I, MW-1603D, MW-1603I, MW-1603S, MW-1604I, MW-1604S, MW-1605I and MW-1605S
 - TDS at wells MW-1002, MW-1602I, MW-1603D, MW-1603I, MW-1603S, MW-1604I, MW-1604S, MW-1605I, and MW-1605S
 - There were no exceedances of Appendix IV parameters
 - Statistical analysis of the May 2025 sampling event was completed in September 2025

The statistical analysis of the second semi-annual sampling event will be completed within 90 days of finishing the sampling and analysis, which took place in November 2025.

VI. Alternate Source Demonstrations

An alternate source demonstration (ASD) investigation relative to past Appendix III SSIs was completed in April 2018. That demonstration concluded that the groundwater quality and Appendix III indicator parameter SSIs identified in the statistical evaluations were potentially influenced by a release from the BAP to the groundwater. An alternate source could not be identified. Therefore, an alternate source demonstration investigation was not undertaken for the exceedances of Appendix III parameters for neither the second semi-annual event of 2024, nor the first semi-annual event of 2025.

Because either there were no SSLs or because an alternate source for the SSL(s) was identified, but no alternate source for the SSI(s) was identified, the BAP remained in assessment monitoring.

VII. Discussion About Transition Between Monitoring Requirements or Alternate Monitoring Frequency

Because an alternate source for the Appendix III SSIs could not be identified, an assessment monitoring program was established at Rockport's BAP complex on April 15, 2018. Assessment monitoring continued through the 2025 calendar year.

The BAP will remain in assessment monitoring unless all Appendix III and IV parameters are below background values for two consecutive monitoring events (return to detection monitoring) as prescribed by 40 CFR 257.95(e). If an Appendix IV parameter exceeds its respective GWPS due to a release from the BAP, an assessment of corrective measures will be undertaken as required by 40 CFR 257.96.

Regarding defining an alternate monitoring frequency, the groundwater velocity and monitoring well production are high enough at this facility that no modification to the semiannual assessment monitoring frequency is needed.

VIII. Other Information Required

The BAP progressed from detection monitoring to its current status in assessment monitoring in 2018. As required by the CCR assessment monitoring rules in 40 CFR 257.95 (b) and (d)(1), sampling all CCR wells for the required Appendix III and IV parameters was completed in 2025.

IX. Description of Any Problems Encountered and Actions Taken

No significant problems were encountered. The low flow sampling effort went smoothly, and the schedule was met to support the annual groundwater report preparation covering the year 2025 groundwater monitoring activities.

X. A Projection of Key Activities for the Upcoming Year

Key activities for 2026 include:

- Complete the statistical analysis of the second semi-annual sampling event that took place in November 2025.
- Conduct the annual groundwater sampling event for all constituents listed in Appendix III and IV as required by 40 CFR 257.95(b).
- Perform statistical analysis on the sampling results for the Appendix III and detected Appendix IV parameters as required by 40 CFR 257.95(d)(1).
- If no GWPSs are exceeded, the BAP will remain in assessment monitoring.
- If a GWPS is exceeded in a downgradient well the following activities will be undertaken:
 - Characterize the nature and extent of a release by installing additional GW wells as necessary, estimate the quantity of material released and the concentrations of Appendix IV parameters that are in the material, and sample all wells to characterize the nature and extent of the release.


- If contaminants have migrated off-site, notify all persons who own land that directly overlies any part of the plume of contamination.
 - Perform an alternate source demonstration (ASD) investigating whether the exceedance was caused by a source other than the BAP or was a result of an error in sampling, analysis, statistical evaluation, or natural variation in groundwater quality.
 - If a successful ASD cannot be made, initiate an assessment of corrective measures and follow all of those requirements.
- Respond to any new data received in light of what the CCR rule requires.
- Prepare the next annual groundwater report.

APPENDIX 1 – Groundwater Data Tables and Figures

Figures and Tables follow, showing the groundwater monitoring network, data collected and the rate and direction of groundwater flow. The dates that the samples were collected, and it also is shown whether the data were collected under background, detection, or assessment monitoring.

Groundwater Monitoring Network Figure

Document Path: P:\GIS Projects\AEP\mxd\2018-08 CSM Proposal\FIG01 Wells.mxd

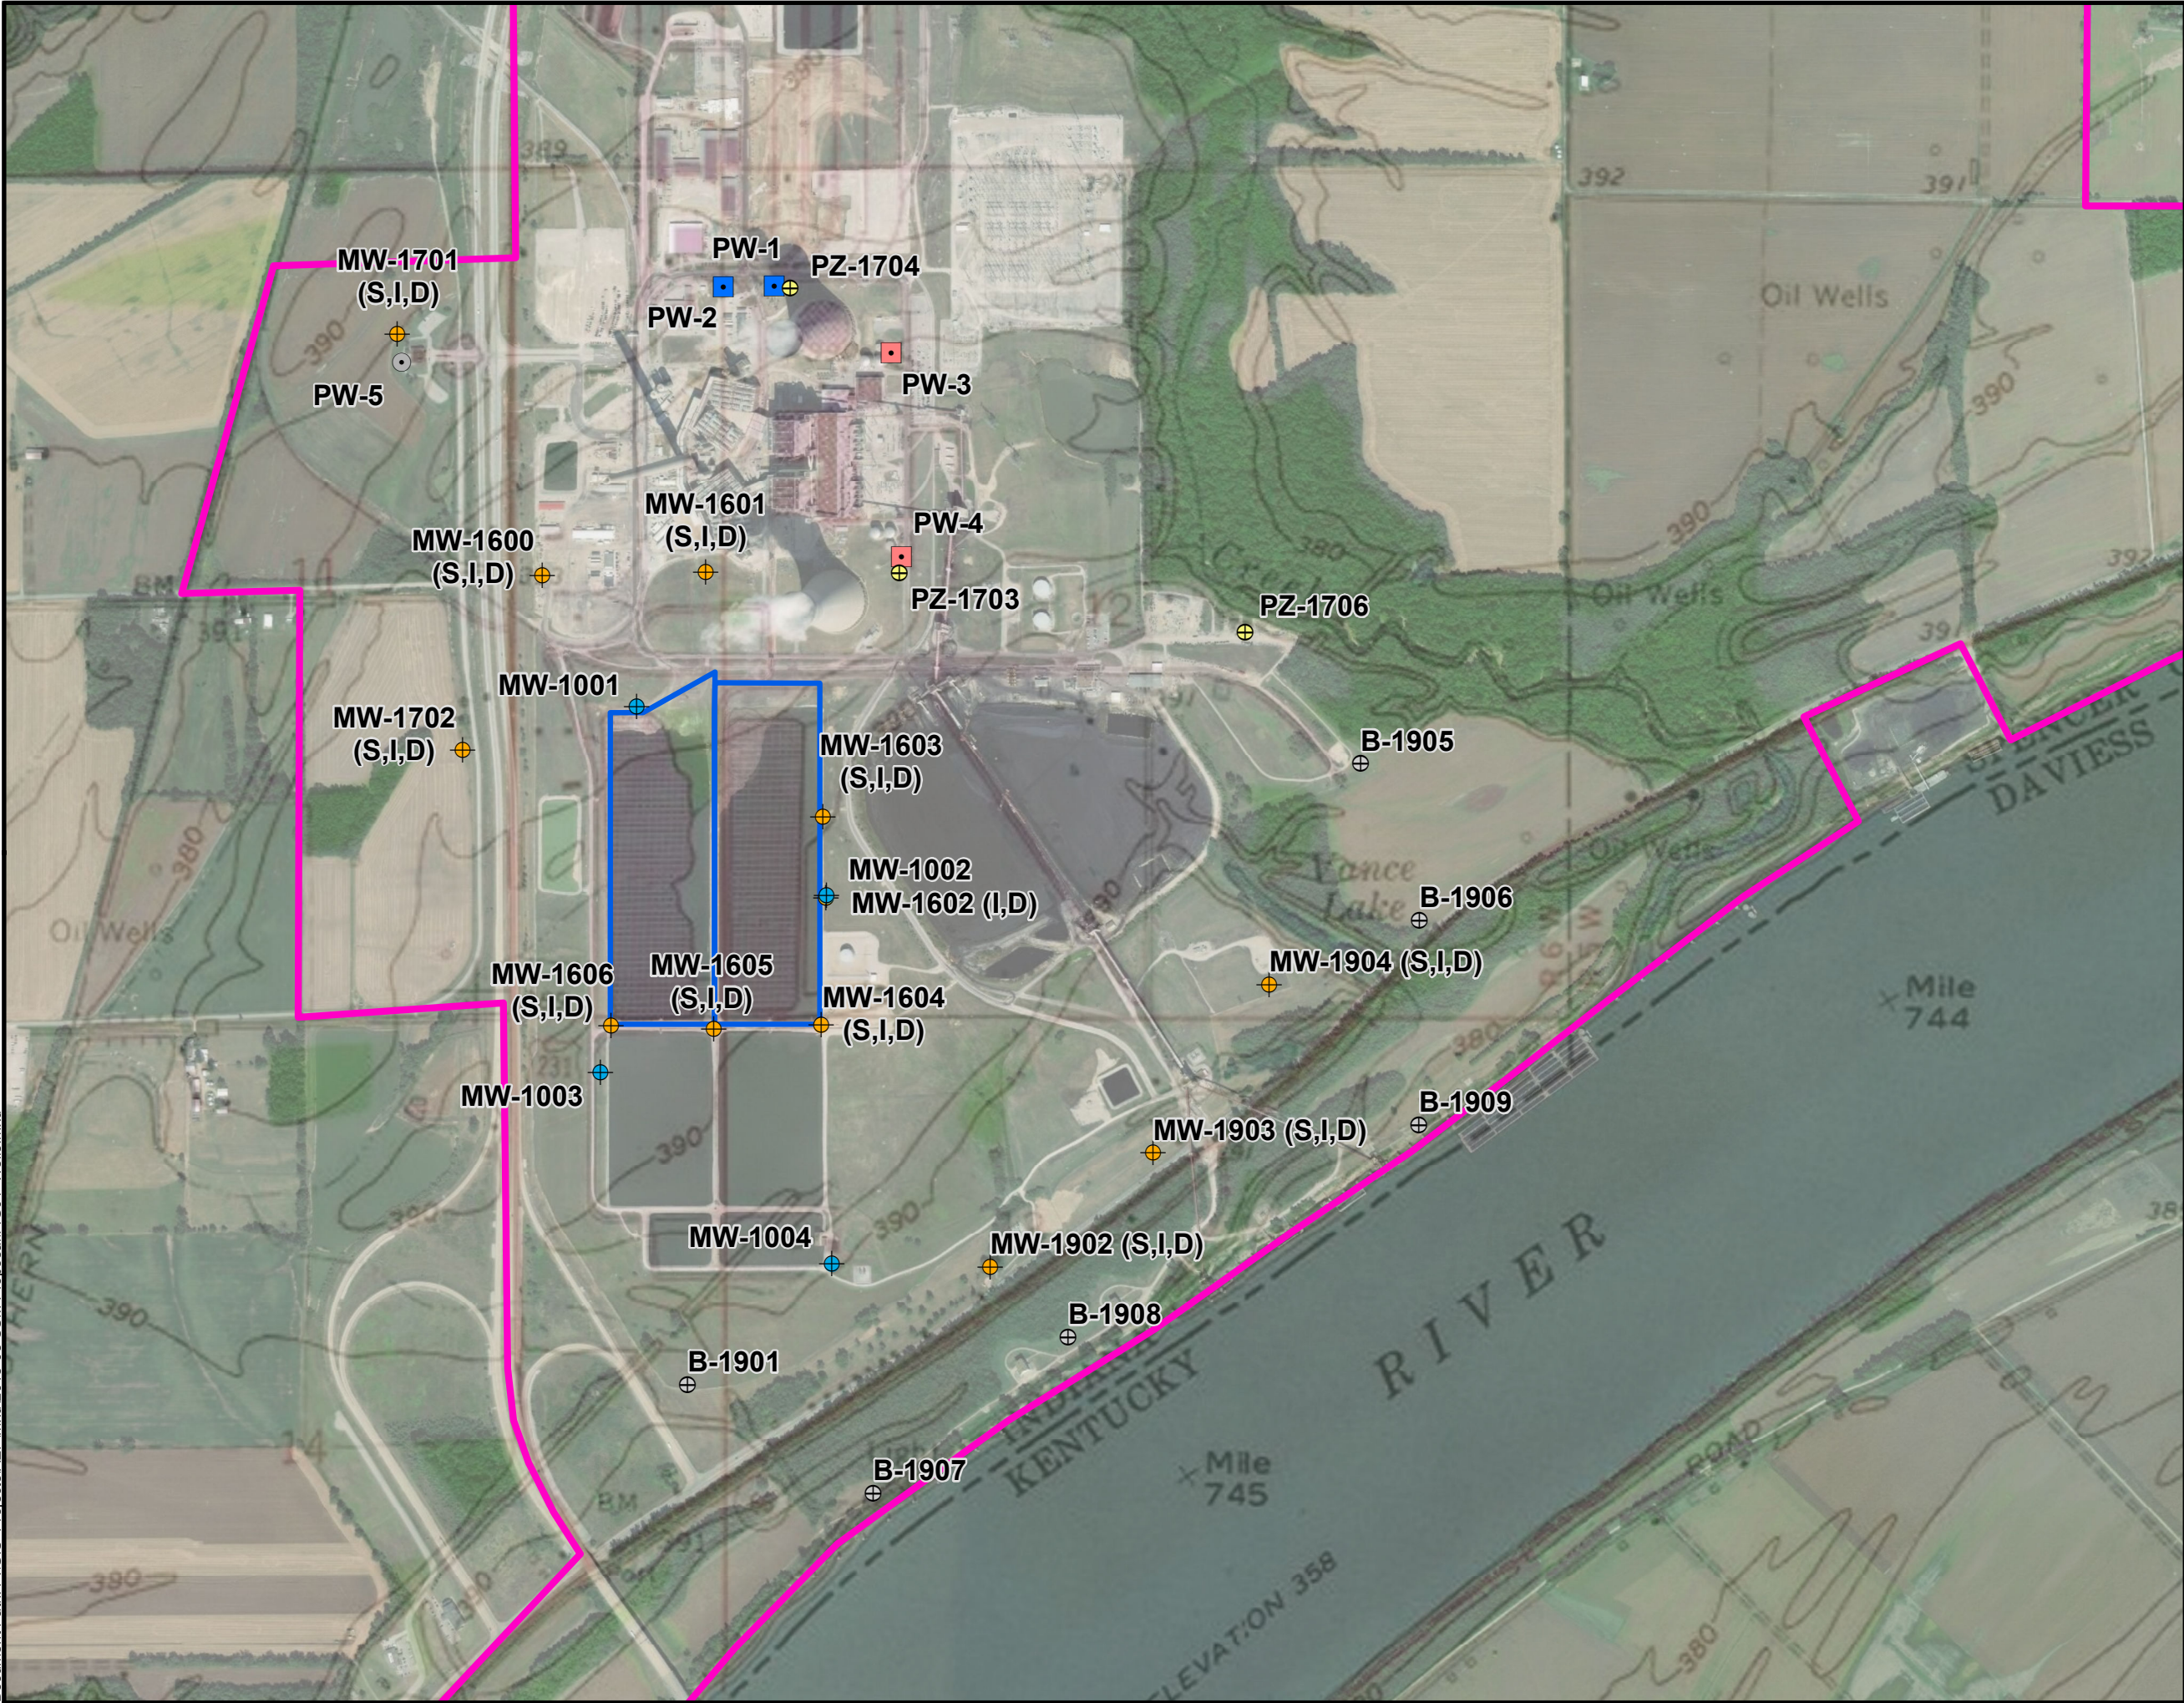

Legend

Piezometer

BAP - USWAG Monitoring Well

BAP - CCR Monitoring Well

Landfill - Monitoring Well

Landfill - CCR Monitoring Well

Landfill - Augmentation Water Supply Well

Landfill - Dust Control Water Supply Well

Plant - Potable Water Supply Well

Plant - Fire Water Supply Well

Groundwater Screening Location (Abandoned)

Inactive Water Supply Well

Property Boundary

Bottom Ash Ponds (BAP)

Data Sources

Date of Photography: 2016

Source of Photography: U.S. Department of Agriculture, National Agriculture Imagery Program (NAIP)

USGS Rockport and Lewisport (IN/KY) Topographic Quadrangle Maps

05001,000

SCALE IN FEET

WELL LOCATIONS

AEP - ROCKPORT, IN

PROJECT NUMBER: 7362182624

SCALE1" = 1,600'

DATE2/6/2019

DRAWN BYTMR

APPROVED BYALD

FIG. 1

wood.

2456 Fortune Drive, Suite 100
Lexington, Kentucky 40509
Phone: (859) 255-3308

Groundwater Data Tables

Table 1. Groundwater Data Summary: MW-1002
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/07/2016	Background	1.77	33.2	58.9	1.05	7.0	149	390
7/18/2016	Background	1.70	32.3	57.8	1.03	7.1	154	385
9/20/2016	Background	1.57	40.1	54.0	0.98	6.8	164	399
11/15/2016	Background	1.67	49.4	53.0	0.87	6.5	178	405
1/09/2017	Background	1.57	55.6	59.0	0.74	6.3	190	440
3/07/2017	Background	1.32	76.3	81.1	0.73	6.5	228	503
5/08/2017	Background	1.04	78.1	75.5	0.73	6.7	215	498
7/17/2017	Background	1.28	50.0	59.9	0.73	6.7	184	430
10/03/2017	Detection	1.63	36.4	54.4	0.80	7.1	166	403
12/12/2017	Detection	--	--	52.5	0.97	7.3	177	--
1/11/2018	Detection	1.71	--	53.2	0.91	7.0	183	--
6/05/2018	Assessment	1.66	40.8	51.4	1.02	8.1	165	425
8/15/2018	Assessment	1.88	41.3	57.4	1.02	7.2	182	453
5/24/2019	Assessment	1.61	32.9	55.9	1.13	7.4	169	435
6/27/2019	Assessment	1.82	36.0	57.1	1.10	7.1	173	425
9/12/2019	Assessment	1.78	33.5	54.7	1.03	6.7	178	418
3/11/2020	Assessment	--	--	--	0.84	6.5	--	--
5/20/2020	Assessment	0.778	42.0	35.9	0.85	5.9	97.5	295
11/16/2020	Assessment	1.43	66.7	99.4	0.84	6.2	217	551
2/02/2021	Assessment	1.56	63.3	81.7	0.97	6.8	250	560
5/26/2021	Assessment	1.11	37.3	50.1	1.01	7.1	149	370
11/09/2021	Assessment	1.70	42.2	59.4	0.96	6.8	169	450
2/15/2022	Assessment	1.81	52.2	66.9	0.95	7.4	176	490
5/10/2022	Assessment	1.74	47.4	61.3	0.96	7.4	173	470 L1
10/31/2022	Assessment	2.46	58.4	40.9	0.93	5.6	323	650
2/08/2023	Assessment	1.63	62.4	32.1	1.08	7.9	194	560
5/31/2023	Assessment	1.63	49.8	30.1	1.21	7.3	205	560
11/01/2023	Assessment	1.72	51.5	31.6	1.38	6.8	214	570
3/06/2024	Assessment	--	--	--	1.13	7.4	--	--
5/13/2024	Assessment	1.45	72.5	27.4	0.93	7.1	239	590
11/14/2024	Assessment	1.47	49	22.7	1.35	7.2	130	450
2/04/2025	Assessment	--	--	--	1.13	7.3	--	--
5/13/2025	Assessment	1.02	51.6	22.9	0.88	7.5	68.3	450
11/06/2025	Assessment	1.20	53.5	23.1	1.19	7.2	85.4	450

Table 1. Groundwater Data Summary: MW-1002
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/07/2016	Background	0.05	0.32	12.3	< 0.005 U1	0.02	0.3	0.830	0.1116	1.05	0.034	0.002	< 0.002 U1	1.92	0.08 J1	0.02 J1
7/18/2016	Background	0.05	0.29	14.2	< 0.005 U1	0.03	0.7	0.931	0.741	1.03	0.026	0.016	< 0.002 U1	2.54	0.1 J1	0.03 J1
9/20/2016	Background	0.04 J1	0.24	18.5	< 0.005 U1	0.03	0.1	0.699	1.377	0.98	0.01 J1	0.004	< 0.002 U1	3.38	0.1 J1	0.02 J1
11/15/2016	Background	0.06	0.24	23.5	0.006 J1	0.15	0.075	0.664	0.686	0.87	0.031	0.010	< 0.002 U1	2.47	0.08 J1	0.04 J1
1/09/2017	Background	0.05 J1	0.25	26.9	< 0.005 U1	0.04	0.078	0.692	1.052	0.74	0.022	0.006	< 0.002 U1	3.16	0.06 J1	0.03 J1
3/07/2017	Background	0.05	0.20	35.6	< 0.005 U1	0.07	0.331	0.568	0.483	0.73	0.163	0.003	< 0.002 U1	2.69	0.1 J1	0.04 J1
5/08/2017	Background	0.05	0.24	26.8	0.020	0.05	0.177	0.526	0.2337	0.73	0.037	0.009	0.005	2.69	0.1	0.050
7/17/2017	Background	0.04 J1	0.21	21.4	< 0.004 U1	0.03	0.107	0.665	3.029	0.73	0.02 J1	0.009	< 0.002 U1	3.05	0.07 J1	0.04 J1
6/05/2018	Assessment	0.07	0.44	12.7	0.004	0.03	0.04	0.768	0.569	1.02	0.031	0.011	< 0.002 U1	6.19	0.06	0.03
8/15/2018	Assessment	0.05 J1	0.28	13.8	< 0.004 U1	0.03	0.281	0.820	0.766	1.02	0.02 J1	< 0.0002 U1	--	7.86	0.07 J1	0.03 J1
5/24/2019	Assessment	0.05 J1	0.23	13.3	< 0.02 U1	0.03 J1	0.09 J1	0.754	0.1886	1.13	< 0.02 U1	< 0.009 U1	< 0.002 U1	8.67	0.05 J1	< 0.1 U1
6/27/2019	Assessment	0.05 J1	0.24	14.8	< 0.02 U1	0.03 J1	0.07 J1	0.805	0.682	1.10	0.03 J1	< 0.009 U1	< 0.002 U1	10.4	0.08 J1	< 0.1 U1
9/12/2019	Assessment	0.05 J1	0.22	15.8	< 0.02 U1	0.02 J1	0.469	0.635	0.384	1.03	< 0.05 U1	0.00438	< 0.002 U1	10.2	0.06 J1	< 0.1 U1
3/11/2020	Assessment	< 0.02 U1	0.21	15.9	< 0.02 U1	0.02 J1	< 0.04 U1	0.608	1.9572	0.84	< 0.05 U1	0.00425	< 0.002 U1	8.51	0.1 J1	< 0.1 U1
5/20/2020	Assessment	0.04 J1	0.19	16.0	< 0.02 U1	0.04 J1	0.09 J1	0.342	0.999	0.85	< 0.05 U1	0.00316	< 0.002 U1	9.65	0.07 J1	< 0.1 U1
11/16/2020	Assessment	0.04 J1	0.25	17.9	< 0.02 U1	0.02 J1	0.212	0.480	1.892	0.84	< 0.05 U1	0.00562	< 0.002 U1	4.95	0.09 J1	< 0.1 U1
2/02/2021	Assessment	0.05 J1	0.27	15.9	< 0.02 U1	0.02 J1	0.05 J1	0.533	0.22	0.97	< 0.05 U1	0.00548	< 0.002 U1	6.42	0.07 J1	< 0.1 U1
5/26/2021	Assessment	0.04 J1	0.25	12.4	< 0.007 U1	0.019 J1	0.21	0.308	0.75	1.01	< 0.05 U1	0.00379	< 0.002 U1	5.3	< 0.09 U1	< 0.04 U1
11/09/2021	Assessment	0.04 J1	0.26	12.5	< 0.007 U1	0.020	0.20	0.500	3.01	0.96	< 0.05 U1	0.00502	< 0.002 U1	6.7	< 0.09 U1	< 0.04 U1
2/15/2022	Assessment	0.04 J1	0.27	13.9	< 0.007 U1	0.020	0.33	0.531	0.43	0.95	< 0.05 U1	0.00554	< 0.002 U1	7.7	< 0.09 U1	< 0.04 U1
5/10/2022	Assessment	0.04 J1	0.27	14.0	< 0.007 U1	0.019 J1	0.24	0.537	1.25	0.96	< 0.05 U1	0.00538	< 0.002 U1	7.1	< 0.09 U1	< 0.04 U1
10/31/2022	Assessment	0.04 J1	0.23	18.2	< 0.007 U1	0.028	0.16 J1	0.777	0.51	0.93	< 0.05 U1	0.00571	< 0.002 U1	12.6	< 0.09 U1	< 0.04 U1
2/08/2023	Assessment	0.05 J1	0.23	18.0	0.007 J1	0.023	0.27	0.482	1.02	1.08	< 0.05 U1	0.00653	< 0.002 U1	18.0	0.70	< 0.04 U1
5/31/2023	Assessment	0.051 J1	0.27	15.3	< 0.007 U1	0.028	0.26 J1	0.576	0.59	1.21	0.06 J1	0.00482	< 0.002 U1	21.5	0.12 J1	< 0.02 U1
11/01/2023	Assessment	0.053 J1	0.27	13.6	< 0.007 U1	0.022	0.33	0.686	0.49	1.38	0.06 J1	0.00521	< 0.002 U1	17.1	0.06 J1	< 0.02 U1
3/06/2024	Assessment	0.050 J1	0.22	15.7	< 0.007 U1	0.027	0.14 J1	0.520	1.33	1.13	< 0.05 U1	0.00585	< 0.002 U1	13.4	0.07 J1	0.02 J1
5/13/2024	Assessment	0.046 J1	0.20	15.8	< 0.007 U1	0.021	0.30	0.515	2.53	0.93	< 0.05 U1	0.00632	< 0.002 U1	13.9	0.08 J1	0.02 J1
11/14/2024	Assessment	0.044 J1	0.22	12.5	< 0.007 U1	0.018 J1	0.17 J1	0.437	2.76	1.35	< 0.05 U1	0.005	< 0.002 U1	12.2	0.09 J1	< 0.02 U1
2/04/2025	Assessment	0.045 J1	0.21	13.7	< 0.007 U1	0.020	0.29 J1	0.450	1.45	1.13	< 0.05 U1	0.00635	< 0.002 U1	11.9	0.07 J1	< 0.02 U1
5/13/2025	Assessment	0.056 J1	0.23	10.6	< 0.007 U1	0.011 J1	0.28 J1	0.232	0.34	0.88	< 0.05 U1	0.00738	< 0.002 U1	9.5	0.09 J1	0.02 J1
11/06/2025	Assessment	0.05 J1	0.23	14.8	< 0.02 U1	0.017 J1	0.42	0.46	0.78	1.19	0.05 J1	0.00613	< 0.002 U1	10.3	0.10 J1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1600D
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/08/2016	Background	0.016	83.5	31.5	0.20	7.6	43.9	444
7/19/2016	Background	0.015	74.9	32.2	0.22	7.2	44.9	413
9/19/2016	Background	< 0.002 U1	85.6	30.9	0.20	7.1	38.7	385
11/16/2016	Background	0.024	83.1	30.9	0.17	7.2	35.9	415
1/10/2017	Background	0.014	87.8	31.0	0.22	7.1	42.5	384
3/07/2017	Background	0.036	84.9	31.6	0.19	7.0	39.2	374
5/08/2017	Background	0.037	89.1	32.6	0.21	6.5	38.4	402
7/17/2017	Background	0.038	73.6	31.6	0.17	6.5	40.1	389
10/03/2017	Detection	0.040	78.3	31.5	0.20	7.3	40.8	398
12/12/2017	Detection	--	--	31.5	0.20	7.1	42.5	--
6/04/2018	Assessment	0.079	83.5	32.8	0.23	7.3	39.2	397
8/14/2018	Assessment	0.085	86.6	31.5	0.24	7.1	41.0	400
5/20/2019	Assessment	< 0.02 U1	76.5	31.4	0.21	7.2	43.0	394
6/25/2019	Assessment	0.03 J1	84.2	31.0	0.22	7.1	37.7	407
9/10/2019	Assessment	< 0.02 U1	90.1	31.1	0.23	7.2	41.3	404
3/11/2020	Assessment	--	--	--	0.21	6.9	--	--
5/21/2020	Assessment	< 0.02 U1	91.1	31.0	0.24	7.6	43.3	396
11/12/2020	Assessment	< 0.02 U1	81.5	30.3	0.25	6.6	42.4	398
2/03/2021	Assessment	< 0.02 U1	78.9	30.2	0.25	6.8	41.3	390
5/27/2021	Assessment	0.017 J1	93.2	29.6	0.25	7.6	41.6	400
11/10/2021	Assessment	0.016 J1	79.3	28.7	0.23	6.6	40.0	380
2/16/2022	Assessment	0.019 J1	82.2	30.5	0.23	6.7	42.7	400
5/10/2022	Assessment	0.016 J1	94.0	30.0	0.22	7.0	44.6	390 L1
11/01/2022	Assessment	0.017 J1	77.2	29.4	0.22	6.5	43.3	370
2/07/2023	Assessment	0.017 J1	78.4	29.0	0.21	7.6	42.4	380
5/31/2023	Assessment	0.016 J1	74.8	28.5	0.20	7.0	42.2	390
10/31/2023	Assessment	0.019 J1	86.0	28.5	0.23	6.6	43.1	390
3/06/2024	Assessment	--	--	--	--	6.9	--	--
3/07/2024	Assessment	--	--	--	0.21	--	--	--
5/15/2024	Assessment	0.018 J1	77.5	28.9	0.10	7.0	44.0	370
11/13/2024	Assessment	0.016 J1	80	28.9	0.26	6.9	43.1	390
2/04/2025	Assessment	--	--	--	0.25	7.0	--	--
5/14/2025	Assessment	0.018 J1	76.8	30.3	0.21	6.5	41.1	390
11/06/2025	Assessment	0.018 J1	81.5	28.5	0.26	7.0	44.1	390

Table 1. Groundwater Data Summary: MW-1600D
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/08/2016	Background	0.01 J1	15.4	940	0.006 J1	< 0.004 U1	0.2	0.109	2.148	0.20	0.095	< 0.0002 U1	< 0.002 U1	1.94	< 0.03 U1	0.01 J1
7/19/2016	Background	0.02 J1	17.2	946	0.005 J1	< 0.004 U1	0.2	0.094	1.615	0.22	0.021	0.020	< 0.002 U1	2.19	0.05 J1	0.054
9/19/2016	Background	0.01 J1	15.1	910	< 0.005 U1	< 0.004 U1	0.9	0.071	1.636	0.20	0.020	0.011	< 0.002 U1	1.75	< 0.03 U1	0.01 J1
11/16/2016	Background	< 0.01 U1	15.8	997	< 0.005 U1	< 0.004 U1	0.128	0.085	1.402	0.17	0.064	0.008	< 0.002 U1	1.79	0.04 J1	< 0.01 U1
1/10/2017	Background	< 0.01 U1	15.2	877	< 0.005 U1	< 0.004 U1	0.115	0.100	2.265	0.22	0.053	0.009	< 0.002 U1	1.65	< 0.03 U1	< 0.01 U1
3/07/2017	Background	< 0.01 U1	16.2	986	< 0.005 U1	< 0.004 U1	0.427	0.081	1.322	0.19	0.038	0.008	< 0.002 U1	1.78	0.05 J1	< 0.01 U1
5/08/2017	Background	0.05	15.9	914	0.020	0.02	0.170	0.096	1.104	0.21	0.073	0.006	0.005	1.64	0.1	0.050
7/17/2017	Background	0.03 J1	15.0	817	0.004 J1	< 0.005 U1	0.180	0.112	2.223	0.17	0.076	0.009	< 0.002 U1	1.56	0.04 J1	< 0.01 U1
6/04/2018	Assessment	0.02 J1	13.8	766	0.01 J1	0.02 J1	0.112	0.297	0.833	0.23	0.102	0.009	< 0.002 U1	1.62	< 0.03 U1	0.02 J1
8/14/2018	Assessment	< 0.01 U1	15.1	840	< 0.004 U1	< 0.005 U1	0.073	0.079	2.858	0.24	0.023	0.004	--	1.62	< 0.03 U1	< 0.01 U1
5/20/2019	Assessment	< 0.02 U1	20.3	873	< 0.02 U1	0.08	0.274	0.176	1.948	0.21	0.238	< 0.009 U1	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
6/25/2019	Assessment	< 0.02 U1	16.6	867	< 0.02 U1	< 0.01 U1	0.1 J1	0.146	1.121	0.22	0.135	0.01 J1	< 0.002 U1	2 J1	0.05 J1	< 0.1 U1
9/10/2019	Assessment	< 0.02 U1	16.1	884	< 0.02 U1	< 0.01 U1	0.2 J1	0.132	1.621	0.23	0.1 J1	0.00627	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
3/11/2020	Assessment	< 0.02 U1	15.3	880	< 0.02 U1	< 0.01 U1	0.2 J1	0.081	2.377	0.21	< 0.05 U1	0.00573	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
5/21/2020	Assessment	< 0.02 U1	25.3	882	< 0.02 U1	< 0.01 U1	0.1 J1	0.090	1.462	0.24	0.06 J1	0.00535	< 0.002 U1	2 J1	0.06 J1	< 0.1 U1
11/12/2020	Assessment	< 0.02 U1	15.8	828	< 0.02 U1	< 0.01 U1	0.2 J1	0.072	1.593	0.25	< 0.05 U1	0.00570	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
2/03/2021	Assessment	< 0.02 U1	16.0	869	< 0.02 U1	< 0.01 U1	0.264	0.070	2.96	0.25	< 0.05 U1	0.00548	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
5/27/2021	Assessment	0.05 J1	19.2	851	0.067	0.043	2.05	0.756	1.18	0.25	1.34	0.00669	< 0.002 U1	1.9	0.17 J1	< 0.04 U1
11/10/2021	Assessment	< 0.02 U1	17.8	788	< 0.007 U1	< 0.004 U1	0.27	0.092	1.21	0.23	0.07 J1	0.00545	< 0.002 U1	3.1	< 0.09 U1	< 0.04 U1
2/16/2022	Assessment	< 0.02 U1	16.2	843	< 0.007 U1	< 0.004 U1	0.38	0.062	1.40	0.23	< 0.05 U1	0.00528	< 0.002 U1	1.7	< 0.09 U1	< 0.04 U1
5/10/2022	Assessment	0.04 J1	18.7	889	< 0.007 U1	0.028	0.33	0.096	1.32	0.22	0.06 J1	0.00509	< 0.002 U1	1.8	< 0.09 U1	< 0.04 U1
11/01/2022	Assessment	< 0.02 U1	16.0	782	< 0.007 U1	< 0.004 U1	0.24	0.044	1.82	0.22	< 0.05 U1	0.00543	< 0.002 U1	2.2	< 0.09 U1	< 0.04 U1
2/07/2023	Assessment	< 0.02 U1	16.8	810	0.008 J1	< 0.004 U1	0.35	0.076	1.74	0.21	< 0.05 U1	0.00570	< 0.002 U1	3.5	< 0.09 U1	< 0.04 U1
5/31/2023	Assessment	< 0.008 U1	15.3	774	< 0.007 U1	< 0.004 U1	0.27 J1	0.081	2.20	0.20	0.05 J1	0.00498	< 0.002 U1	2.1	< 0.04 U1	< 0.02 U1
10/31/2023	Assessment	0.009 J1	16.7	1200	< 0.007 U1	< 0.004 U1	0.35	0.066	2.06	0.23	< 0.05 U1	0.00529	< 0.002 U1	1.9	< 0.04 U1	< 0.02 U1
3/07/2024	Assessment	0.011 J1	15.9	807	< 0.007 U1	< 0.004 U1	0.20 J1	0.064	1.72	0.21	< 0.05 U1	0.00563	< 0.002 U1	1.9	< 0.04 U1	< 0.02 U1
5/15/2024	Assessment	0.009 J1	15.6	806	< 0.007 U1	0.025	0.24 J1	0.050	1.94	0.10	< 0.05 U1	0.00513	< 0.002 U1	1.8	0.04 J1	0.03 J1
11/13/2024	Assessment	< 0.008 U1	14.8	769	< 0.007 U1	0.005 J1	0.31	0.049	2.85	0.26	< 0.05 U1	0.00490	< 0.002 U1	1.7	< 0.04 U1	< 0.02 U1
2/04/2025	Assessment	< 0.008 U1	16.0	764	< 0.007 U1	< 0.004 U1	0.37	0.052	1.60	0.25	< 0.05 U1	0.00577	< 0.002 U1	1.8	< 0.04 U1	< 0.02 U1
5/14/2025	Assessment	0.011 J1	13.8	758	0.008 J1	0.004 J1	0.37	0.082	0.98	0.21	0.10 J1	0.00528	< 0.002 U1	2.5	< 0.04 U1	< 0.02 U1
11/06/2025	Assessment	0.05 J1	16.8	835	0.05	0.022	1.31	0.53	0.99	0.26	1.07	0.00598	< 0.002 U1	1.72	0.24 J1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1600I

Geosyntec Consultants, Inc.

Rockport - BAP
Appendix III Constituents

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/08/2016	Background	0.019	79.2	33.5	0.23	--	52.2	442
7/19/2016	Background	0.019	76.0	26.7	0.23	7.3	55.3	423
9/19/2016	Background	0.004 J1	77.6	24.9	0.21	7.2	48.4	404
11/16/2016	Background	0.031	76.0	24.5	0.17	7.2	44.5	408
1/10/2017	Background	0.016	76.5	23.7	0.19	7.1	45.8	394
3/07/2017	Background	0.049	75.5	26.4	0.20	7.2	49.2	392
5/08/2017	Background	0.033	80.2	25.0	0.22	6.8	48.5	406
7/17/2017	Background	0.046	71.5	24.4	0.17	9.3	48.0	398
10/03/2017	Detection	0.051	71.1	24.4	0.21	7.3	50.7	400
12/12/2017	Detection	--	--	24.7	0.21	7.2	52.4	--
6/04/2018	Assessment	0.046	72.8	25.4	0.24	7.5	50.0	396
8/14/2018	Assessment	0.057	78.6	25.6	0.25	7.1	50.3	426
5/21/2019	Assessment	0.03 J1	71.0	25.4	0.22	7.3	52.8	411
6/25/2019	Assessment	0.02 J1	76.0	25.0	0.23	7.1	46.7	401
9/10/2019	Assessment	0.02 J1	81.1	25.6	0.24	7.2	50.8	404
3/11/2020	Assessment	--	--	--	0.22	6.9	--	--
5/21/2020	Assessment	0.02 J1	82.5	25.7	0.25	7.1	51.8	406
11/12/2020	Assessment	< 0.02 U1	72.7	24.6	0.26	6.7	49.9	392
2/03/2021	Assessment	< 0.02 U1	72.9	25.1	0.26	6.7	49.8	397
5/27/2021	Assessment	0.04 J1	73.2	25.4	0.26	7.7	50.4	410
11/10/2021	Assessment	0.019 J1	70.0	25.7	0.24	7.2	49.0	380
2/17/2022	Assessment	0.019 J1	78.6	26.6	0.24	7.0	52.9	420 P2
5/10/2022	Assessment	0.021 J1	88.3 M1, P3	27.2	0.23	6.8	54.6	410 L1
11/01/2022	Assessment	0.021 J1	72.9	25.8	0.24	6.3	52.2	410
2/07/2023	Assessment	0.021 J1	72.0	25.4	0.24	7.5	51.3	410
5/31/2023	Assessment	0.011 J1	65.5	24.4	0.22	7.3	50.6	430
10/31/2023	Assessment	0.022 J1	71.5	24.9	0.24	6.6	50.9	420
3/06/2024	Assessment	--	--	--	0.22	7.0	--	--
5/15/2024	Assessment	0.018 J1	67.2 M1	25.2	0.12	7.0	52.8	390
11/14/2024	Assessment	0.022 J1	69 M1	24.6	0.28	6.9	51.3	400
2/05/2025	Assessment	--	--	--	0.27	7.3	--	--
5/14/2025	Assessment	0.021 J1	72.6	24.5	0.23	7.2	51.9	390
11/04/2025	Assessment	0.023 J1	73.1	25.7	0.26	7.0	53.7	400

Table 1. Groundwater Data Summary: MW-1600I
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/08/2016	Background	0.05 J1	15.9	832	< 0.005 U1	0.005 J1	0.4	1.27	7.25	0.23	0.107	0.003	< 0.002 U1	1.68	< 0.03 U1	0.02 J1
7/19/2016	Background	0.03 J1	17.9	805	< 0.005 U1	< 0.004 U1	0.3	1.38	1.902	0.23	0.099	0.010	< 0.002 U1	1.83	0.03 J1	< 0.01 U1
9/19/2016	Background	0.03 J1	16.0	778	< 0.005 U1	0.01 J1	0.2	1.13	1.55	0.21	0.037	0.010	< 0.002 U1	1.89	0.06 J1	0.065
11/16/2016	Background	0.03 J1	16.3	801	< 0.005 U1	0.01 J1	0.081	1.14	2.47	0.17	0.01 J1	0.013	< 0.002 U1	1.63	< 0.03 U1	0.02 J1
1/10/2017	Background	0.02 J1	16.7	736	< 0.005 U1	< 0.004 U1	0.158	1.20	0.9137	0.19	0.006 J1	0.005	< 0.002 U1	1.64	< 0.03 U1	0.02 J1
3/07/2017	Background	0.02 J1	16.8	696	< 0.005 U1	0.02 J1	0.270	1.13	1.624	0.20	0.054	0.005	< 0.002 U1	1.67	0.04 J1	0.03 J1
5/08/2017	Background	0.05	17.0	762	0.020	0.02	0.095	1.26	1.75	0.22	0.020	0.011	0.005	1.54	0.1	0.050
7/17/2017	Background	0.02 J1	16.8	710	< 0.004 U1	< 0.005 U1	0.397	1.27	2.009	0.17	0.108	0.010	< 0.002 U1	1.53	< 0.03 U1	0.02 J1
6/04/2018	Assessment	0.04 J1	20.6	820	< 0.004 U1	< 0.005 U1	0.061	1.48	2.59	0.24	0.02 J1	0.012	< 0.002 U1	1.98	< 0.03 U1	0.03 J1
8/14/2018	Assessment	0.02 J1	17.5	726	< 0.004 U1	< 0.005 U1	0.087	1.29	1.797	0.25	0.025	0.007	--	1.64	< 0.03 U1	0.03 J1
5/21/2019	Assessment	< 0.02 U1	17.7	737	< 0.02 U1	< 0.01 U1	0.1 J1	1.24	1.988	0.22	< 0.02 U1	< 0.009 U1	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
6/25/2019	Assessment	< 0.02 U1	17.2	740	< 0.02 U1	< 0.01 U1	< 0.04 U1	1.23	2.301	0.23	< 0.02 U1	0.009 J1	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
9/10/2019	Assessment	< 0.02 U1	16.9	722	< 0.02 U1	< 0.01 U1	0.1 J1	1.29	1.22	0.24	< 0.05 U1	0.00720	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
3/11/2020	Assessment	< 0.02 U1	16.8	715	< 0.02 U1	0.01 J1	0.2 J1	1.22	2.22	0.22	0.1 J1	0.00677	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
5/21/2020	Assessment	0.03 J1	17.9	707	< 0.02 U1	0.08	0.205	1.32	2.90	0.25	0.201	0.00643	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
11/12/2020	Assessment	< 0.02 U1	18.9	698	< 0.02 U1	< 0.01 U1	0.216	1.26	1.734	0.26	< 0.05 U1	0.00656	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
2/03/2021	Assessment	< 0.02 U1	18.4	689	< 0.02 U1	< 0.01 U1	0.1 J1	1.20	2.599	0.26	< 0.05 U1	0.00626	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
5/27/2021	Assessment	0.08 J1	24.8	755	0.031 J1	0.075	1.21	2.32	1.81	0.26	1.3	0.00672	< 0.002 U1	2.2	0.15 J1	0.05 J1
11/10/2021	Assessment	0.02 J1	19.6	658	< 0.007 U1	0.005 J1	0.23	1.14	2.41	0.24	0.08 J1	0.00643	< 0.002 U1	1.5	< 0.09 U1	< 0.04 U1
2/17/2022	Assessment	0.02 J1	20.2	770	< 0.007 U1	0.013 J1	0.11 J1	1.17	3.18	0.24	0.07 J1	0.00645	< 0.002 U1	1.6	< 0.09 U1	< 0.04 U1
5/10/2022	Assessment	0.02 J1	19.5	729 M1, P3	< 0.007 U1	< 0.004 U1	0.25	1.22	2.13	0.23	< 0.05 U1	0.00603	< 0.002 U1	1.7	< 0.09 U1	< 0.04 U1
11/01/2022	Assessment	0.04 J1	22.0	679	< 0.007 U1	0.008 J1	0.33	1.25	1.40	0.24	0.20	0.00690	< 0.002 U1	1.6	< 0.09 U1	< 0.04 U1
2/07/2023	Assessment	0.02 J1	17.8	662	< 0.007 U1	< 0.004 U1	0.26	1.18	2.73	0.24	0.06 J1	0.00707	< 0.002 U1	1.7	< 0.09 U1	< 0.04 U1
5/31/2023	Assessment	0.030 J1	18.0	593	< 0.007 U1	< 0.004 U1	0.21 J1	1.09	1.84	0.22	0.12 J1	0.00573	< 0.002 U1	1.6	< 0.04 U1	< 0.02 U1
10/31/2023	Assessment	0.155	57.4	1010 M1	0.011 J1	0.026	0.38	1.50	2.65	0.24	0.70	0.00636	< 0.002 U1	1.7	0.12 J1	0.03 J1
3/06/2024	Assessment	0.024 J1	17.2	646	< 0.007 U1	0.007 J1	0.20 J1	1.09	2.66	0.22	< 0.05 U1	0.00649	< 0.002 U1	1.6	< 0.04 U1	< 0.02 U1
5/15/2024	Assessment	0.044 J1	20.7	628 M1	< 0.007 U1	0.035	0.23 J1	1.07	2.95	0.12	0.17 J1	0.00622	< 0.002 U1	1.5	< 0.04 U1	< 0.02 U1
11/14/2024	Assessment	0.055 J1	21.4	623 M1	< 0.007 U1	0.01 J1	0.37	1.27 B1	3.11	0.28	0.27	0.00646	< 0.002 U1	1.7	0.05 J1	< 0.02 U1
2/05/2025	Assessment	0.048 J1	22.2	657 M1	< 0.007 U1	0.018 J1	0.39	1.31	2.42	0.27	0.28	0.00671	< 0.002 U1	1.8	< 0.04 U1	< 0.02 U1
5/14/2025	Assessment	0.033 J1	18.3	664	< 0.007 U1	0.005 J1	0.40	1.15	2.65	0.23	0.08 J1	0.00649	< 0.002 U1	1.7	< 0.04 U1	< 0.02 U1
11/04/2025	Assessment	0.03 J1	19.2	649	< 0.02 U1	< 0.004 U1	0.30	1.21	1.67	0.26	0.07 J1	0.00688	< 0.002 U1	1.72	< 0.04 U1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1600S

Geosyntec Consultants, Inc.

Rockport - BAP
Appendix III Constituents

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/08/2016	Background	0.045	69.8	32.0	0.33	6.6	75.8	491
7/19/2016	Background	0.045	67.0	29.9	0.34	6.8	76.0	448
9/19/2016	Background	0.026	63.2	21.3	0.32	6.4	60.8	408
11/16/2016	Background	0.061	63.5	27.1	0.28	6.8	54.4	426
1/10/2017	Background	0.034	68.5	23.7	0.32	6.5	53.1	433
3/07/2017	Background	0.129	63.2	25.0	0.37	6.8	58.5	402
5/08/2017	Background	0.039	69.0	26.0	0.40	6.6	54.6	427
7/17/2017	Background	0.068	58.0	18.0	0.36	9.5	41.0	393
10/03/2017	Detection	0.049	61.4	27.8	0.37	6.8	54.9	430
12/13/2017	Detection	--	--	36.1	0.36	6.7	68.0	--
6/04/2018	Assessment	0.076	60.9	36.5	0.56	7.3	41.3	412
8/15/2018	Assessment	0.088	63.7	44.9	0.51	7.0	42.3	416
5/21/2019	Assessment	0.05 J1	57.4	27.9	0.44	6.9	57.4	423
6/25/2019	Assessment	0.05 J1	62.7	21.4	0.47	6.8	40.9	398
9/10/2019	Assessment	0.04 J1	64.8	23.9	0.46	6.9	45.0	383
3/11/2020	Assessment	--	--	--	0.42	6.5	--	--
5/21/2020	Assessment	0.04 J1	66.6	30.7	0.45	7.2	53.8	412
11/12/2020	Assessment	0.04 J1	59.6	24.6	0.40	6.5	60.4	397
2/03/2021	Assessment	0.04 J1	60.3	26.7	0.44	6.1	52.0	379
5/27/2021	Assessment	0.041 J1	70.2	32.6	0.51	7.3	40.4	420
11/10/2021	Assessment	0.038 J1	56.4	43.0	0.42	6.3	42.7	380
2/17/2022	Assessment	0.038 J1	61.7	35.8	0.46	6.4	43.3	380 P2
5/10/2022	Assessment	0.025 J1	63.5	27.0	0.55	6.7	39.6	380 L1
11/01/2022	Assessment	0.043 J1	57.2	35.7	0.37	6.7	53.3	380
2/07/2023	Assessment	0.037 J1	53.6	22.4	0.54	7.1	34.1	370
6/01/2023	Assessment	0.027 J1	51.3	30.8	0.54	5.3	41.6	390
10/31/2023	Assessment	0.040 J1	56.2	27.7	0.53	6.3	34.4	380
3/06/2024	Assessment	--	--	--	0.50	6.7	--	--
5/15/2024	Assessment	0.17 J1	292	34.3	0.46	6.9	33.3	380
11/13/2024	Assessment	0.039 J1	59	37.1	0.46	6.7	44.7	400
2/04/2025	Assessment	--	--	--	0.42	6.6	--	--
5/15/2025	Assessment	0.033 J1	58.5	21.8	0.52	6.9	29.1	370
11/06/2025	Assessment	0.050	58.8	35.2	0.44	6.4	36.8	370

Table 1. Groundwater Data Summary: MW-1600S
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/08/2016	Background	0.02 J1	0.67	36.1	< 0.005 U1	0.02 J1	0.2	0.243	0.149	0.33	0.118	0.003	0.002 J1	0.61	0.5	< 0.01 U1
7/19/2016	Background	0.02 J1	0.67	37.9	< 0.005 U1	0.02 J1	0.4	0.099	0.52826	0.34	0.048	0.038	< 0.002 U1	0.56	0.3	0.01 J1
9/19/2016	Background	0.02 J1	0.58	30.9	< 0.005 U1	0.01 J1	0.2	0.129	0.0715	0.32	0.087	0.019	< 0.002 U1	0.56	0.3	0.02 J1
11/16/2016	Background	0.04 J1	0.75	32.9	0.008 J1	0.03	0.284	0.690	0.505	0.28	0.360	0.024	< 0.002 U1	0.64	0.4	0.04 J1
1/10/2017	Background	0.02 J1	0.65	29.3	0.006 J1	0.01 J1	0.892	0.306	1.8182	0.32	0.151	0.016	< 0.002 U1	0.60	0.4	0.01 J1
3/07/2017	Background	0.03 J1	0.70	30.5	0.008 J1	0.02 J1	0.459	0.587	1.697	0.37	0.319	0.013	< 0.002 U1	0.66	0.5	0.01 J1
5/08/2017	Background	0.05	0.65	26.9	0.020	0.02	0.163	0.398	0.305	0.40	0.195	0.019	0.005	0.56	0.5	0.050
7/17/2017	Background	0.02 J1	0.61	26.1	0.006 J1	0.02 J1	0.302	0.441	0.117	0.36	0.233	0.019	< 0.002 U1	0.74	0.5	0.02 J1
6/04/2018	Assessment	0.03 J1	0.49	22.7	0.005 J1	0.01 J1	0.109	0.128	1.573	0.56	0.069	0.019	< 0.002 U1	0.72	0.5	0.02 J1
8/15/2018	Assessment	0.02 J1	0.45	23.7	< 0.004 U1	0.01 J1	0.277	0.105	0.646	0.51	0.053	0.014	--	0.65	0.4	0.02 J1
5/21/2019	Assessment	0.03 J1	0.50	26.7	< 0.02 U1	0.01 J1	1.34	0.127	0.6234	0.44	0.07 J1	0.01 J1	< 0.002 U1	0.7 J1	0.6	< 0.1 U1
6/25/2019	Assessment	< 0.02 U1	0.48	22.0	< 0.02 U1	0.01 J1	0.08 J1	0.193	0.528	0.47	0.09 J1	0.03 J1	< 0.002 U1	0.5 J1	0.4	< 0.1 U1
9/10/2019	Assessment	< 0.02 U1	0.46	21.9	< 0.02 U1	0.01 J1	0.2 J1	0.149	0.2093	0.46	0.08 J1	0.0126	< 0.002 U1	0.6 J1	0.5	< 0.1 U1
3/11/2020	Assessment	< 0.02 U1	0.40	22.1	< 0.02 U1	< 0.01 U1	0.1 J1	0.04 J1	0.2165	0.42	< 0.05 U1	0.0126	< 0.002 U1	0.5 J1	0.4	< 0.1 U1
5/21/2020	Assessment	0.02 J1	0.40	23.2	< 0.02 U1	0.09	0.2 J1	0.05 J1	0.662	0.45	< 0.05 U1	0.0135	< 0.002 U1	0.4 J1	0.4	< 0.1 U1
11/12/2020	Assessment	0.04 J1	0.40	23.2	< 0.02 U1	0.01 J1	0.342	0.03 J1	0.9926	0.40	< 0.05 U1	0.0144	< 0.002 U1	< 0.4 U1	0.7	< 0.1 U1
2/03/2021	Assessment	< 0.02 U1	0.41	22.9	< 0.02 U1	< 0.01 U1	0.319	0.05 J1	1.11	0.44	< 0.05 U1	0.0130	< 0.002 U1	0.5 J1	0.3	< 0.1 U1
5/27/2021	Assessment	0.15	4.39	57.9	0.106	0.191	1.92	9.95	0.88	0.51	4.97	0.0111	0.004 J1	0.9	0.73	0.05 J1
11/10/2021	Assessment	0.03 J1	0.66	26.8	0.014 J1	0.041	0.51	1.12	0.45	0.42	0.63	0.0123	< 0.002 U1	0.2 J1	0.41 J1	< 0.04 U1
2/17/2022	Assessment	< 0.02 U1	0.39	21.0	< 0.007 U1	0.011 J1	0.32	0.074	1.27	0.46	< 0.05 U1	0.0116	< 0.002 U1	0.6	0.51	< 0.04 U1
5/10/2022	Assessment	0.02 J1	0.43	19.5	< 0.007 U1	0.011 J1	0.28	0.122	2.69	0.55	0.06 J1	0.0106	< 0.002 U1	0.7	0.63	< 0.04 U1
11/01/2022	Assessment	0.03 J1	0.35	22.9	< 0.007 U1	0.014 J1	0.26	0.030	0.72	0.37	< 0.05 U1	0.0154	< 0.002 U1	0.4 J1	1.13	< 0.04 U1
2/07/2023	Assessment	0.02 J1	0.38	18.1	< 0.007 U1	0.011 J1	0.35	0.119	1.17	0.54	0.06 J1	0.0115	< 0.002 U1	0.6	0.50	< 0.04 U1
6/01/2023	Assessment	0.017 J1	0.31	18.3	< 0.007 U1	0.006 J1	0.27 J1	0.062	0.42	0.54	< 0.05 U1	0.0104	< 0.002 U1	0.5	0.52	< 0.02 U1
10/31/2023	Assessment	0.025 J1	0.41	20.6	< 0.007 U1	0.012 J1	0.43	0.106	0.89	0.53	0.05 J1	0.0101	< 0.002 U1	0.7	0.74	0.04 J1
3/06/2024	Assessment	0.018 J1	0.34	20.4	< 0.007 U1	0.011 J1	0.19 J1	0.039	1.13	0.50	< 0.05 U1	0.0103	< 0.002 U1	0.6	0.62	0.03 J1
5/15/2024	Assessment	0.10 J1	1.7	91.8	< 0.04 U1	0.06 J1	1.3 J1	0.27	0.99	0.46	< 0.3 U1	0.0479	< 0.002 U1	3.2	2.6	< 0.1 U1
11/13/2024	Assessment	0.035 J1	0.34	21.2	< 0.007 U1	0.017 J1	0.29 J1	0.036	0.96	0.46	0.05 J1	0.013 J1	< 0.002 U1	0.5	0.75	< 0.02 U1
2/04/2025	Assessment	< 0.04 U1	0.4 J1	22.7	< 0.04 U1	< 0.02 U1	0.5 J1	0.04 J1	0.82	0.42	< 0.3 U1	0.0157	< 0.002 U1	0.5 J1	0.8 J1	< 0.1 U1
5/15/2025	Assessment	0.016 J1	0.34	17.7	< 0.007 U1	0.006 J1	0.38	0.030	0.59	0.52	< 0.05 U1	0.00951	< 0.002 U1	0.6	0.68	< 0.02 U1
11/06/2025	Assessment	0.02 J1	0.32	21.2	< 0.02 U1	0.013 J1	0.27 J1	0.01 J1	0.27	0.44	0.30	0.0128	< 0.002 U1	0.47 J1	1.04	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1601D
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/27/2016	Background	0.038	79.7	21.8	0.22	7.5	21.9	460
7/19/2016	Background	0.035	89.0	18.9	0.22	7.4	18.9	412
9/20/2016	Background	0.026	87.0	22.6	0.17	7.2	20.4	410
11/16/2016	Background	0.035	89.5	21.8	0.15	7.4	18.0	413
1/10/2017	Background	0.029	90.7	19.5	0.19	6.8	20.3	407
3/07/2017	Background	0.055	85.2	28.7	0.17	7.1	25.4	392
5/09/2017	Background	0.038	90.8	22.5	0.17	6.7	21.3	399
7/17/2017	Background	0.090	77.7	21.3	0.17	6.8	21.4	393
10/04/2017	Detection	0.044	86.8	17.9	0.16	7.3	18.8	390
12/12/2017	Detection	--	--	18.8	0.16	7.2	20.2	--
6/05/2018	Assessment	0.075	87.6	23.8	0.19	6.4	25.0	393
8/15/2018	Assessment	0.122	86.5	19.4	0.17	7.3	19.6	418
5/24/2019	Assessment	0.03 J1	85.4	23.6	0.19	7.1	24.9	414
6/26/2019	Assessment	0.04 J1	85.9	18.7	0.16	7.2	22.9	409
9/09/2019	Assessment	0.03 J1	84.4	19.9	0.18	7.2	18.2	404
3/11/2020	Assessment	--	--	--	0.17	6.9	--	--
5/21/2020	Assessment	0.02 J1	88.5	32.4	0.20	7.1	41.3	409
11/16/2020	Assessment	0.03 J1	85.0	18.6	0.18	6.2	19.1	409
2/03/2021	Assessment	0.03 J1	90.6	19.4	0.20	7.0	20.0	396
5/26/2021	Assessment	0.029 J1	87.6	18.9	0.20	9.4	18.9	410
11/10/2021	Assessment	0.029 J1	86.3	19.1	0.18	6.6	17.4	390
2/16/2022	Assessment	0.028 J1	86.9	20.0	0.18	6.7	21.3	430
5/10/2022	Assessment	0.027 J1	101	23.2	0.17	6.8	25.7	410 L1
11/01/2022	Assessment	0.031 J1	85.5	18.8	0.18	6.8	17.8	400
2/08/2023	Assessment	0.029 J1	84.6	20.4	0.17	7.5	20.4	410
6/01/2023	Assessment	0.022 J1	73.5	--	--	5.6	--	--
6/06/2023	Assessment	--	--	23.9	0.17	7.4	26.4	410
11/01/2023	Assessment	0.027 J1	75.6	19.0	0.18	6.6	18.3	410
3/06/2024	Assessment	--	--	--	0.16	6.9	--	--
5/16/2024	Assessment	0.026 J1	75.5	20.8	0.21	7.1	22.4	380
11/15/2024	Assessment	0.024 J1	76	20.8	0.17	6.8	19.8	410
2/05/2025	Assessment	--	--	--	0.20	7.2	--	--
5/15/2025	Assessment	0.030 J1	85.1	18.1	0.17	6.9	16.9	420
11/04/2025	Assessment	0.028 J1	87.2	22.0	0.19	7.0	22.7	400

Table 1. Groundwater Data Summary: MW-1601D
Rockport - BAP
Appendix IV Constituents

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/27/2016	Background	0.03 J1	6.04	491	0.024	0.12	0.8	1.36	1.116	0.22	1.05	0.003	< 0.002 U1	2.54	0.1	0.01 J1
7/19/2016	Background	0.02 J1	8.20	540	< 0.005 U1	0.01 J1	0.4	0.502	2.248	0.22	0.031	0.005	< 0.002 U1	3.96	0.07 J1	0.055
9/20/2016	Background	0.01 J1	8.59	602	< 0.005 U1	< 0.004 U1	0.2	0.224	1.732	0.17	0.01 J1	< 0.0002 U1	< 0.002 U1	3.08	< 0.03 U1	< 0.01 U1
11/16/2016	Background	0.02 J1	9.20	616	< 0.005 U1	0.01 J1	0.089	0.174	0.946	0.15	0.022	0.015	< 0.002 U1	3.14	< 0.03 U1	0.04 J1
1/10/2017	Background	< 0.01 U1	8.95	527	< 0.005 U1	< 0.004 U1	0.293	0.197	1.929	0.19	0.006 J1	0.004	< 0.002 U1	3.10	< 0.03 U1	< 0.01 U1
3/07/2017	Background	< 0.01 U1	9.32	582	< 0.005 U1	< 0.004 U1	0.417	0.148	0.868	0.17	0.021	0.004	< 0.002 U1	2.66	< 0.03 U1	< 0.01 U1
5/09/2017	Background	0.05	9.47	583	0.020	0.02	0.121	0.152	0.983	0.17	0.026	0.008	0.005	2.84	0.1	0.050
7/17/2017	Background	< 0.01 U1	9.38	532	< 0.004 U1	0.006 J1	0.129	0.103	3.139	0.17	0.031	0.006	< 0.002 U1	2.67	< 0.03 U1	< 0.01 U1
6/05/2018	Assessment	0.03 J1	11.4	552	< 0.004 U1	< 0.005 U1	0.055	0.149	2.095	0.19	0.022	0.007	< 0.002 U1	3.34	< 0.03 U1	< 0.01 U1
8/15/2018	Assessment	0.02 J1	10.3	540	< 0.004 U1	0.01 J1	0.387	0.120	1.188	0.17	0.084	< 0.0002 U1	--	3.11	< 0.03 U1	0.02 J1
5/24/2019	Assessment	< 0.02 U1	10.3	638	< 0.02 U1	< 0.01 U1	0.06 J1	0.090	0.977	0.19	< 0.02 U1	0.01 J1	< 0.002 U1	2.63	0.03 J1	< 0.1 U1
6/26/2019	Assessment	< 0.02 U1	9.80	542	< 0.02 U1	< 0.01 U1	0.07 J1	0.075	0.986	0.16	0.02 J1	0.02 J1	< 0.002 U1	2.94	< 0.03 U1	< 0.1 U1
9/09/2019	Assessment	< 0.02 U1	11.0	575	< 0.02 U1	< 0.01 U1	0.08 J1	0.054	0.702	0.18	< 0.05 U1	0.00170	< 0.002 U1	3.15	< 0.03 U1	< 0.1 U1
3/11/2020	Assessment	< 0.02 U1	10.7	575	< 0.02 U1	< 0.01 U1	0.1 J1	0.059	0.789	0.17	< 0.05 U1	0.00170	< 0.002 U1	2.77	0.04 J1	< 0.1 U1
5/21/2020	Assessment	< 0.02 U1	10.9	670	< 0.02 U1	0.05 J1	0.1 J1	0.077	1.672	0.20	< 0.05 U1	0.00265	< 0.002 U1	2.12	< 0.03 U1	< 0.1 U1
11/16/2020	Assessment	< 0.02 U1	11.0	524	< 0.02 U1	< 0.01 U1	0.2 J1	0.05 J1	1.489	0.18	< 0.05 U1	0.00163	< 0.002 U1	2.89	< 0.03 U1	< 0.1 U1
2/03/2021	Assessment	< 0.02 U1	12.4	567	< 0.02 U1	0.01 J1	0.241	0.052	2.714	0.20	< 0.05 U1	0.00147	< 0.002 U1	3.23	< 0.03 U1	< 0.1 U1
5/26/2021	Assessment	0.09 J1	11.4	536	< 0.007 U1	0.015 J1	0.13 J1	0.05	1.41	0.20	< 0.05 U1	0.0014	< 0.002 U1	3.1	< 0.09 U1	< 0.04 U1
11/10/2021	Assessment	< 0.02 U1	11.5	509	< 0.007 U1	< 0.004 U1	0.21	0.051	0.77	0.18	< 0.05 U1	0.00133	< 0.002 U1	3.1	< 0.09 U1	< 0.04 U1
2/16/2022	Assessment	< 0.02 U1	11.3	522	< 0.007 U1	0.007 J1	0.16 J1	0.054	1.66	0.18	< 0.05 U1	0.00136	< 0.002 U1	3.0	< 0.09 U1	< 0.04 U1
5/10/2022	Assessment	0.02 J1	11.5	594	< 0.007 U1	0.025	0.37	0.102	1.77	0.17	0.06 J1	0.00156	< 0.002 U1	2.9	< 0.09 U1	< 0.04 U1
11/01/2022	Assessment	< 0.02 U1	11.5	515	< 0.007 U1	0.004 J1	0.21	0.033	1.28	0.18	< 0.05 U1	0.00129	< 0.002 U1	3.2	< 0.09 U1	< 0.04 U1
2/08/2023	Assessment	< 0.02 U1	11.7	530	< 0.007 U1	< 0.004 U1	0.34	0.048	2.09	0.17	< 0.05 U1	0.00150	< 0.002 U1	3.1	< 0.09 U1	< 0.04 U1
6/01/2023	Assessment	0.018 J1	9.79	494	< 0.007 U1	< 0.004 U1	0.18 J1	0.055	0.88	--	< 0.05 U1	0.00160	< 0.002 U1	2.5	< 0.04 U1	< 0.02 U1
6/06/2023	Assessment	--	--	--	--	--	--	--	--	0.17	--	--	--	--	--	--
11/01/2023	Assessment	0.01 J1	10.6	443	< 0.007 U1	< 0.004 U1	0.25 J1	0.045	1.88	0.18	< 0.05 U1	0.00106	< 0.002 U1	3.2	< 0.04 U1	< 0.02 U1
3/06/2024	Assessment	0.013 J1	11.1	529 M1	< 0.007 U1	0.008 J1	0.20 J1	0.053	1.49	0.16	< 0.05 U1	0.00159	< 0.002 U1	2.9	< 0.04 U1	< 0.02 U1
5/16/2024	Assessment	0.012 J1	9.65	470	< 0.007 U1	0.019 J1	0.28 J1	0.059	1.29	0.21	< 0.05 U1	0.00139	< 0.002 U1	2.9	< 0.04 U1	< 0.02 U1
11/15/2024	Assessment	< 0.008 U1	10.3	451	< 0.007 U1	< 0.004 U1	0.33	0.052 B1	1.30	0.17	< 0.05 U1	0.00108	< 0.002 U1	2.8	< 0.04 U1	< 0.02 U1
2/05/2025	Assessment	0.028 J1	11.4	507	< 0.007 U1	0.033	0.38	0.059	1.22	0.20	0.08 J1	0.00136	< 0.002 U1	3.3	0.07 J1	0.06 J1
5/15/2025	Assessment	< 0.008 U1	11.3	471	< 0.007 U1	< 0.004 U1	0.27 J1	0.046	1.43	0.17	< 0.05 U1	0.00097	< 0.002 U1	3.4	< 0.04 U1	< 0.02 U1
11/04/2025	Assessment	< 0.02 U1	11.6	539	< 0.02 U1	0.005 J1	0.33	0.04	1.59	0.19	< 0.05 U1	0.00129	< 0.002 U1	3.15	< 0.04 U1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-16011

Geosyntec Consultants, Inc.

Rockport - BAP
Appendix III Constituents

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/08/2016	Background	0.024	84.9	26.3	0.21	7.4	54.0	419
7/19/2016	Background	0.023	84.1	33.3	0.25	7.2	54.0	430
9/20/2016	Background	0.043	85.2	32.3	0.22	7.1	49.1	432
11/16/2016	Background	0.026	91.6	31.7	0.19	7.2	46.7	434
1/10/2017	Background	0.018	92.6	31.3	0.19	6.7	47.7	429
3/07/2017	Background	0.029	84.0	32.5	0.22	7.1	48.5	427
5/09/2017	Background	0.079	90.0	33.1	0.21	6.8	49.1	422
7/17/2017	Background	0.039	82.0	32.0	0.19	9.5	49.9	418
10/04/2017	Detection	0.088	77.5	31.6	0.20	6.8	51.8	428
12/12/2017	Detection	--	--	30.5	0.21	7.1	52.8	--
6/05/2018	Assessment	0.052	87.8	31.4	0.24	7.6	50	424
8/15/2018	Assessment	0.054	91.7	31.3	0.25	7.3	49.9	429
6/26/2019	Assessment	0.03 J1	85.0	31.2	0.21	7.2	50.8	439
9/09/2019	Assessment	0.02 J1	85.1	30.8	0.22	7.1	42.7	426
3/11/2020	Assessment	--	--	--	0.23	6.9	--	--
5/21/2020	Assessment	0.02 J1	87.8	31.5	0.26	6.8	52.1	435
11/16/2020	Assessment	0.02 J1	80.2	29.8	0.24	6.2	49.5	418
2/03/2021	Assessment	0.02 J1	85.7	29.8	0.26	6.8	50.4	414
5/26/2021	Assessment	0.023 J1	95.8	30.0	0.27	9.4	50.2	420
11/10/2021	Assessment	0.025 J1	85.8	29.4	0.25	6.6	48.3	420
2/16/2022	Assessment	0.023 J1	86.6	29.9	0.24	6.6	51.0	430
5/10/2022	Assessment	0.022 J1	94.9	31.0	0.24	6.7	51.5	420 L1
11/01/2022	Assessment	0.025 J1	81.1	29.8	0.24	7.0	49.9	420
2/08/2023	Assessment	0.027 J1	79.7	29.2	0.24	7.2	48.7	420
6/01/2023	Assessment	0.023 J1	76.7	28.6	0.23	5.6	48.8	420
11/01/2023	Assessment	0.023 J1	72.4	28.5	0.25	6.5	48.5	410
3/06/2024	Assessment	--	--	--	--	6.9	--	--
3/07/2024	Assessment	--	--	--	0.23	--	--	--
5/16/2024	Assessment	0.021 J1	72.9	29.0	0.28	7.0	49.9	410
11/15/2024	Assessment	0.021 J1	74	28.4	0.24	6.9	47.6	430
2/05/2025	Assessment	--	--	--	0.27	7.1	--	--
5/14/2025	Assessment	0.025 J1	79.7	28.3	0.24	7.1	49.1	400
11/04/2025	Assessment	0.027 J1	82.6	29.5	0.27	7.0	50.0	400

Table 1. Groundwater Data Summary: MW-1601I
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/08/2016	Background	0.02 J1	11.4	612	< 0.005 U1	< 0.004 U1	0.1	1.84	1.432	0.21	0.042	0.003	< 0.002 U1	2.80	< 0.03 U1	< 0.01 U1
7/19/2016	Background	0.02 J1	14.6	620	< 0.005 U1	< 0.004 U1	0.9	1.98	1.036	0.25	0.045	0.004	< 0.002 U1	2.81	< 0.03 U1	< 0.01 U1
9/20/2016	Background	0.02 J1	14.9	681	< 0.005 U1	< 0.004 U1	0.2	1.68	2.329	0.22	0.02 J1	0.008	< 0.002 U1	2.53	< 0.03 U1	0.01 J1
11/16/2016	Background	0.02 J1	16.2	689	< 0.005 U1	0.007 J1	0.110	1.68	1.451	0.19	0.030	0.002	< 0.002 U1	2.36	< 0.03 U1	0.02 J1
1/10/2017	Background	0.01 J1	16.2	605	< 0.005 U1	< 0.004 U1	0.387	1.58	0.993	0.19	0.02 J1	0.007	< 0.002 U1	2.24	< 0.03 U1	0.02 J1
3/07/2017	Background	0.03 J1	16.9	650	< 0.005 U1	< 0.004 U1	0.267	1.59	0.986	0.22	0.070	0.010	< 0.002 U1	2.74	0.06 J1	0.03 J1
5/09/2017	Background	0.05	17.9	634	0.020	0.02	0.156	1.69	1.064	0.21	0.052	0.014	0.005	2.23	0.1	0.050
7/17/2017	Background	0.02 J1	18.0	613	< 0.004 U1	< 0.005 U1	0.160	1.74	1.276	0.19	0.042	0.011	< 0.002 U1	2.13	< 0.03 U1	0.02 J1
6/05/2018	Assessment	0.02 J1	18.6	631	0.008 J1	0.01 J1	0.21	1.73	1.538	0.24	0.201	0.013	< 0.002 U1	2.48	0.05 J1	0.04 J1
8/15/2018	Assessment	0.02 J1	19.1	626	< 0.004 U1	0.009 J1	0.074	1.63	2.274	0.25	0.067	0.009	--	2.21	< 0.03 U1	0.02 J1
6/26/2019	Assessment	< 0.02 U1	18.0	619	< 0.02 U1	< 0.01 U1	0.06 J1	1.50	1.862	0.21	0.04 J1	0.02 J1	< 0.002 U1	2.28	< 0.03 U1	< 0.1 U1
9/09/2019	Assessment	0.04 J1	39.5	670	< 0.02 U1	0.07	0.250	1.63	1.522	0.22	0.251	0.00672	< 0.002 U1	2.26	0.04 J1	< 0.1 U1
3/11/2020	Assessment	< 0.02 U1	17.4	621	< 0.02 U1	< 0.01 U1	0.1 J1	1.23	1.202	0.23	< 0.05 U1	0.00646	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
5/21/2020	Assessment	< 0.02 U1	17.2	608	< 0.02 U1	< 0.01 U1	0.1 J1	1.26	0.90	0.26	< 0.05 U1	0.00621	< 0.002 U1	2.10	< 0.03 U1	< 0.1 U1
11/16/2020	Assessment	< 0.02 U1	17.8	586	< 0.02 U1	< 0.01 U1	0.2 J1	1.22	2.329	0.24	< 0.05 U1	0.00688	< 0.002 U1	2.02	< 0.03 U1	< 0.1 U1
2/03/2021	Assessment	< 0.02 U1	19.8	634	< 0.02 U1	< 0.01 U1	0.207	1.33	1.949	0.26	0.09 J1	0.00616	< 0.002 U1	2.24	< 0.03 U1	< 0.1 U1
5/26/2021	Assessment	< 0.02 U1	18.3	589 M1, P3	< 0.007 U1	0.039	0.05 J1	1.21	1.50	0.27	< 0.05 U1	0.00624	< 0.002 U1	2.0	< 0.09 U1	< 0.04 U1
11/10/2021	Assessment	< 0.02 U1	19.0	625	< 0.007 U1	< 0.004 U1	0.22	1.19	2.11	0.25	< 0.05 U1	0.00632	< 0.002 U1	2.2	< 0.09 U1	0.04 J1
2/16/2022	Assessment	< 0.02 U1	19.1	643	< 0.007 U1	< 0.004 U1	0.40	1.30	1.49	0.24	< 0.05 U1	0.00627	< 0.002 U1	2.2	< 0.09 U1	< 0.04 U1
5/10/2022	Assessment	< 0.02 U1	19.5	627	< 0.007 U1	0.011 J1	0.24	1.24	1.97	0.24	< 0.05 U1	0.00590	< 0.002 U1	2.2	< 0.09 U1	< 0.04 U1
11/01/2022	Assessment	< 0.02 U1	18.5	593	< 0.007 U1	< 0.004 U1	0.25	1.19	1.16	0.24	< 0.05 U1	0.00682	< 0.002 U1	2.2	< 0.09 U1	< 0.04 U1
2/08/2023	Assessment	< 0.02 U1	18.6	594	< 0.007 U1	< 0.004 U1	0.30	1.22	1.99	0.24	< 0.05 U1	0.00696	< 0.002 U1	2.3	< 0.09 U1	0.05 J1
6/01/2023	Assessment	0.031 J1	17.3	568	< 0.007 U1	< 0.004 U1	0.29 J1	1.11	2.00	0.23	< 0.05 U1	0.00620	< 0.002 U1	2.2	< 0.04 U1	< 0.02 U1
11/01/2023	Assessment	0.012 J1	17.7	562	< 0.007 U1	< 0.004 U1	0.20 J1	1.16	0.95	0.25	< 0.05 U1	0.00648	< 0.002 U1	2.2	< 0.04 U1	0.02 J1
3/07/2024	Assessment	0.018 J1	18.7	611	< 0.007 U1	0.005 J1	0.22 J1	1.19	1.85	0.23	< 0.05 U1	0.00674	< 0.002 U1	2.2	< 0.04 U1	0.03 J1
5/16/2024	Assessment	0.014 J1	16.7	544	< 0.007 U1	0.007 J1	0.20 J1	1.05	1.69	0.28	< 0.05 U1	0.00618	< 0.002 U1	2.1	< 0.04 U1	< 0.02 U1
11/15/2024	Assessment	0.011 J1	16.0	530	< 0.007 U1	0.005 J1	0.23 J1	1.16 B1	1.00	0.24	< 0.05 U1	0.00573	< 0.002 U1	2	< 0.04 U1	< 0.02 U1
2/05/2025	Assessment	0.008 J1	17.3	548	< 0.007 U1	< 0.004 U1	0.43	1.13	1.08	0.27	< 0.05 U1	0.00639	< 0.002 U1	2.2	< 0.04 U1	< 0.02 U1
5/14/2025	Assessment	0.011 J1	17.9	574	< 0.007 U1	0.006 J1	0.27 J1	1.17	1.57	0.24	< 0.05 U1	0.00616	< 0.002 U1	2.3	< 0.04 U1	0.03 J1
11/04/2025	Assessment	< 0.02 U1	19.2	594	< 0.02 U1	0.009 J1	0.30	1.23	1.52	0.27	< 0.05 U1	0.00694	< 0.002 U1	2.25	0.04 J1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1601S

Geosyntec Consultants, Inc.

Rockport - BAP
Appendix III Constituents

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/08/2016	Background	0.108	76.9	45.9	0.34	7.6	39.2	440
7/19/2016	Background	0.106	71.8	46.4	0.36	7.2	40.1	415
9/20/2016	Background	0.094	74.2	43.5	0.33	7.2	37.6	442
11/16/2016	Background	0.100	78.2	42.3	0.26	7.2	36.4	442
1/10/2017	Background	0.113	78.5	42.0	0.28	6.8	35.9	424
3/07/2017	Background	0.098	79.2	41.1	0.30	7.2	42.5	413
5/08/2017	Background	0.092	86.7	41.9	0.31	6.8	44.0	389
7/17/2017	Background	0.077	76.8	41.7	0.25	6.6	40.5	443
10/04/2017	Detection	0.113	73.5	40.9	0.29	7.3	41.6	441
12/12/2017	Detection	--	--	36.9	0.33	7.2	43.0	--
6/05/2018	Assessment	0.142	66.5	34.8	0.41	7.4	26.5	366
8/15/2018	Assessment	0.208	70.8	33.7	0.42	7.2	31.3	374
5/24/2019	Assessment	0.06 J1	77.2	38.5	0.36	7.2	41.8	451
6/25/2019	Assessment	0.07 J1	75.9	35.3	0.31	7.3	51.4	456
9/09/2019	Assessment	0.068	79.6	37.6	0.31	7.2	52.9	445
3/11/2020	Assessment	--	--	--	0.34	7.1	--	--
5/21/2020	Assessment	0.076	82.3	40.6	0.37	7.1	58.3	462
11/16/2020	Assessment	0.092	74.0	40.1	0.35	6.4	53.0	432
2/03/2021	Assessment	0.125	74.0	39.7	0.40	7.1	60.6	432
5/26/2021	Assessment	0.095	77.7	37.6	0.43	9.4	57.2	400
11/10/2021	Assessment	0.113	68.6	36.7	0.42	6.9	60.3	400
2/16/2022	Assessment	0.121	64.3	33.1	0.42	6.9	55.0	380
5/10/2022	Assessment	0.109	66.7	36.1	0.40	7.0	54.3	380 L1
11/01/2022	Assessment	0.140	68.3	33.7	0.38	7.1	62.2	390
2/08/2023	Assessment	0.144	65.8 M1	35.2	0.39	7.9	54.4	370
6/01/2023	Assessment	0.116	63.0	36.5	0.36	5.8	52.8	390
10/31/2023	Assessment	0.142	60.1	36.2	0.39	6.8	50.0	370
3/05/2024	Assessment	--	--	--	--	7.2	--	--
3/06/2024	Assessment	--	--	--	0.36	--	--	--
5/16/2024	Assessment	0.113	61.1	38.5	0.43	7.1	48.7	370
11/15/2024	Assessment	0.103	61	36.2	0.36	7.3	51.9	270
2/04/2025	Assessment	--	--	--	0.40	7.5	--	--
5/14/2025	Assessment	0.118	68.5	44.5	0.37	7.3	41.6	410
11/04/2025	Assessment	0.118	66.9	41.0	0.42	7.1	42.3	380

Table 1. Groundwater Data Summary: MW-1601S
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/08/2016	Background	0.02 J1	1.90	49.4	0.006 J1	0.01 J1	0.2	0.957	0.788	0.34	0.220	< 0.0002 U1	< 0.002 U1	2.17	1.3	0.05 J1
7/19/2016	Background	0.02 J1	2.12	47.7	< 0.005 U1	0.007 J1	0.6	0.478	1.26	0.36	0.114	0.024	< 0.002 U1	1.91	1.3	< 0.01 U1
9/20/2016	Background	0.02 J1	1.99	41.6	< 0.005 U1	0.006 J1	0.2	0.381	0.4671	0.33	0.127	0.005	< 0.002 U1	1.40	1.3	0.03 J1
11/16/2016	Background	0.03 J1	2.00	39.0	< 0.005 U1	0.01 J1	0.123	0.274	0.1634	0.26	0.084	0.009	< 0.002 U1	2.17	1.3	0.03 J1
1/10/2017	Background	0.05 J1	2.00	43.5	< 0.005 U1	0.03	0.279	0.520	0.717	0.28	0.247	0.006	< 0.002 U1	1.61	1.4	0.104
3/07/2017	Background	0.02 J1	2.25	50.7	< 0.005 U1	0.01 J1	1.52	0.980	0.1969	0.30	0.348	0.010	< 0.002 U1	1.49	1.4	0.01 J1
5/08/2017	Background	0.05	2.02	42.6	0.020	0.02	0.192	0.411	0.3203	0.31	0.119	0.010	0.005	1.24	1.7	0.050
7/17/2017	Background	0.05	2.70	70.0	0.01 J1	0.03	1.05	2.67	1.812	0.25	0.807	0.012	0.003 J1	1.46	1.8	0.04 J1
6/05/2018	Assessment	0.04 J1	2.45	44.0	0.02 J1	0.24	0.579	0.615	0.261	0.41	0.349	0.012	< 0.002 U1	1.79	0.5	< 0.01 U1
8/15/2018	Assessment	0.03 J1	2.28	38.0	0.005 J1	0.009 J1	0.114	0.557	0.398	0.42	0.141	0.004	--	1.81	1.1	0.05 J1
5/24/2019	Assessment	< 0.02 U1	2.05	37.2	< 0.02 U1	< 0.01 U1	0.08 J1	0.02 J1	0.0711	0.36	0.03 J1	0.01 J1	< 0.002 U1	1 J1	1.7	< 0.1 U1
6/25/2019	Assessment	< 0.02 U1	2.06	44.2	< 0.02 U1	< 0.01 U1	0.1 J1	0.649	0.248	0.31	0.165	0.01 J1	< 0.002 U1	1 J1	1.4	< 0.1 U1
9/09/2019	Assessment	0.02 J1	2.30	51.4	< 0.02 U1	0.02 J1	0.452	1.14	0.914	0.31	0.325	0.00691	< 0.002 U1	1 J1	1.2	< 0.1 U1
3/11/2020	Assessment	< 0.02 U1	1.95	37.9	< 0.02 U1	< 0.01 U1	0.2 J1	0.203	1.649	0.34	0.05 J1	0.00618	< 0.002 U1	1 J1	0.9	< 0.1 U1
5/21/2020	Assessment	< 0.02 U1	1.94	36.2	< 0.02 U1	< 0.01 U1	0.227	0.053	0.084	0.37	< 0.05 U1	0.00632	< 0.002 U1	1 J1	1.5	< 0.1 U1
11/16/2020	Assessment	< 0.02 U1	1.97	34.9	< 0.02 U1	< 0.01 U1	0.347	0.077	0.0911	0.35	< 0.05 U1	0.00609	< 0.002 U1	1 J1	1.6	< 0.1 U1
2/03/2021	Assessment	< 0.02 U1	2.10	32.8	< 0.02 U1	< 0.01 U1	0.640	0.070	0.7085	0.40	< 0.05 U1	0.00563	< 0.002 U1	2 J1	1.2	< 0.1 U1
5/26/2021	Assessment	0.07 J1	2.01	30.2	< 0.007 U1	0.005 J1	0.77	0.05	0.87	0.43	0.24	0.00507	< 0.002 U1	1.8	0.66	< 0.04 U1
11/10/2021	Assessment	< 0.02 U1	2.23	30.2	< 0.007 U1	< 0.004 U1	0.75	0.074	0.72	0.42	< 0.05 U1	0.00489	< 0.002 U1	1.9	0.67	< 0.04 U1
2/16/2022	Assessment	< 0.02 U1	2.32	30.3	< 0.007 U1	0.044	0.72	0.257	1.58	0.42	0.07 J1	0.00464	< 0.002 U1	2.2	0.76	< 0.04 U1
5/10/2022	Assessment	< 0.02 U1	2.47	31.4	< 0.007 U1	0.006 J1	0.34	0.452	0.41	0.40	0.12 J1	0.00458	< 0.002 U1	2.1	0.76	< 0.04 U1
11/01/2022	Assessment	< 0.02 U1	2.17	30.4	< 0.007 U1	< 0.004 U1	0.25	0.049	1.09	0.38	< 0.05 U1	0.00537	< 0.002 U1	1.9	1.0	< 0.04 U1
2/08/2023	Assessment	< 0.02 U1	2.28	28.9	< 0.007 U1	< 0.004 U1	0.36	0.051	0.38	0.39	< 0.05 U1	0.00538	< 0.002 U1	1.9	0.75	< 0.04 U1
6/01/2023	Assessment	0.016 J1	2.02	28.0	< 0.007 U1	0.005 J1	0.27 J1	0.049	0.54	0.36	< 0.05 U1	0.00536	< 0.002 U1	1.8	1.01	< 0.02 U1
10/31/2023	Assessment	0.019 J1	2.12	29.9	< 0.007 U1	< 0.004 U1	0.44	0.119	0.96	0.39	< 0.05 U1	0.00547	< 0.002 U1	2.0	0.87	0.03 J1
3/06/2024	Assessment	0.015 J1	2.14	31.8	< 0.007 U1	0.089	0.27 J1	0.139	0.58	0.36	< 0.05 U1	0.00545	< 0.002 U1	1.9	1.04	0.03 J1
5/16/2024	Assessment	0.014 J1	1.96	28.6	< 0.007 U1	0.010 J1	0.24 J1	0.118	0.19	0.43	< 0.05 U1	0.00542	< 0.002 U1	1.8	0.91	< 0.02 U1
11/15/2024	Assessment	0.011 J1	1.86	27.0	< 0.007 U1	0.009 J1	0.50	0.039 B1	0.21	0.36	< 0.05 U1	0.00448	< 0.002 U1	1.5	1.10	< 0.02 U1
2/04/2025	Assessment	0.014 J1	1.96	29.4	< 0.007 U1	< 0.004 U1	0.38	0.050	0.43	0.40	< 0.05 U1	0.00601	< 0.002 U1	1.6	1.42	< 0.02 U1
5/14/2025	Assessment	0.015 J1	1.93	31.8	< 0.007 U1	0.009 J1	0.22 J1	0.008 J1	0.53	0.37	< 0.05 U1	0.00560	< 0.002 U1	1.8	0.77	0.04 J1
11/04/2025	Assessment	< 0.02 U1	2.14	29.9	< 0.02 U1	0.008 J1	0.37	0.03	0.76	0.42	< 0.05 U1	0.00580	< 0.002 U1	1.68	1.06	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1602D
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/07/2016	Background	0.058	69.7	138	0.36	5.1	20.5	528
7/18/2016	Background	0.065	77.6	166	0.34	8.2	18.5	574
9/20/2016	Background	0.047	71.7	172	0.30	7.8	12.9	580
11/15/2016	Background	0.078	78.0	177	0.33	7.1	17.4	601
1/09/2017	Background	0.084	75.3	178	0.34	7.3	11.4	594
3/07/2017	Background	0.076	66.8	158	0.31	7.3	14.5	586
5/08/2017	Background	0.073	71.9	124	0.31	7.0	16.1	520
7/17/2017	Background	0.091	64.6	112	0.26	7.0	17.5	472
10/03/2017	Detection	0.064	68.3	135	0.29	7.4	16.0	518
12/12/2017	Detection	--	--	141	0.30	7.4	16.9	--
1/03/2018	Detection	--	--	146	--	7.8	--	574
6/05/2018	Assessment	0.070	66.0	92.8	0.35	7.8	21.6	440
8/13/2018	Assessment	0.098	73.0	131	0.31	7.2	18.0	521
5/24/2019	Assessment	0.04 J1	67.9	68.3	0.33	7.4	20.5	418
6/27/2019	Assessment	0.06 J1	69.8	68.7	0.33	7.3	20.3	429
9/12/2019	Assessment	0.059	57.8	65.1	0.28	7.1	20.2	440
3/11/2020	Assessment	--	--	--	0.33	7.1	--	--
5/20/2020	Assessment	0.04 J1	74.2	62.8	0.35	6.8	23.8	416
11/17/2020	Assessment	0.05 J1	64.0	87.1	0.33	6.9	20.5	452
2/02/2021	Assessment	0.052	66.2	83.8	0.36	6.9	21.3	472
5/26/2021	Assessment	0.045 J1	64.0	76.9	0.35	7.4	22.0	450
11/09/2021	Assessment	0.051	67.6 M1, P3	86.9	0.35	7.4	19.3	460
2/15/2022	Assessment	0.057	68.2	80.7	0.34	7.3	20.2	440
5/11/2022	Assessment	0.048 J1	76.0	66.5	0.34	7.5	24.7	430 L1
11/01/2022	Assessment	0.053	65.5			7.0		
11/03/2022	Assessment	--	--	77.5	0.32	6.3	21.8	430
2/09/2023	Assessment	0.048 J1	62.9	77.6	0.32	7.9	21.9	440
5/31/2023	Assessment	0.046 J1	62.0	66.7	0.31	7.3	22.3	450
11/01/2023	Assessment	0.053	63.2	85.2	0.33	6.7	20.7	450
3/06/2024	Assessment	--	--	--	0.31	7.3	--	--
5/14/2024	Assessment	0.058	92.6	26.0	0.26	7.1	196	600
11/14/2024	Assessment	0.05	68	74.5	0.36	7.1	22.2	440
2/04/2025	Assessment	--	--	--	0.36	7.4	--	--
5/14/2025	Assessment	0.045 J1	64.1	57.4	0.33	7.2	22.1	400
11/05/2025	Assessment	0.049 J1	64.1	83.7	0.32	7.2	20.5	450

Table 1. Groundwater Data Summary: MW-1602D
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/07/2016	Background	0.02 J1	7.35	380	< 0.005 U1	< 0.004 U1	0.3	0.227	1.147	0.36	0.061	0.001	< 0.002 U1	4.69	0.03 J1	< 0.01 U1
7/18/2016	Background	0.01 J1	8.54	507	< 0.005 U1	< 0.004 U1	0.5	0.166	2.43	0.34	0.02 J1	0.022	< 0.002 U1	3.89	< 0.03 U1	< 0.01 U1
9/20/2016	Background	0.02 J1	8.24	487	< 0.005 U1	< 0.004 U1	0.2	0.116	1.128	0.30	0.022	0.007	< 0.002 U1	3.31	0.03 J1	< 0.01 U1
11/15/2016	Background	0.03 J1	8.32	585	0.01 J1	0.02	0.338	0.248	4.204	0.33	0.195	0.012	< 0.002 U1	3.31	0.05 J1	0.066
1/09/2017	Background	0.01 J1	7.92	503	< 0.005 U1	< 0.004 U1	0.187	0.112	0.976	0.34	0.01 J1	0.005	< 0.002 U1	3.36	< 0.03 U1	0.02 J1
3/07/2017	Background	0.01 J1	8.04	458	< 0.005 U1	< 0.004 U1	0.395	0.106	0.705	0.31	0.029	0.004	< 0.002 U1	3.88	0.05 J1	0.02 J1
5/08/2017	Background	0.05	9.08	436	0.020	0.07	0.232	0.115	0.5884	0.31	0.056	0.007	0.005	3.93	0.1	0.050
7/17/2017	Background	0.01 J1	8.51	419	0.005 J1	< 0.005 U1	0.268	0.110	1.349	0.26	0.036	0.003	< 0.002 U1	3.60	< 0.03 U1	< 0.01 U1
6/05/2018	Assessment	0.02 J1	10.0	442	0.006 J1	0.01 J1	0.210	0.157	1.861	0.35	0.103	0.008	< 0.002 U1	3.93	< 0.03 U1	< 0.01 U1
8/13/2018	Assessment	0.01 J1	9.28	459	0.008 J1	< 0.005 U1	0.201	0.173	1.021	0.31	0.113	0.002	--	3.18	0.05 J1	< 0.01 U1
5/24/2019	Assessment	< 0.02 U1	9.29	405	< 0.02 U1	< 0.01 U1	0.05 J1	0.065	0.71	0.33	< 0.02 U1	0.01 J1	< 0.002 U1	3.23	0.03 J1	< 0.1 U1
6/27/2019	Assessment	< 0.02 U1	9.05	386	< 0.02 U1	< 0.01 U1	0.06 J1	0.066	0.688	0.33	0.02 J1	< 0.009 U1	< 0.002 U1	3.12	0.03 J1	< 0.1 U1
9/12/2019	Assessment	0.17	10.3	433	0.02 J1	0.03 J1	0.763	0.373	1.130	0.28	0.437	0.00286	< 0.002 U1	3.64	0.09 J1	< 0.1 U1
3/11/2020	Assessment	0.03 J1	9.56	439	0.05 J1	0.01 J1	1.32	0.850	2.253	0.33	0.864	0.00291	0.003 J1	3.13	0.2 J1	< 0.1 U1
5/20/2020	Assessment	< 0.02 U1	9.46	412	< 0.02 U1	< 0.01 U1	0.354	0.066	0.872	0.35	< 0.05 U1	0.00212	< 0.002 U1	3.38	0.07 J1	< 0.1 U1
11/17/2020	Assessment	< 0.02 U1	8.82	431	< 0.02 U1	< 0.01 U1	0.276	0.055	2.518	0.33	< 0.05 U1	0.00275	< 0.002 U1	3.04	< 0.03 U1	< 0.1 U1
2/02/2021	Assessment	< 0.02 U1	9.29	445	< 0.02 U1	< 0.01 U1	0.247	0.057	1.727	0.36	< 0.05 U1	0.00247	< 0.002 U1	3.51	< 0.03 U1	< 0.1 U1
5/26/2021	Assessment	< 0.02 U1	10.2	452	< 0.007 U1	< 0.004 U1	0.26	0.052	0.99	0.35	< 0.05 U1	0.00234	< 0.002 U1	3.5	< 0.09 U1	< 0.04 U1
11/09/2021	Assessment	< 0.02 U1	9.51	449 M1	< 0.007 U1	0.028	0.18 J1	0.049	1.32	0.35	< 0.05 U1	0.00239	< 0.002 U1	3.2	< 0.09 U1	< 0.04 U1
2/15/2022	Assessment	0.02 J1	9.69	445	< 0.007 U1	< 0.004 U1	0.48	0.080	1.85	0.34	< 0.05 U1	0.00241	< 0.002 U1	3.4	< 0.09 U1	< 0.04 U1
5/11/2022	Assessment	< 0.02 U1	10.1	444	< 0.007 U1	< 0.004 U1	0.24	0.067	1.29	0.34	< 0.05 U1	0.00215	< 0.002 U1	3.6	< 0.09 U1	< 0.04 U1
11/01/2022	Assessment	< 0.02 U1	10.1	451	< 0.007 U1	< 0.004 U1	0.27	0.027	2.20		< 0.05 U1	0.00241	< 0.002 U1	3.3	< 0.09 U1	< 0.04 U1
11/03/2022	Assessment	--	--	--	--	--	--	--	--	0.32	--	--	--	--	--	--
2/09/2023	Assessment	< 0.02 U1	8.89	411	0.007 J1	< 0.004 U1	0.18 J1	0.042	1.35	0.32	< 0.05 U1	0.00239	< 0.002 U1	3.2	< 0.09 U1	< 0.04 U1
5/31/2023	Assessment	0.013 J1	9.17	408	< 0.007 U1	< 0.004 U1	0.24 J1	0.045	2.42	0.31	< 0.05 U1	0.00213	< 0.002 U1	3.2	< 0.04 U1	< 0.02 U1
11/01/2023	Assessment	0.012 J1	9.47	455	< 0.007 U1	< 0.004 U1	0.26 J1	0.059	5.66	0.33	< 0.05 U1	0.00250	< 0.002 U1	3.2	< 0.04 U1	< 0.02 U1
3/06/2024	Assessment	0.010 J1	9.53	457	< 0.007 U1	< 0.004 U1	0.25 J1	0.049	1.50	0.31	< 0.05 U1	0.00227	< 0.002 U1	3.1	< 0.04 U1	0.03 J1
5/14/2024	Assessment	0.033 J1	27.1	111	< 0.007 U1	0.006 J1	0.29 J1	1.41	2.65	0.26	< 0.05 U1	0.00566	< 0.002 U1	2.2	0.04 J1	0.02 J1
11/14/2024	Assessment	0.027 J1	9.62	577	0.008 J1	< 0.004 U1	0.40	0.118 B1	2.30	0.36	0.09 J1	0.00236	< 0.002 U1	3.1	0.05 J1	< 0.02 U1
2/04/2025	Assessment	0.010 J1	9.80	454	< 0.007 U1	< 0.004 U1	0.36	0.060	2.42	0.36	< 0.05 U1	0.00245	< 0.002 U1	3.3	< 0.04 U1	< 0.02 U1
5/14/2025	Assessment	< 0.008 U1	9.23	399	< 0.007 U1	< 0.004 U1	0.36	0.023	1.85	0.33	< 0.05 U1	0.00204	< 0.002 U1	3.4	< 0.04 U1	< 0.02 U1
11/05/2025	Assessment	< 0.02 U1	9.32	478	< 0.02 U1	< 0.004 U1	0.44	0.08	1.53	0.32	0.06 J1	0.00224	< 0.002 U1	2.95	< 0.04 U1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1602I
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/07/2016	Background	0.047	78.6	33.0	0.32	7.1	84.1	424
7/18/2016	Background	0.043	81.1	32.3	0.30	7.4	89.4	452
9/20/2016	Background	0.037	79.9	30.2	0.28	7.3	77.7	412
11/15/2016	Background	0.057	87.6	28.7	0.29	7.1	85.3	457
1/09/2017	Background	0.039	80.6	27.8	0.26	7.4	77.6	420
3/07/2017	Background	0.061	71.1	27.5	0.27	7.3	77.8	388
5/08/2017	Background	0.108	79.7	27.6	0.28	6.9	78.4	430
7/17/2017	Background	0.052	68.8	27.1	0.23	6.9	76.3	421
10/03/2017	Detection	0.065	69.2	27.5	0.26	7.3	80.8	414
12/12/2017	Detection	--	--	28.3	0.26	7.3	82.8	--
1/03/2018	Detection	--	--	--	--	7.7	82.3	--
6/05/2018	Assessment	0.060	71.3	29.8	0.31	7.8	77.6	410
8/13/2018	Assessment	0.109	76.0	28.5	0.28	7.4	75.0	405
5/24/2019	Assessment	0.05 J1	74.6	29.0	0.30	7.4	65.9	410
6/27/2019	Assessment	0.06 J1	76.2	29.2	0.30	7.3	67.4	405
9/12/2019	Assessment	0.051	83.1	28.7	0.30	7.3	70.7	404
3/11/2020	Assessment	--	--	--	0.29	7.0	--	--
5/20/2020	Assessment	0.114	113	79.0	0.30	7.7	177	627
11/17/2020	Assessment	0.121	85.0	54.5	0.30	7.0	135	537
2/03/2021	Assessment	0.088	76.1	35.6	0.33	6.7	86.0	428
5/26/2021	Assessment	0.067	73.7	31.2	0.32	7.5	76.6	420
11/09/2021	Assessment	0.048 J1	68.4	23.0	0.31	6.9	57.0	370
2/15/2022	Assessment	0.046 J1	68.5	23.0	0.30	7.1	57.8	380
5/11/2022	Assessment	0.043 J1	81.0	24.0	0.29	7.5	58.7	380 L1
10/31/2022	Assessment	0.041 J1	68.4			6.6		
11/03/2022	Assessment	--	--	22.5	0.29	7.2	60.2	360
2/08/2023	Assessment	0.041 J1	77.3	23.6	0.27	7.8	105	430 S7
5/31/2023	Assessment	0.040 J1	102	24.1	0.24	7.3	235	620
11/01/2023	Assessment	0.050	58.9	22.2	0.31	6.8	62.2	380
3/07/2024	Assessment	--	--	--	0.27	7.4	--	--
5/14/2024	Assessment	0.052	62.6	69.5	0.31	7.0	20.7	430
11/14/2024	Assessment	0.055	117	26.2	0.30	7.1	329	790
2/04/2025	Assessment	--	--	--	0.31	7.4	--	--
5/14/2025	Assessment	0.061	125	28.1	0.25	7.3	378	860
11/06/2025	Assessment	0.147	79.1	26.2	0.36	7.2	214	620

Table 1. Groundwater Data Summary: MW-1602I
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/07/2016	Background	0.02 J1	16.5	135	< 0.005 U1	0.005 J1	0.2	1.35	0.983	0.32	0.096	0.003	< 0.002 U1	2.61	< 0.03 U1	< 0.01 U1
7/18/2016	Background	0.02 J1	18.7	145	< 0.005 U1	0.006 J1	0.2	1.70	1.526	0.30	0.074	0.006	< 0.002 U1	2.68	0.03 J1	0.01 J1
9/20/2016	Background	0.02 J1	15.5	123	< 0.005 U1	< 0.004 U1	0.2	1.34	1.421	0.28	0.045	0.006	< 0.002 U1	2.31	0.05 J1	0.01 J1
11/15/2016	Background	0.03 J1	18.2	136	< 0.005 U1	0.006 J1	0.075	1.44	1.19	0.29	0.02 J1	0.015	< 0.002 U1	2.13	0.04 J1	0.03 J1
1/09/2017	Background	0.02 J1	18.3	126	< 0.005 U1	< 0.004 U1	0.161	1.38	0.7655	0.26	0.045	0.003	< 0.002 U1	2.23	< 0.03 U1	0.02 J1
3/07/2017	Background	0.03 J1	20.0	122	0.005 J1	< 0.004 U1	0.484	1.43	0.845	0.27	0.178	0.009	< 0.002 U1	2.21	0.06 J1	0.02 J1
5/08/2017	Background	0.14	25.5	123	0.020	0.02	0.459	1.69	1.024	0.28	0.292	0.009	0.005	2.08	0.1	0.050
7/17/2017	Background	0.05	27.3	127	0.006 J1	0.006 J1	0.193	1.52	0.8024	0.23	0.167	0.010	< 0.002 U1	2.01	< 0.03 U1	0.04 J1
6/05/2018	Assessment	0.10	38.6	128	0.01 J1	0.01 J1	0.338	1.80	0.968	0.31	0.374	0.013	< 0.002 U1	2.42	0.07 J1	0.03 J1
8/13/2018	Assessment	0.05 J1	26.9	111	0.006 J1	0.007 J1	0.086	1.31	0.90	0.28	0.092	0.001	--	2.10	< 0.03 U1	0.03 J1
5/24/2019	Assessment	0.08 J1	29.6	121	< 0.02 U1	0.03 J1	0.305	1.75	0.819	0.30	0.354	0.009 J1	< 0.002 U1	2.03	0.04 J1	< 0.1 U1
6/27/2019	Assessment	0.03 J1	22.4	115	< 0.02 U1	< 0.01 U1	0.2 J1	1.39	0.733	0.30	0.06 J1	< 0.009 U1	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
9/12/2019	Assessment	0.04 J1	30.0	120	< 0.02 U1	< 0.01 U1	0.1 J1	1.32	1.312	0.30	0.1 J1	0.00572	< 0.002 U1	2.11	0.03 J1	< 0.1 U1
3/11/2020	Assessment	< 0.02 U1	22.7	118	< 0.02 U1	< 0.01 U1	< 0.04 U1	1.36	0.6159	0.29	< 0.05 U1	0.00566	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
5/20/2020	Assessment	0.03 J1	24.6	142	< 0.02 U1	< 0.01 U1	0.09 J1	1.83	0.665	0.30	< 0.05 U1	0.00620	< 0.002 U1	2 J1	0.1 J1	< 0.1 U1
11/17/2020	Assessment	0.06 J1	33.9	127	< 0.02 U1	< 0.01 U1	0.2 J1	1.43	2.14	0.30	0.06 J1	0.00580	< 0.002 U1	2.02	0.08 J1	< 0.1 U1
2/03/2021	Assessment	0.03 J1	27.8	107	< 0.02 U1	< 0.01 U1	0.226	1.21	1.668	0.33	< 0.05 U1	0.00531	< 0.002 U1	2.09	< 0.03 U1	< 0.1 U1
5/26/2021	Assessment	0.06 J1	24.9	108	0.009 J1	< 0.004 U1	0.26	1.18	1.17	0.32	< 0.05 U1	0.00524	< 0.002 U1	2.2	< 0.09 U1	< 0.04 U1
11/09/2021	Assessment	0.04 J1	27.7	97.2	< 0.007 U1	< 0.004 U1	0.22	1.10	1.31	0.31	< 0.05 U1	0.00505	< 0.002 U1	2.2	< 0.09 U1	< 0.04 U1
2/15/2022	Assessment	0.02 J1	24.4	95.0	< 0.007 U1	< 0.004 U1	0.36	1.06	0.90	0.30	< 0.05 U1	0.00487	< 0.002 U1	2.2	< 0.09 U1	< 0.04 U1
5/11/2022	Assessment	0.12	42.9	99.2	< 0.007 U1	0.005 J1	0.33	1.21	1.04	0.29	0.09 J1	0.00455	< 0.002 U1	2.3	< 0.09 U1	< 0.04 U1
10/31/2022	Assessment	0.02 J1	21.5	98.2	< 0.007 U1	< 0.004 U1	0.21	1.05	0.86		< 0.05 U1	0.00509	< 0.002 U1	2.2	< 0.09 U1	< 0.04 U1
11/03/2022	Assessment	--	--	--	--	--	--	--	--	0.29	--	--	--	--	--	--
2/08/2023	Assessment	0.15	72.4	123	0.012 J1	0.005 J1	0.31	1.46	1.73	0.27	0.20	0.00555	< 0.002 U1	2.1	< 0.09 U1	< 0.04 U1
5/31/2023	Assessment	0.032 J1	24.5	120	< 0.007 U1	< 0.004 U1	0.22 J1	1.49	1.86	0.24	< 0.05 U1	0.00561	< 0.002 U1	2.0	0.05 J1	0.03 J1
11/01/2023	Assessment	0.033 J1	20.1	85.6	< 0.007 U1	< 0.004 U1	0.21 J1	1.02	1.28	0.31	< 0.05 U1	0.00521	< 0.002 U1	2.7	< 0.04 U1	0.03 J1
3/07/2024	Assessment	0.030 J1	23.2	107	< 0.007 U1	< 0.004 U1	0.69	1.26	1.38	0.27	< 0.05 U1	0.00557	< 0.002 U1	2.3	< 0.04 U1	0.02 J1
5/14/2024	Assessment	< 0.008 U1	8.84	425	< 0.007 U1	< 0.004 U1	0.23 J1	0.044	1.70	0.31	< 0.05 U1	0.00208	< 0.002 U1	3.1	< 0.04 U1	< 0.02 U1
11/14/2024	Assessment	0.025 J1	21.3	92.5	< 0.007 U1	< 0.004 U1	0.43	1.77 B1	1.77	0.30	< 0.05 U1	0.00635	< 0.002 U1	2.3	0.06 J1	0.03 J1
2/04/2025	Assessment	0.022 J1	21.1	80.0	< 0.007 U1	< 0.004 U1	0.36	1.62	2.55	0.31	< 0.05 U1	0.00633	< 0.002 U1	2.6	0.08 J1	0.02 J1
5/14/2025	Assessment	0.022 J1	21.6	60.4	< 0.007 U1	< 0.004 U1	0.29 J1	1.77	1.55	0.25	< 0.05 U1	0.00583	< 0.002 U1	2.3	< 0.04 U1	0.02 J1
11/06/2025	Assessment	0.03 J1	20.2	50.3	< 0.02 U1	< 0.004 U1	0.22 J1	1.05	1.26	0.36	< 0.05 U1	0.00574	< 0.002 U1	3.17	0.05 J1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1603D
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/08/2016	Background	0.073	70.8	26.7	0.31	7.1	59.0	433
7/18/2016	Background	0.074	79.6	26.7	0.33	6.9	55.3	430
10/10/2016	Background	0.065	81.2	26.0	0.32	7.3	47.2	406
11/15/2016	Background	0.062	90.5	25.5	0.30	7.1	50.6	399
1/09/2017	Background	0.055	91.9	25.1	0.26	7.3	49.7	401
3/07/2017	Background	0.061	86.8	26.1	0.29	7.2	47.7	392
5/08/2017	Background	0.082	91.1	26.3	0.27	7.2	47.1	417
7/17/2017	Background	0.080	80.4	25.9	0.24	6.7	45.9	400
10/03/2017	Detection	0.054	79.4	26.2	0.26	7.1	44.6	393
12/12/2017	Detection	--	--	27.0	0.27	7.0	42.3	--
6/05/2018	Assessment	0.081	80.6	30.1	0.300	7.2	40.9	412
8/13/2018	Assessment	0.147	87.9	25.4	0.27	7.1	39.1	385
5/21/2019	Assessment	0.04 J1	71.6	25.3	0.28	7.2	38.5	397
6/27/2019	Assessment	0.06 J1	77.9	25.0	0.30	7.6	32.8	388
9/11/2019	Assessment	0.04 J1	82.8	26.1	0.30	7.2	36.4	407
3/10/2020	Assessment	--	--	--	0.28	6.7	--	--
5/21/2020	Assessment	0.04 J1	82.2	25.6	0.31	7.4	34.0	400
11/13/2020	Assessment	0.04 J1	79.4	24.6	0.29	6.8	31.5	380
2/02/2021	Assessment	0.04 J1	79.4	25.6	0.31	6.3	33.7	381
5/26/2021	Assessment	0.031 J1	80.6	26.8	0.31	7.7	33.8	390
11/09/2021	Assessment	0.031 J1	81.1	26.3	0.30	6.8	31.5	380
2/15/2022	Assessment	0.035 J1	86.6	27.3	0.28	7.1	34.9	390
5/10/2022	Assessment	0.021 J1	88.9 M1, P3	29.1	0.28	7.2	36.2	390 L1
11/02/2022	Assessment	0.032 J1	83.8 M1, P3	29.7	0.28	11.0	39.8	380
2/09/2023	Assessment	0.034 J1	81.9	28.0	0.27	7.9	36.3	320
5/31/2023	Assessment	0.027 J1	80.4 M1	--	--	5.8	--	--
6/06/2023	Assessment	--	--	28.4	0.27	6.8	37.2	370
11/01/2023	Assessment	0.034 J1	101	29.6	0.28	6.6	39.5	390
3/06/2024	Assessment	--	--	--	0.25	7.1	--	--
5/14/2024	Assessment	0.035 J1	85.8 M1	29.9	0.26	7.0	43.2	390
11/13/2024	Assessment	0.03 J1	97 M1	36.1	0.31	7.0	109	510
2/06/2025	Assessment	--	--	--	0.30	7.2	--	--
5/13/2025	Assessment	0.032 J1	109	34.8	0.25	7.2	150	580
11/05/2025	Assessment	0.030 J1	89.1	34.6	0.29	7.1	79.5	440
11/07/2025	Assessment	--	--	--	--	7.0	--	--

Table 1. Groundwater Data Summary: MW-1603D
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/08/2016	Background	0.01 J1	10.2	112	< 0.005 U1	< 0.004 U1	0.2	1.34	1.206	0.31	0.02 J1	0.003	< 0.002 U1	6.70	< 0.03 U1	< 0.01 U1
7/18/2016	Background	0.02 J1	11.0	120	< 0.005 U1	0.007 J1	0.3	1.30	0.66	0.33	0.01 J1	0.008	< 0.002 U1	6.39	0.04 J1	0.068
10/10/2016	Background	0.09	9.91	122	0.049	0.03	23.8	2.01	0.954	0.32	1.38	0.007	< 0.002 U1	6.82	0.3	0.04 J1
11/15/2016	Background	0.03 J1	11.3	113	< 0.01 U1	0.01 J1	0.08 J1	0.703	1.275	0.30	0.02 J1	0.011	< 0.002 U1	5.02	< 0.06 U1	< 0.02 U1
1/09/2017	Background	0.01 J1	11.3	111	< 0.005 U1	0.009 J1	0.143	0.584	0.343	0.26	0.029	0.012	< 0.002 U1	4.98	< 0.03 U1	< 0.01 U1
3/07/2017	Background	0.01 J1	11.3	108	< 0.005 U1	< 0.004 U1	0.220	0.553	0.838	0.29	0.024	0.007	< 0.002 U1	5.11	0.04 J1	0.02 J1
5/08/2017	Background	0.05	11.3	103	0.020	0.02	0.238	0.586	0.982	0.27	0.068	0.006	0.005	4.78	0.1	0.050
7/17/2017	Background	0.02 J1	12.1	114	< 0.004 U1	< 0.005 U1	0.112	0.525	1.696	0.24	0.006 J1	0.008	< 0.002 U1	4.68	< 0.03 U1	< 0.01 U1
6/05/2018	Assessment	0.02 J1	12.3	109	0.009 J1	< 0.005 U1	0.251	0.441	1.607	0.30	0.207	0.008	< 0.002 U1	4.09	0.09 J1	0.03 J1
8/13/2018	Assessment	0.02 J1	12.5	105	< 0.004 U1	< 0.005 U1	0.097	0.409	0.84	0.27	0.040	0.005	--	4.38	< 0.03 U1	0.02 J1
5/21/2019	Assessment	< 0.02 U1	12.6	111	< 0.02 U1	< 0.01 U1	0.05 J1	0.354	0.73	0.28	0.04 J1	< 0.009 U1	< 0.002 U1	4.56	< 0.03 U1	< 0.1 U1
6/27/2019	Assessment	< 0.02 U1	13.2	111	< 0.02 U1	< 0.01 U1	0.06 J1	0.327	0.766	0.30	< 0.02 U1	< 0.009 U1	< 0.002 U1	3.98	< 0.03 U1	< 0.1 U1
9/11/2019	Assessment	< 0.02 U1	13.2	112	< 0.02 U1	< 0.01 U1	0.2 J1	0.327	0.957	0.30	0.08 J1	0.00380	< 0.002 U1	4.10	0.03 J1	< 0.1 U1
3/10/2020	Assessment	< 0.02 U1	12.8	120	< 0.02 U1	< 0.01 U1	0.07 J1	0.291	1.167	0.28	< 0.05 U1	0.00380	< 0.002 U1	4.00	0.03 J1	< 0.1 U1
5/21/2020	Assessment	< 0.02 U1	13.8	120	< 0.02 U1	< 0.01 U1	0.275	0.280	0.721	0.31	< 0.05 U1	0.00323	< 0.002 U1	3.62	0.04 J1	< 0.1 U1
11/13/2020	Assessment	< 0.02 U1	13.5	119	< 0.02 U1	< 0.01 U1	0.2 J1	0.281	1.91	0.29	< 0.05 U1	0.00326	< 0.002 U1	3.64	< 0.03 U1	< 0.1 U1
2/02/2021	Assessment	< 0.02 U1	14.6	121	< 0.02 U1	< 0.01 U1	0.2 J1	0.281	2.834	0.31	< 0.05 U1	0.00315	< 0.002 U1	3.66	0.04 J1	< 0.1 U1
5/26/2021	Assessment	< 0.02 U1	14.7	125	< 0.007 U1	< 0.004 U1	0.25	0.288	0.47	0.31	< 0.05 U1	0.00331	< 0.002 U1	3.6	< 0.09 U1	< 0.04 U1
11/09/2021	Assessment	0.03 J1	14.1	121	< 0.007 U1	< 0.004 U1	0.21	0.247	1.78	0.30	< 0.05 U1	0.00321	< 0.002 U1	3.3	< 0.09 U1	< 0.04 U1
2/15/2022	Assessment	0.02 J1	14.6	128	< 0.007 U1	0.035	0.41	0.326	1.88	0.28	0.48	0.00329	< 0.002 U1	3.7	< 0.09 U1	< 0.04 U1
5/10/2022	Assessment	< 0.02 U1	14.6	122	< 0.007 U1	< 0.004 U1	0.30	0.286	1.59	0.28	< 0.05 U1	0.00320	< 0.002 U1	3.7	< 0.09 U1	< 0.04 U1
11/02/2022	Assessment	< 0.02 U1	14.2	128 P3	< 0.007 U1	< 0.004 U1	0.28	0.237	1.48	0.28	< 0.05 U1	0.00347	< 0.002 U1	3.3	< 0.09 U1	< 0.04 U1
2/09/2023	Assessment	< 0.02 U1	14.5	129	0.011 J1	< 0.004 U1	0.25	0.272	0.97	0.27	< 0.05 U1	0.00347	< 0.002 U1	3.5	< 0.09 U1	< 0.04 U1
5/31/2023	Assessment	0.036 J1	13.4	122	< 0.007 U1	0.016 J1	0.25 J1	0.275	1.01	--	0.17 J1	0.00331	< 0.002 U1	3.4	< 0.04 U1	0.06 J1
6/06/2023	Assessment	--	--	--	--	--	--	--	--	0.27	--	--	--	--	--	--
11/01/2023	Assessment	0.012 J1	14.4	137	< 0.007 U1	< 0.004 U1	0.28 J1	0.279	0.51	0.28	< 0.05 U1	0.00323	< 0.002 U1	3.7	< 0.04 U1	< 0.02 U1
3/06/2024	Assessment	0.022 J1	13.7	130	< 0.007 U1	< 0.004 U1	0.22 J1	0.244	1.90	0.25	< 0.05 U1	0.00323	< 0.002 U1	3.6	< 0.04 U1	< 0.02 U1
5/14/2024	Assessment	0.012 J1	13.4	130 M1	< 0.007 U1	< 0.004 U1	0.27 J1	0.263	1.21	0.26	< 0.05 U1	0.00318	< 0.002 U1	3.7	< 0.04 U1	< 0.02 U1
11/13/2024	Assessment	0.012 J1	13.8	190 M1	< 0.007 U1	0.027	0.31	0.314 B1	2.11	0.31	< 0.05 U1	0.00354	< 0.002 U1	3.2	< 0.04 U1	< 0.02 U1
2/06/2025	Assessment	0.011 J1	12.6	167 M1	< 0.007 U1	< 0.004 U1	0.35	0.286	1.10	0.30	< 0.05 U1	0.00398	< 0.002 U1	3.0	< 0.04 U1	< 0.02 U1
5/13/2025	Assessment	0.012 J1	13.8	176	< 0.007 U1	< 0.004 U1	0.30	0.295	0.74	0.25	< 0.05 U1	0.00349	< 0.002 U1	3.6	< 0.04 U1	< 0.02 U1
11/05/2025	Assessment	< 0.02 U1	13.6	143	< 0.02 U1	< 0.004 U1	0.21 J1	0.25	0.92	0.29	< 0.05 U1	0.00342	--	3.39	< 0.04 U1	< 0.02 U1
11/07/2025	Assessment	--	--	--	--	--	--	--	--	--	--	--	< 0.002 U1	--	--	--

Table 1. Groundwater Data Summary: MW-16031

Geosyntec Consultants, Inc.

Rockport - BAP
Appendix III Constituents

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/08/2016	Background	0.151	89.2	37.7	0.39	7.6	71.9	465
7/18/2016	Background	0.157	93.9	38.8	0.43	7.2	83.8	502
9/20/2016	Background	0.153	99.8	40.1	0.39	7.3	111	500
11/15/2016	Background	0.173	101	37.4	0.42	7.2	88.5	481
1/09/2017	Background	0.147	94.7	34.6	0.38	7.2	75.3	478
3/07/2017	Background	0.187	85.0	34.7	0.40	7.3	73.2	460
5/08/2017	Background	0.187	87.2	36.8	0.40	7.3	71.0	452
7/17/2017	Background	0.196	79.3	35.1	0.35	9.8	74.9	449
10/03/2017	Detection	0.134	80.9	35.6	0.39	7.2	74.1	442
12/12/2017	Detection	--	--	57.4	0.52	6.8	201	--
1/03/2018	Detection	0.166	--	--	--	7.9	65.1	--
6/05/2018	Assessment	0.131	77.7	37.3	0.46	7.3	62.0	424
8/13/2018	Assessment	0.130	85.9	31.5	0.43	7.4	66.2	434
5/21/2019	Assessment	0.06 J1	81.4	39.4	0.45	7.3	74.6	467
6/27/2019	Assessment	0.07 J1	78.6	37.7	0.47	8.1	66.9	560
9/11/2019	Assessment	0.087	80.1	38.7	0.46	7.3	58.2	443
3/10/2020	Assessment	--	--	--	0.45	7.1	--	--
5/21/2020	Assessment	0.04 J1	82.4	37.9	0.46	7.7	51.0	428
11/13/2020	Assessment	0.04 J1	76.1	35.4	0.42	7.2	60.0	440
2/02/2021	Assessment	0.04 J1	78.4	35.5	0.45	6.8	56.9	424
5/26/2021	Assessment	0.035 J1	86.9	34.4	0.45	7.8	51.4	420
11/09/2021	Assessment	0.043 J1	77.3	33.3	0.41	6.7	58.8	390
2/15/2022	Assessment	0.048 J1	74.8	32.3	0.42	7.2	66.7	430
5/10/2022	Assessment	0.032 J1	80.8	33.4	0.42	7.3	66.3	440 L1
11/02/2022	Assessment	0.131	86.7	31.4	0.40	7.2	134	530
2/09/2023	Assessment	0.076	75.8	31.9	0.41	7.3	83.2	460
5/31/2023	Assessment	0.041 J1	60.8	31.6	0.39	5.8	75.2	460
11/01/2023	Assessment	0.060	77.4	31.7	0.42	6.8	73.8	450
3/06/2024	Assessment	--	--	--	0.37	7.3	--	--
5/17/2024	Assessment	0.062	87.8	37.5	0.46	7.2	73.1	430
11/13/2024	Assessment	0.085	92	41.8	0.39	7.1	83.1	480
2/05/2025	Assessment	--	--	--	0.38	7.4	--	--
5/13/2025	Assessment	0.061	83.0 M1	33.6	0.39	7.3	142	560
11/04/2025	Assessment	0.15 M1	101 M1	37.8	0.35	7.2	138	540

Table 1. Groundwater Data Summary: MW-1603I
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/08/2016	Background	0.05 J1	13.0	81.1	< 0.005 U1	0.004 J1	0.3	1.36	0.593	0.39	0.117	< 0.0002 U1	< 0.002 U1	8.86	< 0.03 U1	0.03 J1
7/18/2016	Background	0.03 J1	12.8	83.1	< 0.005 U1	< 0.004 U1	0.8	1.30	1.821	0.43	0.053	0.013	< 0.002 U1	9.76	< 0.03 U1	0.02 J1
9/20/2016	Background	0.03 J1	12.2	94.2	< 0.005 U1	< 0.004 U1	0.1	1.41	0.904	0.39	0.008 J1	0.009	< 0.002 U1	9.85	0.04 J1	0.04 J1
11/15/2016	Background	0.04 J1	12.2	86.6	< 0.005 U1	0.007 J1	0.074	1.17	1.583	0.42	0.021	0.015	< 0.002 U1	9.21	< 0.03 U1	0.03 J1
1/09/2017	Background	0.03 J1	12.9	84.6	< 0.005 U1	< 0.004 U1	0.232	1.26	1.417	0.38	0.066	0.008	< 0.002 U1	9.47	< 0.03 U1	0.03 J1
3/07/2017	Background	0.03 J1	12.5	82.5	< 0.005 U1	< 0.004 U1	0.743	1.10	1.076	0.40	0.057	0.009	< 0.002 U1	8.79	0.05 J1	0.05 J1
5/08/2017	Background	0.05	13.0	76.8	0.020	0.02	0.145	1.24	0.824	0.40	0.174	0.009	0.005	8.86	0.1	0.050
7/17/2017	Background	0.03 J1	12.5	85.3	< 0.004 U1	< 0.005 U1	0.109	1.30	2.746	0.35	0.02 J1	0.013	< 0.002 U1	8.27	< 0.03 U1	0.05 J1
6/05/2018	Assessment	0.10	12.7	88.4	0.01 J1	0.02 J1	1.11	1.40	2.348	0.46	0.374	0.012	< 0.002 U1	7.31	0.07 J1	0.03 J1
8/13/2018	Assessment	0.03 J1	12.4	80.0	< 0.004 U1	< 0.005 U1	0.081	1.27	1.152	0.43	0.030	0.002	--	7.67	< 0.03 U1	0.04 J1
5/21/2019	Assessment	0.02 J1	12.9	81.6	< 0.02 U1	< 0.01 U1	0.08 J1	1.39	0.832	0.45	< 0.02 U1	< 0.009 U1	< 0.002 U1	6.45	< 0.03 U1	< 0.1 U1
6/27/2019	Assessment	0.07 J1	12.7	84.3	< 0.02 U1	0.01 J1	0.678	1.58	0.966	0.47	0.312	< 0.009 U1	< 0.002 U1	6.29	0.07 J1	< 0.1 U1
9/11/2019	Assessment	0.08 J1	13.2	83.0	< 0.02 U1	< 0.01 U1	0.355	1.36	1.41	0.46	0.2 J1	0.00711	< 0.002 U1	7.48	< 0.03 U1	< 0.1 U1
3/10/2020	Assessment	< 0.02 U1	12.1	80.3	< 0.02 U1	< 0.01 U1	0.1 J1	1.23	1.056	0.45	< 0.05 U1	0.00720	< 0.002 U1	5.52	< 0.03 U1	< 0.1 U1
5/21/2020	Assessment	0.03 J1	15.5	89.5	< 0.02 U1	< 0.01 U1	0.09 J1	1.22	1.004	0.46	< 0.05 U1	0.00697	< 0.002 U1	5.08	< 0.03 U1	< 0.1 U1
11/13/2020	Assessment	0.32	53.0	107	0.03 J1	< 0.01 U1	0.286	1.19	1.959	0.42	0.564	0.00667	< 0.002 U1	5.29	0.07 J1	< 0.1 U1
2/02/2021	Assessment	0.03 J1	15.1	97.0	< 0.02 U1	< 0.01 U1	0.270	1.12	2.058	0.45	0.05 J1	0.00667	< 0.002 U1	5.01	< 0.03 U1	< 0.1 U1
5/26/2021	Assessment	0.03 J1	14.0	89.2	< 0.007 U1	< 0.004 U1	0.13 J1	1.03	0.88	0.45	< 0.05 U1	0.00623	< 0.002 U1	4.7	< 0.09 U1	< 0.04 U1
11/09/2021	Assessment	0.99	220	147	0.077	0.006 J1	0.47	3.49	1.27	0.41	1.54	0.00598	< 0.002 U1	6.2	0.28 J1	< 0.04 U1
2/15/2022	Assessment	0.20	37.9	97.7	0.016 J1	0.016 J1	0.46	1.16	2.26	0.42	0.29	0.00643	< 0.002 U1	5.7	< 0.09 U1	< 0.04 U1
5/10/2022	Assessment	0.04 J1	17.1	94.0	< 0.007 U1	< 0.004 U1	0.27	1.16	0.93	0.42	0.07 J1	0.00628	< 0.002 U1	5.3	< 0.09 U1	< 0.04 U1
11/02/2022	Assessment	< 0.02 U1	12.8	79.8	< 0.007 U1	< 0.004 U1	0.21	1.24	1.39	0.40	< 0.05 U1	0.00798	< 0.002 U1	6.5	< 0.09 U1	< 0.04 U1
2/09/2023	Assessment	0.05 J1	15.8	78.5	< 0.007 U1	< 0.004 U1	0.36	1.19	1.73	0.41	0.21	0.00713	< 0.002 U1	6.5	< 0.09 U1	< 0.04 U1
5/31/2023	Assessment	0.031 J1	11.6	64.0	< 0.007 U1	< 0.004 U1	0.24 J1	0.915	0.82	0.39	0.06 J1	0.00528	< 0.002 U1	5.5	< 0.04 U1	< 0.02 U1
11/01/2023	Assessment	0.070 J1	16.5	87.0	< 0.007 U1	0.006 J1	0.49	1.42	0.64	0.42	0.15 J1	0.00702	< 0.002 U1	7.7	0.05 J1	0.03 J1
3/06/2024	Assessment	0.024 J1	12.6	80.7	< 0.007 U1	< 0.004 U1	0.24 J1	1.01	1.64	0.37	< 0.05 U1	0.00670	< 0.002 U1	7.0	< 0.04 U1	< 0.02 U1
5/17/2024	Assessment	0.184	9.80	181	0.020 J1	0.063	0.79	1.35	1.18	0.46	0.85	0.00657	< 0.002 U1	8.9	0.14 J1	0.03 J1
11/13/2024	Assessment	0.049 J1	14.8	91.9	0.03 J1	0.026	1.12	1.21	0.63	0.39	1.23	0.00441	< 0.002 U1	4.5	0.24 J1	0.02 J1
2/05/2025	Assessment	0.018 J1	14.2	74.0	0.009 J1	0.007 J1	0.55	0.426	1.25	0.38	0.26	0.00428	< 0.002 U1	4.4	< 0.04 U1	< 0.02 U1
5/13/2025	Assessment	0.065 J1	14.1	124	0.010 J1	0.008 J1	0.57	1.20	1.41	0.39	0.35	0.00690	< 0.002 U1	6.1	0.05 J1	0.03 J1
11/04/2025	Assessment	0.04 M1, J1	28.2 M1	176 M1	< 0.04 M1, U1	0.012 M1, J1	0.7 M1	0.76 M1	0.92	0.35	0.2 M1, J1	0.0089 M1	< 0.002 U1	9.0 M1	< 0.08 M1, U1	< 0.04 M1, U1

Table 1. Groundwater Data Summary: MW-1603S
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/08/2016	Background	1.77	49.6	60.3	0.44	7.6	197	480
7/18/2016	Background	1.77	46.4	53.6	0.50	7.2	171	445
9/20/2016	Background	1.83	59.3	57.6	0.39	7.0	197	479
11/15/2016	Background	2.19	71.9	50.9	0.43	6.9	208	469
1/09/2017	Background	2.22	74.8	55.6	0.40	6.5	220	483
3/07/2017	Background	1.72	99.4	67.6	0.33	6.7	261	581
5/08/2017	Background	1.25	81.7	55.1	0.36	6.9	203	466
7/17/2017	Background	1.94	68.1	52.9	0.27	9.6	222	482
10/03/2017	Detection	1.84	51.5	20.8	0.17	6.9	75.1	481
12/12/2017	Detection	--	--	33.9	0.41	7.1	65.8	--
1/03/2018	Detection	1.67	--	--	--	7.5	218	514
6/05/2018	Assessment	1.40	42.2	54.3	0.63	7.0	178	504
8/13/2018	Assessment	1.70	52.0	69.7	0.56	7.0	243	558
5/21/2019	Assessment	1.47	62.6	56.0	0.55	6.6	187	506
6/27/2019	Assessment	1.65	67.2	57.8	0.59	7.3	205	530
9/11/2019	Assessment	2.16	55.1	51.1	0.69	7.1	224	482
3/10/2020	Assessment	--	--	--	0.71	6.5	--	--
5/21/2020	Assessment	0.826	47.5	31.1	0.77	7.4	88.3	276
11/13/2020	Assessment	2.35	39.1	37.6	0.92	7.0	131	365
2/02/2021	Assessment	2.49	40.4	41.9	0.91	6.6	137	406
5/25/2021	Assessment	2.06	33.4	23.0	1.02	7.0	82.8	250
11/09/2021	Assessment	1.87	42.0	43.9	0.94	6.4	145	410
2/15/2022	Assessment	1.85	42.4	59.1	0.98	6.9	197	500
5/10/2022	Assessment	1.59	81.9	36.9	0.81	7.1	296	600 L1
11/02/2022	Assessment	1.56	43.9	55.8	1.16	6.8	187	510
2/09/2023	Assessment	1.28	39.4	38.0	1.08	7.0	177	460
5/31/2023	Assessment	1.20	32.6	37.7	1.37	5.4	176	450
11/01/2023	Assessment	1.40	24.7	34.6	1.42	6.5	161	370
3/05/2024	Assessment	--	--	--	1.26	6.9	--	--
5/14/2024	Assessment	1.45	42.4	25.5	0.93	7.0	85.9	310
11/14/2024	Assessment	1.44	43	27.8	1.32	6.7	95.3	340
2/05/2025	Assessment	--	--	--	1.10	7.1	--	--
5/13/2025	Assessment	0.894	75.3	25.6	1.02	7.1	93.7	450
11/05/2025	Assessment	1.32	62.0	25.5	1.00	7.0	107	400

Table 1. Groundwater Data Summary: MW-1603S
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/08/2016	Background	0.04 J1	0.36	13.0	< 0.005 U1	0.02	0.2	0.648	0.485	0.44	0.171	< 0.0002 U1	< 0.002 U1	1.36	0.04 J1	0.02 J1
7/18/2016	Background	0.05 J1	0.27	12.5	< 0.005 U1	0.02	0.2	0.656	1.123	0.50	0.130	0.013	< 0.002 U1	0.74	< 0.03 U1	0.02 J1
9/20/2016	Background	0.04 J1	0.21	16.7	< 0.005 U1	0.02 J1	0.3	0.310	1.373	0.39	0.025	0.007	< 0.002 U1	0.50	0.7	0.04 J1
11/15/2016	Background	0.06	0.19	18.4	0.008 J1	0.03	0.104	0.233	0.508	0.43	0.072	0.013	< 0.002 U1	0.39	0.2	0.091
1/09/2017	Background	0.04 J1	0.20	16.2	< 0.005 U1	0.02 J1	0.653	0.176	0.391	0.40	0.023	0.002	< 0.002 U1	0.47	0.06 J1	0.02 J1
3/07/2017	Background	0.06	0.18	22.3	< 0.005 U1	0.06	0.530	0.092	0.2002	0.33	0.037	0.005	< 0.002 U1	0.23	0.2	0.02 J1
5/08/2017	Background	0.05	0.23	16.3	0.020	0.02	0.325	0.219	0.4136	0.36	0.116	0.006	0.005	0.15	0.2	0.050
7/17/2017	Background	0.04 J1	0.19	16.2	< 0.004 U1	0.03	0.154	0.349	2.9307	0.27	0.042	0.007	< 0.002 U1	0.20	0.06 J1	0.02 J1
6/05/2018	Assessment	0.06	0.36	12.4	0.01 J1	0.03	0.261	0.881	2.059	0.63	0.339	0.012	< 0.002 U1	2.74	0.1	0.03 J1
8/13/2018	Assessment	0.04 J1	0.20	10.5	0.01 J1	0.02	0.058	0.506	0.762	0.56	0.047	0.002	--	1.78	0.04 J1	0.054
5/21/2019	Assessment	0.03 J1	0.17	14.0	< 0.02 U1	0.02 J1	0.09 J1	0.417	0.5289	0.55	< 0.02 U1	< 0.009 U1	< 0.002 U1	< 0.4 U1	0.08 J1	< 0.1 U1
6/27/2019	Assessment	0.03 J1	0.17	13.7	< 0.02 U1	0.03 J1	0.06 J1	0.383	0.555	0.59	< 0.02 U1	< 0.009 U1	< 0.002 U1	0.5 J1	1.5	< 0.1 U1
9/11/2019	Assessment	0.04 J1	0.22	12.0	< 0.02 U1	0.02 J1	0.04 J1	0.266	0.172	0.69	< 0.05 U1	0.00414	< 0.002 U1	0.6 J1	0.3	< 0.1 U1
3/10/2020	Assessment	< 0.02 U1	0.13	10.4	< 0.02 U1	< 0.01 U1	0.335	0.055	0.4889	0.71	< 0.05 U1	0.00225	< 0.002 U1	< 0.4 U1	0.2 J1	< 0.1 U1
5/21/2020	Assessment	0.03 J1	0.11	7.53	< 0.02 U1	0.01 J1	0.325	0.04 J1	0.579	0.77	< 0.05 U1	0.00179	< 0.002 U1	< 0.4 U1	0.1 J1	< 0.1 U1
11/13/2020	Assessment	0.04 J1	0.17	9.07	< 0.02 U1	0.01 J1	0.208	0.297	0.6734	0.92	< 0.05 U1	0.00320	< 0.002 U1	< 0.4 U1	0.08 J1	< 0.1 U1
2/02/2021	Assessment	0.05 J1	0.20	11.8	< 0.02 U1	0.02 J1	0.230	0.324	0.5735	0.91	< 0.05 U1	0.00350	< 0.002 U1	0.4 J1	0.1 J1	< 0.1 U1
5/25/2021	Assessment	0.05 J1	0.13	4.82	< 0.007 U1	0.005 J1	0.18 J1	0.129	0.93	1.02	< 0.05 U1	0.00152	< 0.002 U1	0.2 J1	< 0.09 U1	< 0.04 U1
11/09/2021	Assessment	0.04 J1	0.19	10.7	< 0.007 U1	0.022	0.21	0.439	0.67	0.94	< 0.05 U1	0.00381	< 0.002 U1	0.4 J1	0.12 J1	< 0.04 U1
2/15/2022	Assessment	0.04 J1	0.19	10.6	< 0.007 U1	0.540	0.32	0.547	1.06	0.98	< 0.05 U1	0.00396	< 0.002 U1	0.7	< 0.09 U1	< 0.04 U1
5/10/2022	Assessment	0.04 J1	0.20	19.0	< 0.007 U1	0.037	0.29	0.389	1.13	0.81	< 0.05 U1	0.00499	< 0.002 U1	0.5	0.15 J1	< 0.04 U1
11/02/2022	Assessment	0.04 J1	0.18	8.82	< 0.007 U1	0.021	0.36	0.506	1.22	1.16	< 0.05 U1	0.00337	< 0.002 U1	0.3 J1	0.20 J1	< 0.04 U1
2/09/2023	Assessment	0.04 J1	0.20	8.27	< 0.007 U1	0.028	0.29	0.480	1.91	1.08	0.06 J1	0.00414	< 0.002 U1	0.7	0.74	< 0.04 U1
5/31/2023	Assessment	0.042 J1	0.18	6.78	< 0.007 U1	0.018 J1	0.20 J1	0.434	0.85	1.37	< 0.05 U1	0.00281	< 0.002 U1	0.5	0.52	< 0.02 U1
11/01/2023	Assessment	0.048 J1	0.15	4.48	< 0.007 U1	0.014 J1	0.31	0.384	0.12	1.42	< 0.05 U1	0.00201	< 0.002 U1	0.5	0.13 J1	< 0.02 U1
3/05/2024	Assessment	0.040 J1	0.18	4.95	< 0.007 U1	0.017 J1	0.25 J1	0.270	0.72	1.26	< 0.05 U1	0.00297	< 0.002 U1	1.4	0.16 J1	< 0.02 U1
5/14/2024	Assessment	0.037 J1	0.17	7.08	< 0.007 U1	0.019 J1	0.32	0.271	0.79	0.93	< 0.05 U1	0.00356	< 0.002 U1	1.6	0.16 J1	0.03 J1
11/14/2024	Assessment	0.103	0.16	8.12	< 0.007 U1	0.054	0.53	0.467 B1	2.00	1.32	0.13 J1	0.00351	< 0.002 U1	1.2	0.17 J1	< 0.02 U1
2/05/2025	Assessment	0.033 J1	0.17	10.6	< 0.007 U1	0.034	0.37	0.322	0.80	1.10	< 0.05 U1	0.00441	< 0.002 U1	1.6	0.13 J1	< 0.02 U1
5/13/2025	Assessment	0.033 J1	0.16	15.6	< 0.007 U1	0.042	0.31	0.356	0.62	1.02	< 0.05 U1	0.00557	< 0.002 U1	2.3	0.11 J1	0.06 J1
11/05/2025	Assessment	0.03 J1	0.16	10.7	< 0.02 U1	0.032	0.45	0.37	0.50	1.00	< 0.05 U1	0.00448	< 0.002 U1	1.89	0.12 J1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1604D

Geosyntec Consultants, Inc.

Rockport - BAP
Appendix III Constituents

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/07/2016	Background	0.032	70.8	19.6	0.30	7.1	39.1	292
7/18/2016	Background	0.022	67.8	19.3	0.28	6.9	38.6	332
9/19/2016	Background	0.010	69.8	17.8	0.26	7.3	31.9	280
11/15/2016	Background	0.025	74.9	18.0	0.27	7.1	35.0	320
1/09/2017	Background	0.016	72.9	17.1	0.24	7.2	29.6	326
3/07/2017	Background	0.075	67.2	17.4	0.24	7.3	30.4	290
5/08/2017	Background	0.050	71.8	17.3	0.26	7.2	29.2	318
7/18/2017	Background	0.095	63.7	16.9	0.21	7.2	28.7	304
10/03/2017	Detection	0.075	62.7	16.5	0.24	7.3	28.7	318
12/13/2017	Detection	--	--	16.3	0.24	7.3	29.3	--
6/06/2018	Assessment	0.037	67.6	16.1	0.28	7.3	26.3	308
8/14/2018	Assessment	0.052	70.5	16.4	0.26	7.1	26.2	311
5/21/2019	Assessment	0.03 J1	69.3	16.1	0.27	7.2	27.4	309
6/26/2019	Assessment	0.03 J1	69.5	15.8	0.28	7.3	23.2	326
9/10/2019	Assessment	0.02 J1	74.7	15.9	0.28	7.3	24.7	326
3/11/2020	Assessment	--	--	--	0.26	7.1	--	--
5/21/2020	Assessment	0.02 J1	73.9	15.9	0.30	6.8	24.4	329
11/13/2020	Assessment	0.02 J1	68.4	15.1	0.27	6.4	20.9	306
2/03/2021	Assessment	< 0.02 U1	70.0	15.3	0.30	6.7	21.2	310
5/25/2021	Assessment	0.022 J1	71.5	15.2	0.30	7.6	20.6	310
11/09/2021	Assessment	0.021 J1	69.3	15.3	0.29	7.3	18.6	320
2/15/2022	Assessment	0.021 J1	67.8	15.2	0.27	6.7	19.8	310
5/11/2022	Assessment	0.013 J1	71.7	15.1	0.27	7.4	19.8	320
10/31/2022	Assessment	0.023 J1	69.4	15.4	0.26	7.0	19.0	310
2/09/2023	Assessment	0.021 J1	64.5	15.3	0.27	7.2	19.0	320
5/31/2023	Assessment	0.01 J1	59.1 M1	15.2	0.25	7.2	18.4	330
11/01/2023	Assessment	0.022 J1	68.6 M1	15.1	0.28	7.1	18.2	310
3/07/2024	Assessment	--	--	--	0.25	7.0	--	--
5/15/2024	Assessment	0.019 J1	65.1 M1	15.1	0.16	7.0	18.4	290
11/14/2024	Assessment	0.02 J1	71 M1	15.6	0.31	7.3	18.6	320
2/05/2025	Assessment	--	--	--	0.30	7.3	--	--
5/14/2025	Assessment	0.019 J1	67.1	16.2	0.26	7.3	20.1	310
11/06/2025	Assessment	0.034 J1	73.6	16.1	0.31	6.9	19.3	300

Table 1. Groundwater Data Summary: MW-1604D
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/07/2016	Background	0.02 J1	14.6	216	< 0.005 U1	< 0.004 U1	0.2	0.119	0.374	0.30	0.098	0.002	< 0.002 U1	3.96	< 0.03 U1	< 0.01 U1
7/18/2016	Background	0.01 J1	17.9	239	< 0.005 U1	< 0.004 U1	0.2	0.086	0.8422	0.28	0.022	0.010	< 0.002 U1	3.33	0.04 J1	< 0.01 U1
9/19/2016	Background	0.01 J1	16.2	234	< 0.005 U1	< 0.004 U1	0.1	0.052	0.377	0.26	0.02 J1	0.004	< 0.002 U1	2.82	< 0.03 U1	< 0.01 U1
11/15/2016	Background	0.03 J1	16.7	247	< 0.005 U1	0.008 J1	0.117	0.047	0.454	0.27	0.02 J1	0.009	< 0.002 U1	2.80	< 0.03 U1	0.02 J1
1/09/2017	Background	0.02 J1	16.9	243	< 0.005 U1	0.007 J1	0.158	0.057	2.235	0.24	0.01 J1	< 0.0002 U1	< 0.002 U1	3.04	0.03 J1	0.095
3/07/2017	Background	0.02 J1	18.4	267	< 0.005 U1	< 0.004 U1	0.267	0.070	0.868	0.24	0.061	0.003	0.002 J1	3.20	0.06 J1	< 0.01 U1
5/08/2017	Background	0.05	18.1	226	0.020	0.02	0.128	0.091	0.744	0.26	0.043	0.004	0.005	2.90	0.1	0.050
7/18/2017	Background	0.02 J1	16.8	249	< 0.004 U1	< 0.005 U1	0.165	0.072	1.079	0.21	0.02 J1	0.002	< 0.002 U1	2.61	< 0.03 U1	< 0.01 U1
6/06/2018	Assessment	0.04 J1	22.1	266	0.004 J1	< 0.005 U1	0.057	0.117	0.942	0.28	0.034	0.007	< 0.002 U1	3.56	< 0.03 U1	< 0.01 U1
8/14/2018	Assessment	0.01 J1	16.6	237	< 0.004 U1	< 0.005 U1	0.04 J1	0.059	0.617	0.26	0.005 J1	< 0.0002 U1	--	2.50	< 0.03 U1	0.01 J1
5/21/2019	Assessment	< 0.02 U1	18.3	235	< 0.02 U1	< 0.01 U1	0.04 J1	0.051	0.771	0.27	0.06 J1	< 0.009 U1	< 0.002 U1	2.52	< 0.03 U1	< 0.1 U1
6/26/2019	Assessment	< 0.02 U1	18.2	263	< 0.02 U1	< 0.01 U1	0.06 J1	0.067	1.164	0.28	0.04 J1	< 0.009 U1	< 0.002 U1	2.58	< 0.03 U1	< 0.1 U1
9/10/2019	Assessment	< 0.02 U1	18.0	257	< 0.02 U1	< 0.01 U1	0.09 J1	0.052	0.859	0.28	< 0.05 U1	0.00157	< 0.002 U1	2.70	< 0.03 U1	< 0.1 U1
3/11/2020	Assessment	< 0.02 U1	17.8	228	< 0.02 U1	< 0.01 U1	0.09 J1	0.052	1.017	0.26	< 0.05 U1	0.00139	< 0.002 U1	2.22	< 0.03 U1	< 0.1 U1
5/21/2020	Assessment	< 0.02 U1	17.9	242	< 0.02 U1	< 0.01 U1	0.2 J1	0.05 J1	1.070	0.30	< 0.05 U1	0.00140	< 0.002 U1	2.35	< 0.03 U1	< 0.1 U1
11/13/2020	Assessment	< 0.02 U1	18.2	250	< 0.02 U1	< 0.01 U1	0.1 J1	0.05 J1	1.853	0.27	< 0.05 U1	0.00154	< 0.002 U1	2.54	< 0.03 U1	< 0.1 U1
2/03/2021	Assessment	< 0.02 U1	18.5	257	< 0.02 U1	< 0.01 U1	0.2 J1	0.055	1.899	0.30	< 0.05 U1	0.00138	< 0.002 U1	2.55	< 0.03 U1	< 0.1 U1
5/25/2021	Assessment	< 0.02 U1	18.5	269 M1, P3	< 0.007 U1	< 0.004 U1	0.05 J1	0.046	1.11	0.30	< 0.05 U1	0.00131	< 0.002 U1	2.5	< 0.09 U1	< 0.04 U1
11/09/2021	Assessment	< 0.02 U1	18.3	267	< 0.007 U1	< 0.004 U1	0.20	0.049	1.43	0.29	< 0.05 U1	0.00148	< 0.002 U1	2.5	< 0.09 U1	< 0.04 U1
2/15/2022	Assessment	< 0.02 U1	17.8	254	< 0.007 U1	< 0.004 U1	0.25	0.051	0.92	0.27	< 0.05 U1	0.00136	< 0.002 U1	2.5	< 0.09 U1	< 0.04 U1
5/11/2022	Assessment	< 0.02 U1	18.6	259	< 0.007 U1	< 0.004 U1	0.30	0.057	1.31	0.27	< 0.05 U1	0.00138	< 0.002 U1	2.6	< 0.09 U1	< 0.04 U1
10/31/2022	Assessment	< 0.02 U1	18.2	273	< 0.007 U1	< 0.004 U1	0.26	0.071	1.20	0.26	0.12 J1	0.00154	< 0.002 U1	2.5	< 0.09 U1	< 0.04 U1
2/09/2023	Assessment	< 0.02 U1	16.9	257	< 0.007 U1	0.008 J1	0.28	0.058	1.19	0.27	< 0.05 U1	0.00156	< 0.002 U1	2.5	< 0.09 U1	< 0.04 U1
5/31/2023	Assessment	< 0.008 U1	15.8	231 M1	< 0.007 U1	< 0.004 U1	0.17 J1	0.048	0.67	0.25	< 0.05 U1	0.00126	< 0.002 U1	2.4	< 0.04 U1	< 0.02 U1
11/01/2023	Assessment	0.018 J1	17.8	285 M1	< 0.007 U1	0.013 J1	0.25 J1	0.064	0.57	0.28	0.05 J1	0.00144	< 0.002 U1	2.7	< 0.04 U1	< 0.02 U1
3/07/2024	Assessment	0.008 J1	17.7	270	< 0.007 U1	< 0.004 U1	0.29 J1	0.050	1.34	0.25	< 0.05 U1	0.00149	< 0.002 U1	2.4	< 0.04 U1	< 0.02 U1
5/15/2024	Assessment	< 0.008 U1	16.9	223 M1	< 0.007 U1	< 0.004 U1	0.24 J1	0.046	1.43	0.16	< 0.05 U1	0.00129	< 0.002 U1	2.2	< 0.04 U1	< 0.02 U1
11/14/2024	Assessment	< 0.008 U1	16.3	254 M1	< 0.007 M1, U1	< 0.004 U1	0.33	0.056	2.09	0.31	< 0.05 U1	0.00143 M1	< 0.002 U1	2.5	< 0.04 U1	< 0.02 U1
2/05/2025	Assessment	< 0.008 U1	17.5	267	< 0.007 U1	< 0.004 U1	0.34	0.048	0.91	0.30	< 0.05 U1	0.00149	< 0.002 U1	2.7	< 0.04 U1	< 0.02 U1
5/14/2025	Assessment	0.010 J1	17.3	215	< 0.007 U1	0.032	0.34	0.026	0.65	0.26	< 0.05 U1	0.00128	< 0.002 U1	2.3	< 0.04 U1	< 0.02 U1
11/06/2025	Assessment	< 0.02 U1	17.9	291	< 0.02 U1	< 0.004 U1	0.34	0.03	0.98	0.31	0.47	0.00153	< 0.002 U1	2.61	< 0.04 U1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1604I
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/07/2016	Background	0.111	76.5	50.4	0.34	7.1	138	530
7/18/2016	Background	0.185	79.7	53.6	0.33	7.4	152	548
9/19/2016	Background	0.320	73.1	46.5	0.29	7.5	120	504
11/15/2016	Background	0.368	78.7	46.2	0.32	7.3	130	521
1/09/2017	Background	0.241	72.4	39.5	0.31	7.5	99.8	456
3/07/2017	Background	0.252	68.7	41.6	0.31	7.4	104	448
5/09/2017	Background	0.363	81.3	53.4	0.34	7.5	139	546
7/18/2017	Background	0.379	73.5	49.3	0.27	7.3	139	522
10/03/2017	Detection	0.442	69.5	45.2	0.30	7.5	129	502
12/12/2017	Detection	--	--	45.6	0.32	7.5	132	--
1/04/2018	Detection	0.385	--	--	--	7.9	119	504
6/06/2018	Assessment	0.188	62.9	39.4	0.37	7.6	95.4	442
8/14/2018	Assessment	0.193	73.8	43.7	0.33	7.4	112	487
5/21/2019	Assessment	0.254	78.2	70.1	0.34	7.3	181	618
6/27/2019	Assessment	0.278	75.2	63.5	0.38	7.5	167	622
9/11/2019	Assessment	0.269	71.5	43.6	0.35	7.4	127	515
3/10/2020	Assessment	--	--	--	0.35	7.2	--	--
5/21/2020	Assessment	0.324	68.1	43.9	0.40	7.8	118	496
11/13/2020	Assessment	0.298	66.3	38.0	0.35	6.4	94.4	439
2/03/2021	Assessment	0.145	56.6	29.6	0.39	6.9	52.0	351
5/25/2021	Assessment	0.108	59.4	32.4	0.40	7.3	68.6	380
11/09/2021	Assessment	0.079	56.9	35.7	0.40	7.5	77.2	400
2/15/2022	Assessment	0.118	60.5	37.8	0.37	7.1	86.6	420
5/11/2022	Assessment	0.092	64.0	39.2	0.38	7.5	81.8	400
11/01/2022	Assessment	0.066	63.4	39.4	0.36	7.3	94.4	420
2/09/2023	Assessment	0.065	57.2	34.7	0.38	7.3	70.2	380
5/31/2023	Assessment	0.102	56.7	--	--	7.3	--	--
6/06/2023	Assessment	--	--	38.4	0.35	7.2	95.7	420
10/31/2023	Assessment	0.065	55.1	33.0	0.36	7.2	66.2	380
3/07/2024	Assessment	--	--	--	0.35	7.3	--	--
5/15/2024	Assessment	0.505	80.9	44.2	0.28	7.1	188	610
11/14/2024	Assessment	0.565	79	38.4	0.41	7.4	189	580
2/05/2025	Assessment	--	--	--	0.40	7.5	--	--
5/15/2025	Assessment	0.297	72.1	35.0	0.37	7.3	157	520
11/06/2025	Assessment	0.310	62.7	31.1	0.41	7.2	80.8	400

Table 1. Groundwater Data Summary: MW-1604I
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/07/2016	Background	0.02 J1	19.5	124	< 0.005 U1	0.12	0.1	0.893	1.118	0.34	0.02 J1	0.004	< 0.002 U1	2.59	0.03 J1	0.01 J1
7/18/2016	Background	0.02 J1	19.1	132	< 0.005 U1	< 0.004 U1	0.4	0.875	1.299	0.33	0.02 J1	0.011	< 0.002 U1	2.48	< 0.03 U1	0.01 J1
9/19/2016	Background	0.03 J1	20.4	123	< 0.005 U1	< 0.004 U1	0.4	0.742	0.624	0.29	0.02 J1	0.008	< 0.002 U1	2.87	0.07 J1	0.078
11/15/2016	Background	0.04 J1	19.4	123	< 0.005 U1	0.009 J1	0.153	0.704	1.664	0.32	0.045	0.015	< 0.002 U1	2.49	< 0.03 U1	0.02 J1
1/09/2017	Background	0.02 J1	20.2	114	< 0.005 U1	< 0.004 U1	0.114	0.696	1.455	0.31	0.01 J1	0.003	< 0.002 U1	2.84	< 0.03 U1	0.02 J1
3/07/2017	Background	0.02 J1	20.0	117	< 0.005 U1	< 0.004 U1	0.573	0.743	0.671	0.31	0.024	0.009	< 0.002 U1	3.08	0.05 J1	0.02 J1
5/09/2017	Background	0.06	26.4	125	0.020	0.02	0.112	1.03	0.844	0.34	0.043	0.013	0.005	3.02	0.1	0.050
7/18/2017	Background	0.24	19.0	130	< 0.004 U1	0.005 J1	0.208	0.877	1.059	0.27	0.093	0.009	< 0.002 U1	2.75	< 0.03 U1	0.02 J1
6/06/2018	Assessment	0.03 J1	18.7	107	0.004 J1	< 0.005 U1	0.05 J1	0.792	1.089	0.37	0.01 J1	0.012	< 0.002 U1	3	0.03 J1	0.02 J1
8/14/2018	Assessment	0.03 J1	18.5	110	< 0.004 U1	< 0.005 U1	0.075	0.737	0.183	0.33	0.007 J1	0.004	--	2.50	< 0.03 U1	0.052
5/21/2019	Assessment	0.02 J1	21.2	151	< 0.02 U1	< 0.01 U1	0.05 J1	1.03	1.458	0.34	< 0.02 U1	0.01 J1	< 0.002 U1	2.54	0.1 J1	< 0.1 U1
6/27/2019	Assessment	0.02 J1	18.5	135	< 0.02 U1	< 0.01 U1	0.09 J1	0.979	0.888	0.38	< 0.02 U1	< 0.009 U1	< 0.002 U1	2.51	0.1 J1	< 0.1 U1
9/11/2019	Assessment	0.03 J1	20.7	119	< 0.02 U1	< 0.01 U1	0.1 J1	0.735	0.819	0.35	< 0.05 U1	0.00772	< 0.002 U1	2.26	0.05 J1	< 0.1 U1
3/10/2020	Assessment	< 0.02 U1	17.5	96.7	< 0.02 U1	< 0.01 U1	0.09 J1	0.831	1.000	0.35	< 0.05 U1	0.00775	< 0.002 U1	2.10	< 0.03 U1	< 0.1 U1
5/21/2020	Assessment	0.02 J1	18.7	102	< 0.02 U1	< 0.01 U1	0.09 J1	0.763	1.32	0.40	< 0.05 U1	0.00714	< 0.002 U1	2.19	0.07 J1	< 0.1 U1
11/13/2020	Assessment	0.02 J1	27.9	101	< 0.02 U1	< 0.01 U1	0.2 J1	0.630	1.186	0.35	< 0.05 U1	0.00674	< 0.002 U1	2.19	< 0.03 U1	< 0.1 U1
2/03/2021	Assessment	0.02 J1	24.4	83.3	< 0.02 U1	< 0.01 U1	0.235	0.460	1.423	0.39	< 0.05 U1	0.00555	< 0.002 U1	2.34	< 0.03 U1	< 0.1 U1
5/25/2021	Assessment	0.09 J1	22.1	88.9	< 0.007 U1	< 0.004 U1	0.08 J1	0.497	0.90	0.40	< 0.05 U1	0.00568	< 0.002 U1	2.2	< 0.09 U1	< 0.04 U1
11/09/2021	Assessment	0.17	56.7	102	0.025 J1	0.005 J1	0.53	0.478	2.41	0.40	0.17 J1	0.00539	< 0.002 U1	2.2	< 0.09 U1	< 0.04 U1
2/15/2022	Assessment	< 0.02 U1	19.5	88.8	< 0.007 U1	< 0.004 U1	0.27	0.600	2.12	0.37	< 0.05 U1	0.00626	< 0.002 U1	2.1	< 0.09 U1	< 0.04 U1
5/11/2022	Assessment	0.05 J1	28.3	92.4	< 0.007 U1	0.004 J1	0.42	0.674	3.74	0.38	0.06 J1	0.00547	< 0.002 U1	2.2	< 0.09 U1	< 0.04 U1
11/01/2022	Assessment	0.02 J1	19.7	94.2	< 0.007 U1	< 0.004 U1	0.25	0.597	1.36	0.36	0.07 J1	0.00613	< 0.002 U1	2.0	< 0.09 U1	< 0.04 U1
2/09/2023	Assessment	0.02 J1	18.9	83.6	< 0.007 U1	< 0.004 U1	0.30	0.528	0.82	0.38	< 0.05 U1	0.00571	< 0.002 U1	2.1	< 0.09 U1	< 0.04 U1
5/31/2023	Assessment	0.031 J1	16.7	90.9	< 0.007 U1	0.007 J1	0.19 J1	0.509	2.04	--	< 0.05 U1	0.00552	< 0.002 U1	1.8	< 0.04 U1	< 0.02 U1
6/06/2023	Assessment	--	--	--	--	--	--	--	--	0.35	--	--	--	--	--	--
10/31/2023	Assessment	0.043 J1	19.3	83.1	< 0.007 U1	0.013 J1	0.43	0.522	1.47	0.36	0.06 J1	0.00506	< 0.002 U1	2.0	< 0.04 U1	< 0.02 U1
3/07/2024	Assessment	0.020 J1	17.6	101	< 0.007 U1	0.005 J1	0.28 J1	0.625	1.39	0.35	< 0.05 U1	0.00582	< 0.002 U1	1.9	< 0.04 U1	< 0.02 U1
5/15/2024	Assessment	0.020 J1	16.1	127	< 0.007 U1	< 0.004 U1	0.31	1.08	2.01	0.28	< 0.05 U1	0.00771	< 0.002 U1	1.7	< 0.04 U1	< 0.02 U1
11/14/2024	Assessment	0.02 J1	17.3	139	< 0.007 U1	< 0.004 U1	0.28 J1	0.932 B1	1.80	0.41	< 0.05 U1	0.00792	< 0.002 U1	1.7	< 0.04 U1	< 0.02 U1
2/05/2025	Assessment	0.024 J1	16.8	119	< 0.007 U1	< 0.004 U1	0.25 J1	0.892	1.24	0.40	< 0.05 U1	0.00815	< 0.002 U1	1.7	< 0.04 U1	< 0.02 U1
5/15/2025	Assessment	0.023 J1	15.6	106	< 0.007 U1	0.043	0.21 J1	0.936	1.23	0.37	< 0.05 U1	0.00742	< 0.002 U1	1.6	< 0.04 U1	< 0.02 U1
11/06/2025	Assessment	< 0.02 U1	17.9	96.6	< 0.02 U1	< 0.004 U1	0.29 J1	0.62	0.66	0.41	< 0.05 U1	0.00635	< 0.002 U1	1.80	< 0.04 U1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1604S
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/07/2016	Background	0.653	84.5	62.6	0.89	7.2	187	532
7/20/2016	Background	0.530	79.8	60.8	0.88	7.3	186	526
9/19/2016	Background	0.650	68.1	50.3	0.92	7.5	141	456
11/15/2016	Background	0.736	82.9	58.3	0.83	--	165	533
1/09/2017	Background	0.721	83.9	63.5	0.91	7.4	173	535
3/07/2017	Background	0.725	79.1	64.1	0.94	7.5	170	528
5/08/2017	Background	0.554	111	88.0	0.81	7.5	251	672
5/18/2017	Background	--	--	--	--	7.3	--	--
7/17/2017	Background	0.473	98.6	76.0	0.76	7.3	234	657
10/03/2017	Detection	0.562	67.8	55.3	0.87	7.7	123	462
12/12/2017	Detection	--	--	53.9	0.97	7.7	112	--
1/04/2018	Detection	0.778	--	54.5	1.02	8.0	104	--
6/06/2018	Assessment	0.521	72.5	53.7	1.04	7.7	134	474
8/14/2018	Assessment	0.582	92.6	73.0	0.90	7.4	187	583
5/20/2019	Assessment	0.451	80.4	57.2	0.99	7.5	179	572
6/26/2019	Assessment	0.667	75.8	81.4	0.91	7.5	246	718
9/10/2019	Assessment	0.802	53.1	57.6	1.63	7.5	134	506
3/10/2020	Assessment	--	--	--	1.05	7.4	--	--
5/21/2020	Assessment	0.544	50.2	40.2	1.26	8.1	99.7	405
11/13/2020	Assessment	0.559	59.5	58.6	1.03	6.5	93.8	428
2/03/2021	Assessment	0.639	66.0	63.6	1.04	7.1	93.8	445
5/25/2021	Assessment	0.526	52.1	47.9	1.07	9.1	83.6	380
11/09/2021	Assessment	0.564	65.9	70.0	0.92	6.9	92.7	470
2/15/2022	Assessment	0.738	81.4	89.1	0.90	7.3	128	570
5/11/2022	Assessment	0.665	81.6	76.3	0.90	7.5	131	520
10/31/2022	Assessment	0.773	87.5	81.1	0.82	7.2	148	590
2/08/2023	Assessment	0.782	80.3	62.7	0.88	7.5	136	540
5/31/2023	Assessment	0.672	76.1	--	--	7.4	--	--
6/06/2023	Assessment	--	--	55.7	0.90	7.4	128	520
10/31/2023	Assessment	0.679	72.6	41.5	0.84	7.3	125	490
3/06/2024	Assessment	--	--	--	0.80	7.3	--	--
5/15/2024	Assessment	3.12	349	39.0	0.75	7.2	126	460
11/14/2024	Assessment	0.673	75	34.7	0.94	7.5	199	560
2/05/2025	Assessment	--	--	--	0.93	7.5	--	--
5/15/2025	Assessment	0.529	70.9	40.8	0.98	7.3	154	510
11/05/2025	Assessment	0.622	68.9	39.4	0.93	7.1	161	500

Table 1. Groundwater Data Summary: MW-1604S
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/07/2016	Background	0.06	0.41	19.2	0.007 J1	0.02	0.2	0.548	0.3437	0.89	0.315	0.011	< 0.002 U1	2.57	0.07 J1	0.02 J1
7/20/2016	Background	0.13	0.76	21.7	0.059	0.09	0.6	0.955	0.9695	0.88	0.911	0.006	< 0.002 U1	2.33	0.2	0.057
9/19/2016	Background	0.06	0.24	13.3	< 0.005 U1	0.01 J1	0.5	0.325	1.126	0.92	0.060	0.008	< 0.002 U1	2.51	0.07 J1	0.05 J1
11/15/2016	Background	0.07	0.24	18.5	0.005 J1	0.03	0.081	0.326	0.377	0.83	0.045	0.014	< 0.002 U1	4.79	0.05 J1	0.096
1/09/2017	Background	0.06	0.31	17.3	< 0.005 U1	0.02 J1	0.701	0.338	1.629	0.91	0.02 J1	0.013	< 0.002 U1	2.59	0.06 J1	0.04 J1
3/07/2017	Background	0.05	0.20	16.0	< 0.005 U1	0.01 J1	0.326	0.321	0.151	0.94	0.027	0.013	< 0.002 U1	2.61	0.07 J1	0.03 J1
5/08/2017	Background	0.07	0.30	18.8	0.020	0.02	0.079	0.355	0.579	0.81	0.050	0.018	0.005	2.16	0.1	0.050
7/17/2017	Background	0.07	0.24	20.7	< 0.004 U1	0.02 J1	0.136	0.285	0.731	0.76	0.064	0.014	< 0.002 U1	1.88	0.03 J1	0.02 J1
6/06/2018	Assessment	0.06	0.20	14.1	< 0.004 U1	0.02 J1	0.056	0.407	1.058	1.04	0.04	0.014	< 0.002 U1	2.5	0.05 J1	0.02 J1
8/14/2018	Assessment	0.05 J1	0.20	16.3	< 0.004 U1	0.02 J1	0.088	0.365	0.444	0.90	0.009 J1	0.009	--	2.21	0.2	0.03 J1
5/20/2019	Assessment	0.06 J1	0.18	18.8	< 0.02 U1	0.03 J1	0.219	0.352	0.677	0.99	0.03 J1	< 0.009 U1	< 0.002 U1	2.29	0.07 J1	< 0.1 U1
6/26/2019	Assessment	0.04 J1	0.47	46.1	< 0.02 U1	0.02 J1	0.1 J1	1.13	0.565	0.91	0.122	0.01 J1	< 0.002 U1	1 J1	0.2	< 0.1 U1
9/10/2019	Assessment	0.06 J1	0.26	12.0	< 0.02 U1	0.02 J1	0.202	0.207	0.115	1.63	< 0.05 U1	0.00913	< 0.002 U1	4.72	0.1 J1	< 0.1 U1
3/10/2020	Assessment	0.02 J1	0.18	13.0	< 0.02 U1	0.02 J1	0.1 J1	0.384	0.941	1.05	< 0.05 U1	0.00972	< 0.002 U1	2.90	0.07 J1	< 0.1 U1
5/21/2020	Assessment	0.06 J1	0.20	12.9	< 0.02 U1	0.02 J1	0.1 J1	0.297	0.996	1.26	< 0.05 U1	0.00689	< 0.002 U1	3.09	0.1 J1	< 0.1 U1
11/13/2020	Assessment	0.08 J1	0.17	10.5	< 0.02 U1	0.03 J1	0.2 J1	0.285	0.2723	1.03	< 0.05 U1	0.00868	< 0.002 U1	2.94	0.09 J1	< 0.1 U1
2/03/2021	Assessment	0.06 J1	0.18	11.5	< 0.02 U1	0.03 J1	0.1 J1	0.355	2.752	1.04	< 0.05 U1	0.00902	< 0.002 U1	3.10	0.07 J1	< 0.1 U1
5/25/2021	Assessment	0.07 J1	0.17	10.1	< 0.007 U1	0.031	0.14 J1	0.27	0.35	1.07	< 0.05 U1	0.00777	< 0.002 U1	3.1	< 0.09 U1	< 0.04 U1
11/09/2021	Assessment	0.05 J1	0.20	11.7	< 0.007 U1	0.018 J1	0.24	0.271	1.12	0.92	< 0.05 U1	0.00870	< 0.002 U1	2.9	0.13 J1	< 0.04 U1
2/15/2022	Assessment	0.05 J1	0.19	13.9	< 0.007 U1	0.023	0.39	0.342	0.19	0.90	< 0.05 U1	0.0100	< 0.002 U1	3.0	0.18 J1	< 0.04 U1
5/11/2022	Assessment	0.05 J1	0.17	13.2	< 0.007 U1	0.024	0.32	0.327	0.62	0.90	< 0.05 U1	0.0102	< 0.002 U1	3.1	0.13 J1	< 0.04 U1
10/31/2022	Assessment	0.05 J1	0.17	17.2	< 0.007 U1	0.033	0.19 J1	0.295	0.46	0.82	< 0.05 U1	0.0110	< 0.002 U1	3.1	0.16 J1	< 0.04 U1
2/08/2023	Assessment	0.05 J1	0.16	16.5	< 0.007 U1	0.021	0.25	0.272	0.79	0.88	< 0.05 U1	0.0118	< 0.002 U1	3.6	0.09 J1	< 0.04 U1
5/31/2023	Assessment	0.051 J1	0.15	15.1	< 0.007 U1	0.024	0.19 J1	0.269	0.39	--	< 0.05 U1	0.0110	< 0.002 U1	3.3	0.11 J1	0.02 J1
6/06/2023	Assessment	--	--	--	--	--	--	--	--	0.90	--	--	--	--	--	--
10/31/2023	Assessment	0.051 J1	0.15	14.7	< 0.007 U1	0.026	0.25 J1	0.222	1.44	0.84	< 0.05 U1	0.0112	< 0.002 U1	3.5	0.06 J1	< 0.02 U1
3/06/2024	Assessment	0.045 J1	0.13	12.9	< 0.007 U1	0.029	0.27 J1	0.177	0.66	0.80	< 0.05 U1	0.0115	< 0.002 U1	3.1	< 0.04 U1	< 0.02 U1
5/15/2024	Assessment	0.21 J1	0.7	60.3	< 0.04 U1	0.11	1.0 J1	1.25	0.73	0.75	< 0.3 U1	0.0556	< 0.002 U1	13.4	< 0.2 U1	0.1 J1
11/14/2024	Assessment	0.05 J1	0.14	14.8	< 0.007 U1	0.025	0.4	0.315	1.74	0.94	< 0.05 U1	0.013 J1	< 0.002 U1	3.5	< 0.04 U1	0.03 J1
2/05/2025	Assessment	0.053 J1	0.15	13.3	< 0.007 U1	0.022	0.25 J1	0.290	1.05	0.93	< 0.05 U1	0.0120	< 0.002 U1	3.6	< 0.04 U1	< 0.02 U1
5/15/2025	Assessment	0.053 J1	0.14	13.6	< 0.007 U1	0.036	0.45	0.388	0.60	0.98	< 0.05 U1	0.0112	< 0.002 U1	3.4	0.06 J1	< 0.02 U1
11/05/2025	Assessment	0.05 J1	0.14	14.8	< 0.02 U1	0.021	0.62	0.28	1.21	0.93	< 0.05 U1	0.0114	< 0.002 U1	3.75	0.05 J1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1605D
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/07/2016	Background	0.027	81.7	31.9	0.25	7.1	59.7	406
7/18/2016	Background	0.021	85.7	31.5	0.22	7.2	61.6	408
9/19/2016	Background	0.002 J1	84.2	29.8	0.19	7.1	54.1	370
11/16/2016	Background	0.021	93.9	28.8	0.21	7.1	56.2	400
1/10/2017	Background	0.014	89.9	27.4	0.21	7.3	55.1	794
1/11/2017	Background	--	--	--	--	7.2	--	--
3/07/2017	Background	0.045	88.5	29.4	0.19	7.2	58.4	386
5/09/2017	Background	0.021	90.1	29.2	0.19	6.9	58.5	400
7/18/2017	Background	0.025	84.6	28.6	0.17	9.5	59.1	416
10/03/2017	Detection	0.022	83.1	26.4	0.18	7.1	56.8	390
12/11/2017	Detection	--	--	25.8	0.19	7.2	56.4	--
6/06/2018	Assessment	0.03	81.5	24.2	0.16	7.3	49.2	388
8/15/2018	Assessment	0.024	88.6	23.8	0.23	7.1	48.7	379
5/24/2019	Assessment	0.02 J1	75.7	22.1	0.24	6.9	38.9	364
6/25/2019	Assessment	< 0.02 U1	82.1	22.1	0.21	7.3	40.3	379
9/12/2019	Assessment	< 0.02 U1	84.0	23.7	0.22	7.0	45.1	388
3/09/2020	Assessment	--	--	--	0.20	7.0	--	--
5/20/2020	Assessment	< 0.02 U1	85.0	25.1	0.23	6.9	45.9	382
11/13/2020	Assessment	< 0.02 U1	76.6	24.4	0.21	7.0	43.2	367
2/04/2021	Assessment	< 0.02 U1	79.0	25.0	0.24	6.8	43.1	369
5/25/2021	Assessment	0.017 J1	76.8	23.8	0.23	8.9	41.0	360
11/10/2021	Assessment	0.014 J1	76.0	23.3	0.22	7.4	37.8	370
2/15/2022	Assessment	0.016 J1	75.9	23.5	0.21	7.1	39.1	350
5/11/2022	Assessment	< 0.009 U1	78.6 M1, P3	23.2	0.21	7.3	39.4	350
11/01/2022	Assessment	0.017 J1	75.6	24.1	0.20	7.2	38.3	350
2/08/2023	Assessment	0.014 J1	72.8	25.3	0.20	7.2	41.1	350
5/30/2023	Assessment	0.016 J1	69.5	24.5	0.20	6.8	40.6	350
10/31/2023	Assessment	0.016 J1	70.2	24.5	0.20	6.6	39.7	360
3/07/2024	Assessment	--	--	--	0.20	7.3	--	--
5/15/2024	Assessment	0.07 J1	363	25.5	0.08	7.0	45.2	350
11/14/2024	Assessment	0.015 J1	77	26.5	0.24	7.3	47.9	380 S7
2/05/2025	Assessment	--	--	--	0.23	6.8	--	--
5/14/2025	Assessment	0.016 J1	78.4	25.4	0.20	6.8	44.6	360
11/06/2025	Assessment	0.020 J1	85.1	28.1	0.24	7.0	52.8	370

Table 1. Groundwater Data Summary: MW-1605D
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/07/2016	Background	0.02 J1	17.5	400	< 0.005 U1	< 0.004 U1	0.2	0.284	1.094	0.25	0.051	0.004	< 0.002 U1	7.65	0.03 J1	< 0.01 U1
7/18/2016	Background	0.01 J1	17.4	434	< 0.005 U1	< 0.004 U1	0.3	0.170	1.666	0.22	0.051	0.005	< 0.002 U1	3.19	< 0.03 U1	< 0.01 U1
9/19/2016	Background	0.01 J1	18.1	488	< 0.005 U1	< 0.004 U1	0.3	0.118	0.873	0.19	0.009 J1	0.006	< 0.002 U1	2.72	< 0.03 U1	< 0.01 U1
11/16/2016	Background	0.01 J1	18.6	453	< 0.005 U1	< 0.004 U1	0.259	0.097	1.371	0.21	0.008 J1	0.006	< 0.002 U1	2.21	< 0.03 U1	0.01 J1
1/10/2017	Background	0.01 J1	19.0	430	< 0.005 U1	< 0.004 U1	0.128	0.086	1.589	0.21	< 0.004 U1	0.004	< 0.002 U1	2.21	< 0.03 U1	< 0.01 U1
3/07/2017	Background	0.02 J1	19.1	490	< 0.005 U1	0.006 J1	0.322	0.107	1.104	0.19	0.045	0.006	< 0.002 U1	2.44	0.03 J1	< 0.01 U1
5/09/2017	Background	0.05	18.3	420	0.020	0.02	0.131	0.108	0.4527	0.19	0.037	0.003	0.005	2.08	0.1	0.050
7/18/2017	Background	0.02 J1	17.9	457	< 0.004 U1	< 0.005 U1	0.119	0.111	1.657	0.17	0.009 J1	0.005	< 0.002 U1	1.98	< 0.03 U1	0.03 J1
6/06/2018	Assessment	0.02 J1	18.2	382	0.01 J1	< 0.005 U1	0.272	0.188	1.978	0.16	0.273	0.007	< 0.002 U1	1.97	0.04 J1	< 0.01 U1
8/15/2018	Assessment	0.01 J1	20.3	443	< 0.004 U1	< 0.005 U1	0.077	0.079	0.605	0.23	0.035	0.003	--	1.94	< 0.03 U1	< 0.01 U1
5/24/2019	Assessment	0.05 J1	13.9	385	< 0.02 U1	< 0.01 U1	0.06 J1	0.255	1.116	0.24	< 0.02 U1	< 0.009 U1	< 0.002 U1	2.60	< 0.03 U1	< 0.1 U1
6/25/2019	Assessment	< 0.02 U1	18.3	365	< 0.02 U1	< 0.01 U1	0.2 J1	0.104	0.655	0.21	0.05 J1	< 0.009 U1	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
9/12/2019	Assessment	< 0.02 U1	21.2	471	< 0.02 U1	< 0.01 U1	0.652	0.084	0.896	0.22	< 0.05 U1	0.00176	< 0.002 U1	2.08	< 0.03 U1	< 0.1 U1
3/09/2020	Assessment	< 0.02 U1	19.9	448	< 0.02 U1	< 0.01 U1	0.1 J1	0.069	1.802	0.20	< 0.05 U1	0.00178	< 0.002 U1	2 J1	0.04 J1	< 0.1 U1
5/20/2020	Assessment	< 0.02 U1	20.7	436	< 0.02 U1	< 0.01 U1	0.1 J1	0.074	2.158	0.23	< 0.05 U1	0.00180	< 0.002 U1	2.05	0.05 J1	< 0.1 U1
11/13/2020	Assessment	< 0.02 U1	21.1	445	< 0.02 U1	< 0.01 U1	0.2 J1	0.060	1.119	0.21	< 0.05 U1	0.00156	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
2/04/2021	Assessment	< 0.02 U1	21.5	457	< 0.02 U1	< 0.01 U1	0.226	0.054	1.102	0.24	< 0.05 U1	0.00161	< 0.002 U1	2 J1	0.04 J1	< 0.1 U1
5/25/2021	Assessment	0.04 J1	20.9	445	< 0.007 U1	0.006 J1	0.08 J1	0.053	1.03	0.23	< 0.05 U1	0.00153	< 0.002 U1	1.9	< 0.09 U1	< 0.04 U1
11/10/2021	Assessment	< 0.02 U1	21.3	450	< 0.007 U1	< 0.004 U1	0.27	0.057	1.17	0.22	< 0.05 U1	0.00154	< 0.002 U1	1.9	< 0.09 U1	< 0.04 U1
2/15/2022	Assessment	< 0.02 U1	22.3	440	< 0.007 U1	< 0.004 U1	0.34	0.052	0.90	0.21	< 0.05 U1	0.00156	< 0.002 U1	1.9	< 0.09 U1	< 0.04 U1
5/11/2022	Assessment	< 0.02 U1	23.3	460 M1, P3	< 0.007 U1	< 0.004 U1	0.20	0.060	0.81	0.21	< 0.05 U1	0.00149	< 0.002 U1	2.0	< 0.09 U1	< 0.04 U1
11/01/2022	Assessment	< 0.02 U1	21.8	453	< 0.007 U1	< 0.004 U1	0.19 J1	0.029	2.10	0.20	< 0.05 U1	0.00153	< 0.002 U1	1.9	< 0.09 U1	< 0.04 U1
2/08/2023	Assessment	< 0.02 U1	20.6	439	0.043 J1	0.005 J1	0.23	0.065	1.18	0.20	< 0.05 U1	0.00156	< 0.002 U1	1.9	< 0.09 U1	< 0.04 U1
5/30/2023	Assessment	0.016 J1	18.6	402	< 0.007 U1	< 0.004 U1	0.18 J1	0.046	1.37	0.20	< 0.05 U1	0.00152	< 0.002 U1	1.8	< 0.04 U1	< 0.02 U1
10/31/2023	Assessment	0.016 J1	19.3	431	< 0.007 U1	< 0.004 U1	0.29 J1	0.056	1.94	0.20	0.05 J1	0.00141	< 0.002 U1	1.8	< 0.04 U1	< 0.02 U1
3/07/2024	Assessment	0.009 J1	20.4	462	< 0.007 U1	0.006 J1	0.19 J1	0.052	1.70	0.20	< 0.05 U1	0.00150	< 0.002 U1	1.9	< 0.04 U1	< 0.02 U1
5/15/2024	Assessment	0.04 J1	93.9	2080	< 0.04 U1	< 0.02 U1	1.5	0.29	1.06	0.08	< 0.3 U1	0.0069	< 0.002 U1	9.0	< 0.2 U1	< 0.1 U1
11/14/2024	Assessment	0.028 J1	20.5	448	< 0.007 U1	< 0.004 U1	0.23 J1	0.046 B1	1.47	0.24	< 0.05 U1	0.00148	< 0.002 U1	1.9	< 0.04 U1	< 0.02 U1
2/05/2025	Assessment	< 0.008 U1	20.0	438	< 0.007 U1	< 0.004 U1	0.22 J1	0.042	1.03	0.23	< 0.05 U1	0.00153	< 0.002 U1	1.9	< 0.04 U1	< 0.02 U1
5/14/2025	Assessment	0.031 J1	19.8	437	< 0.007 U1	< 0.004 U1	0.20 J1	0.034	1.74	0.20	< 0.05 U1	0.00141	< 0.002 U1	2.0	< 0.04 U1	< 0.02 U1
11/06/2025	Assessment	< 0.02 U1	21.0	511	< 0.02 U1	< 0.004 U1	0.40	0.03	1.23	0.24	0.10 J1	0.00144	< 0.002 U1	1.90	< 0.04 U1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-16051
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/07/2016	Background	0.027	89.5	45.6	0.21	7.0	130	522
7/19/2016	Background	0.027	92.5	46.8	0.22	7.3	135	544
9/19/2016	Background	0.020	97.9	45.6	0.18	7.3	140	548
11/16/2016	Background	0.034	103	44.4	0.19	7.1	140	567
1/10/2017	Background	0.020	91.3	43.5	0.19	7.2	119	534
3/07/2017	Background	0.046	81.9	44.7	0.17	7.3	115	474
5/09/2017	Background	0.043	93.5	41.8	0.19	7.0	115	508
7/18/2017	Background	0.036	79.9	39.7	0.1 J1	7.0	116	488
10/03/2017	Detection	0.041	82.5	40.7	0.19	7.2	120	494
12/11/2017	Detection	--	--	41.3	0.18	7.3	135	--
1/04/2018	Detection	--	--	--	--	7.6	144	536
6/06/2018	Assessment	0.129	79.2	39.1	0.16	7.3	120	500
8/15/2018	Assessment	0.158	83.4	38.0	0.23	7.3	114	483
5/24/2019	Assessment	0.08 J1	73.8	36.8	0.23	7.3	89.2	443
6/25/2019	Assessment	0.126	83.4	38.3	0.21	7.4	104	471
9/12/2019	Assessment	0.199	89.4	41.7	0.20	7.4	128	524
3/10/2020	Assessment	--	--	--	0.21	7.1	--	--
5/20/2020	Assessment	0.097	90.1	37.8	0.23	6.9	109	476
11/13/2020	Assessment	0.060	73.3	32.8	0.21	7.1	86.2	429
2/04/2021	Assessment	0.04 J1	74.2	32.9	0.24	6.9	85.1	424
5/26/2021	Assessment	0.039 J1	80.4	35.6	0.24	9.5	97.2	450
11/10/2021	Assessment	0.040 J1	81.1	36.3	0.21	7.5	106	470
2/15/2022	Assessment	0.060	77.4	36.2	0.21	7.2	108	440
5/11/2022	Assessment	0.056	76.5	37.1	0.22	7.4	106	450
11/01/2022	Assessment	0.059	76.0	35.7	0.21	7.2	104	470
2/08/2023	Assessment	0.046 J1	76.0	35.0	0.21	7.3	109	450
5/30/2023	Assessment	0.069	60.6	32.4	0.20	6.6	102	450
10/31/2023	Assessment	0.063	69.2	30.4	0.21	7.2	89.1	430
3/07/2024	Assessment	--	--	--	0.20	7.3	--	--
5/14/2024	Assessment	0.059	76.3	34.1	0.20	7.1	115	470
11/14/2024	Assessment	0.082	86	39.1	0.24	7.3	165	540
2/05/2025	Assessment	--	--	--	0.23	6.9	--	--
5/14/2025	Assessment	0.249	89.5	42.2	0.19	7.2	205	600
11/05/2025	Assessment	0.352	94.4	44.8	0.21	7.0	222	610

Table 1. Groundwater Data Summary: MW-1605I
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/07/2016	Background	0.02 J1	17.3	151	< 0.005 U1	< 0.004 U1	0.2	1.67	1.219	0.21	0.122	0.004	< 0.002 U1	1.42	0.03 J1	0.02 J1
7/19/2016	Background	0.03 J1	20.1	178	< 0.005 U1	< 0.004 U1	1.2	1.79	2.288	0.22	0.032	0.005	< 0.002 U1	1.39	0.07 J1	0.02 J1
9/19/2016	Background	0.04 J1	19.5	180	< 0.005 U1	0.005 J1	0.2	1.66	2.171	0.18	0.160	0.008	< 0.002 U1	1.23	< 0.03 U1	0.03 J1
11/16/2016	Background	0.04 J1	18.0	168	< 0.005 U1	0.008 J1	0.091	1.58	1.912	0.19	0.079	0.017	< 0.002 U1	1.07	< 0.03 U1	0.03 J1
1/10/2017	Background	0.03 J1	18.5	161	< 0.005 U1	< 0.004 U1	0.110	1.52	1.823	0.19	0.02 J1	0.004	< 0.002 U1	1.43	0.04 J1	0.183
3/07/2017	Background	0.03 J1	18.6	156	< 0.005 U1	0.008 J1	0.214	1.48	1.721	0.17	0.063	0.007	< 0.002 U1	1.33	0.04 J1	0.03 J1
5/09/2017	Background	0.05	20.1	148	0.020	0.02	0.137	1.56	1.139	0.19	0.037	0.010	0.005	1.18	0.1	0.050
7/18/2017	Background	0.05 J1	26.2	153	< 0.004 U1	< 0.005 U1	0.104	1.49	2.173	0.1 J1	0.137	0.010	< 0.002 U1	1.16	< 0.03 U1	0.03 J1
6/06/2018	Assessment	0.03 J1	17.0	135	0.004 J1	< 0.005 U1	0.04 J1	1.47	2.27	0.16	0.184	0.011	< 0.002 U1	1.06	< 0.03 U1	0.04 J1
8/15/2018	Assessment	0.03 J1	18.8	149	0.004 J1	< 0.005 U1	0.116	1.45	1.167	0.23	0.095	0.005	--	1.12	< 0.03 U1	0.04 J1
5/24/2019	Assessment	0.04 J1	25.3	157	< 0.02 U1	< 0.01 U1	0.07 J1	1.12	1.054	0.23	0.04 J1	0.01 J1	< 0.002 U1	1 J1	0.04 J1	< 0.1 U1
6/25/2019	Assessment	< 0.1 U1	17.8	134	< 0.1 U1	< 0.05 U1	< 0.2 U1	1.29	2.118	0.21	< 0.1 U1	0.01 J1	< 0.002 U1	< 2 U1	< 0.2 U1	< 0.5 U1
9/12/2019	Assessment	0.05 J1	22.3	154	< 0.02 U1	< 0.01 U1	0.1 J1	1.42	1.679	0.20	0.1 J1	0.00628	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
3/10/2020	Assessment	< 0.02 U1	25.7	149	< 0.02 U1	< 0.01 U1	0.1 J1	1.12	1.641	0.21	< 0.05 U1	0.00517	< 0.002 U1	1 J1	0.04 J1	< 0.1 U1
5/20/2020	Assessment	0.16	54.2	139	< 0.02 U1	< 0.01 U1	0.227	1.26	1.169	0.23	0.2 J1	0.00520	< 0.002 U1	1 J1	0.06 J1	< 0.1 U1
11/13/2020	Assessment	0.09 J1	28.1	126	< 0.02 U1	< 0.01 U1	0.232	1.24	1.672	0.21	0.2 J1	0.00513	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
2/04/2021	Assessment	0.04 J1	20.0	127	< 0.02 U1	< 0.01 U1	0.2 J1	1.12	1.611	0.24	0.06 J1	0.00497	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
5/26/2021	Assessment	0.06 J1	20.1	136	< 0.007 U1	< 0.004 U1	0.12 J1	1.13	1.36	0.24	< 0.05 U1	0.00482	< 0.002 U1	1.3	< 0.09 U1	< 0.04 U1
11/10/2021	Assessment	0.03 J1	17.5	120	< 0.007 U1	0.023	0.27	1.32	2.54	0.21	0.26	0.00518	< 0.002 U1	1.3	< 0.09 U1	< 0.04 U1
2/15/2022	Assessment	0.03 J1	18.5	120	< 0.007 U1	0.004 J1	0.29	1.27	3.18	0.21	0.06 J1	0.00479	< 0.002 U1	1.4	< 0.09 U1	< 0.04 U1
5/11/2022	Assessment	0.03 J1	19.2	121	< 0.007 U1	0.005 J1	0.31	1.24	1.37	0.22	0.06 J1	0.00471	< 0.002 U1	1.3	< 0.09 U1	< 0.04 U1
11/01/2022	Assessment	0.06 J1	21.2	128	< 0.007 U1	0.006 J1	0.22	1.18	1.17	0.21	0.14 J1	0.00507	< 0.002 U1	1.3	< 0.09 U1	0.04 J1
2/08/2023	Assessment	0.05 J1	19.0	127	< 0.007 U1	0.006 J1	0.27	1.28	1.86	0.21	0.13 J1	0.00528	< 0.002 U1	1.3	< 0.09 U1	< 0.04 U1
5/30/2023	Assessment	0.024 J1	14.0	105	< 0.007 U1	< 0.004 U1	0.16 J1	0.908	1.99	0.20	< 0.05 U1	0.00463	< 0.002 U1	1.1	< 0.04 U1	0.02 J1
10/31/2023	Assessment	0.157	28.4	131	0.010 J1	0.012 J1	0.42	1.21	1.97	0.21	1.24	0.00459	< 0.002 U1	1.4	0.07 J1	0.03 J1
3/07/2024	Assessment	0.031 J1	17.3	127	< 0.007 U1	0.508	0.34	1.21	2.30	0.20	0.17 J1	0.00557	< 0.002 U1	1.3	< 0.04 U1	0.03 J1
5/14/2024	Assessment	0.028 J1	18.8	143	< 0.007 U1	< 0.004 U1	0.25 J1	1.10	1.78	0.20	0.06 J1	0.00425	< 0.002 U1	1.4	< 0.04 U1	0.03 J1
11/14/2024	Assessment	0.024 J1	15.8	135	< 0.007 U1	< 0.004 U1	0.19 J1	1.32	1.63	0.24	< 0.05 U1	0.00465	< 0.002 U1	1.3	0.05 J1	0.03 J1
2/05/2025	Assessment	0.030 J1	16.2	156	< 0.007 U1	0.004 J1	0.23 J1	1.47	3.33	0.23	0.08 J1	0.00575	< 0.002 U1	1.3	0.10 J1	0.03 J1
5/14/2025	Assessment	0.028 J1	15.5	150	< 0.007 U1	0.005 J1	0.18 J1	1.48	2.32	0.19	< 0.05 U1	0.00629	< 0.002 U1	1.2	0.08 J1	0.05 J1
11/05/2025	Assessment	0.03 J1	15.8	165	< 0.02 U1	< 0.004 U1	0.26 J1	1.54	1.46	0.21	< 0.05 U1	0.00674	< 0.002 U1	1.25	0.11 J1	0.03 J1

Table 1. Groundwater Data Summary: MW-1605S
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/07/2016	Background	0.48	76.6	51.0	0.55	7.1	167	576
7/19/2016	Background	0.438	72.6	53.1	0.55	7.2	174	586
9/19/2016	Background	0.482	79.1	54.0	0.51	7.3	179	594
11/16/2016	Background	0.584	84.0	49.7	0.53	7.1	186	599
1/10/2017	Background	0.533	78.5	48.2	0.43	7.2	170	584
3/07/2017	Background	0.608	71.2	52.0	0.55	7.2	180	564
5/09/2017	Background	0.470	79.9	50.1	0.50	7.2	181	606
7/17/2017	Background	0.490	68.6	47.5	0.43	7.1	177	582
10/03/2017	Detection	0.539	71.6	44.1	0.46	7.1	175	578
12/11/2017	Detection	--	--	42.5	0.53	7.2	164	--
1/04/2018	Detection	0.616	--	--	0.48	7.7	168	614
6/05/2018	Assessment	0.461	71	46.5	0.58	7.6	154	592
8/15/2018	Assessment	0.029	45.8	46.5	0.59	7.1	153	573
5/24/2019	Assessment	0.415	76.0	46.1	0.61	7.3	147	586
6/27/2019	Assessment	0.438	72.0	46.3	0.63	7.2	150	595
9/12/2019	Assessment	0.431	77.0	49.4	0.54	7.0	162	593
3/10/2020	Assessment	--	--	--	0.56	6.9	--	--
5/21/2020	Assessment	0.501	84.7	55.5	0.60	6.9	195	656
11/13/2020	Assessment	0.555	72.7	48.4	0.54	6.9	167	609
2/04/2021	Assessment	0.481	71.8	50.9	0.58	6.7	174	610
5/26/2021	Assessment	0.500	74.9	52.7	0.57	9.5	178	610
11/10/2021	Assessment	0.476	71.3	50.7	0.54	7.0	173	590
2/15/2022	Assessment	0.538	77.2	51.8	0.49	7.0	181	600
5/11/2022	Assessment	0.598	87.3	50.5	0.55	7.2	178	600
11/01/2022	Assessment	0.574	72.6 M1, P3	50.5	0.50	7.1	183	580
2/09/2023	Assessment	0.595	68.3	50.5	0.57	7.1	174	580
5/30/2023	Assessment	0.499	53.5	47.1	0.56	6.5	163	560
10/31/2023	Assessment	0.633	64.0	43.1	0.60	7.0	152	--
12/20/2023	Assessment	--	--	--	--	--	--	550
3/07/2024	Assessment	--	--	--	0.54	7.0	--	--
5/14/2024	Assessment	0.556	64.9	45.6	0.59	7.0	156	550
11/14/2024	Assessment	0.517	72	47.6	0.68	7.1	160	570
2/04/2025	Assessment	--	--	--	0.66	7.1	--	--
5/13/2025	Assessment	0.501	67.3	38.0	0.62	7.4	155	540
11/05/2025	Assessment	0.497	69.3	40.8	0.68	6.8	165	520

Table 1. Groundwater Data Summary: MW-1605S
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/07/2016	Background	0.04 J1	0.52	8.07	< 0.005 U1	0.03	0.2	0.471	0.2307	0.55	0.116	0.13	< 0.002 U1	2.52	1.3	0.02 J1
7/19/2016	Background	0.10	0.60	8.65	< 0.005 U1	0.04	0.4	0.856	0.39	0.55	0.223	0.017	< 0.002 U1	2.20	1.0	0.02 J1
9/19/2016	Background	0.04 J1	0.42	7.61	< 0.005 U1	0.03	0.9	0.443	0.15	0.51	0.049	0.015	< 0.002 U1	1.83	1.0	0.03 J1
11/16/2016	Background	0.05	0.36	7.76	< 0.005 U1	0.04	0.108	0.355	0.964	0.53	0.021	0.021	< 0.002 U1	1.79	1.1	0.03 J1
1/10/2017	Background	0.06	0.50	8.33	< 0.005 U1	0.04	0.135	0.401	1.6248	0.43	0.02 J1	0.016	< 0.002 U1	2.01	1.1	0.060
3/07/2017	Background	0.04 J1	0.39	8.72	< 0.005 U1	0.03	0.279	0.307	0.339	0.55	0.033	0.015	< 0.002 U1	1.85	0.5	0.03 J1
5/09/2017	Background	0.05	0.45	8.41	0.020	0.03	0.247	0.370	0.255	0.50	0.020	0.013	0.005	1.81	0.9	0.050
7/17/2017	Background	0.04 J1	0.42	8.55	< 0.004 U1	0.03	0.113	0.336	1.254	0.43	0.026	0.015	< 0.002 U1	1.73	1.2	0.03 J1
6/05/2018	Assessment	0.04 J1	0.42	8.63	0.004 J1	0.03	0.093	0.321	0.705	0.58	0.042	0.016	< 0.002 U1	1.75	0.6	0.05 J1
8/15/2018	Assessment	0.04 J1	0.20	10.9	< 0.004 U1	0.03	0.078	0.087	0.1783	0.59	0.041	0.007	--	1.13	5.4	0.02 J1
5/24/2019	Assessment	0.15	2.84	15.4	0.04 J1	0.11	0.636	3.91	0.2689	0.61	1.96	0.02 J1	< 0.002 U1	2 J1	0.3	< 0.1 U1
6/27/2019	Assessment	0.11	2.44	12.5	0.04 J1	0.07	0.536	2.46	0.245	0.63	1.52	< 0.009 U1	< 0.002 U1	2 J1	0.5	0.1 J1
9/12/2019	Assessment	0.04 J1	0.61	6.72	< 0.02 U1	0.04 J1	0.09 J1	0.469	0.00129	0.54	0.1 J1	0.0108	< 0.002 U1	2.07	2.0	< 0.1 U1
3/10/2020	Assessment	0.04 J1	1.57	11.9	0.02 J1	0.05 J1	1.13	2.11	1.8805	0.56	0.920	0.0119	< 0.002 U1	2 J1	0.3	< 0.1 U1
5/21/2020	Assessment	0.05 J1	0.59	8.92	< 0.02 U1	0.04 J1	0.2 J1	0.575	1.007	0.60	0.2 J1	0.0113	< 0.002 U1	1 J1	0.4	< 0.1 U1
11/13/2020	Assessment	0.03 J1	0.47	6.32	< 0.02 U1	0.04 J1	1.12	0.377	2.5781	0.54	< 0.05 U1	0.0105	< 0.002 U1	2.21	0.8	< 0.1 U1
2/04/2021	Assessment	0.03 J1	0.47	6.04	< 0.02 U1	0.04 J1	0.928	0.361	0.544	0.58	< 0.05 U1	0.0104	< 0.002 U1	2 J1	0.6	< 0.1 U1
5/26/2021	Assessment	0.03 J1	0.45	6.85	< 0.007 U1	0.038	0.52	0.343	0.94	0.57	< 0.05 U1	0.0105	< 0.002 U1	1.8	0.71	< 0.04 U1
11/10/2021	Assessment	0.05 J1	0.46	6.29	< 0.007 U1	0.041	1.39	0.378	1.19	0.54	< 0.05 U1	0.0100	< 0.002 U1	1.8	0.27 J1	< 0.04 U1
2/15/2022	Assessment	0.04 J1	0.52	5.79	< 0.007 U1	0.045	0.62	0.470	0.70	0.49	< 0.05 U1	0.00954	< 0.002 U1	1.9	0.31 J1	< 0.04 U1
5/11/2022	Assessment	0.03 J1	0.55	6.47	< 0.007 U1	0.042	0.56	0.418	0.66	0.55	< 0.05 U1	0.00964	< 0.002 U1	1.8	0.73	0.05 J1
11/01/2022	Assessment	0.03 J1	0.54	5.70	< 0.007 U1	0.042	0.52	0.472	1.24	0.50	< 0.05 U1	0.0106	< 0.002 U1	1.8	0.09 J1	< 0.04 U1
2/09/2023	Assessment	0.05 J1	0.84	6.86	0.052	0.038	0.46	1.09	1.24	0.57	0.36	0.0109	< 0.002 U1	1.8	< 0.09 U1	0.06 J1
5/30/2023	Assessment	0.033 J1	0.48	4.88	< 0.007 U1	0.036	0.56	0.458	1.43	0.56	0.13 J1	0.00920	< 0.002 U1	1.5	0.07 J1	0.03 J1
10/31/2023	Assessment	0.046 J1	0.69	6.04	< 0.007 U1	0.039	0.71	0.643	1.34	0.60	0.17 J1	0.00944	< 0.002 U1	1.9	0.15 J1	0.07 J1
3/07/2024	Assessment	0.036 J1	0.54	5.28	< 0.007 U1	0.036	0.46	0.443	0.27	0.54	0.06 J1	0.00938	< 0.002 U1	1.8	0.08 J1	0.03 J1
5/14/2024	Assessment	0.033 J1	0.55	5.13	< 0.007 U1	0.031	0.38	0.298	0.66	0.59	< 0.05 U1	0.0102	< 0.002 U1	1.9	0.08 J1	0.03 J1
11/14/2024	Assessment	0.04 J1	0.51	6.4	< 0.007 U1	0.039	0.52	0.411	0.69	0.68	0.06 J1	0.0097	< 0.002 U1	1.8	0.09 J1	0.03 J1
2/04/2025	Assessment	0.038 J1	0.46	5.86	< 0.007 U1	0.044	0.51	0.320	0.88	0.66	< 0.05 U1	0.0113	< 0.002 U1	1.7	0.08 J1	0.03 J1
5/13/2025	Assessment	0.121	0.54	10.6	0.013 J1	0.110	1.21	0.584	0.86	0.62	5.39	0.00934	< 0.002 U1	2.0	0.23 J1	0.04 J1
11/05/2025	Assessment	0.04 J1	0.44	5.92	< 0.02 U1	0.037	0.89	0.30	0.92	0.68	< 0.05 U1	0.0109	< 0.002 U1	1.95	0.22 J1	0.02 J1

Table 1. Groundwater Data Summary: MW-1606D
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/07/2016	Background	0.020	67.5	21.3	0.23	7.1	13.9	290
7/19/2016	Background	0.018	69.9	20.8	0.20	5.9	12.8	298
9/19/2016	Background	0.020	72.3	21.7	0.19	7.3	13.2	290
11/16/2016	Background	0.017	77.1	22.0	0.19	7.2	16.4	301
1/10/2017	Background	0.012	75.5	21.6	0.16	7.2	12.8	284
3/06/2017	Background	0.073	69.9	22.3	0.18	7.2	8.7	325
5/09/2017	Background	0.034	78.1	22.3	0.17	6.9	14.4	308
7/18/2017	Background	0.028	69.3	21.6	0.15	8.4	13.5	307
10/03/2017	Detection	0.022	74.4	22.3	0.16	7.0	17.1	308
12/11/2017	Detection	--	--	22.6	0.17	7.1	19.4	--
6/06/2018	Assessment	0.044	72.0	23.1	0.19	8.0	19.9	331
8/15/2018	Assessment	0.028	80.5	23.9	0.20	7.3	21.5	329
5/24/2019	Assessment	0.02 J1	75.7	25.0	0.20	7.2	19.6	330
6/24/2019	Assessment	0.02 J1	80.8	25.2	0.19	7.3	21.0	329
9/12/2019	Assessment	< 0.02 U1	76.7	26.9	0.18	7.3	25.6	361
3/09/2020	Assessment	--	--	--	0.17	6.9	--	--
5/20/2020	Assessment	0.03 J1	89.7	29.9	0.20	6.9	30.7	354
11/16/2020	Assessment	< 0.02 U1	81.1	28.9	0.18	7.3	30.8	371
2/04/2021	Assessment	< 0.02 U1	82.6	29.0	0.20	7.4	32.8	348
5/25/2021	Assessment	0.019 J1	81.6	28.4	0.20	8.9	33.4	350
11/10/2021	Assessment	0.017 J1	84.6	27.5	0.19	7.1	31.0	360
2/15/2022	Assessment	0.017 J1	82.1	27.7	0.18	6.8	34.3	380
5/10/2022	Assessment	0.016 J1	85.4	28.4	0.18	7.2	35.2	360 L1
11/01/2022	Assessment	0.017 J1	83.3	27.3	0.18	6.4	35.8	360
2/08/2023	Assessment	0.016 J1	79.7	27.1	0.17	7.1	37.9	390
5/30/2023	Assessment	0.017 J1	77.4	26.3	0.17	7.1	40.1	370
10/31/2023	Assessment	0.016 J1	76.8	25.6	0.18	6.7	39.1	390
3/07/2024	Assessment	--	--	--	0.16	7.1	--	--
5/14/2024	Assessment	0.017 J1	74.7	24.6	0.17	6.9	30.9	350
11/14/2024	Assessment	0.019 J1	83	24.1	0.2	7.0	29	350
2/05/2025	Assessment	--	--	--	0.21	6.8	--	--
5/13/2025	Assessment	--	--	--	--	7.1	--	--
5/14/2025	Assessment	0.018 J1	78.1	32.7	0.17	--	28.0	360
11/06/2025	Assessment	0.022 J1	85.7	28.9	0.20	7.1	27.9	360

Table 1. Groundwater Data Summary: MW-1606D
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/07/2016	Background	0.03 J1	11.5	327	0.01 J1	< 0.004 U1	0.5	0.508	0.551	0.23	0.214	0.003	< 0.002 U1	3.82	0.06 J1	< 0.01 U1
7/19/2016	Background	0.02 J1	13.7	372	< 0.005 U1	< 0.004 U1	0.3	0.178	0.464	0.20	0.086	0.009	< 0.002 U1	2.10	0.05 J1	< 0.01 U1
9/19/2016	Background	0.01 J1	13.4	378	< 0.005 U1	< 0.004 U1	0.1	0.113	1.152	0.19	< 0.004 U1	0.002	< 0.002 U1	2.00	< 0.03 U1	< 0.01 U1
11/16/2016	Background	0.01 J1	14.4	419	< 0.005 U1	< 0.004 U1	0.138	0.102	0.333	0.19	< 0.004 U1	0.002	< 0.002 U1	2.21	< 0.03 U1	< 0.01 U1
1/10/2017	Background	0.03 J1	13.9	383	0.034	0.02 J1	0.160	0.109	1.612	0.16	0.023	< 0.0002 U1	< 0.002 U1	2.46	0.04 J1	0.124
3/06/2017	Background	0.01 J1	13.5	374	< 0.005 U1	< 0.004 U1	0.667	0.098	0.924	0.18	0.02 J1	0.007	< 0.002 U1	2.00	< 0.03 U1	< 0.01 U1
5/09/2017	Background	0.05	14.3	370	0.020	0.02	0.153	0.086	2.300	0.17	0.020	0.004	0.005	2.07	0.1	0.050
7/18/2017	Background	0.02 J1	14.8	401	< 0.004 U1	< 0.005 U1	0.131	0.084	1.584	0.15	0.01 J1	0.006	< 0.002 U1	1.85	< 0.03 U1	< 0.01 U1
6/06/2018	Assessment	< 0.01 U1	14.7	392	0.004 J1	< 0.005 U1	0.04 J1	0.07	1.5971	0.19	0.008 J1	0.005	< 0.002 U1	1.77	< 0.03 U1	0.03 J1
8/15/2018	Assessment	0.04 J1	16.9	431	0.006 J1	0.007 J1	0.148	0.117	0.56	0.20	0.141	0.002	--	1.77	< 0.03 U1	0.02 J1
5/24/2019	Assessment	< 0.02 U1	17.4	447	< 0.02 U1	< 0.01 U1	0.1 J1	0.066	0.946	0.20	< 0.02 U1	< 0.009 U1	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
6/24/2019	Assessment	< 0.02 U1	17.5	431	< 0.02 U1	< 0.01 U1	0.1 J1	0.068	0.809	0.19	0.02 J1	< 0.009 U1	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
9/12/2019	Assessment	< 0.02 U1	17.4	458	< 0.02 U1	< 0.01 U1	0.09 J1	0.085	0.593	0.18	< 0.05 U1	0.000651	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
3/09/2020	Assessment	< 0.02 U1	17.2	470	0.02 J1	< 0.01 U1	0.05 J1	0.053	0.98	0.17	0.05 J1	0.000659	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
5/20/2020	Assessment	< 0.02 U1	17.9	472	< 0.02 U1	< 0.01 U1	0.07 J1	0.063	0.939	0.20	0.2 J1	0.000622	< 0.002 U1	2.13	0.09 J1	< 0.1 U1
11/16/2020	Assessment	< 0.02 U1	17.7	467	< 0.02 U1	< 0.01 U1	0.287	0.052	0.924	0.18	< 0.05 U1	0.000564	< 0.002 U1	2 J1	0.04 J1	< 0.1 U1
2/04/2021	Assessment	< 0.02 U1	18.2	470	< 0.02 U1	< 0.01 U1	0.208	0.052	0.567	0.20	< 0.05 U1	0.000505	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
5/25/2021	Assessment	< 0.02 U1	18.3	494	< 0.007 U1	< 0.004 U1	< 0.04 U1	0.50	0.70	0.20	< 0.05 U1	0.0005	< 0.002 U1	1.7	< 0.09 U1	< 0.04 U1
11/10/2021	Assessment	< 0.02 U1	18.1	488	< 0.007 U1	< 0.004 U1	0.24	0.043	1.76	0.19	< 0.05 U1	0.00049	< 0.002 U1	1.7	< 0.09 U1	< 0.04 U1
2/15/2022	Assessment	< 0.02 U1	17.8	493	< 0.007 U1	< 0.004 U1	0.34	0.048	2.33	0.18	< 0.05 U1	0.00048	< 0.002 U1	1.7	< 0.09 U1	< 0.04 U1
5/10/2022	Assessment	< 0.02 U1	17.8	472	< 0.007 U1	< 0.004 U1	0.36	0.049	0.81	0.18	< 0.05 U1	0.00047	< 0.002 U1	1.7	< 0.09 U1	< 0.04 U1
11/01/2022	Assessment	< 0.02 U1	18.5	500	< 0.007 U1	< 0.004 U1	0.29	0.039	1.09	0.18	< 0.05 U1	0.00051	< 0.002 U1	1.8	< 0.09 U1	< 0.04 U1
2/08/2023	Assessment	< 0.02 U1	17.8	484	< 0.007 U1	< 0.004 U1	0.32	0.067	1.58	0.17	< 0.05 U1	0.00055	< 0.002 U1	1.7	< 0.09 U1	< 0.04 U1
5/30/2023	Assessment	0.017 J1	16.3	457	< 0.007 U1	< 0.004 U1	0.28 J1	0.065	1.04	0.17	< 0.05 U1	0.00055	< 0.002 U1	1.7	< 0.04 U1	< 0.02 U1
10/31/2023	Assessment	0.013 J1	17.2	480	< 0.007 U1	< 0.004 U1	0.48	0.056	0.94	0.18	0.07 J1	0.00048	< 0.002 U1	1.8	< 0.04 U1	< 0.02 U1
3/07/2024	Assessment	0.008 J1	17.6	494	< 0.007 U1	< 0.004 U1	0.19 J1	0.046	0.91	0.16	< 0.05 U1	0.00046	< 0.002 U1	1.7	< 0.04 U1	< 0.02 U1
5/14/2024	Assessment	< 0.008 U1	16.1	466	< 0.007 U1	< 0.004 U1	0.26 J1	0.042	0.87	0.17	< 0.05 U1	0.00061	< 0.002 U1	1.7	< 0.04 U1	< 0.02 U1
11/14/2024	Assessment	< 0.008 U1	17.4	491	< 0.007 U1	< 0.004 U1	0.28 J1	0.046 B1	1.33	0.2	< 0.05 U1	0.00047	< 0.002 U1	1.8	< 0.04 U1	< 0.02 U1
2/05/2025	Assessment	0.009 J1	16.3	430	< 0.007 U1	< 0.004 U1	0.35	0.040	0.86	0.21	< 0.05 U1	0.00057	< 0.002 U1	1.7	< 0.04 U1	< 0.02 U1
5/14/2025	Assessment	0.010 J1	16.5	461	< 0.007 U1	< 0.004 U1	0.21 J1	0.016 J1	0.99	0.17	< 0.05 U1	0.00071	< 0.002 U1	1.8	< 0.04 U1	< 0.02 U1
11/06/2025	Assessment	< 0.02 U1	18.4	522	< 0.02 U1	0.005 J1	0.29 J1	0.04	0.65	0.20	< 0.05 U1	0.00050	< 0.002 U1	1.80	< 0.04 U1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1606I

Geosyntec Consultants, Inc.

Rockport - BAP
Appendix III Constituents

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/07/2016	Background	0.011	66.6	23.9	0.22	7.0	42.3	300
7/19/2016	Background	0.013	62.0	25.1	0.21	5.0	42.9	350
9/19/2016	Background	< 0.002 U1	62.8	24.2	0.19	7.2	36.7	314
11/16/2016	Background	0.014	70.7	25.0	0.21	7.3	42.6	325
1/10/2017	Background	0.007	68.0	24.5	0.17	7.4	39.3	326
3/06/2017	Background	0.025	64.1	23.8	0.19	7.4	37.8	317
5/09/2017	Background	0.070	67.8	23.0	0.19	7.4	36.8	318
7/18/2017	Background	0.023	55.5	22.6	0.17	6.7	37.1	304
10/03/2017	Detection	0.021	57.8	23.0	0.18	7.1	38.4	304
12/11/2017	Detection	--	--	23.0	0.19	7.1	37.9	--
6/06/2018	Assessment	0.053	78.2	31.5	0.20	8.1	52.4	392
8/15/2018	Assessment	0.031	86.3	25.4	0.21	7.3	50.3	387
5/21/2019	Assessment	0.02 J1	79.5	29.8	0.16	8.6	55.5	407
6/25/2019	Assessment	< 0.02 U1	86.8	31.5	0.18	7.2	51.0	406
9/12/2019	Assessment	< 0.02 U1	72.8	20.1	0.18	7.4	47.9	367
3/09/2020	Assessment	--	--	--	0.19	7.0	--	--
5/20/2020	Assessment	< 0.02 U1	74.7	19.2	0.21	6.9	43.8	340
11/16/2020	Assessment	< 0.02 U1	60.9	19.9	0.21	7.4	39.1	309
2/05/2021	Assessment	< 0.02 U1	63.8	21.0	0.24	7.5	40.7	316
5/25/2021	Assessment	0.013 J1	65.4	20.6	0.24	8.9	40.4	320
11/10/2021	Assessment	0.012 J1	62.5	19.3	0.23	7.6	39.2	310
2/14/2022	Assessment	0.013 J1	63.4	19.0	0.21	7.7	40.9	320
5/10/2022	Assessment	0.016 J1	66.8	19.5	0.22	7.4	43.6	310 L1
11/01/2022	Assessment	0.013 J1	58.5	17.2	0.21	7.0	43.1	300
2/08/2023	Assessment	0.012 J1	61.8	17.3	0.21	7.3	41.8	310
5/30/2023	Assessment	0.013 J1	55.9	17.4	0.20	7.2	44.3	310
10/31/2023	Assessment	0.012 J1	56.9	16.4	0.22	6.8	42.4	310
3/06/2024	Assessment	--	--	--	0.19	7.2	--	--
5/14/2024	Assessment	0.013 J1	54.5	17.1	0.19	7.1	39.3	290
11/14/2024	Assessment	0.012 J1	66	16.8	0.23	7.3	40.4	300
2/05/2025	Assessment	--	--	--	0.22	7.0	--	--
5/13/2025	Assessment	0.015 J1	66.8	15.1	0.18	7.1	44.3	330
11/05/2025	Assessment	0.014 J1	58.7	15.2	0.21	6.9	41.8	300

Table 1. Groundwater Data Summary: MW-1606I
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/07/2016	Background	0.03 J1	3.00	49.4	< 0.005 U1	0.004 J1	0.2	0.929	1.347	0.22	0.166	0.004	< 0.002 U1	1.64	0.05 J1	0.03 J1
7/19/2016	Background	0.03 J1	3.99	54.0	< 0.005 U1	< 0.004 U1	0.4	0.823	1.286	0.21	0.037	0.013	< 0.002 U1	1.57	< 0.03 U1	0.03 J1
9/19/2016	Background	0.02 J1	4.99	46.7	< 0.005 U1	< 0.004 U1	0.1	0.733	1.104	0.19	0.02 J1	0.009	< 0.002 U1	1.50	< 0.03 U1	0.03 J1
11/16/2016	Background	0.02 J1	4.59	48.1	< 0.005 U1	< 0.004 U1	0.070	0.700	0.951	0.21	< 0.004 U1	0.008	< 0.002 U1	1.83	< 0.03 U1	0.04 J1
1/10/2017	Background	0.02 J1	5.11	53.6	0.007 J1	0.01 J1	0.138	0.921	4.283	0.17	0.022	0.005	< 0.002 U1	2.12	< 0.03 U1	0.05 J1
3/06/2017	Background	0.02 J1	5.07	54.7	< 0.005 U1	< 0.004 U1	0.524	0.950	0.934	0.19	0.032	0.007	< 0.002 U1	1.78	0.03 J1	0.04 J1
5/09/2017	Background	0.05	4.81	49.9	0.020	0.02	0.179	1.26	0.677	0.19	0.071	0.008	0.005	1.27	0.1	0.050
7/18/2017	Background	0.02 J1	4.72	51.1	< 0.004 U1	< 0.005 U1	0.097	1.06	0.813	0.17	0.043	0.008	< 0.002 U1	1.11	< 0.03 U1	0.04 J1
6/06/2018	Assessment	0.03 J1	5.69	67.3	< 0.004 U1	< 0.005 U1	0.083	1.49	1.252	0.20	0.026	0.007	< 0.002 U1	0.98	< 0.03 U1	0.05 J1
8/15/2018	Assessment	0.03 J1	9.11	85.2	< 0.004 U1	0.005 J1	0.061	1.95	0.3912	0.21	0.034	0.006	--	1.34	< 0.03 U1	0.083
5/21/2019	Assessment	< 0.02 U1	7.69	74.5	< 0.02 U1	< 0.01 U1	< 0.04 U1	1.56	0.562	0.16	< 0.02 U1	< 0.009 U1	< 0.002 U1	0.8 J1	< 0.03 U1	< 0.1 U1
6/25/2019	Assessment	< 0.1 U1	7.96	78.1	< 0.1 U1	< 0.05 U1	< 0.2 U1	1.80	1.214	0.18	< 0.1 U1	0.01 J1	< 0.002 U1	< 2 U1	< 0.2 U1	< 0.5 U1
9/12/2019	Assessment	0.02 J1	11.2	76.7	< 0.02 U1	< 0.01 U1	0.1 J1	1.58	0.947	0.18	< 0.05 U1	0.00405	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
3/09/2020	Assessment	< 0.02 U1	8.69	65.2	< 0.02 U1	< 0.01 U1	0.05 J1	1.23	0.993	0.19	< 0.05 U1	0.00348	< 0.002 U1	1 J1	0.05 J1	< 0.1 U1
5/20/2020	Assessment	< 0.02 U1	8.40	61.8	< 0.02 U1	< 0.01 U1	0.1 J1	1.28	0.663	0.21	0.2 J1	0.00326	< 0.002 U1	1 J1	0.03 J1	< 0.1 U1
11/16/2020	Assessment	< 0.02 U1	9.37	60.8	< 0.02 U1	< 0.01 U1	0.2 J1	1.26	0.968	0.21	< 0.05 U1	0.00361	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
2/05/2021	Assessment	< 0.02 U1	9.73	59.1	< 0.02 U1	< 0.01 U1	0.238	1.30	1.711	0.24	< 0.05 U1	0.00319	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
5/25/2021	Assessment	< 0.02 U1	10.6	58.0	< 0.007 U1	0.020	0.19 J1	1.14	0.69	0.24	< 0.05 U1	0.00320	< 0.002 U1	1.3	< 0.09 U1	< 0.04 U1
11/10/2021	Assessment	< 0.02 U1	12.2	55.6	< 0.007 U1	< 0.004 U1	0.29	1.04	1.80	0.23	< 0.05 U1	0.00313	< 0.002 U1	1.2	< 0.09 U1	< 0.04 U1
2/14/2022	Assessment	0.02 J1	14.0	56.9	< 0.007 U1	0.004 J1	0.36	1.24	0.92	0.21	< 0.05 U1	0.00323	< 0.002 U1	1.3	< 0.09 U1	< 0.04 U1
5/10/2022	Assessment	< 0.02 U1	9.79	51.2	< 0.007 U1	< 0.004 U1	0.34	1.18	1.03	0.22	< 0.05 U1	0.00277	< 0.002 U1	1.3	< 0.09 U1	< 0.04 U1
11/01/2022	Assessment	< 0.02 U1	11.2	54.1	< 0.007 U1	< 0.004 U1	0.19 J1	1.04	1.69	0.21	< 0.05 U1	0.00314	< 0.002 U1	1.3	< 0.09 U1	< 0.04 U1
2/08/2023	Assessment	0.04 J1	20.3	57.2	< 0.007 U1	0.005 J1	0.27	1.26	1.94	0.21	0.06 J1	0.00313	< 0.002 U1	1.3	< 0.09 U1	< 0.04 U1
5/30/2023	Assessment	0.027 J1	12.2	46.7	< 0.007 U1	< 0.004 U1	0.20 J1	0.947	1.53	0.20	< 0.05 U1	0.00310	< 0.002 U1	1.1	< 0.04 U1	0.03 J1
10/31/2023	Assessment	0.015 J1	11.1	54.2	< 0.007 U1	0.005 J1	1.30	1.09	1.61	0.22	< 0.05 U1	0.00313	< 0.002 U1	1.3	< 0.04 U1	0.02 J1
3/06/2024	Assessment	0.017 J1	12.0	48.8	< 0.007 U1	0.004 J1	0.16 J1	0.986	1.04	0.19	< 0.05 U1	0.00316	< 0.002 U1	1.1	< 0.04 U1	0.03 J1
5/14/2024	Assessment	0.013 J1	9.50	46.2	< 0.007 U1	0.016 J1	0.46	1.01	1.10	0.19	< 0.05 U1	0.00322	< 0.002 U1	1.1	< 0.04 U1	0.02 J1
11/14/2024	Assessment	0.015 J1	13.7	50.3	< 0.007 U1	0.005 J1	0.83	1.07	1.42	0.23	< 0.05 U1	0.00285	< 0.002 U1	1.0	< 0.04 U1	0.03 J1
2/05/2025	Assessment	0.018 J1	15.8	51.8	< 0.007 U1	0.004 J1	0.34	1.09	2.27	0.22	< 0.05 U1	0.00336	< 0.002 U1	1.1	< 0.04 U1	0.03 J1
5/13/2025	Assessment	0.018 J1	13.0	57.2	< 0.007 U1	< 0.004 U1	0.53	1.09	1.17	0.18	< 0.05 U1	0.00315	< 0.002 U1	1.1	< 0.04 U1	0.03 J1
11/05/2025	Assessment	< 0.02 U1	12.0	52.1	< 0.02 U1	< 0.004 U1	0.21 J1	0.92	1.27	0.21	< 0.05 U1	0.00310	< 0.002 U1	0.90	< 0.04 U1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1606S
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
6/07/2016	Background	0.024	55.8	30.6	0.46	6.9	47.6	410
7/19/2016	Background	0.019	46.0	24.0	0.43	7.1	38.1	386
9/19/2016	Background	< 0.002 U1	44.4	18.7	0.40	7.1	31.8	316
11/16/2016	Background	0.020	54.1	26.6	0.40	6.9	40.0	358
1/10/2017	Background	0.014	48.5	22.1	0.31	6.7	30.5	351
3/07/2017	Background	0.054	47.2	23.9	0.41	7.1	33.2	331
5/09/2017	Background	0.020	52.7	24.7	0.38	7.0	37.5	377
7/18/2017	Background	0.090	44.7	22.8	0.37	6.9	36.8	367
10/03/2017	Detection	0.026	43.4	24.1	0.41	6.6	35.6	363
12/11/2017	Detection	--	--	24.0	0.41	6.6	36.8	--
1/04/2018	Detection	--	--	--	0.42	7.4	--	--
6/06/2018	Assessment	0.029	50.9	25.5	0.46	7.8	52.6	398
8/15/2018	Assessment	0.563	76.1	20.7	0.47	6.9	34.9	316
5/21/2019	Assessment	0.05 J1	48.9	26.6	0.47	7.9	64.5	416
6/25/2019	Assessment	0.03 J1	49.8	25.0	0.45	7.0	41.7	380
9/12/2019	Assessment	0.02 J1	44.4	24.4	0.54	7.0	41.9	376
3/09/2020	Assessment	--	--	--	0.58	6.8	--	--
5/20/2020	Assessment	0.05 J1	48.4	25.1	0.63	6.9	46.9	375
11/16/2020	Assessment	< 0.02 U1	40.5	21.7	0.56	6.8	32.7	337
2/05/2021	Assessment	< 0.02 U1	42.0	29.0	0.52	7.1	31.1	374
5/25/2021	Assessment	0.016 J1	45.4	29.6	0.48	8.6	36.0	400
11/10/2021	Assessment	0.021 J1	51.1	32.5	0.52	7.2	42.4	440
2/14/2022	Assessment	0.019 J1	49.3	32.6	0.50	6.9	44.3	440
5/10/2022	Assessment	0.030 J1	47.7	33.2	0.47	6.9	42.7	420 L1
11/01/2022	Assessment	0.024 J1	63.3	16.6	0.20	6.1	43.2	300
2/08/2023	Assessment	0.019 J1	45.0	28.2	0.50	7.1	38.4	380
5/30/2023	Assessment	0.020 J1	39.6	22.5	0.53	6.9	32.6	350
11/01/2023	Assessment	0.017 J1	37.0	21.9	0.50	6.5	28.5	340
3/06/2024	Assessment	--	--	--	0.54	6.9	--	--
5/14/2024	Assessment	0.018 J1	43.2	23.8	0.52	6.9	33.8	350
11/14/2024	Assessment	0.017 J1	51	29.2	0.53	6.9	33.4	360
2/05/2025	Assessment	--	--	--	0.54	6.6	--	--
5/13/2025	Assessment	--	--	--	--	7.0	--	--
5/14/2025	Assessment	0.021 J1	51.8	33.8	0.43	--	41.0	400 S7
11/05/2025	Assessment	0.040 J1	54.4	35.4	0.47	6.5	29.8	330

Table 1. Groundwater Data Summary: MW-1606S
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
6/07/2016	Background	0.08	0.26	12.5	< 0.005 U1	0.02	0.1	0.090	0.7867	0.46	0.145	0.012	< 0.002 U1	1.91	3.3	0.02 J1
7/19/2016	Background	0.06	0.23	11.5	< 0.005 U1	0.02 J1	0.5	0.052	0.94	0.43	0.034	0.017	< 0.002 U1	1.56	4.0	< 0.01 U1
9/19/2016	Background	0.05 J1	0.22	9.34	< 0.005 U1	0.01 J1	0.2	0.038	0.75	0.40	0.020	0.010	< 0.002 U1	1.32	5.7	0.01 J1
11/16/2016	Background	0.05 J1	0.20	11.1	< 0.005 U1	0.02 J1	0.148	0.038	0.574	0.40	0.004 J1	0.013	< 0.002 U1	1.02	3.1	0.01 J1
1/10/2017	Background	0.04 J1	0.24	10.7	0.01 J1	0.02 J1	1.29	0.141	2.025	0.31	0.097	0.006	< 0.002 U1	1.11	4.2	0.02 J1
3/07/2017	Background	0.07	0.60	16.7	0.024	0.06	1.25	0.883	1.822	0.41	1.33	0.011	< 0.002 U1	1.22	4.5	0.03 J1
5/09/2017	Background	0.05	0.29	12.0	0.020	0.03	0.277	0.371	0.193	0.38	0.355	0.010	0.005	0.90	6.0	0.050
7/18/2017	Background	0.05	0.32	12.6	0.01 J1	0.03	0.259	0.363	0.268	0.37	0.386	0.010	< 0.002 U1	1.08	4.7	0.02 J1
6/06/2018	Assessment	0.05 J1	0.20	13.6	0.005 J1	0.03	0.108	0.092	0.496	0.46	0.032	0.012	< 0.002 U1	1.19	2.7	0.03 J1
8/15/2018	Assessment	0.04 J1	0.44	8.22	0.004 J1	0.04	0.251	0.338	1.146	0.47	0.028	0.013	--	1.89	1.6	0.078
5/21/2019	Assessment	0.14	0.19	16.7	< 0.02 U1	0.05 J1	0.1 J1	0.094	0.668	0.47	< 0.02 U1	< 0.009 U1	< 0.002 U1	0.9 J1	3.3	< 0.1 U1
6/25/2019	Assessment	< 0.1 U1	0.2 J1	14.4	< 0.1 U1	0.06 J1	< 0.2 U1	< 0.1 U1	0.0646	0.45	< 0.1 U1	0.01 J1	< 0.002 U1	< 2 U1	2.9	< 0.5 U1
9/12/2019	Assessment	0.03 J1	0.17	11.8	< 0.02 U1	0.03 J1	0.08 J1	0.051	0.1052	0.54	< 0.05 U1	0.00814	< 0.002 U1	1 J1	2.8	< 0.1 U1
3/09/2020	Assessment	< 0.02 U1	0.17	10.7	< 0.02 U1	0.02 J1	0.2 J1	0.05 J1	0.00206	0.58	< 0.05 U1	0.00787	< 0.002 U1	1 J1	4.4	< 0.1 U1
5/20/2020	Assessment	0.04 J1	0.20	13.6	< 0.02 U1	0.03 J1	0.294	0.081	0.4706	0.63	< 0.05 U1	0.00858	< 0.002 U1	1 J1	3.2	< 0.1 U1
11/16/2020	Assessment	0.03 J1	0.17	11.5	< 0.02 U1	0.03 J1	0.286	0.05 J1	1.328	0.56	< 0.05 U1	0.00846	< 0.002 U1	1 J1	4.7	< 0.1 U1
2/05/2021	Assessment	0.03 J1	0.17	13.0	< 0.02 U1	0.03 J1	0.241	0.05 J1	0.827	0.52	< 0.05 U1	0.00830	< 0.002 U1	1 J1	3.2	< 0.1 U1
5/25/2021	Assessment	0.03 J1	0.18	11.8	< 0.007 U1	0.031	0.28	0.080	0.56	0.48	0.05 J1	0.00864	< 0.002 U1	1.1	2.23	< 0.04 U1
11/10/2021	Assessment	0.03 J1	0.18	13.6	< 0.007 U1	0.034	0.52	0.054	0.72	0.52	0.09 J1	0.00839	< 0.002 U1	1.3	1.36	< 0.04 U1
2/14/2022	Assessment	0.04 J1	0.18	13.9	< 0.007 U1	0.031	0.34	0.073	0.72	0.50	< 0.05 U1	0.00880	< 0.002 U1	1.2	2.71	< 0.04 U1
5/10/2022	Assessment	0.04 J1	0.18	18.4	< 0.007 U1	0.032	0.34	0.112	0.77	0.47	0.09 J1	0.00763	< 0.002 U1	1.1	2.48	< 0.04 U1
11/01/2022	Assessment	0.20	84.0	64.1	0.017 J1	0.007 J1	0.28	1.43	0.90	0.20	0.32	0.00311	< 0.002 U1	1.5	0.11 J1	< 0.04 U1
2/08/2023	Assessment	0.05 J1	0.22	14.4	0.011 J1	0.127	0.59	1.12	1.98	0.50	0.19 J1	0.00884	< 0.002 U1	1.4	1.53	< 0.04 U1
5/30/2023	Assessment	0.035 J1	0.14	9.77	< 0.007 U1	0.024	0.31	0.108	1.06	0.53	< 0.05 U1	0.00785	< 0.002 U1	1.4	2.37	< 0.02 U1
11/01/2023	Assessment	0.030 J1	0.14	8.66	< 0.007 U1	0.029	0.38	0.077	1.10	0.50	< 0.05 U1	0.00675	< 0.002 U1	1.3	3.55	< 0.02 U1
3/06/2024	Assessment	0.031 J1	0.15	12.7	< 0.007 U1	0.031	0.20 J1	0.068	1.04	0.54	< 0.05 U1	0.00733	< 0.002 U1	1.2	3.41	< 0.02 U1
5/14/2024	Assessment	0.034 J1	0.16	10.9	< 0.007 U1	0.023	0.25 J1	0.060	1.05	0.52	< 0.05 U1	0.00769	< 0.002 U1	1.7	2.95	< 0.02 U1
11/14/2024	Assessment	0.032 J1	0.14	12.1	< 0.007 U1	0.026	0.24 J1	0.062 B1	0.78	0.53	< 0.05 U1	0.00779	< 0.002 U1	1.5	4.07	< 0.02 U1
2/05/2025	Assessment	0.031 J1	0.14	12.2	< 0.007 U1	0.029	0.24 J1	0.066	1.70	0.54	< 0.05 U1	0.00789	< 0.002 U1	1.5	1.91	< 0.02 U1
5/14/2025	Assessment	0.036 J1	0.14	10.3	< 0.007 U1	0.049	0.30	0.087	0.67	0.43	< 0.05 U1	0.00746	< 0.002 U1	1.7	1.98	< 0.02 U1
11/05/2025	Assessment	0.03 J1	0.13	12.1	< 0.02 U1	0.056	0.27 J1	0.28	0.35	0.47	< 0.05 U1	0.00746	< 0.002 U1	1.35	3.27	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1701D

Geosyntec Consultants, Inc.

Rockport - BAP
Appendix III Constituents

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
12/12/2017	Detection	0.054	71.8	20.1	0.28	7.3	44	378
2/08/2018	Assessment	0.066	70.8	19.9	0.3	7.5	45.3	402
6/05/2018	Assessment	0.041	68.1	13.7	0.34	7.3	36.8	700
8/14/2018	Assessment	0.060	77.0	14.1	0.36	7.2	39.8	369
9/24/2018	Assessment	0.047	71.6	15.2	0.33	7.5	40.0	366
10/29/2018	Assessment	0.125	76.5	15.4	0.32	7.8	40.7	362
11/12/2018	Assessment	0.114	76.7	15.7	0.35	7.1	40	358
5/20/2019	Assessment	0.02 J1	66.8	14.0	0.32	7.2	43.5	371
6/25/2019	Assessment	0.02 J1	70.8	14.9	0.32	7.1	39.0	387
9/09/2019	Assessment	0.02 J1	70.5	16.0	0.31	7.0	36.6	376
3/10/2020	Assessment	--	--	--	0.33	7.0	--	--
5/21/2020	Assessment	0.02 J1	72.8	14.7	0.36	7.5	43.4	368
11/17/2020	Assessment	0.02 J1	71.1	16.8	0.33	7.0	40.3	379
2/02/2021	Assessment	0.03 J1	68.9	14.2	0.35	6.9	40.5	366
5/26/2021	Assessment	0.021 J1	68.7	14.8	0.36	9.3	39.8	350
11/09/2021	Assessment	0.023 J1	69.1	15.1	0.34	6.8	38.7	360
2/16/2022	Assessment	0.023 J1	68.6	14.0	0.34	7.1	39.4	360
5/11/2022	Assessment	0.018 J1	77.8	13.4	0.35	7.1	38.9	350 L1
11/02/2022	Assessment	0.023 J1	67.4	15.2	0.34	7.0	40.3	350
2/07/2023	Assessment	0.022 J1	66.5	14.6	0.33	7.7	39.5	350
6/01/2023	Assessment	0.013 J1	62.1	14.2	0.32	7.1	38.3	350
10/31/2023	Assessment	0.027 J1	66.1	15.2	0.35	6.7	38.9	380
3/06/2024	Assessment	--	--	--	0.30	7.0	--	--
5/16/2024	Assessment	0.019 J1	61.0 M1	15.3	0.38	7.0	39.8	350
11/14/2024	Assessment	0.024 J1	67	16.9	0.39	6.9	39.4	350
2/04/2025	Assessment	--	--	--	0.39	7.4	--	--
5/13/2025	Assessment	0.019 J1	66.8	15.2	0.32	7.1	29.7	350
11/04/2025	Assessment	0.023 J1	66.3	16.0	0.38	7.0	35.1	330

Table 1. Groundwater Data Summary: MW-1701D
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
2/08/2018	Assessment	0.03 J1	9.3	65	< 0.004 U1	0.009 J1	0.104	1.75	1.33	0.30	0.065	0.01	< 0.002 U1	1.37	0.04 J1	0.03 J1
6/05/2018	Assessment	0.02 J1	10.6	63.7	0.005 J1	0.02 J1	0.103	1.56	2.346	0.34	0.096	0.012	< 0.002 U1	1.38	< 0.03 U1	0.03 J1
8/14/2018	Assessment	0.01 J1	10.2	65.2	< 0.004 U1	< 0.005 U1	0.060	1.68	0.929	0.36	0.021	0.008	--	1.38	< 0.03 U1	0.03 J1
9/24/2018	Assessment	< 0.01 U1	10.1	64.0	< 0.004 U1	0.005 J1	0.076	1.71	0.564	0.33	0.074	< 0.0002 U1	--	1.33	< 0.03 U1	0.02 J1
10/29/2018	Assessment	< 0.02 U1	9.79	65.9	< 0.02 U1	< 0.01 U1	0.1 J1	1.66	0.417	0.32	0.04 J1	< 0.009 U1	--	1 J1	< 0.03 U1	< 0.1 U1
11/12/2018	Assessment	< 0.02 U1	9.10	62.2	< 0.02 U1	< 0.01 U1	0.1 J1	1.6	0.972	0.35	0.04 J1	< 0.009 U1	--	1 J1	< 0.03 U1	< 0.1 U1
5/20/2019	Assessment	< 0.02 U1	9.55	65.1	< 0.02 U1	< 0.01 U1	0.2 J1	1.59	0.702	0.32	< 0.02 U1	< 0.009 U1	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
6/25/2019	Assessment	< 0.1 U1	9.58	64.6	< 0.1 U1	< 0.05 U1	< 0.2 U1	1.62	2.63	0.32	< 0.1 U1	0.01 J1	< 0.002 U1	< 2 U1	0.2 J1	< 0.5 U1
9/09/2019	Assessment	< 0.02 U1	9.37	65.0	< 0.02 U1	< 0.01 U1	0.2 J1	1.53	0.341	0.31	< 0.05 U1	0.00691	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
3/10/2020	Assessment	< 0.02 U1	9.31	61.4	< 0.02 U1	< 0.01 U1	0.06 J1	1.48	0.546	0.33	< 0.05 U1	0.00654	< 0.002 U1	1 J1	0.03 J1	< 0.1 U1
5/21/2020	Assessment	< 0.02 U1	9.40	62.4	< 0.02 U1	< 0.01 U1	0.1 J1	1.48	1.095	0.36	< 0.05 U1	0.00636	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
11/17/2020	Assessment	< 0.02 U1	9.58	64.4	< 0.02 U1	< 0.01 U1	0.209	1.59	1.585	0.33	< 0.05 U1	0.00659	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
2/02/2021	Assessment	< 0.02 U1	10.2	64.6	< 0.02 U1	< 0.01 U1	0.299	1.63	0.815	0.35	< 0.05 U1	0.00625	< 0.002 U1	1 J1	0.04 J1	< 0.1 U1
5/26/2021	Assessment	< 0.02 U1	9.57	61.6	< 0.007 U1	< 0.004 U1	0.1 J1	1.46	0.65	0.36	< 0.05 U1	0.00631	< 0.002 U1	1.2	< 0.09 U1	< 0.04 U1
11/09/2021	Assessment	< 0.02 U1	9.55	59.6	< 0.007 U1	< 0.004 U1	0.28	1.52	1.89	0.34	0.06 J1	0.00608	< 0.002 U1	1.3	< 0.09 U1	< 0.04 U1
2/16/2022	Assessment	< 0.02 U1	9.82	61.9	< 0.007 U1	0.021	0.12 J1	1.56	0.92	0.34	< 0.05 U1	0.00604	< 0.002 U1	1.3	< 0.09 U1	< 0.04 U1
5/11/2022	Assessment	< 0.02 U1	9.57	57.9	< 0.007 U1	< 0.004 U1	0.25	1.43	0.58	0.35	< 0.05 U1	0.00566	< 0.002 U1	1.4	< 0.09 U1	< 0.04 U1
11/02/2022	Assessment	0.05 J1	9.35	59.5	< 0.007 U1	< 0.004 U1	0.26	1.45	0.73	0.34	0.57	0.00683	< 0.002 U1	1.3	< 0.09 U1	< 0.04 U1
2/07/2023	Assessment	< 0.02 U1	9.53	61.6	< 0.007 U1	< 0.004 U1	0.23	1.50	1.34	0.33	0.09 J1	0.00682	< 0.002 U1	1.3	< 0.09 U1	< 0.04 U1
6/01/2023	Assessment	0.014 J1	8.84	55.9	< 0.007 U1	< 0.004 U1	0.18 J1	1.44	0.45	0.32	< 0.05 U1	0.00579	< 0.002 U1	1.3	< 0.04 U1	< 0.02 U1
10/31/2023	Assessment	0.009 J1	8.96	62.6	< 0.007 U1	< 0.004 U1	0.25 J1	1.45	4.28	0.35	< 0.05 U1	0.00646	< 0.002 U1	1.3	< 0.04 U1	0.02 J1
3/06/2024	Assessment	0.013 J1	9.09	60.8	< 0.007 U1	0.005 J1	0.60	1.47	1.50	0.30	< 0.05 U1	0.00631	< 0.002 U1	1.3	< 0.04 U1	0.03 J1
5/16/2024	Assessment	< 0.008 U1	8.33 M1	58.5 M1	< 0.007 U1	< 0.004 U1	0.20 M1, J1	1.33 M1	0.35	0.38	< 0.05 U1	0.00629	< 0.002 U1	1.2	< 0.04 U1	0.02 J1
11/14/2024	Assessment	0.011 J1	9.42	62.1	< 0.007 U1	< 0.004 U1	0.51	1.53 B1	0.90	0.39	< 0.05 U1	0.00639	< 0.002 U1	1.3	< 0.04 U1	0.02 J1
2/04/2025	Assessment	0.016 J1	8.75	57.3	< 0.007 U1	0.023	0.26 J1	1.41	1.03	0.39	< 0.05 U1	0.00680	< 0.002 U1	1.3	< 0.04 U1	< 0.02 U1
5/13/2025	Assessment	0.011 J1	9.36	61.0	< 0.007 U1	0.005 J1	0.18 J1	1.50	0.41	0.32	0.07 J1	0.00533	< 0.002 U1	1.5	< 0.04 U1	0.02 J1
11/04/2025	Assessment	0.02 J1	10.0	60.4	< 0.02 U1	< 0.004 U1	0.48	1.50	0.97	0.38	0.07 J1	0.00654	< 0.002 U1	1.40	< 0.04 U1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-17011
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
12/12/2017	Detection	0.066	65.4	13.5	0.33	7.3	40.7	338
2/08/2018	Assessment	0.095	63.7	14.5	0.38	7.7	43.1	363
6/05/2018	Assessment	0.044	65.5	14.1	0.44	7.4	36.5	328
8/14/2018	Assessment	0.052	67.9	14.5	0.39	7.2	34.8	352
9/24/2018	Assessment	0.038	68.9	14.9	0.41	7.6	35.0	346
10/31/2018	Assessment	0.104	62.4	14.8	0.40	7.9	34.8	338
11/12/2018	Assessment	0.166	71.7	14.5	0.42	7.3	35.0	322
5/20/2019	Assessment	0.02 J1	59.6	12.8	0.40	7.3	39.8	345
6/25/2019	Assessment	0.02 J1	69.4	12.8	0.41	7.7	36.3	388
9/09/2019	Assessment	< 0.02 U1	65.1	12.9	0.38	7.3	34.5	339
3/10/2020	Assessment	--	--	--	0.41	6.8	--	--
5/21/2020	Assessment	< 0.02 U1	73.3	13.0	0.43	7.2	39.8	349
11/17/2020	Assessment	< 0.02 U1	68.4	13.1	0.43	6.9	36.5	341
2/02/2021	Assessment	0.02 J1	65.9	13.2	0.45	7.0	36.1	362
5/26/2021	Assessment	0.017 J1	75.9	13.1	0.46	7.9	35.6	350
11/09/2021	Assessment	0.018 J1	64.3	13.4	0.43	6.4	32.1	310
2/16/2022	Assessment	0.017 J1	64.4	14.2	0.44	7.2	34.7	340
5/11/2022	Assessment	0.016 J1	65.2	14.8	0.43	7.2	34.8	330 L1
11/02/2022	Assessment	0.020 J1	63.4	14.7	0.42	7.3	33.6	330
2/08/2023	Assessment	0.018 J1	64.8	14.6	0.43	7.7	33.6	320
6/01/2023	Assessment	0.016 J1	61.1 M1	--	--	7.2	--	--
6/05/2023	Assessment	--	--	14.6	0.43	7.1	34.0	330
10/31/2023	Assessment	0.030 J1	62.2	14.6	0.45	6.7	33.3	340
3/07/2024	Assessment	--	--	--	0.41	7.2	--	--
5/16/2024	Assessment	0.015 J1	58.9	14.5	0.48	7.2	33.7	320
11/14/2024	Assessment	0.018 J1	64	14.8	0.49	7.1	33.7	330
2/04/2025	Assessment	--	--	--	0.47	7.5	--	--
5/13/2025	Assessment	0.017 J1	64.8	16.3	0.43	7.0	26.4	330
11/04/2025	Assessment	0.020 J1	65.8	16.6	0.47	7.1	26.7	310

Table 1. Groundwater Data Summary: MW-1701I
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
2/08/2018	Assessment	0.07	9.17	46.8	< 0.004 U1	0.01 J1	0.184	1.34	1.06	0.38	0.26	0.007	< 0.002 U1	2.52	0.07 J1	0.03 J1
6/05/2018	Assessment	0.05	8.07	42.7	0.021	0.02 J1	0.446	1.87	0.658	0.44	0.564	0.01	< 0.002 U1	1.15	0.2	0.05 J1
8/14/2018	Assessment	0.04 J1	6.42	38.3	0.004 J1	0.01 J1	0.085	1.10	0.3144	0.39	0.108	0.002	--	1.01	< 0.03 U1	0.02 J1
9/24/2018	Assessment	0.23	9.38	41.2	0.008 J1	0.02 J1	0.371	1.62	0.335	0.41	0.497	0.002	--	1.67	0.1	0.01 J1
10/31/2018	Assessment	0.25	6.69	40.7	< 0.02 U1	0.03 J1	0.337	1.12	0.304	0.40	0.403	0.02 J1	--	1 J1	0.07 J1	< 0.1 U1
11/12/2018	Assessment	0.10	6.77	40.3	< 0.02 U1	< 0.01 U1	0.2 J1	1.19	0.579	0.42	0.09 J1	< 0.009 U1	--	1 J1	< 0.03 U1	< 0.1 U1
5/20/2019	Assessment	0.14	12.8	41.5	< 0.02 U1	0.02 J1	0.09 J1	1.16	0.628	0.40	0.09 J1	< 0.009 U1	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
6/25/2019	Assessment	< 0.1 U1	9.47	41.9	< 0.1 U1	< 0.05 U1	< 0.2 U1	1.16	0.116	0.41	< 0.1 U1	0.01 J1	< 0.002 U1	< 2 U1	< 0.2 U1	< 0.5 U1
9/09/2019	Assessment	0.21	7.92	40.6	< 0.02 U1	< 0.01 U1	0.08 J1	0.843	0.781	0.38	0.08 J1	0.00561	< 0.002 U1	1 J1	< 0.03 U1	< 0.1 U1
3/10/2020	Assessment	0.20	14.3	46.8	< 0.02 U1	0.02 J1	0.256	1.42	1.233	0.41	0.384	0.00594	< 0.002 U1	1 J1	0.1 J1	< 0.1 U1
5/21/2020	Assessment	0.13	11.9	41.9	< 0.02 U1	0.01 J1	0.2 J1	1.32	0.943	0.43	0.276	0.00549	< 0.002 U1	1 J1	0.06 J1	< 0.1 U1
11/17/2020	Assessment	0.06 J1	9.93	41.4	< 0.02 U1	< 0.01 U1	0.231	1.17	1.337	0.43	0.07 J1	0.00553	< 0.002 U1	1 J1	0.04 J1	< 0.1 U1
2/02/2021	Assessment	0.05 J1	9.36	41.0	< 0.02 U1	< 0.01 U1	0.2 J1	1.18	0.675	0.45	< 0.05 U1	0.00539	< 0.002 U1	1 J1	0.06 J1	< 0.1 U1
5/26/2021	Assessment	0.17	21.6	43.5	0.012 J1	0.067	0.44	2.06	0.63	0.46	0.67	0.00533	< 0.002 U1	1.1	< 0.09 U1	< 0.04 U1
11/09/2021	Assessment	0.02 J1	7.42	39.7	< 0.007 U1	< 0.004 U1	0.30	0.872	1.09	0.43	0.09 J1	0.00579	< 0.002 U1	1.0	< 0.09 U1	< 0.04 U1
2/16/2022	Assessment	0.02 J1	7.51	37.3	< 0.007 U1	< 0.004 U1	0.21	0.845	0.70	0.44	< 0.05 U1	0.00536	< 0.002 U1	1.1	< 0.09 U1	< 0.04 U1
5/11/2022	Assessment	0.05 J1	9.66	35.2	< 0.007 U1	0.009 J1	0.27	0.981	0.99	0.43	0.07 J1	0.00494	< 0.002 U1	1.1	< 0.09 U1	< 0.04 U1
11/02/2022	Assessment	0.03 J1	6.22	37.2	< 0.007 U1	< 0.004 U1	0.18 J1	0.727	1.09	0.42	< 0.05 U1	0.00596	< 0.002 U1	1.1	< 0.09 U1	< 0.04 U1
2/08/2023	Assessment	0.05 J1	11.5	38.7	< 0.007 U1	0.009 J1	0.25	1.07	0.67	0.43	0.15 J1	0.00582	< 0.002 U1	1.1	< 0.09 U1	< 0.04 U1
6/01/2023	Assessment	0.031 J1	9.26	36.5	< 0.007 U1	0.005 J1	0.25 J1	0.980	0.92	--	0.07 J1	0.00544	< 0.002 U1	1.1	< 0.04 U1	< 0.02 U1
6/05/2023	Assessment	--	--	--	--	--	--	--	--	0.43	--	--	--	--	--	--
10/31/2023	Assessment	0.095 J1	29.3	44.5	< 0.007 U1	0.022	0.27 J1	2.00	0.94	0.45	0.35	0.00533	< 0.002 U1	1.1	0.09 J1	< 0.02 U1
3/07/2024	Assessment	0.077 J1	14.1	40.1	< 0.007 U1	0.010 J1	0.44	1.06	1.35	0.41	0.17 J1	0.00564	< 0.002 U1	1.1	< 0.04 U1	< 0.02 U1
5/16/2024	Assessment	0.106	37.4	39.8	0.010 J1	0.018 J1	0.24 J1	1.32	0.77	0.48	0.32	0.00548	< 0.002 U1	1.2	0.06 J1	< 0.02 U1
11/14/2024	Assessment	0.168	29.9	41.5	< 0.007 U1	0.023	0.24 J1	1.65	2.09	0.49	0.39	0.00509	< 0.002 U1	1.2	0.1 J1	< 0.02 U1
2/04/2025	Assessment	0.023 J1	9.38	38.4	< 0.007 U1	0.004 J1	0.25 J1	1.13	0.53	0.47	< 0.05 U1	0.00599	< 0.002 U1	1.1	< 0.04 U1	< 0.02 U1
5/13/2025	Assessment	0.067 J1	34.4	40.6	< 0.007 U1	0.006 J1	0.50	1.51	1.35	0.43	0.13 J1	0.00530	< 0.002 U1	1.2	< 0.04 U1	< 0.02 U1
11/04/2025	Assessment	0.03 J1	9.66	39.8	< 0.02 U1	0.005 J1	0.41	1.22	1.00	0.47	0.08 J1	0.00578	< 0.002 U1	1.19	< 0.04 U1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1701S
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
12/12/2017	Detection	0.051	58.1	18.6	0.35	7.5	21.1	288
2/08/2018	Assessment	0.025	56.6	19.0	0.36	7.8	21.6	334
6/04/2018	Assessment	0.032	59.2	19.4	0.38	7.4	21.3	368
8/14/2018	Assessment	0.056	64.1	19.6	0.36	7.3	20.4	329
9/25/2018	Assessment	0.035	60.7	19.6	0.37	6.6	20.3	316
10/29/2018	Assessment	0.129	63.7	19.1	0.38	7.2	18.8	312
11/12/2018	Assessment	0.139	63.6	19.1	0.39	7.5	18.9	318
5/20/2019	Assessment	< 0.02 U1	56.5	19.7	0.42	7.2	20.0	320
6/25/2019	Assessment	0.02 J1	63.5	19.6	0.37	7.3	20.7	353
9/09/2019	Assessment	< 0.02 U1	57.0	20.0	0.37	7.2	17.8	332
3/10/2020	Assessment	--	--	--	0.39	7.1	--	--
5/21/2020	Assessment	< 0.02 U1	67.8	21.6	0.41	7.3	19.6	348
11/17/2020	Assessment	< 0.02 U1	61.3	21.1	0.40	6.9	17.1	322
2/02/2021	Assessment	< 0.02 U1	57.2	20.6	0.41	7.0	16.7	319
5/26/2021	Assessment	0.015 J1	70.0	20.6	0.42	7.9	16.9	310
11/09/2021	Assessment	0.016 J1	58.6	19.4	0.39	6.5	15.6	300
2/16/2022	Assessment	0.015 J1	56.4	20.3	0.40	7.3	18.0	350
5/11/2022	Assessment	0.014 J1	60.0	22.1	0.40	7.3	17.3	320 L1
11/02/2022	Assessment	0.017 J1	56.3	21.0	0.38	6.7	16.4	310
2/08/2023	Assessment	0.015 J1	57.6	20.9	0.37	7.8	15.6	330
6/01/2023	Assessment	0.013 J1	53.9	--	--	7.2	--	--
8/16/2023	Assessment	--	--	22.4	0.36	7.2	16.6	330
10/31/2023	Assessment	0.014 J1	53.2	21.4	0.39	6.7	15.4	320
3/06/2024	Assessment	--	--	--	0.35	7.2	--	--
5/15/2024	Assessment	0.07 J1	275	22.2	0.27	7.2	17.9	320
11/14/2024	Assessment	0.013 J1	57	21.6	0.44	7.2	15.5	310
2/04/2025	Assessment	--	--	--	0.41	7.7	--	--
5/13/2025	Assessment	< 0.04 U1	60.6	23.3	0.35	6.9	16.4	310 S7
11/04/2025	Assessment	0.015 J1	56.8	23.7	0.43	7.0	15.4	290

Table 1. Groundwater Data Summary: MW-1701S
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
2/08/2018	Assessment	0.14	0.39	9.51	< 0.004 U1	0.03	0.256	0.198	0.356	0.36	0.176	0.007	< 0.002 U1	0.85	0.4	0.03 J1
6/04/2018	Assessment	0.07	0.38	5.20	< 0.004 U1	0.009 J1	0.05 J1	0.087	1.053	0.38	0.023	0.009	< 0.002 U1	0.68	0.6	0.01 J1
8/14/2018	Assessment	0.04 J1	0.37	9.34	< 0.004 U1	0.008 J1	0.065	0.092	0.3729	0.36	0.028	0.002	--	0.69	0.4	0.02 J1
9/25/2018	Assessment	0.12	0.38	8.55	< 0.004 U1	0.008 J1	0.03 J1	0.096	1.02	0.37	0.021	0.002	--	0.69	0.4	< 0.01 U1
10/29/2018	Assessment	0.07 J1	0.39	13.2	< 0.02 U1	0.02 J1	0.1 J1	0.091	0.1291	0.38	0.06 J1	< 0.009 U1	--	0.7 J1	0.4	< 0.1 U1
11/12/2018	Assessment	0.08 J1	0.37	8.20	< 0.02 U1	0.01 J1	0.2 J1	0.092	0.2239	0.39	0.05 J1	< 0.009 U1	--	0.7 J1	0.4	< 0.1 U1
5/20/2019	Assessment	0.06 J1	0.41	18.7	< 0.02 U1	0.04 J1	0.2 J1	0.053	0.0249	0.42	0.06 J1	< 0.009 U1	< 0.002 U1	0.7 J1	0.3	< 0.1 U1
6/25/2019	Assessment	< 0.1 U1	0.4 J1	8.08	< 0.1 U1	< 0.05 U1	< 0.2 U1	0.2 J1	0.931	0.37	< 0.1 U1	0.01 J1	< 0.002 U1	< 2 U1	0.5 J1	< 0.5 U1
9/09/2019	Assessment	0.16	0.38	16.8	< 0.02 U1	< 0.01 U1	0.1 J1	0.073	0.327	0.37	< 0.05 U1	0.00556	< 0.002 U1	0.7 J1	0.3	< 0.1 U1
3/10/2020	Assessment	0.03 J1	0.41	11.4	< 0.02 U1	0.02 J1	0.2 J1	0.087	0.597	0.39	< 0.05 U1	0.00537	< 0.002 U1	0.7 J1	0.3	< 0.1 U1
5/21/2020	Assessment	0.05 J1	0.39	10.4	< 0.02 U1	0.01 J1	0.1 J1	0.075	0.472	0.41	< 0.05 U1	0.00499	< 0.002 U1	0.6 J1	0.3	< 0.1 U1
11/17/2020	Assessment	0.04 J1	0.41	12.3	< 0.02 U1	0.01 J1	0.504	0.080	1.675	0.40	< 0.05 U1	0.00508	< 0.002 U1	0.7 J1	0.3	< 0.1 U1
2/02/2021	Assessment	0.05 J1	0.42	8.12	< 0.02 U1	0.01 J1	0.310	0.087	0.447	0.41	< 0.05 U1	0.00490	< 0.002 U1	0.7 J1	0.3	< 0.1 U1
5/26/2021	Assessment	0.15	0.40	13.1	< 0.007 U1	0.04	0.09 J1	0.229	0.98	0.42	0.06 J1	0.00499	< 0.002 U1	0.7	0.48 J1	< 0.04 U1
11/09/2021	Assessment	0.03 J1	0.38	11.7	< 0.007 U1	0.011 J1	0.23	0.111	0.62	0.39	< 0.05 U1	0.00507	< 0.002 U1	0.7	0.40 J1	< 0.04 U1
2/16/2022	Assessment	0.06 J1	0.40	10.0	< 0.007 U1	0.012 J1	0.59	0.085	0.77	0.40	< 0.05 U1	0.00446	< 0.002 U1	0.7	0.47 J1	< 0.04 U1
5/11/2022	Assessment	0.08 J1	0.45	12.1	< 0.007 U1	0.012 J1	0.28	0.056	1.23	0.40	< 0.05 U1	0.00456	< 0.002 U1	0.7	0.52	< 0.04 U1
11/02/2022	Assessment	0.02 J1	0.36	10.9	< 0.007 U1	0.009 J1	0.24	0.049	0.71	0.38	< 0.05 U1	0.00517	< 0.002 U1	0.7	0.56	< 0.04 U1
2/08/2023	Assessment	0.02 J1	0.39	8.17	< 0.007 U1	0.011 J1	0.25	0.074	0.75	0.37	0.25	0.00517	< 0.002 U1	0.7	0.46 J1	< 0.04 U1
6/01/2023	Assessment	0.051 J1	0.35	11.3	< 0.007 U1	0.008 J1	0.20 J1	0.089	0.48	--	< 0.05 U1	0.00481	< 0.002 U1	0.7	0.38 J1	< 0.02 U1
8/16/2023	Assessment	--	--	--	--	--	--	--	--	0.36	--	--	--	--	--	--
10/31/2023	Assessment	0.034 J1	0.35	10.5	< 0.007 U1	0.025	0.29 J1	0.130	0.63	0.39	< 0.05 U1	0.00489	< 0.002 U1	0.7	0.41 J1	< 0.02 U1
3/06/2024	Assessment	0.041 J1	0.35	8.72	< 0.007 U1	0.015 J1	0.36	0.075	0.91	0.35	< 0.05 U1	0.00475	< 0.002 U1	0.7	0.42 J1	< 0.02 U1
5/15/2024	Assessment	0.11 J1	1.7	44.4	< 0.04 U1	0.04 J1	1.6	0.36	0.57	0.27	< 0.3 U1	0.0211	< 0.002 U1	3.4	2.3 J1	< 0.1 U1
11/14/2024	Assessment	0.073 J1	0.33	8.44	< 0.007 U1	0.04	0.36	0.082	1.29	0.44	< 0.05 U1	0.0047	< 0.002 U1	0.7	0.41 J1	< 0.02 U1
2/04/2025	Assessment	0.08 J1	0.5	6.8	< 0.04 U1	0.07 J1	< 0.4 U1	0.09 J1	0.51	0.41	< 0.3 U1	0.0054	< 0.002 U1	0.7 J1	0.6 J1	< 0.1 U1
5/13/2025	Assessment	0.06 J1	0.4 J1	6.4	< 0.04 U1	< 0.02 U1	0.4 J1	< 0.03 U1	0.43	0.35	< 0.3 U1	0.0052	< 0.002 U1	0.8 J1	0.6 J1	< 0.1 U1
11/04/2025	Assessment	0.07 J1	0.43	14.6	< 0.02 U1	0.041	0.32	0.17	0.76	0.43	0.13 J1	0.00535	< 0.002 U1	0.78	0.33 J1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1702D
Rockport - BAP
Appendix III Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
12/12/2017	Detection	0.105	74.3	30.3	0.19	7.2	39.9	362
2/09/2018	Assessment	0.042	76.1	30.5	0.19	8.0	41.3	386
6/04/2018	Assessment	0.024	78.5	31.6	0.24	7.1	39.9	372
8/14/2018	Assessment	0.071	80.7	30.7	0.20	6.8	38.1	379
9/26/2018	Assessment	0.096	80.0	31.2	0.20	7.1	37.8	392
10/30/2018	Assessment	0.06 J1	87.2	30.9	0.200	8.2	37.3	394
11/12/2018	Assessment	0.06 J1	89.8	31.5	0.21	7.4	37.3	374
5/20/2019	Assessment	0.02 J1	78.7	30.5	0.18	7.0	38.9	402
6/26/2019	Assessment	0.02 J1	80.0	30.4	0.17	7.6	39.0	388
9/10/2019	Assessment	< 0.02 U1	86.6	30.6	0.20	7.1	37.9	384
3/09/2020	Assessment	--	--	--	0.19	7.0	--	--
5/21/2020	Assessment	< 0.02 U1	88.2	31.5	0.22	7.1	39.2	393
11/17/2020	Assessment	< 0.02 U1	86.5	30.6	0.20	6.8	37.0	384
2/02/2021	Assessment	< 0.02 U1	79.2	30.5	0.22	6.8	37.4	396
5/27/2021	Assessment	0.017 J1	83.3	30.8	0.22	7.7	37.6	400
11/09/2021	Assessment	0.015 J1	79.1	30.3	0.20	6.7	35.0	390
2/16/2022	Assessment	0.017 J1	80.7	30.8	0.19	6.9	38.0	390
5/10/2022	Assessment	0.019 J1	84.1	31.6	0.19	7.1	39.8	390 L1
11/03/2022	Assessment	0.050	76.8	31.1	0.19	7.1	39.1	370
2/07/2023	Assessment	0.017 J1	72.0	30.9	0.19	7.4	38.3	390
6/01/2023	Assessment	0.017 J1	71.4	--	--	5.7	--	--
6/05/2023	Assessment	--	--	30.3	0.18	7.3	45.9	400
10/31/2023	Assessment	0.022 J1	74.5	30.8	0.20	6.6	40.9	390
3/07/2024	Assessment	--	--	--	0.19	7.0	--	--
5/16/2024	Assessment	0.015 J1	73.0 M1	31.2	0.23	6.8	41.8	380
11/14/2024	Assessment	0.017 J1	79	31.0	0.23	6.9	40.3	390
2/05/2025	Assessment	--	--	--	0.22	7.2	--	--
5/13/2025	Assessment	0.022 J1	46.7	24.0	0.17	6.8	87.8	400
11/05/2025	Assessment	0.024 J1	61.5	28.4	0.20	7.0	68.6	400

Table 1. Groundwater Data Summary: MW-1702D
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
2/09/2018	Assessment	0.25	22.5	212	< 0.004 U1	0.02 J1	0.389	0.877	0.977	0.19	0.27	0.007	< 0.002 U1	5.91	0.09 J1	0.03 J1
6/04/2018	Assessment	0.18	25.2	208	0.005 J1	0.02	0.105	0.698	1.345	0.24	0.052	0.009	< 0.002 U1	4.18	< 0.03 U1	0.02 J1
8/14/2018	Assessment	0.15	21.3	191	< 0.004 U1	0.02 J1	0.091	0.590	0.949	0.20	0.026	0.002	--	3.68	< 0.03 U1	0.03 J1
9/26/2018	Assessment	0.18	22.0	211	< 0.004 U1	0.01 J1	0.069	0.564	1.084	0.20	0.230	0.008	--	3.38	< 0.03 U1	0.02 J1
10/30/2018	Assessment	0.1	22.5	204	< 0.02 U1	0.01 J1	0.08 J1	0.581	0.784	0.200	0.02 J1	< 0.009 U1	--	2.77	0.03 J1	< 0.1 U1
11/12/2018	Assessment	0.08 J1	20.2	199	< 0.02 U1	0.02 J1	0.1 J1	0.498	1.167	0.21	0.03 J1	< 0.009 U1	--	2.53	< 0.03 U1	< 0.1 U1
5/20/2019	Assessment	0.08 J1	25.6	223	< 0.02 U1	0.02 J1	0.1 J1	0.686	1.207	0.18	0.04 J1	< 0.009 U1	< 0.002 U1	2.43	< 0.03 U1	< 0.1 U1
6/26/2019	Assessment	0.07 J1	24.4	209	< 0.02 U1	0.02 J1	0.08 J1	0.601	0.689	0.17	0.07 J1	0.02 J1	< 0.002 U1	2.15	0.03 J1	< 0.1 U1
9/10/2019	Assessment	0.04 J1	22.1	203	< 0.02 U1	< 0.01 U1	0.1 J1	0.536	0.639	0.20	< 0.05 U1	0.00456	< 0.002 U1	2.16	< 0.03 U1	< 0.1 U1
3/09/2020	Assessment	0.02 J1	21.2	207	< 0.02 U1	0.02 J1	0.07 J1	0.534	1.102	0.19	< 0.05 U1	0.00430	< 0.002 U1	2 J1	0.04 J1	< 0.1 U1
5/21/2020	Assessment	0.08 J1	20.3	199	< 0.02 U1	0.04 J1	0.2 J1	0.517	1.047	0.22	< 0.05 U1	0.00398	< 0.002 U1	2 J1	0.07 J1	< 0.1 U1
11/17/2020	Assessment	0.05 J1	21.0	206	< 0.02 U1	< 0.01 U1	0.2 J1	0.519	1.100	0.20	< 0.05 U1	0.00416	< 0.002 U1	2 J1	0.03 J1	< 0.1 U1
2/02/2021	Assessment	0.08 J1	25.6	202	< 0.02 U1	0.02 J1	0.2 J1	0.574	1.0318	0.22	0.06 J1	0.00409	< 0.002 U1	2.00	0.05 J1	< 0.1 U1
5/27/2021	Assessment	0.08 J1	29.8	209 P3	< 0.007 U1	0.016 J1	0.36	0.607	1.45	0.22	0.07 J1	0.00407	< 0.002 U1	2.1	< 0.09 U1	< 0.04 U1
11/09/2021	Assessment	0.03 J1	35.9	204	< 0.007 U1	0.007 J1	0.29	0.534	2.42	0.20	0.09 J1	0.00417	< 0.002 U1	1.9	< 0.09 U1	< 0.04 U1
2/16/2022	Assessment	0.13	22.9	195	< 0.007 U1	0.047	0.40	0.551	1.02	0.19	0.06 J1	0.00396	< 0.002 U1	1.9	< 0.09 U1	< 0.04 U1
5/10/2022	Assessment	0.07 J1	26.6	188	< 0.007 U1	0.014 J1	0.24	0.537	1.09	0.19	0.12 J1	0.00366	< 0.002 U1	2.0	< 0.09 U1	< 0.04 U1
11/03/2022	Assessment	0.10	36.2	209	0.050	0.082	0.28	0.642	0.45	0.19	0.22	0.00441	0.005	1.9	0.50	0.20
2/07/2023	Assessment	0.05 J1	36.9	197	< 0.007 U1	0.023	0.29	0.671	0.97	0.19	0.22	0.00443	< 0.002 U1	1.9	< 0.09 U1	< 0.04 U1
6/01/2023	Assessment	0.077 J1	26.2	187	0.011 J1	0.074	0.32	0.587	0.93	--	0.28	0.00414	< 0.002 U1	1.9	0.14 J1	< 0.02 U1
6/05/2023	Assessment	--	--	--	--	--	--	--	--	0.18	--	--	--	--	--	--
10/31/2023	Assessment	0.090 J1	43.1	206	0.014 J1	0.019 J1	0.33	0.832	2.12	0.20	0.50	0.00423	< 0.002 U1	1.8	0.16 J1	0.02 J1
3/07/2024	Assessment	0.126	63.2	230	0.020 J1	0.045	0.39	1.75	1.41	0.19	0.66	0.00440	< 0.002 U1	2.1	0.10 J1	0.03 J1
5/16/2024	Assessment	0.114	33.8	196	0.009 J1	0.169	0.73	0.720	1.12	0.23	0.31	0.00405	< 0.002 U1	2.1	0.07 J1	< 0.02 U1
11/14/2024	Assessment	0.100	25.0	200	0.011 J1	0.02	0.37	0.505	3.12	0.23	0.86	0.00365	< 0.002 U1	1.9	0.13 J1	< 0.02 U1
2/05/2025	Assessment	0.054 J1	19.6	189	< 0.007 U1	0.016 J1	0.28 J1	0.472	1.44	0.22	0.21	0.00431	< 0.002 U1	2.0	< 0.04 U1	< 0.02 U1
5/13/2025	Assessment	0.223	20.2	126	0.012 J1	0.025	0.39	0.506	0.89	0.17	0.29	0.00422	< 0.002 U1	2.1	0.26 J1	< 0.02 U1
11/05/2025	Assessment	0.15	25.8	165	< 0.02 U1	0.019 J1	0.41	0.60	0.91	0.20	0.13 J1	0.00450	< 0.002 U1	2.08	0.23 J1	< 0.02 U1

Table 1. Groundwater Data Summary: MW-1702I

Geosyntec Consultants, Inc.

Rockport - BAP

Appendix III Constituents

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
12/12/2017	Detection	0.037	76.2	27.1	0.20	7.2	45.4	376
2/09/2018	Assessment	0.045	72.7	27.6	0.22	7.8	46.6	377
6/04/2018	Assessment	0.081	76.2	28.7	0.24	7.1	43.4	760
8/13/2018	Assessment	0.051	81.1	29.0	0.22	6.6	41.5	382
9/25/2018	Assessment	0.056	78.9	29.8	0.23	6.8	41.9	398
10/30/2018	Assessment	0.07 J1	81.7	29.2	0.23	7.8	41.9	392
11/12/2018	Assessment	0.07 J1	82.7	29.9	0.24	6.8	41.9	364
5/20/2019	Assessment	0.02 J1	73.2	28.8	0.21	6.9	44.5	376
6/25/2019	Assessment	0.02 J1	74.7	28.5	0.20	7.3	44.7	376
9/10/2019	Assessment	< 0.02 U1	80.2	28.9	0.24	7.1	43.6	384
3/09/2020	Assessment	--	--	--	--	7.1	--	--
3/11/2020	Assessment	--	--	--	0.22	--	--	--
5/21/2020	Assessment	< 0.02 U1	83.3	29.7	0.25	7.1	44.1	376
11/17/2020	Assessment	< 0.02 U1	76.5	29.0	0.23	6.8	41.6	394
2/02/2021	Assessment	< 0.02 U1	74.2	28.7	0.25	6.7	41.8	389
5/27/2021	Assessment	0.014 J1	78.5	28.2	0.25	7.8	41.8	380
11/09/2021	Assessment	0.014 J1	72.7	28.9	0.24	6.6	40.0	380
2/16/2022	Assessment	0.015 J1	76.4	28.7	0.23	7.1	42.9	390
5/10/2022	Assessment	0.016 J1	87.1	28.6	0.23	7.1	44.9	390 L1
11/03/2022	Assessment	0.050	69.2 M1	28.9	0.23	7.3	44.2	370
2/07/2023	Assessment	0.017 J1	66.7	27.5	0.23	7.5	42.9	390
6/01/2023	Assessment	0.014 J1	67.0	--	--	7.2	--	--
6/06/2023	Assessment	--	--	28.6	0.23	6.8	43.0	360
10/31/2023	Assessment	0.019 J1	68.2	29.5	0.24	6.6	41.6	400
3/07/2024	Assessment	--	--	--	0.22	7.0	--	--
5/16/2024	Assessment	0.015 J1	68.2	30.3	0.28	7.0	42.9	370
11/15/2024	Assessment	0.014 J1	70	30.6	0.22	6.9	39.1	340
2/05/2025	Assessment	--	--	--	0.27	7.3	--	--
5/14/2025	Assessment	0.014 J1	70.3	32.3	0.23	6.9	42.5	370
11/06/2025	Assessment	0.017 J1	73.2	32.4	0.27	7.0	41.8	370

Table 1. Groundwater Data Summary: MW-1702I
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
2/09/2018	Assessment	0.05 J1	42.3	109	0.007 J1	0.01 J1	1.49	2.15	1.324	0.22	0.337	0.004	< 0.002 U1	7.9	0.1	0.04 J1
6/04/2018	Assessment	0.07	28.1	109	0.007 J1	0.06	0.129	1.29	1.969	0.24	0.247	0.009	< 0.002 U1	1.91	0.08 J1	0.054
8/13/2018	Assessment	0.10	28.9	102	0.004 J1	0.02 J1	0.146	1.35	1.243	0.22	0.074	0.002	--	1.89	0.05 J1	0.102
9/25/2018	Assessment	0.44	39.6	114	< 0.004 U1	0.01 J1	0.050	1.70	0.3854	0.23	0.087	0.003	--	2.04	0.04 J1	0.05 J1
10/30/2018	Assessment	0.14	43.0	113	< 0.02 U1	0.22	0.1 J1	1.57	1.364	0.23	0.129	< 0.009 U1	--	2 J1	0.05 J1	< 0.1 U1
11/12/2018	Assessment	0.18	37.3	109	< 0.02 U1	0.05	0.1 J1	1.52	0.746	0.24	0.09 J1	< 0.009 U1	--	2 J1	0.04 J1	< 0.1 U1
5/20/2019	Assessment	0.07 J1	49.5	115	< 0.02 U1	0.01 J1	0.05 J1	1.43	1.519	0.21	0.05 J1	< 0.009 U1	< 0.002 U1	2 J1	0.05 J1	< 0.1 U1
6/25/2019	Assessment	0.07 J1	54.1	114	< 0.02 U1	0.02 J1	0.07 J1	1.78	0.467	0.20	0.1 J1	0.02 J1	< 0.002 U1	2 J1	0.07 J1	< 0.1 U1
9/10/2019	Assessment	0.08 J1	55.8	112	< 0.02 U1	< 0.01 U1	0.1 J1	1.60	0.584	0.24	0.06 J1	0.00469	< 0.002 U1	2.03	< 0.03 U1	< 0.1 U1
3/09/2020	Assessment	0.12	67.5	121	< 0.02 U1	0.13	0.852	3.15	1.081	--	0.678	0.00453	< 0.002 U1	2 J1	0.1 J1	< 0.1 U1
3/11/2020	Assessment	--	--	--	--	--	--	--	--	0.22	--	--	--	--	--	--
5/21/2020	Assessment	0.08 J1	38.7	108	< 0.02 U1	0.02 J1	0.2 J1	1.53	1.589	0.25	0.1 J1	0.00415	< 0.002 U1	2 J1	0.06 J1	< 0.1 U1
11/17/2020	Assessment	0.12	65.4	113	< 0.02 U1	0.05	0.204	1.66	1.671	0.23	0.1 J1	0.00429	< 0.002 U1	2 J1	< 0.03 U1	< 0.1 U1
2/02/2021	Assessment	0.13	72.7	115	< 0.02 U1	0.02 J1	0.205	1.60	1.535	0.25	0.05 J1	0.00425	< 0.002 U1	2 J1	0.05 J1	< 0.1 U1
5/27/2021	Assessment	0.08 J1	50.4	110	< 0.007 U1	0.008 J1	0.13 J1	1.42	0.88	0.25	< 0.05 U1	0.00422	< 0.002 U1	1.8	< 0.09 U1	< 0.04 U1
11/09/2021	Assessment	0.06 J1	54.4	110	< 0.007 U1	0.006 J1	0.22	1.54	1.35	0.24	< 0.05 U1	0.00426	< 0.002 U1	1.9	< 0.09 U1	< 0.04 U1
2/16/2022	Assessment	0.10	75.4	116	< 0.007 U1	0.014 J1	0.33	1.70	1.64	0.23	0.05 J1	0.00412	< 0.002 U1	2.0	< 0.09 U1	< 0.04 U1
5/10/2022	Assessment	0.12	57.1	110	< 0.007 U1	0.013 J1	0.26	1.26	1.56	0.23	0.07 J1	0.00390	< 0.002 U1	2.0	< 0.09 U1	< 0.04 U1
11/03/2022	Assessment	0.10	79.1	114	0.050	0.020	0.36	1.75	1.36	0.23	0.20	0.00449	0.005	1.8	0.50	0.20
2/07/2023	Assessment	0.07 J1	61.0	108	< 0.007 U1	0.021	0.28	1.84	1.36	0.23	< 0.05 U1	0.00451	< 0.002 U1	1.9	< 0.09 U1	< 0.04 U1
6/01/2023	Assessment	0.089 J1	76.1	106	< 0.007 U1	0.013 J1	0.19 J1	1.52	1.22	--	0.08 J1	0.00412	< 0.002 U1	1.9	0.06 J1	0.03 J1
6/06/2023	Assessment	--	--	--	--	--	--	--	--	0.23	--	--	--	--	--	--
10/31/2023	Assessment	0.075 J1	66.0	110	< 0.007 U1	0.015 J1	0.25 J1	1.95	1.72	0.24	0.07 J1	0.00424	< 0.002 U1	1.9	0.06 J1	0.04 J1
3/07/2024	Assessment	0.171	73.3	114	< 0.007 U1	0.018 J1	0.23 J1	1.64	1.25	0.22	0.06 J1	0.00446	< 0.002 U1	2.0	< 0.04 U1	0.03 J1
5/16/2024	Assessment	0.067 J1	41.0	106	< 0.007 U1	0.065	0.47	1.35	1.12	0.28	< 0.05 U1	0.00435	< 0.002 U1	2.0	< 0.04 U1	0.03 J1
11/15/2024	Assessment	0.058 J1	52.8	106	< 0.007 U1	0.013 J1	0.33	1.31 B1	1.18	0.22	0.05 J1	0.00391	< 0.002 U1	1.9	< 0.04 U1	0.03 J1
2/05/2025	Assessment	0.117	58.3	109	< 0.007 U1	0.071	0.34	1.39	2.11	0.27	0.06 J1	0.00436	< 0.002 U1	2.1	< 0.04 U1	0.03 J1
5/14/2025	Assessment	0.070 J1	34.1	102	< 0.007 U1	0.107	0.22 J1	1.21	1.04	0.23	< 0.05 U1	0.00416	< 0.002 U1	2.1	< 0.04 U1	0.03 J1
11/06/2025	Assessment	0.06 J1	45.3	113	< 0.02 U1	0.016 J1	0.39	1.86	1.00	0.27	< 0.05 U1	0.00431	< 0.002 U1	2.02	0.04 J1	0.03 J1

Table 1. Groundwater Data Summary: MW-1702S

Geosyntec Consultants, Inc.

Rockport - BAP

Appendix III Constituents

Collection Date	Monitoring Program	Boron	Calcium	Chloride	Fluoride	pH	Sulfate	Total Dissolved Solids
		mg/L	mg/L	mg/L	mg/L	S.U.	mg/L	mg/L
12/12/2017	Detection	0.051	33.6	13.4	0.49	7.3	22.7	254
2/09/2018	Assessment	0.042	29.7	14	0.62	7.9	22.2	281
6/04/2018	Assessment	0.059	38.4	14.4	0.57	7.0	26.7	276
8/13/2018	Assessment	0.057	36.9	13.6	0.55	6.3	22.0	272
9/25/2018	Assessment	0.041	36.2	14.1	0.54	6.6	20.7	266
10/30/2018	Assessment	0.09 J1	34.9	14.1	0.61	7.5	17.1	256
11/12/2018	Assessment	0.1 J1	41.5	14.5	0.56	6.8	21.5	246
5/20/2019	Assessment	0.03 J1	27.1	14.7	0.70	6.8	20.8	272
6/25/2019	Assessment	0.04 J1	36.7	14.6	0.59	7.2	22.3	284
9/10/2019	Assessment	0.04 J1	35.6	16.5	0.63	6.7	19.2	284
3/09/2020	Assessment	--	--	--	--	7.2	--	--
3/11/2020	Assessment	--	--	--	0.63	--	--	--
5/21/2020	Assessment	0.03 J1	37.2	14.3	0.67	7.0	23.0	276
11/17/2020	Assessment	0.04 J1	32.7	13.9	0.64	6.5	17.6	259
2/04/2021	Assessment	0.03 J1	33.7	13.5	0.70	7.5	18.1	259
5/27/2021	Assessment	0.032 J1	34.9	13.5	0.64	7.8	18.7	270
11/09/2021	Assessment	0.029 J1	34.6	13.4	0.59	7.1	17.0	260
2/16/2022	Assessment	0.028 J1	34.4	14.2	0.62	7.2	20.6	270
5/10/2022	Assessment	0.017 J1	28.6	13.7	0.68	7.1	19.1	260 L1
11/03/2022	Assessment	0.050	34.9	13.4	0.57	7.1	18.7	250
2/08/2023	Assessment	0.031 J1	34.6	14.5	0.59	7.5	20.7	270
6/01/2023	Assessment	0.023 J1	35.6 M1	14.7	0.54	7.3	20.7	280
10/31/2023	Assessment	0.035 J1	36.5	15.1	0.58	6.7	18.4	290
3/07/2024	Assessment	--	--	--	0.56	7.2	--	--
5/16/2024	Assessment	0.032 J1	37.2	14.8	0.64	7.1	20.0	260
11/15/2024	Assessment	0.034 J1	37	14.3	0.54	6.9	16.5	290
2/05/2025	Assessment	--	--	--	0.60	7.6	--	--
5/14/2025	Assessment	0.032 J1	38.7	18.3	0.56	7.3	23.0	280
11/06/2025	Assessment	0.032 J1	41.1	16.8	0.65	7.2	18.3	280

Table 1. Groundwater Data Summary: MW-1702S
Rockport - BAP
Appendix IV Constituents

Geosyntec Consultants, Inc.

Collection Date	Monitoring Program	Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Combined Radium	Fluoride	Lead	Lithium	Mercury	Molybdenum	Selenium	Thallium
		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	pCi/L	mg/L	µg/L	mg/L	µg/L	µg/L	µg/L	µg/L
2/09/2018	Assessment	0.05 J1	0.72	9.81	< 0.004 U1	0.006 J1	0.212	0.258	0.00483	0.62	0.223	< 0.0002 U1	< 0.002 U1	1.09	1.1	0.01 J1
6/04/2018	Assessment	0.05 J1	0.45	7.67	< 0.004 U1	0.04	0.124	0.07	1.231	0.57	0.077	0.006	< 0.002 U1	1.42	3.8	0.01 J1
8/13/2018	Assessment	0.13	0.47	7.14	0.005 J1	0.05	0.175	0.173	0.1628	0.55	0.188	< 0.0002 U1	--	1.15	1.8	0.03 J1
9/25/2018	Assessment	0.08	0.44	5.97	< 0.004 U1	0.008 J1	0.130	0.104	0.421	0.54	0.079	< 0.0002 U1	--	1.20	1.2	< 0.01 U1
10/30/2018	Assessment	0.05 J1	0.48	5.5	< 0.02 U1	0.11	0.2 J1	0.05 J1	0.0859	0.61	0.08 J1	< 0.009 U1	--	1 J1	1	< 0.1 U1
11/12/2018	Assessment	0.04 J1	0.42	6.27	< 0.02 U1	0.03 J1	0.2 J1	0.272	0.107	0.56	0.229	< 0.009 U1	--	1 J1	1.5	< 0.1 U1
5/20/2019	Assessment	0.09 J1	0.45	5.92	< 0.02 U1	0.28	0.475	0.058	0.56253	0.70	0.373	< 0.009 U1	< 0.002 U1	1 J1	1.5	< 0.1 U1
6/25/2019	Assessment	< 0.1 U1	0.4 J1	5.71	< 0.1 U1	< 0.05 U1	0.2 J1	< 0.1 U1	0.357	0.59	< 0.1 U1	< 0.009 U1	< 0.002 U1	< 2 U1	2.4	< 0.5 U1
9/10/2019	Assessment	0.08 J1	0.43	4.87	< 0.02 U1	0.01 J1	0.215	0.096	0.2432	0.63	0.1 J1	0.00127	< 0.002 U1	1 J1	1.3	< 0.1 U1
3/09/2020	Assessment	0.04 J1	0.42	4.46	< 0.02 U1	0.01 J1	0.335	0.03 J1	1.1358	--	< 0.05 U1	0.00128	< 0.002 U1	1 J1	1.8	< 0.1 U1
3/11/2020	Assessment	--	--	--	--	--	--	--	--	0.63	--	--	--	--	--	--
5/21/2020	Assessment	0.03 J1	0.37	4.79	< 0.02 U1	< 0.01 U1	0.208	< 0.02 U1	1.14	0.67	< 0.05 U1	0.00106	< 0.002 U1	1 J1	1.8	< 0.1 U1
11/17/2020	Assessment	0.07 J1	0.37	4.22	< 0.02 U1	0.05 J1	0.278	0.03 J1	1.17	0.64	< 0.05 U1	0.00116	< 0.002 U1	1 J1	1.3	< 0.1 U1
2/04/2021	Assessment	0.07 J1	0.48	5.59	< 0.02 U1	0.05	0.430	0.348	0.392	0.70	0.350	0.00136	< 0.002 U1	1 J1	2.0	< 0.1 U1
5/27/2021	Assessment	0.07 J1	0.30	4.51	< 0.007 U1	0.019 J1	0.20	0.028	0.55	0.64	< 0.05 U1	0.00142	< 0.002 U1	1.4	2.23	< 0.04 U1
11/09/2021	Assessment	0.02 J1	0.30	4.15	< 0.007 U1	0.017 J1	0.51	0.026	0.62	0.59	< 0.05 U1	0.00152	< 0.002 U1	1.4	1.74	< 0.04 U1
2/16/2022	Assessment	0.04 J1	0.35	3.94	< 0.007 U1	0.118	0.52	0.026	1.47	0.62	< 0.05 U1	0.00152	< 0.002 U1	1.5	2.65	< 0.04 U1
5/10/2022	Assessment	0.09 J1	0.44	4.13	< 0.007 U1	0.014 J1	0.40	0.021	0.71	0.68	< 0.05 U1	0.00099	< 0.002 U1	1.0	1.92	< 0.04 U1
11/03/2022	Assessment	0.10	0.29	3.81	0.050	0.020	0.30	0.020	0.66	0.57	0.20	0.00163	0.005	1.4	2.79	0.20
2/08/2023	Assessment	0.03 J1	0.28	3.97	< 0.007 U1	0.021	0.32	0.028	0.78	0.59	< 0.05 U1	0.00175	< 0.002 U1	1.5	4.37	< 0.04 U1
6/01/2023	Assessment	0.023 J1	0.26	3.89	< 0.007 U1	0.020	0.25 J1	0.020	0.26	0.54	< 0.05 U1	0.00152	< 0.002 U1	1.5	3.87	< 0.02 U1
10/31/2023	Assessment	0.026 J1	0.24	3.93	< 0.007 U1	0.021	0.38	0.022	1.62	0.58	< 0.05 U1	0.00174	< 0.002 U1	1.4	3.00	< 0.02 U1
3/07/2024	Assessment	0.085 J1	0.30	4.28	< 0.007 U1	0.072	0.29 J1	0.034	0.79	0.56	0.07 J1	0.00174	< 0.002 U1	1.4	3.80	< 0.02 U1
5/16/2024	Assessment	0.049 J1	0.26	4.06	< 0.007 U1	0.020	0.36	0.016 J1	1.48	0.64	< 0.05 U1	0.00165	< 0.002 U1	1.5	3.52	0.03 J1
11/15/2024	Assessment	0.09 J1	0.26	4.60	< 0.007 U1	0.047	0.41	0.027 B1	0.52	0.54	< 0.05 U1	0.00153	< 0.002 U1	1.4	1.66	< 0.02 U1
2/05/2025	Assessment	0.096 J1	0.44	4.29	< 0.007 U1	0.050	0.54	0.035	1.01	0.60	0.14 J1	0.00177	< 0.002 U1	1.7	2.24	0.03 J1
5/14/2025	Assessment	0.032 J1	0.27	4.56	< 0.007 U1	0.021	0.28 J1	< 0.005 U1	0.85	0.56	< 0.05 U1	0.00160	< 0.002 U1	1.5	4.26	< 0.02 U1
11/06/2025	Assessment	0.04 J1	0.27	4.43	< 0.02 U1	0.013 J1	0.50	0.14	0.65	0.65	0.26	0.00193	< 0.002 U1	1.96	3.41	< 0.02 U1

Table 1. Groundwater Data Summary
Rockport - BAP

Geosyntec Consultants, Inc.

Notes:

Combined radium values were calculated from the sum of the reported radium-226 and radium-228 results.

Radium data quality flags were not included. Reported negative radium-226 or radium-228 results were replaced with zero.

--: Not analyzed

<: Non-detect value. Analytes which were not detected are shown as less than the method detection limit (MDL) followed by a 'U1' flag. In analytical data prior to 5/18/2021, U1 flags were reported as U in the analytical report.

B1: Analyte detected in method blank (MB) at or above the method criteria.

J1: Concentration estimated. Analyte was detected between the method detection limit and the reporting limit.

In analytical data prior to 5/18/2021, J1 flags were reported as J in the analytical report.

L1: The associated laboratory control sample (LCS) or laboratory control sample duplicate (LCSD) recovery was outside acceptance limits.

M1: The associated matrix spike (MS) or matrix spike duplicate (MSD) recovery was outside acceptance limits.

mg/L: milligrams per liter

P2: The precision on the laboratory control sample duplicate (LCSD) was above acceptance limits.

P3: The precision on the matrix spike duplicate (MSD) was above acceptance limits.


pCi/L: picocuries per liter

S7: Sample did not achieve constant weight.

SU: standard unit

µg/L: micrograms per liter


Groundwater Flow Direction Maps

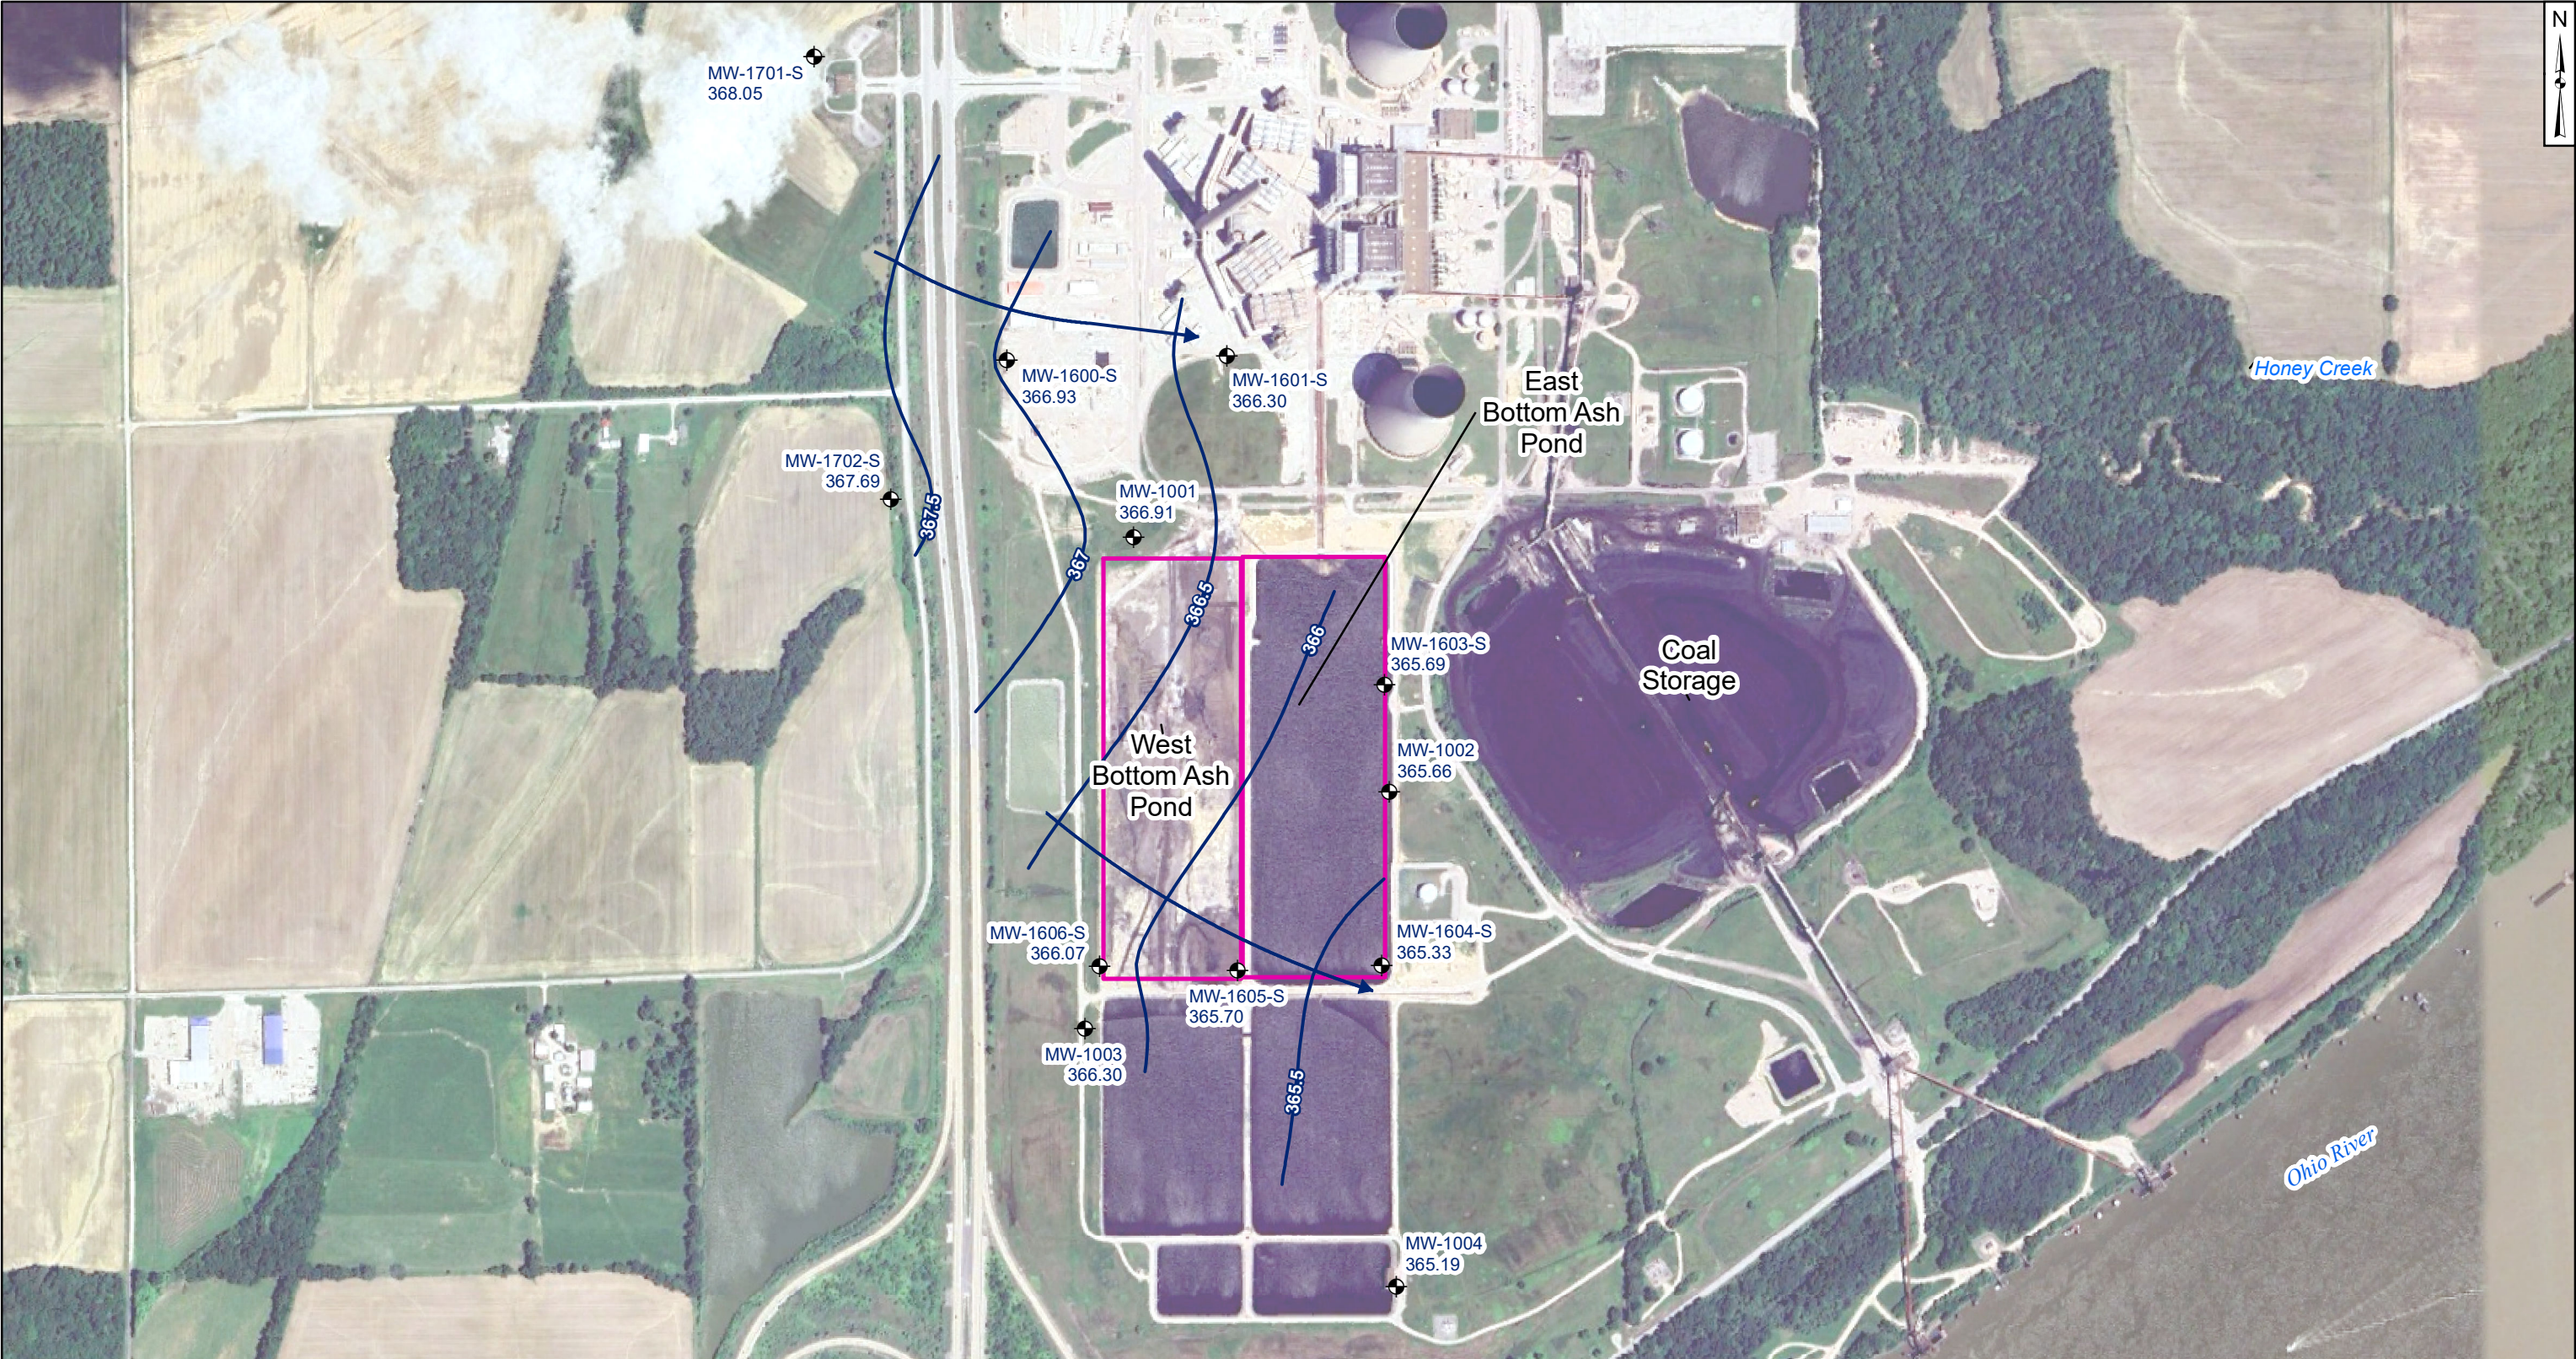


Legend

- Groundwater Monitoring Well
- Approximate Groundwater Flow Direction
- Groundwater Elevation Contour
- Bottom Ash Ponds

- Notes:**
- Monitoring well coordinates and water level data (collected on February 4, 2025) provided by AEP.
 - Site features based on information available in the Groundwater Monitoring Network Evaluation (AMEC 2016) provided by AEP.
 - Only shallow screened wells were used for generating groundwater contours.
 - Groundwater elevation units are feet above mean sea level (ft amsl).
 - Aerial imagery provided by Google Earth (dated May 2024).




Potentiometric Surface Map - Uppermost Aquifer February 2025	
AEP-Rockport Power Plant - Bottom Ash Ponds Rockport, Indiana	
Geosyntec consultants	
Columbus, Ohio	2025/06/30
Figure 1	

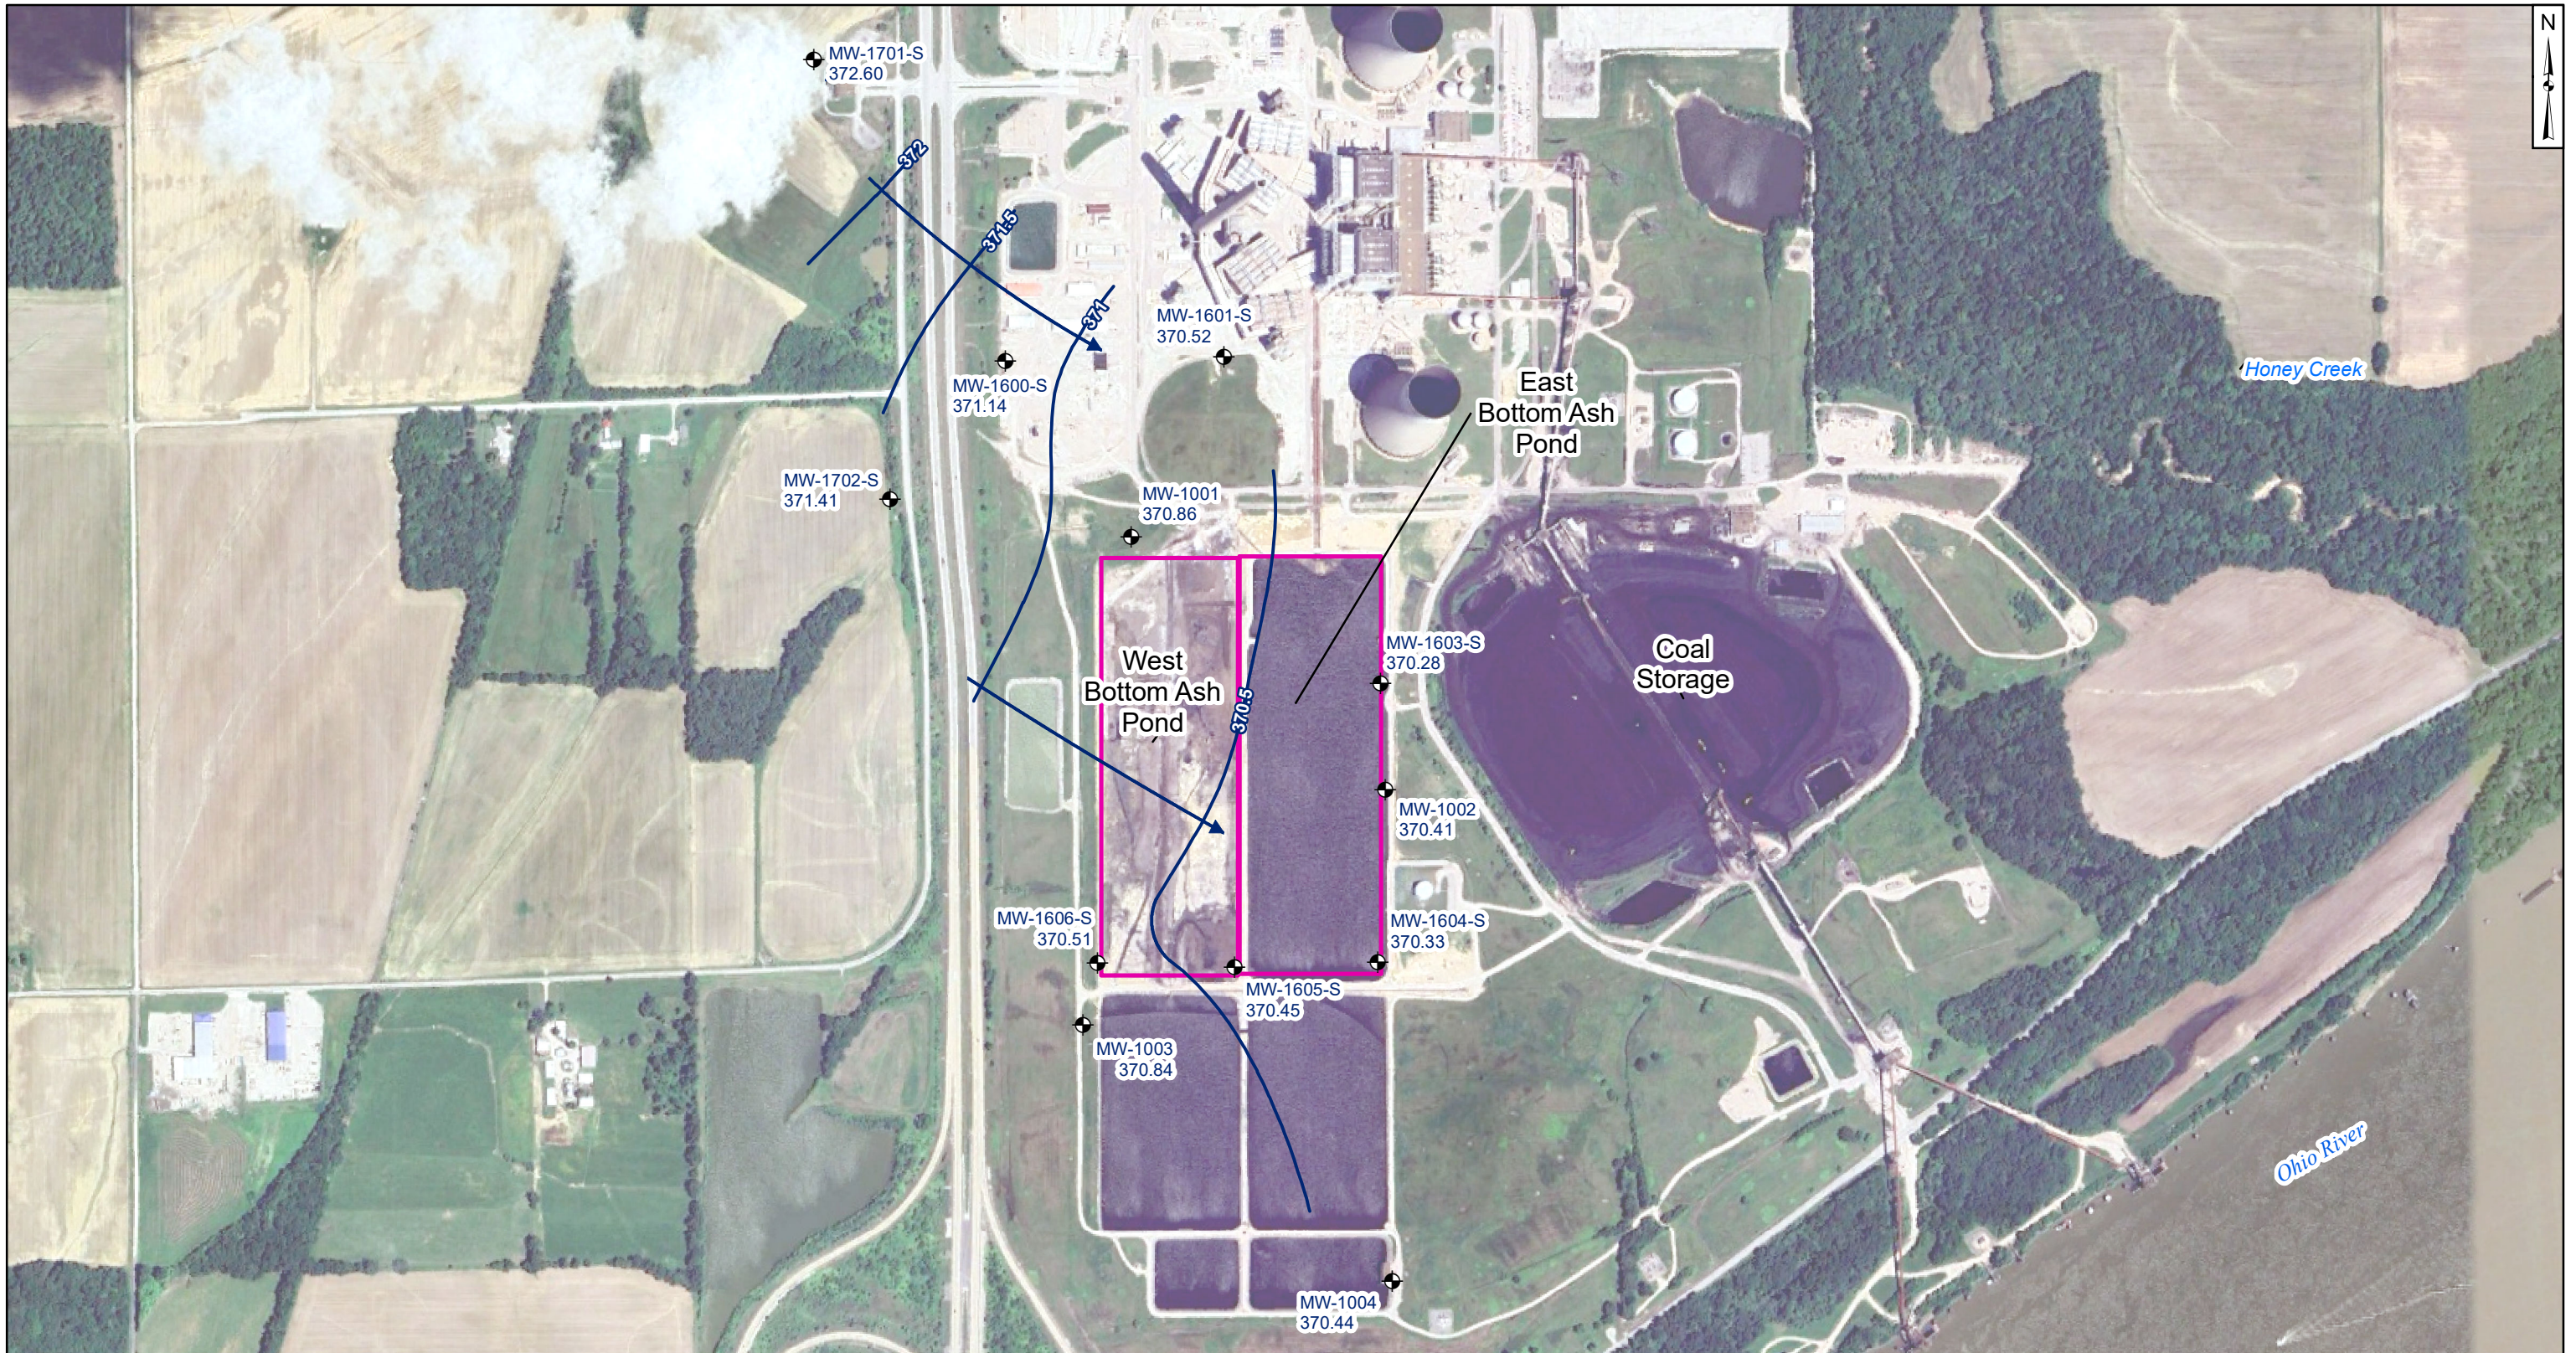


Legend

- Groundwater Monitoring Well
- Approximate Groundwater Flow Direction
- Groundwater Elevation Contour
- Bottom Ash Ponds

- Notes:**
- Monitoring well coordinates and water level data (collected on May 12, 2025) provided by AEP.
 - Site features based on information available in the Groundwater Monitoring Network Evaluation (AMEC 2016) provided by AEP.
 - Only shallow screened wells were used for generating groundwater contours.
 - Groundwater elevation units are feet above mean sea level (ft amsl).
 - Aerial imagery provided by Google Earth (dated May 2024).



Potentiometric Surface Map - Uppermost Aquifer May 2025	
AEP-Rockport Power Plant - Bottom Ash Ponds Rockport, Indiana	
Geosyntec consultants	
Columbus, Ohio	2025/06/27
Figure 2	

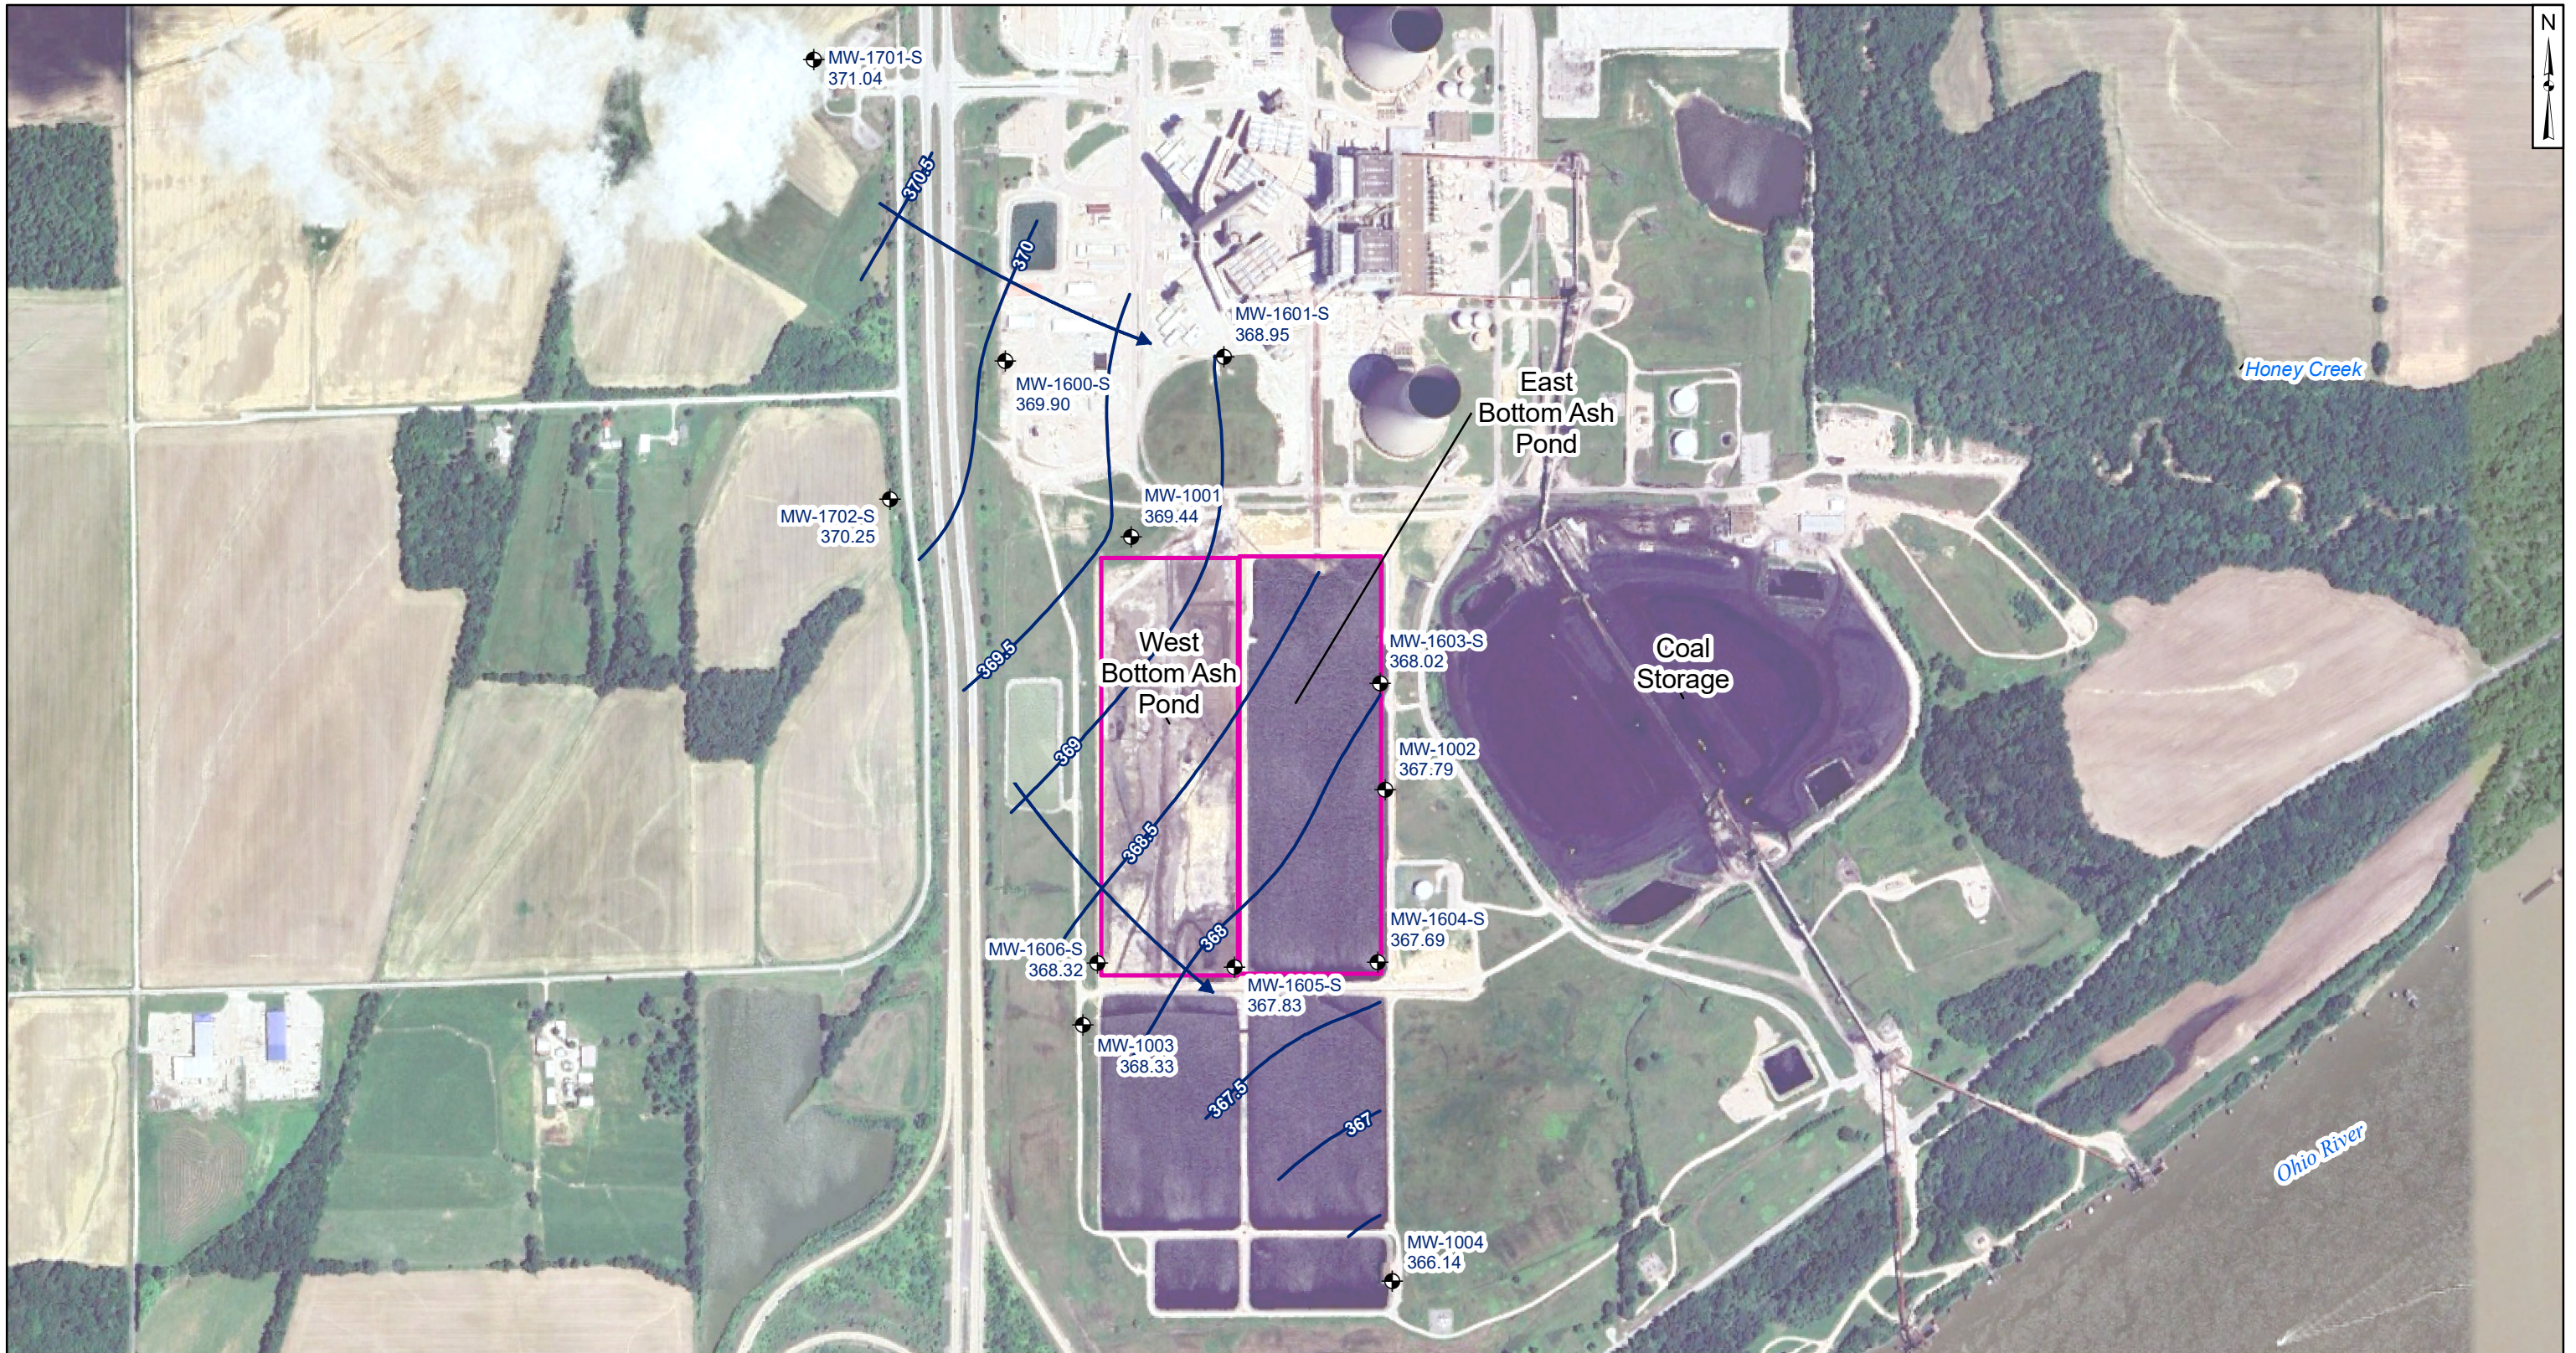

Legend - Groundwater Monitoring Well - Rockport_BAP_Contours_Nov2025 - Approximate Groundwater Flow Direction - Groundwater Elevation Contour - Bottom Ash Ponds	Notes: - Monitoring well coordinates and water level data (collected on November 3, 2025) provided by AEP. - Site features based on information available in the Groundwater Monitoring Network Evaluation (AMEC 2016) provided by AEP. - Only shallow screened wells were used for generating groundwater contours. - Groundwater elevation units are feet above mean sea level (ft amsl). - Aerial imagery provided by Google Earth (dated May 2024).	Potentiometric Surface Map - Uppermost Aquifer November 2025 AEP-Rockport Power Plant - Bottom Ash Ponds Rockport, Indiana	
		Columbus, Ohio	

Groundwater Flow Velocity Calculations

Table 1: Residence Time Calculation Summary
Rockport - Bottom Ash Ponds

Geosyntec Consultants, Inc.

CCR Management Unit	Monitoring Well	Well Diameter (inches)	2025-02		2025-05		2025-11	
			Groundwater Velocity (ft/year)	Groundwater Residence Time (days)	Groundwater Velocity (ft/year)	Groundwater Residence Time (days)	Groundwater Velocity (ft/year)	Groundwater Residence Time (days)
Bottom Ash Ponds	MW-1600D ^[1]	2.0	577	0.11	743	0.08	581	0.10
	MW-1600I ^[1]	2.0	470	0.13	610	0.10	489	0.12
	MW-1600S ^[1]	2.0	609	0.10	535	0.11	459	0.13
	MW-1601D ^[1]	2.0	185	0.33	127	0.48	437	0.14
	MW-1601I ^[1]	2.0	292	0.21	274	0.22	488	0.12
	MW-1601S ^[1]	2.0	417	0.15	470	0.13	596	0.10
	MW-1002 ^[2]	2.0	326	0.19	184	0.33	539	0.11
	MW-1602D ^[2]	2.0	509	0.12	209	0.29	646	0.09
	MW-1602I ^[2]	2.0	461	0.13	205	0.30	562	0.11
	MW-1603D ^[2]	2.0	667	0.09	278	0.22	874	0.07
	MW-1603I ^[2]	2.0	440	0.14	253	0.24	567	0.11
	MW-1603S ^[2]	2.0	470	0.13	253	0.24	567	0.11
	MW-1604D ^[2]	2.0	465	0.13	166	0.37	704	0.09
	MW-1604I ^[2]	2.0	381	0.16	135	0.45	629	0.10
	MW-1604S ^[2]	2.0	359	0.17	135	0.45	287	0.21
	MW-1605D ^[2]	2.0	76	0.80	86	0.71	56	1.09
	MW-1605I ^[2]	2.0	483	0.13	225	0.27	504	0.12
	MW-1605S ^[2]	2.0	381	0.16	196	0.31	476	0.13
	MW-1606D ^[2]	2.0	414	0.15	210	0.29	373	0.16
	MW-1606I ^[2]	2.0	414	0.15	190	0.32	287	0.21
	MW-1606S ^[2]	2.0	223	0.27	244	0.25	516	0.12

Notes:

[1] - Upgradient Well

[2] - Downgradient Well

APPENDIX 2 – Statistical Analyses

The memorandums summarizing the statistical evaluation follow.

STATISTICAL ANALYSIS SUMMARY 2024 2ND SEMIANNUAL EVENT EAST AND WEST BOTTOM ASH PONDS

Rockport Plant
Rockport, Indiana

Prepared for

American Electric Power
1 Riverside Plaza
Columbus, Ohio 43215-2372

Prepared by

Geosyntec Consultants, Inc.
500 West Wilson Bridge Road, Suite 250
Worthington, Ohio 43085

Project Number: CHA8500B

March 2025

TABLE OF CONTENTS

1. INTRODUCTION	1
2. BOTTOM ASH POND EVALUATION.....	2
2.1 Data Validation and QA/QC	2
2.2 Statistical Analysis	2
2.2.1 Establishment of GWPSs	2
2.2.2 Evaluation of Potential Appendix IV SSLs.....	3
2.2.3 Updating Appendix III Prediction Limits	3
2.2.4 Evaluation of Potential Appendix III SSIs	4
2.3 Conclusions	5
3. REFERENCES	6

LIST OF TABLES

Table 1:	Groundwater Data Summary
Table 2:	Appendix IV Groundwater Protection Standards
Table 3:	Appendix III Data Summary

LIST OF ATTACHMENTS

Attachment A:	Certification by Qualified Professional Engineer
Attachment B:	Statistical Analysis Output

ACRONYMS AND ABBREVIATIONS

BAP	Bottom Ash Pond
CCR	coal combustion residuals
CFR	code of federal regulations
GWPS	groundwater protection standard
LPL	lower prediction limit
MCL	maximum contaminant level
mg/L	milligrams per liter
PQL	practical quantitation limit
QA/QC	quality assurance/quality control
SSI	statistically significant increase
SSL	statistically significant level
TDS	total dissolved solids
UPL	upper prediction limit

1. INTRODUCTION

In accordance with United States Environmental Protection Agency regulations regarding the disposal of coal combustion residuals (CCR) in landfills and surface impoundments (Code of Federal Regulations [CFR] Title 40, Section 257, Subpart D), groundwater monitoring has been conducted at the East and West Bottom Ash Ponds (BAP), an existing CCR unit at the Rockport Power Plant in Rockport, Indiana. Recent groundwater monitoring results were used to identify concentrations of Appendix IV constituents that are above site-specific groundwater protection standards (GWPS).

Based on detection monitoring conducted in 2017 and 2018, statistically significant increases (SSIs) over background were concluded for boron, chloride, fluoride, sulfate, and total dissolved solids (TDS) at the BAP. An alternative source was not identified at the time; thus, the BAP has been in assessment monitoring since 2018. During the previous assessment monitoring event, conducted in March and May 2024, Appendix III detections of boron, calcium, chloride, fluoride, sulfate, and TDS were observed above background levels and the unit remained in assessment monitoring (Geosyntec 2024a).

A semiannual sampling event for Appendix III parameters and Appendix IV parameters, as required by 40 CFR 257.95(d)(1), was completed in November 2024. The results of the November 2024 assessment sampling event are documented in this report.

Before the statistical analyses were conducted, the groundwater data underwent several validation tests, including those for completeness, sample tracking accuracy, transcription errors, and consistent use of measurement units. No data quality issues that would impact data usability were identified.

The monitoring data were submitted to Groundwater Stats Consulting, LLC for statistical analysis. GWPSs were reestablished for the Appendix IV parameters following calculation of site-specific background values. Confidence intervals were calculated from the Appendix IV parameter data at the compliance wells to assess whether any were present at statistically significant levels (SSLs) above the corresponding GWPS. No SSLs were identified; however, concentrations of Appendix III parameters remained above background. Therefore, the unit will remain in assessment monitoring. Certification of the selected statistical methods by a qualified professional engineer is documented in Attachment A.

2. BOTTOM ASH POND EVALUATION

2.1 Data Validation and QA/QC

Samples were collected for analysis from each upgradient and downgradient well to meet the requirements of 40 CFR 257.95(d)(1) in November 2024 as part of the assessment monitoring program. Samples from the November 2024 sampling event were analyzed for all Appendix III and Appendix IV parameters. A summary of data collected during this assessment monitoring event is presented in Table 1.

Chemical analysis was completed by a National Environmental Laboratory Accreditation Program-certified analytical laboratory. The laboratory completed analysis of quality assurance and quality control (QA/QC) samples such as laboratory reagent blanks, continuing calibration verification samples, and laboratory fortified blanks.

The analytical data were imported into a Microsoft Access database, where checks were completed to assess the accuracy of sample location identification and analyte identification. Where necessary, unit conversions were applied to standardize reported units across all sampling events. Exported data files were created for use with the Sanitas™ v.10.0.24 statistics software. The export file was checked against the analytical data for transcription errors and completeness. No QA/QC issues that would impact data usability were noted.

2.2 Statistical Analysis

Statistical analyses for the BAP were conducted in accordance with the October 2020 *Statistical Analysis Plan* (Geosyntec 2020). Time series plots and results for all completed statistical tests are provided in Attachment B.

The data obtained in November 2024 were screened for potential outliers. Potential outliers were identified for arsenic, barium, boron, combined radium, fluoride, and lithium. While no values from the November 2024 event were removed from the dataset, the lithium outliers at background well MW-1600S and compliance well MW-1604S from May 2024 were flagged and removed from the dataset. The remaining identified values were similar to upgradient concentrations or below their respective maximum contaminant level (MCL); therefore, no additional outliers were flagged.

2.2.1 Establishment of GWPSs

A GWPS was established for each Appendix IV parameter in accordance with 40 CFR 257.95(h) and the Statistical Analysis Plan (Geosyntec 2020). The established GWPS was determined to be the greater value of the background concentration and either the MCL or risk-based level specified in 40 CFR 257.95(h)(2) for each Appendix IV parameter. To determine background concentrations, an upper tolerance limit was calculated using pooled data from the background wells collected during the background monitoring and assessment monitoring events.

A tolerance limit was calculated parametrically with 95% coverage and 95% confidence for combined radium. Nonparametric tolerance limits were calculated for antimony, arsenic, barium, cadmium, chromium, cobalt, fluoride, lead, lithium, molybdenum, and selenium due to apparent nonnormal distributions. Nonparametric tolerance limits were calculated for beryllium, mercury,

and thallium because greater than 50% of the data was composed of nondetect results. Upper tolerance limits and the final GWPSs are summarized in Table 2.

2.2.2 Evaluation of Potential Appendix IV SSLs

A confidence interval was constructed for each Appendix IV parameter at each compliance well. Confidence limits were generally calculated parametrically ($\alpha = 0.01$); however, nonparametric confidence limits were calculated in some cases (e.g., when the data were not normally distributed or when the nondetect frequency was too high). An SSL was concluded if the lower confidence limit exceeded the GWPS (i.e., if the entire confidence interval exceeded the GWPS). The calculated confidence limits (Attachment B) were compared to the GWPSs provided in Table 2.

No SSLs were identified at the Rockport BAP.

2.2.3 Updating Appendix III Prediction Limits

Upper prediction limits (UPLs) were originally established for all Appendix III parameters following the background monitoring period. Intrawell tests were used to evaluate potential SSIs for calcium and pH, whereas interwell tests were used to evaluate potential SSIs for boron, chloride, fluoride, sulfate, and TDS. Prediction limits have been updated periodically during the assessment monitoring period as sufficient data became available.

For intrawell tests, insufficient data was available to compare against the existing background dataset, and so the prediction limits were not updated for the intrawell tests at this time. The intrawell prediction limits were previously calculated using historical data through August 2023 (Geosyntec 2024b). The established intrawell prediction limits were used to evaluate potential SSIs for calcium and pH.

Prediction limits for the interwell tests were recalculated using data collected during the 2024 assessment monitoring events. New upgradient well data were tested for outliers prior to being added to the background dataset. Upgradient well data were also evaluated for statistically significant trends using the Sen's Slope/Mann-Kendall trend test, and the results are included in Attachment B.

After the revised background set was established, a parametric or nonparametric analysis was selected based on the distribution of the data and the frequency of nondetect data. Estimated results less than the reporting limit (practical quantitation limit, [PQL]) but above the method detection limit – i.e., “J-flagged” data – were considered detections and the estimated results were used in the statistical analyses. Nonparametric analyses were selected for datasets with at least 50% nondetect data or datasets that could not be normalized by transformation. Parametric analyses were selected for datasets (either transformed or untransformed) that passed the Shapiro-Wilk / Shapiro-Francia test for normality. The Kaplan-Meier nondetect adjustment was applied to datasets with between 15% and 50% nondetect data. For datasets with fewer than 15% nondetect data, nondetect data were replaced with one half of the PQL. The selected analysis (i.e., parametric or nonparametric) and transformation (where applicable) for each background dataset are shown in Attachment B.

The updated interwell prediction limits for boron, chloride, fluoride, sulfate, and TDS and previously established intrawell prediction limits for calcium and pH are summarized in Table 3.

The UPLs were calculated for a one-of-two retesting procedure; i.e., if at least one sample in a series of two does not exceed the UPL, or in the case of pH, is neither less than the lower prediction limit (LPL) nor greater than the UPL, then it can be concluded that an SSI has not occurred. In practice, where the initial result does not exceed the UPL, or in the case of pH, is neither less than the LPL nor greater than the UPL, a second sample will not be collected. The retesting procedures allow achieving an acceptably high statistical power to detect changes at downgradient wells for constituents evaluated using intrawell prediction limits.

2.2.4 Evaluation of Potential Appendix III SSIs

The Appendix III results were analyzed to assess whether concentrations of Appendix III parameters at the compliance wells were above background concentrations. Data collected during the November 2024 assessment monitoring event from each compliance well were compared to the prediction limits to assess whether the results were statistically above background values (Table 3). The SSIs above the UPLs were noted:

- Boron concentrations were above the interwell UPL of 0.208 milligrams per liter (mg/L) at MW-1002 (1.47 mg/L), MW-1603S (1.44 mg/L), MW-1604I (0.565 mg/L), MW-1604S (0.673 mg/L), and MW-1605S (0.517 mg/L).
- Calcium concentrations were above the intrawell UPL of 96.1 mg/L at MW-1602I (117 mg/L) and the intrawell UPL of 95.3 mg/L at MW-1603D (97 mg/L).
- Chloride concentrations were above the interwell UPL of 46.4 mg/L at MW-1602D (74.5 mg/L) and MW-1605S (47.6 mg/L).
- Fluoride concentrations were above the interwell UPL of 0.700 mg/L at MW-1002 (1.35 mg/L), MW-1603S (1.32 mg/L), and MW-1604S (0.94 mg/L).
- Sulfate concentrations were above the interwell UPL of 76.0 mg/L at MW-1002 (130 mg/L), MW-1602I (329 mg/L), MW-1603D (109 mg/L), MW-1603I (83.1 mg/L), MW-1603S (95.3 mg/L), MW-1604I (189 mg/L), MW-1604S (199 mg/L), MW-1605I (165 mg/L), and MW-1605S (160 mg/L).
- TDS concentrations were above the interwell UPL of 446 mg/L at MW-1002 (450 mg/L), MW-1602I (790 mg/L), MW-1603D (510 mg/L), MW-1603I (480 mg/L), MW-1604I (580 mg/L), MW-1604S (560 mg/L), MW-1605I (540 mg/L), and MW-1605S (570 mg/L).

While the prediction limits were calculated for a one-of-two retesting procedure, SSIs were conservatively assumed if the November 2024 sample was above the UPL or, in the case of pH, below the LPL. Based on this evaluation, concentrations of Appendix III constituents appear to be above background concentrations and the unit will remain in assessment monitoring.

2.3 Conclusions

A semiannual assessment monitoring event was conducted in accordance with the CCR Rule. The laboratory and field data were reviewed prior to statistical analysis, with no QA/QC issues identified that prevented data usage. A review of outliers identified potential outliers in the November 2024 data. Two outliers for lithium from May 2024 which were not previously flagged were flagged removed from the dataset. GWPSs were reestablished for the Appendix IV parameters. A confidence interval was constructed at each compliance well for each Appendix IV parameter; SSLs were concluded if the entire confidence interval was above the GWPSs. No SSLs were identified. Appendix III parameters were compared to site-specific prediction limits; concentrations of boron, calcium, chloride, fluoride, sulfate, and TDS were identified above the prediction limits.

Based on this evaluation, the Rockport BAP CCR unit will remain in assessment monitoring.

3. REFERENCES

Geosyntec. 2020. Statistical Analysis Plan – Rockport Plant. Geosyntec Consultants, Inc. October.

Geosyntec. 2024a. Statistical Analysis Summary – 2024 1st Semiannual Event, East and West Bottom Ash Ponds, Rockport Plant, Rockport, Indiana. Geosyntec Consultants, Inc. September.

Geosyntec. 2024b. Statistical Analysis Summary – East and West Bottom Ash Ponds, Rockport Plant, Rockport, Indiana. Geosyntec Consultants, Inc. March.

TABLES

Table 1. Groundwater Data Summary
Statistical Analysis Summary
Rockport Plant – East and West Bottom Ash Ponds

Geosyntec Consultants, Inc.

Parameter	Unit	MW-1002	MW-1600D	MW-1600I	MW-1600S	MW-1601D	MW-1601I	MW-1601S
		11/14/2024	11/13/2024	11/14/2024	11/13/2024	11/15/2024	11/15/2024	11/15/2024
Antimony	µg/L	0.044 J1	0.1 U1	0.055 J1	0.035 J1	0.1 U1	0.011 J1	0.011 J1
Arsenic	µg/L	0.22	14.8	21.4	0.34	10.3	16	1.86
Barium	µg/L	12.5	769	623 M1	21.2	451	530	27
Beryllium	µg/L	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1
Boron	mg/L	1.47	0.016 J1	0.022 J1	0.039 J1	0.024 J1	0.021 J1	0.103
Cadmium	µg/L	0.018 J1	0.005 J1	0.01 J1	0.017 J1	0.02 U1	0.005 J1	0.009 J1
Calcium	mg/L	49	80	69 M1	59	76	74	61
Chloride	mg/L	22.7	28.9	24.6	37.1	20.8	28.4	36.2
Chromium	µg/L	0.17 J1	0.31	0.37	0.29 J1	0.33	0.23 J1	0.5
Cobalt	µg/L	0.437	0.049	1.27 B1	0.036	0.052 B1	1.16 B1	0.039 B1
Combined Radium	pCi/L	2.76	2.85	3.11	0.96	1.3	1	0.21
Fluoride	mg/L	1.35	0.26	0.28	0.46	0.17	0.24	0.36
Lead	µg/L	0.2 U1	0.2 U1	0.27	0.05 J1	0.2 U1	0.2 U1	0.2 U1
Lithium	mg/L	0.005	0.0049	0.00646	0.013 J1	0.00108	0.00573	0.00448
Mercury	µg/L	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1
Molybdenum	µg/L	12.2	1.7	1.7	0.5	2.8	2	1.5
Selenium	µg/L	0.09 J1	0.5 U1	0.05 J1	0.75	0.5 U1	0.5 U1	1.1
Sulfate	mg/L	130	43.1	51.3	44.7	19.8	47.6	51.9
Thallium	µg/L	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1
Total Dissolved Solids	mg/L	450	390	400	400	410	430	270
pH	SU	7.2	6.9	6.9	6.7	6.8	6.9	7.3

Table 1. Groundwater Data Summary
Statistical Analysis Summary
Rockport Plant – East and West Bottom Ash Ponds

Geosyntec Consultants, Inc.

Parameter	Unit	MW-1602D	MW-1602I	MW-1603D	MW-1603I	MW-1603S	MW-1604D	MW-1604I
		11/14/2024	11/14/2024	11/13/2024	11/13/2024	11/14/2024	11/14/2024	11/14/2024
Antimony	µg/L	0.027 J1	0.025 J1	0.012 J1	0.049 J1	0.103	0.1 U1	0.02 J1
Arsenic	µg/L	9.62	21.3	13.8	14.8	0.16	16.3	17.3
Barium	µg/L	577	92.5	190 M1	91.9	8.12	254 M1	139
Beryllium	µg/L	0.008 J1	0.05 U1	0.05 U1	0.03 J1	0.05 U1	0.05 M1, U1	0.05 U1
Boron	mg/L	0.05	0.055	0.03 J1	0.085	1.44	0.02 J1	0.565
Cadmium	µg/L	0.02 U1	0.02 U1	0.027	0.026	0.054	0.02 U1	0.02 U1
Calcium	mg/L	68	117	97 M1	92	43	71 M1	79
Chloride	mg/L	74.5	26.2	36.1	41.8	27.8	15.6	38.4
Chromium	µg/L	0.4	0.43	0.31	1.12	0.53	0.33	0.28 J1
Cobalt	µg/L	0.118 B1	1.77 B1	0.314 B1	1.21	0.467 B1	0.056	0.932 B1
Combined Radium	pCi/L	2.3	1.77	2.11	0.63	2	2.09	1.8
Fluoride	mg/L	0.36	0.3	0.31	0.39	1.32	0.31	0.41
Lead	µg/L	0.09 J1	0.2 U1	0.2 U1	1.23	0.13 J1	0.2 U1	0.2 U1
Lithium	mg/L	0.00236	0.00635	0.00354	0.00441	0.00351	0.00143 M1	0.00792
Mercury	µg/L	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1
Molybdenum	µg/L	3.1	2.3	3.2	4.5	1.2	2.5	1.7
Selenium	µg/L	0.05 J1	0.06 J1	0.5 U1	0.24 J1	0.17 J1	0.5 U1	0.5 U1
Sulfate	mg/L	22.2	329	109	83.1	95.3	18.6	189
Thallium	µg/L	0.2 U1	0.03 J1	0.2 U1	0.02 J1	0.2 U1	0.2 U1	0.2 U1
Total Dissolved Solids	mg/L	440	790	510	480	340	320	580
pH	SU	7.1	7.1	7.0	7.1	6.7	7.3	7.4

Table 1. Groundwater Data Summary
Statistical Analysis Summary
Rockport Plant – East and West Bottom Ash Ponds

Geosyntec Consultants, Inc.

Parameter	Unit	MW-1604S	MW-1605D	MW-1605I	MW-1605S	MW-1606D	MW-1606I	MW-1606S
		11/14/2024	11/14/2024	11/14/2024	11/14/2024	11/14/2024	11/14/2024	11/14/2024
Antimony	µg/L	0.05 J1	0.028 J1	0.024 J1	0.04 J1	0.1 U1	0.015 J1	0.032 J1
Arsenic	µg/L	0.14	20.5	15.8	0.51	17.4	13.7	0.14
Barium	µg/L	14.8	448	135	6.4	491	50.3	12.1
Beryllium	µg/L	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1
Boron	mg/L	0.673	0.015 J1	0.082	0.517	0.019 J1	0.012 J1	0.017 J1
Cadmium	µg/L	0.025	0.02 U1	0.02 U1	0.039	0.02 U1	0.005 J1	0.026
Calcium	mg/L	75	77	86	72	83	66	51
Chloride	mg/L	34.7	26.5	39.1	47.6	24.1	16.8	29.2
Chromium	µg/L	0.4	0.23 J1	0.19 J1	0.52	0.28 J1	0.83	0.24 J1
Cobalt	µg/L	0.315	0.046 B1	1.32	0.411	0.046 B1	1.07	0.062 B1
Combined Radium	pCi/L	1.74	1.47	1.63	0.69	1.33	1.42	0.78
Fluoride	mg/L	0.94	0.24	0.24	0.68	0.2	0.23	0.53
Lead	µg/L	0.2 U1	0.2 U1	0.2 U1	0.06 J1	0.2 U1	0.2 U1	0.2 U1
Lithium	mg/L	0.013 J1	0.00148	0.00465	0.0097	0.00047	0.00285	0.00779
Mercury	µg/L	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1
Molybdenum	µg/L	3.5	1.9	1.3	1.8	1.8	1	1.5
Selenium	µg/L	0.5 U1	0.5 U1	0.05 J1	0.09 J1	0.5 U1	0.5 U1	4.07
Sulfate	mg/L	199	47.9	165	160	29	40.4	33.4
Thallium	µg/L	0.03 J1	0.2 U1	0.03 J1	0.03 J1	0.2 U1	0.03 J1	0.2 U1
Total Dissolved Solids	mg/L	560	380 S7	540	570	350	300	360
pH	SU	7.5	7.3	7.3	7.1	7.0	7.3	6.9

Table 1. Groundwater Data Summary
Statistical Analysis Summary
Rockport Plant – East and West Bottom Ash Ponds

Geosyntec Consultants, Inc.

Parameter	Unit	MW-1701D	MW-1701I	MW-1701S	MW-1702D	MW-1702I	MW-1702S
		11/14/2024	11/14/2024	11/14/2024	11/14/2024	11/15/2024	11/15/2024
Antimony	µg/L	0.011 J1	0.168	0.073 J1	0.1	0.058 J1	0.09 J1
Arsenic	µg/L	9.42	29.9	0.33	25	52.8	0.26
Barium	µg/L	62.1	41.5	8.44	200	106	4.6
Beryllium	µg/L	0.05 U1	0.05 U1	0.05 U1	0.011 J1	0.05 U1	0.05 U1
Boron	mg/L	0.024 J1	0.018 J1	0.013 J1	0.017 J1	0.014 J1	0.034 J1
Cadmium	µg/L	0.02 U1	0.023	0.04	0.02	0.013 J1	0.047
Calcium	mg/L	67	64	57	79	70	37
Chloride	mg/L	16.9	14.8	21.6	31	30.6	14.3
Chromium	µg/L	0.51	0.24 J1	0.36	0.37	0.33	0.41
Cobalt	µg/L	1.53 B1	1.65	0.082	0.505	1.31 B1	0.027 B1
Combined Radium	pCi/L	0.9	2.09	1.29	3.12	1.18	0.52
Fluoride	mg/L	0.39	0.49	0.44	0.23	0.22	0.54
Lead	µg/L	0.2 U1	0.39	0.2 U1	0.86	0.05 J1	0.2 U1
Lithium	mg/L	0.00639	0.00509	0.0047	0.00365	0.00391	0.00153
Mercury	µg/L	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1
Molybdenum	µg/L	1.3	1.2	0.7	1.9	1.9	1.4
Selenium	µg/L	0.5 U1	0.1 J1	0.41 J1	0.13 J1	0.5 U1	1.66
Sulfate	mg/L	39.4	33.7	15.5	40.3	39.1	16.5
Thallium	µg/L	0.02 J1	0.2 U1	0.2 U1	0.2 U1	0.03 J1	0.2 U1
Total Dissolved Solids	mg/L	350	330	310	390	340	290
pH	SU	6.9	7.1	7.2	6.9	6.9	6.9

Notes:

--: not measured

B1: Analyte detected in method blank (MB) at or above the method criteria.

J1: Estimated value. Parameter was detected in concentrations below the reporting limit.

M1: The associated matrix spike (MS) or matrix spike duplicate (MSD) recovery was outside acceptance limits.

mg/L: milligrams per liter

pCi/L: picocuries per liter

S7: Sample did not achieve constant weight.

SU: standard unit

U1: Non-detect value. For statistical analysis, parameters which were not detected were replaced with the reporting limit.

µg/L: micrograms per liter

Table 2. Appendix IV Groundwater Protection Standards
Statistical Analysis Summary
Rockport Plant – East and West Bottom Ash Ponds

Geosyntec Consultants, Inc.

Constituent Name	MCL	CCR Rule-Specified	Calculated UTL	GWPS
Antimony, Total (mg/L)	0.00600		0.000440	0.00600
Arsenic, Total (mg/L)	0.0100		0.0791	0.0791
Barium, Total (mg/L)	2.00		1.20	2.00
Beryllium, Total (mg/L)	0.00400		0.000106	0.00400
Cadmium, Total (mg/L)	0.00500		0.000280	0.00500
Chromium, Total (mg/L)	0.100		0.00205	0.100
Cobalt, Total (mg/L)	n/a	0.00600	0.00334	0.00600
Combined Radium, Total (pCi/L)	5.00		2.79	5.00
Fluoride, Total (mg/L)	4.00		0.700	4.00
Lead, Total (mg/L)	n/a	0.0150	0.00497	0.0150
Lithium, Total (mg/L)	n/a	0.0400	0.0380	0.0400
Mercury, Total (mg/L)	0.00200		0.00000500	0.00200
Molybdenum, Total (mg/L)	n/a	0.100	0.00867	0.100
Selenium, Total (mg/L)	0.0500		0.00437	0.0500
Thallium, Total (mg/L)	0.00200		0.000200	0.00200

Notes:

1. Calculated UTL (upper tolerance limit) represents site-specific background values.
2. Grey cells indicate the GWPS is based on the calculated UTL, which is higher than the MCL or CCR Rule-specified value.

CCR: coal combustion residuals

GWPS: groundwater protection standard

MCL: maximum contaminant level

mg/L: milligrams per liter

n/a: not applicable

pCi/L: picocuries per liter

Table 3. Appendix III Data Summary
Statistical Analysis Summary
Rockport Plant – Bottom Ash Pond

Analyte	Unit	Description	MW-1002	MW-1602D	MW-1602I	MW-1603D	MW-1603I	MW-1603S	MW-1604D	MW-1604I	MW-1604S
			11/14/2024	11/14/2024	11/14/2024	11/13/2024	11/13/2024	11/14/2024	11/14/2024	11/14/2024	11/14/2024
Boron	mg/L	Interwell Background Value (UPL)	0.208								
		Analytical Result	1.47	0.05	0.055	0.03	0.085	1.44	0.02	0.565	0.673
Calcium	mg/L	Intrawell Background Value (UPL)	80.7	81.2	96.1	95.3	104	89.5	77.9	87.6	111
		Analytical Result	49	68	117	97	92	43	71	79	75
Chloride	mg/L	Interwell Background Value (UPL)	46.4								
		Analytical Result	22.7	74.5	26.2	36.1	41.8	27.8	15.6	38.4	34.7
Fluoride	mg/L	Interwell Background Value (UPL)	0.700								
		Analytical Result	1.35	0.36	0.3	0.31	0.39	1.32	0.31	0.41	0.94
pH	SU	Intrawell Background Value (UPL)	8.2	8.1	7.9	8.1	8.1	7.8	7.7	7.9	8.0
		Intrawell Background Value (LPL)	5.5	6.5	6.5	6.0	5.8	5.8	6.5	6.7	6.7
		Analytical Result	7.2	7.1	7.1	7.0	7.1	6.7	7.3	7.4	7.5
Sulfate	mg/L	Interwell Background Value (UPL)	76.0								
		Analytical Result	130	22.2	329	109	83.1	95.3	18.6	189	199
Total Dissolved Solids	mg/L	Interwell Background Value (UPL)	446								
		Analytical Result	450	440	790	510	480	340	320	580	560

Analyte	Unit	Description	MW-1605D	MW-1605I	MW-1605S	MW-1606D	MW-1606I	MW-1606S
			11/14/2024	11/14/2024	11/14/2024	11/14/2024	11/14/2024	11/14/2024
Boron	mg/L	Interwell Background Value (UPL)	0.208					
		Analytical Result	0.015	0.082	0.517	0.019	0.012	0.017
Calcium	mg/L	Intrawell Background Value (UPL)	96.3	105	91.3	91.6	87.9	68.3
		Analytical Result	77	86	72	83	66	51
Chloride	mg/L	Interwell Background Value (UPL)	46.4					
		Analytical Result	26.5	39.1	47.6	24.1	16.8	29.2
Fluoride	mg/L	Interwell Background Value (UPL)	0.700					
		Analytical Result	0.24	0.24	0.68	0.2	0.23	0.53
pH	SU	Intrawell Background Value (UPL)	7.5	7.7	7.6	8.4	8.3	7.9
		Intrawell Background Value (LPL)	6.7	6.7	6.6	6.4	6.5	6.1
		Analytical Result	7.3	7.3	7.1	7.0	7.3	6.9
Sulfate	mg/L	Interwell Background Value (UPL)	76.0					
		Analytical Result	47.9	165	160	29	40.4	33.4
Total Dissolved Solids	mg/L	Interwell Background Value (UPL)	446					
		Analytical Result	380	540	570	350	300	360

Notes:

1. Bold values exceed the background value.

2. Background values are shaded gray.

LPL: lower prediction limit

mg/L: milligrams per liter

SU: standard units

UPL: upper prediction limit

ATTACHMENT A

Certification by Qualified Professional Engineer

Certification by Qualified Professional Engineer

I certify that selected and above described statistical method is appropriate for evaluating the groundwater monitoring data for the Rockport Bottom Ash Pond CCR management area and that the requirements of 40 CFR 257.93(f) have been met.

David Anthony Miller

Printed Name of Licensed Professional Engineer

David Anthony Miller

Signature



11700730

License Number

Indiana

Licensing State

03.07.2025

Date


ATTACHMENT B

Statistical Analysis Output

GROUNDWATER STATS CONSULTING

February 24, 2025

Geosyntec Consultants
Attn: Ms. Allison Kreinberg
500 W. Wilson Bridge Road, Suite 250
Worthington, OH 43085

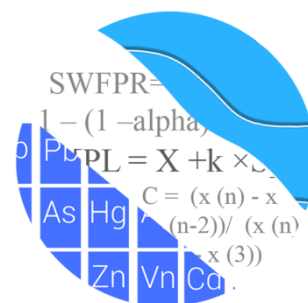

Re: Rockport Bottom Ash Pond
Background Update & November 2024 Assessment Monitoring Analysis

Dear Ms. Kreinberg,

Groundwater Stats Consulting (GSC), formerly the statistical consulting division of Sanitas Technologies, is pleased to provide statistical analysis and background update of interwell statistical limits through 2024 for American Electric Power Inc.'s Rockport Bottom Ash Pond. The analysis complies with the federal rule for the Disposal of Coal Combustion Residuals (CCR) from Electric Utilities (CCR Rule, 2015) as well as with the United States Environmental Protection Agency (USEPA) Unified Guidance (2009).

Sampling began at the site for the CCR program in 2016. The monitoring well network, as provided by Geosyntec Consultants, consists of the following:

- **Upgradient wells:** MW-1600D, MW-1600I, MW-1600S, MW-1601D, MW-1601I, MW-1601S; MW-1701S, MW-1702D, MW-1702I, MW-1702S, MW-1701D, and MW-1701I
- **Downgradient wells:** MW-1002, MW-1602D, MW-1602I, MW-1603D, MW-1603I, MW-1603S, MW-1604D, MW-1604I, MW-1604S, MW-1605D, MW-1605I, MW-1605S, MW-1606D, MW-1606I, and MW-1606S

Data were sent electronically to Groundwater Stats Consulting, and the statistical analysis was reviewed by Dr. Jim Loftis, Civil & Environmental Engineering professor emeritus at Colorado State University and Senior Advisor to Groundwater Stats Consulting. The statistical analysis was conducted according to the January 2018 screening evaluation prepared by GSC and approved by Dr. Kirk Cameron.

The CCR program consists of the following constituents listed below. The terms “constituent” and “parameter” are interchangeable.

- **Appendix III** (Detection Monitoring) - boron, calcium, chloride, fluoride, pH, sulfate, and TDS
- **Appendix IV** (Assessment Monitoring) – antimony, arsenic, barium, beryllium, cadmium, chromium, cobalt, combined radium 226 + 228, fluoride, lead, lithium, mercury, molybdenum, selenium, and thallium

Time series plots and box plots for Appendix III and IV parameters are provided for all wells (Figures A and B, respectively). Values which have been flagged as outliers may be seen in a lighter font and as a disconnected symbol on the time series plots. A summary of flagged values follows this letter (Figure C). The time series plots are used to evaluate concentrations over time and between wells, to initially screen for suspected outliers and trends, while the box plots provide visual representation of variation within individual wells and between wells.

Due to varying detection limits in background data sets resulting from improved laboratory practices, a substitution of the most recent reporting limit is used for all non-detects. In some cases, the reporting limit provided by the laboratory contains varying limits for a given parameter; therefore, the substitution may differ from well to well.

For regulatory comparison of current observations against statistical limits for Appendix III constituents, the annual site-wide false positive rate is based on the USEPA Unified Guidance (2009) recommendation of 10% (5% for each semi-annual sample event). Power curves were included with previous reports and demonstrated that the selected statistical methods provide sufficient power to detect a change at any of the downgradient wells which complies with the USEPA Unified Guidance recommendation. The EPA suggests the selected statistical method should provide at least 55% power at 3 standard deviations or at least 80% power at 4 standard deviations. Power curves were based on the following:

- Semi-Annual Sampling
- Intrawell Prediction Limits = 1-of-2 resample plan
- Interwell Prediction Limits = 1-of-2 resample plan
- # Constituents, $c=7$
- # Downgradient wells, $w=15$

Summary of Statistical Methods:

- 1) Intrawell prediction limits, combined with a 1-of-2 resample plan for calcium and pH
- 2) Interwell prediction limits combined with a 1-of-2 resample plan for boron, chloride, fluoride, sulfate, and TDS

Parametric prediction limits are utilized when the screened historical data follow a normal or transformed-normal distribution. When data cannot be normalized or the majority of data are non-detects, a nonparametric test is utilized. The distribution of data is tested using the Shapiro-Wilk/Shapiro-Francia test for normality. After testing for normality and performing any adjustments as discussed below (US EPA, 2009), data are analyzed using either parametric or non-parametric prediction limits. Non-detects are handled as follows.

- No statistical analyses are required on wells and analytes containing 100% non-detects (USEPA Unified Guidance, 2009, Chapter 6).
- When data contain <15% non-detects, simple substitution of one-half the reporting limit is utilized in the in background statistical analysis. The reporting limit utilized for non-detects is the most recent practical quantification limit (PQL) as reported by the laboratory.
- When data contain between 15-50% non-detects, the Kaplan-Meier non-detect adjustment is applied to the background data for parametric limits. This technique adjusts the mean and standard deviation of the historical concentrations to account for concentrations below the reporting limit.
- Nonparametric prediction limits are used on data containing greater than 50% non-detects.

Note that values shown on data pages reflect raw data as reported by the laboratory. When non-detects have been substituted in the statistical analysis with one-half of the most reporting limit due to data sets containing <15% non-detects as described above, values are displayed as the original reporting limit.

Natural systems continuously evolve due to physical changes made to the environment. Examples include capping a landfill, paving areas near a well, or lining a drainage channel to prevent erosion. Periodic updating of background statistical limits is necessary to accommodate these types of changes. In the intrawell case, data for all wells and constituents may be re-evaluated when a minimum of 4 new data points are available to determine whether earlier concentrations are representative of present-day groundwater quality. In the interwell case, prediction limits are updated with upgradient well data following each sampling event after careful screening for any new outliers. In some cases,

deselecting the earlier portion of data may be necessary prior to construction of limits so that resulting statistical limits are capable of rapidly detecting changes in groundwater quality. Even though the data are excluded from the calculation, the values will continue to be reported and shown in tables and graphs.

Initial Background Screening – January 2018

All proposed background data were screened for outliers and trends during the background screening, and the findings were submitted with that analysis. At the time of the screening, a 1-of-3 verification strategy was recommended, but power curves have since demonstrated that the increased number of samples in background provides sufficient power using the 1-of-2 resample plan. Interwell prediction limits combined with a 1-of-2 verification strategy are used for boron, chloride, fluoride, sulfate and TDS; and intrawell prediction limits combined with a 1-of-2 verification strategy are used for calcium and pH. As recommended in the EPA Unified Guidance (2009), the background data sets are evaluated for the purpose of updating statistical limits, as described below, using the Mann-Whitney test when at least four additional measurements are available.

Background Update Summaries

Intrawell prediction limits, which are constructed using background data from an individual well, are used to evaluate calcium and pH at each well. These limits are updated every two years as described below when a minimum of four new measurements is available. Interwell prediction limits, which pool upgradient well data to construct background limits for an individual constituent, are used to evaluate boron, chloride, fluoride, sulfate, and TDS. These limits are updated annually after screening upgradient well data as described below.

Fall 2023

Intrawell Prediction Limits

Intrawell prediction limits were last updated in the Fall 2021 for calcium and pH using background data through May 2021. The results of those findings were submitted at that time. Prior to constructing intrawell prediction limits during this analysis, Tukey's outlier test and visual screening were used to re-evaluate data for updating background limits through August 2023 at all wells.

Tukey's outlier test identified one value for calcium at upgradient well MW-1601D and several values for pH. The highest value for pH at MW-1603D was flagged during this

event to reduce variation, and all values that were previously flagged remain flagged as outliers. Any values identified by Tukey's test but not flagged were similar to other concentrations within their respective wells. Although not identified by Tukey's test, a high value for calcium at MW-1603S was also flagged to provide a statistical limit that is readily capable of detecting changes in groundwater quality. No changes to previously flagged outliers were made.

For constituents requiring intrawell prediction limits, the Mann-Whitney (Wilcoxon Rank Sum) test was used to compare the medians of historical data through May 2021 to the new compliance samples through May/June 2023 at each well to evaluate whether the groups are statistically different at the 99% confidence level. The record for pH at upgradient well MW-1701S contained data through August 2023 and, therefore, was evaluated through that period of time. During a prior update, the record for calcium at well MW-1603S was truncated to use concentrations that were representative of groundwater quality conditions at that time; however, more recent concentrations resemble those earlier in the record. Therefore, during the Fall 2023 update, the record for calcium at this well uses all available data for the Mann-Whitney test. There were no statistically significant increases in medians identified by the Mann-Whitney test. Regarding well/constituent pairs with statistically significant decreases in medians, the background datasets were updated through August 2023 because the majority of compliance data were within the range of or close to background data and in order to construct statistical limits that are readily capable of detecting changes in groundwater quality.

Interwell Prediction Limits

For parameters which use interwell prediction limits, Tukey's outlier test identified values for boron, chloride, fluoride, sulfate, and TDS on pooled upgradient well data. Since the majority of the identified values were relatively similar in concentration to non-significant values, the measurements were not flagged as outliers in the database. No new values were flagged as outliers and Tukey's outlier test and visual screening confirmed previously flagged measurements for Appendix III constituents.

The Sen's Slope/Mann-Kendall trend test was then used to evaluate these constituents in upgradient wells to determine whether concentrations are statistically increasing, decreasing or stable at the 99% confidence level. Results of the trend tests were included with the Fall 2023 update. Since the magnitudes of the slopes for the well/constituent pairs with statistically significant trends were marginal relative to the concentrations and resulting statistical limits are representative of upgradient concentrations, no adjustments were required for these well/constituent pairs at this time. As more data are collected, all

upgradient well data will be re-evaluated for possible deselection of earlier portion of the record if the measurements no longer represent present-day groundwater quality conditions.

Current Update – Fall 2024

Interwell prediction limits are updated on an annual basis as mentioned earlier. During this analysis, upgradient well data were evaluated for updating background for interwell prediction limits through November 2024. For any parameters which use intrawell prediction limits (calcium and pH), observations were not re-evaluated as these records had insufficient new samples for updating background limits during this evaluation period.

Interwell – Outlier Analysis

Prior to updating background data, Tukey's outlier test and visual screening were used to re-evaluate data through November 2024 at all upgradient wells for parameters utilizing interwell prediction limits (boron, chloride, fluoride, sulfate, and TDS).

Tukey's outlier test identified values for boron, chloride, fluoride, sulfate, and TDS. Since the majority of these values were similar to remaining observations within each respective record, the measurements were not flagged in the database. Tukey's outlier test and visual screening confirmed previously flagged measurements, and no new values were flagged as outliers for Appendix III constituents. A list of flagged values follows this report along with the results of Tukey's outlier tests (Figure C).

Interwell – Trend Test Evaluation

For parameters which are tested using interwell prediction limits, the Sen's Slope/Mann-Kendall trend test was used to test data in upgradient wells to determine whether concentrations are statistically increasing, decreasing or stable at the 99% confidence level (Figure D). Statistically significant trends were identified for the following well/constituent pairs:

Increasing

- Chloride: MW-1701S
- Fluoride: MW-1600S, MW-1601I, MW-1601S, and MW-1701I
- Sulfate: MW-1601S

Decreasing

- Boron: MW-1601D, MW-1701I, MW-1701S, MW-1702D, MW-1702I, and MW-1702S
- Chloride: MW-1600D, MW-1601I, and MW-1601S
- Sulfate: MW-1600S, MW-1701I, and MW-1701S
- TDS: MW-1600S, MW-1601S, and MW-1701D

Although statistically significant trends were identified when each upgradient well was tested individually, the magnitudes of the trends are low relative to average concentrations among pooled upgradient well data, and reported measurements are consistent with those reported at one or more neighboring upgradient wells. Therefore, the full period of record, including the trend, is appropriate to represent upgradient groundwater quality conditions, and no adjustments were made to the records at this time. As more data are collected, all upgradient well data will be re-evaluated for possible deselection of earlier portion of the record if needed to adequately represent background conditions.

Prediction Limits – Fall 2024

Intrawell limits constructed from carefully screened background data from within each well serve to provide statistical limits that are representative of the background data population, and that will rapidly identify a change in more recent compliance data within a given well. The most recent sample from the same well is compared to its respective background. This statistical method removes the element of variation from across wells and eliminates the chance of mistaking spatial variation for a release from the facility. Intrawell prediction limits are updated when a minimum of 4 compliance samples is available. Intrawell prediction limits, combined with a 1-of-2 resample plan, were constructed for calcium and pH using screened background data through May/June 2023 at each well (and through August 2023 for pH at upgradient well MW-1701S (Figure E). No comparison of the November 2024 compliance data to statistical limits was made in this analysis.

Interwell prediction limits, which pool upgradient well data to establish a background limit for an individual constituent, were updated during this analysis after visual screening for new outliers. Interwell prediction limits, combined with a 1-of-2 resample plan, were constructed using all pooled upgradient well data through November 2024 for boron, chloride, fluoride, sulfate, and TDS (Figure F). Time series plots were included with the interwell prediction limit graphs to display concentrations at upgradient wells that were used to construct the statistical limits. No comparison of the November 2024 compliance data to statistical limits was made in this analysis.

In the event of an initial exceedance of compliance well data, the 1-of-2 resample plan allows for collection of one additional sample to determine whether the initial exceedance is confirmed. When the resample confirms the initial exceedance, a statistically significant increase (SSI) is identified, and further research is required to identify the cause of the exceedance (i.e., impact from the site, natural variation, or an off-site source). If a resample falls within the statistical limit, the initial exceedance is considered a false positive result; therefore, no further action is necessary.

Evaluation of Appendix IV Parameters – November 2024 Sample Event

Prior to evaluating Appendix IV parameters, upgradient well data are screened through both visual screening and Tukey's outlier test for potential outliers and extreme trending patterns that would lead to artificially elevated statistical limits. Tukey's test and visual screening with time series graphs confirmed previously flagged outliers. All flagged values may be seen on the Outlier Summary following this letter (Figure C).

For the current analysis, Tukey's outlier test on pooled upgradient well data through November 2024 identified outliers for arsenic, barium, combined radium 226 + 228, fluoride, and lithium. Most values identified by Tukey's test were either similar to concentrations upgradient of the facility or were lower than the respective Maximum Contaminant Level (MCL), with the exception of a high value for lithium in well MW-1600S, which was flagged during this analysis. All previously flagged values in upgradient wells were confirmed by Tukey's outlier test or visual screening.

Additionally, downgradient well data through November 2024 were screened through visual screening using time series graphs. Since the downgradient well data are used to construct confidence intervals, values that are marginally high relative to the rest of the data are retained unless there is a particular justification for excluding them. One high value for lithium in downgradient well MW-1604S was flagged during this analysis as it was significantly higher than remaining measurements within this well. Previously flagged values for cobalt in MW-1606D and lead in wells MW-1603D, 1604S, and 1606S were unflagged as the measurements were found to be similar to surrounding concentrations.

Interwell Upper Tolerance Limits

Interwell upper tolerance limits were used to calculate the site-specific background limits from pooled upgradient well data through November 2024 for Appendix IV parameters (Figure G). These limits are updated on an annual basis and will be updated again during the Fall 2025 sample event. Parametric tolerance limits are used when data follow a normal or transformed-normal distribution and use a target of 95% confidence and 95%

coverage. The confidence and coverage levels for nonparametric tolerance limits are dependent upon the number of background samples. When data contained greater than 50% non-detects or did not follow a normal or transformed-normal distribution, nonparametric tolerance limits were used. Time series for the upgradient wells are included with the upper tolerance limits results.

Groundwater Protection Standards

These background limits were compared to the Maximum Contaminant Levels (MCLs) as shown in the Groundwater Protection Standard (GWPS) table following this letter to determine the highest limit for use as the GWPS in the confidence interval comparisons (Figure H).

Confidence Intervals

Confidence intervals were then constructed using all available data through November 2024 on downgradient wells for each of the Appendix IV parameters using the highest limit of the MCL, CCR-Rule specified, or background limit as the GWPS, as discussed above (Figure I). These intervals were constructed as either parametric or nonparametric confidence intervals depending on the data distribution and percentage of non-detects. When data followed a normal or transformed-normal distribution, parametric confidence intervals were used for Appendix IV parameters. Nonparametric confidence intervals were constructed when data did not follow a normal or transformed-normal distribution or when there were greater than 50% non-detects. The lower confidence limit, which is constructed with 99% confidence for parametric confidence intervals, is compared to the GWPS prepared as described above. The confidence level associated with nonparametric confidence intervals is dependent upon the number samples available.

Only when the entire confidence interval is above a GWPS is the well/constituent pair considered to exceed its respective standard. If there is an exceedance of the GWPS, a statistically significant level (SSL) exceedance is identified. No confidence interval exceedances were found for any of the downgradient wells. A summary of the confidence interval results follows this letter.

Trend Test Evaluation

When confidence interval exceedances are identified in downgradient wells, data are further evaluated using the Sen's Slope/Mann Kendall trend test to determine whether concentrations are statistically increasing, decreasing, or stable at the 95% confidence level. Utilizing the 95% confidence level for trend tests readily identifies significant trends

and is more sensitive than the 99% confidence level without drastically increasing the false negative rate. Upgradient wells are included in the trend analyses for all parameters found to exceed their confidence interval in downgradient wells. When similar patterns exist upgradient of the site, it is an indication of variability in groundwater which may be unrelated to practices at the site. Since no exceedances were identified, no trend tests were required.

Thank you for the opportunity to assist you in the statistical analysis of groundwater quality for the Rockport Bottom Ash Pond. If you have any questions or comments, please feel free to contact us.

For Groundwater Stats Consulting,



Easton Rayner
Groundwater Analyst




Andrew T. Collins
Project Manager

FIGURE A


Time Series

Time Series

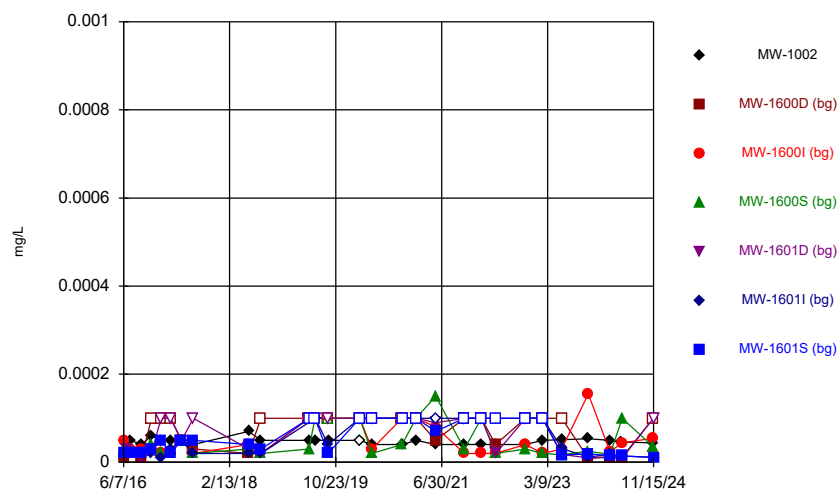


Constituent: Antimony, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

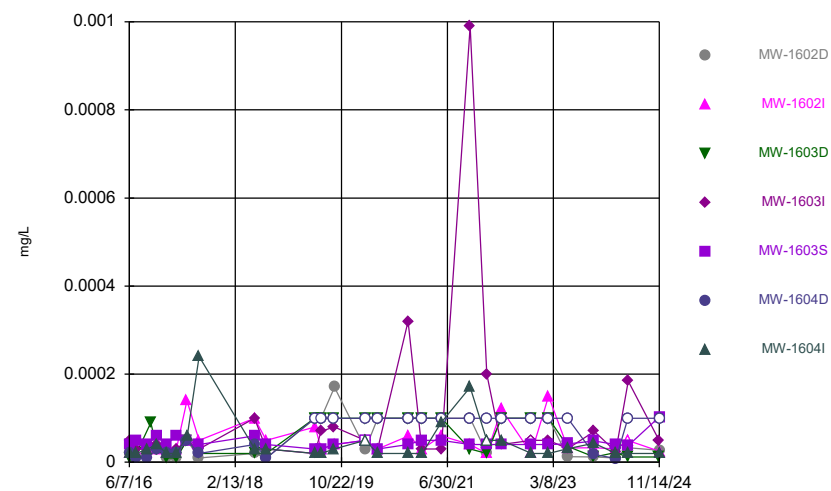


Constituent: Antimony, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series




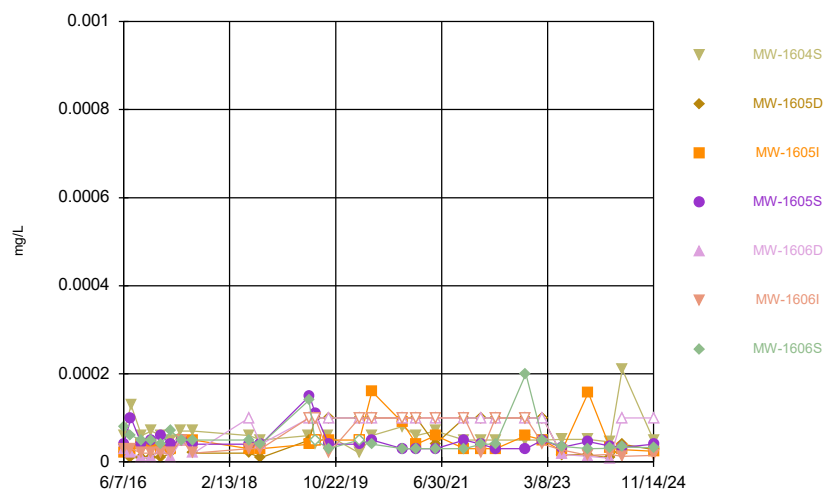


Constituent: Antimony, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Time Series

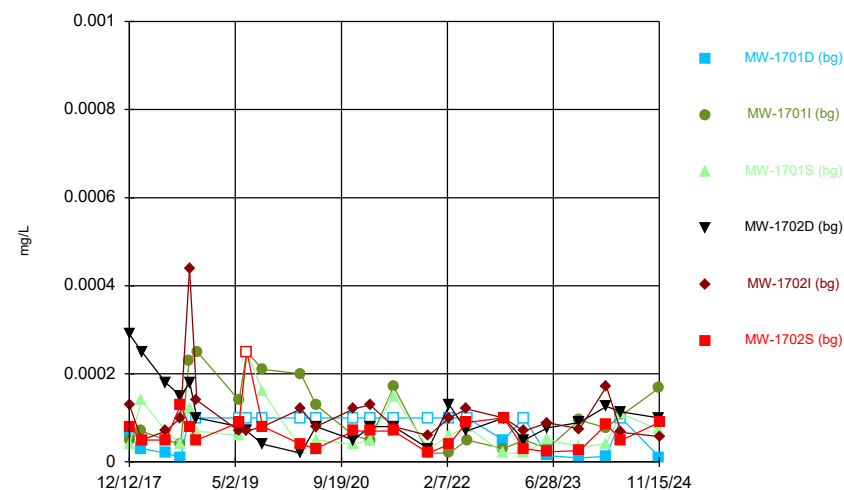

Constituent: Antimony, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

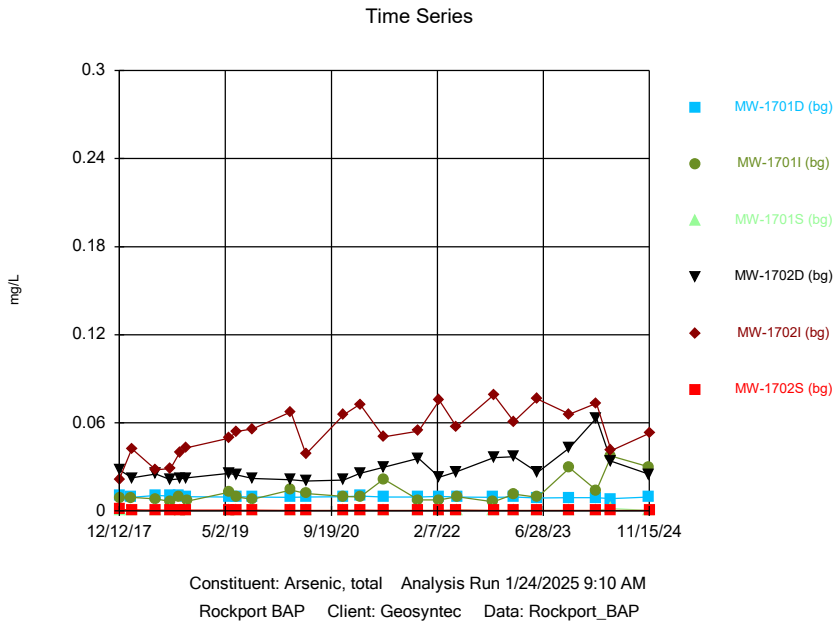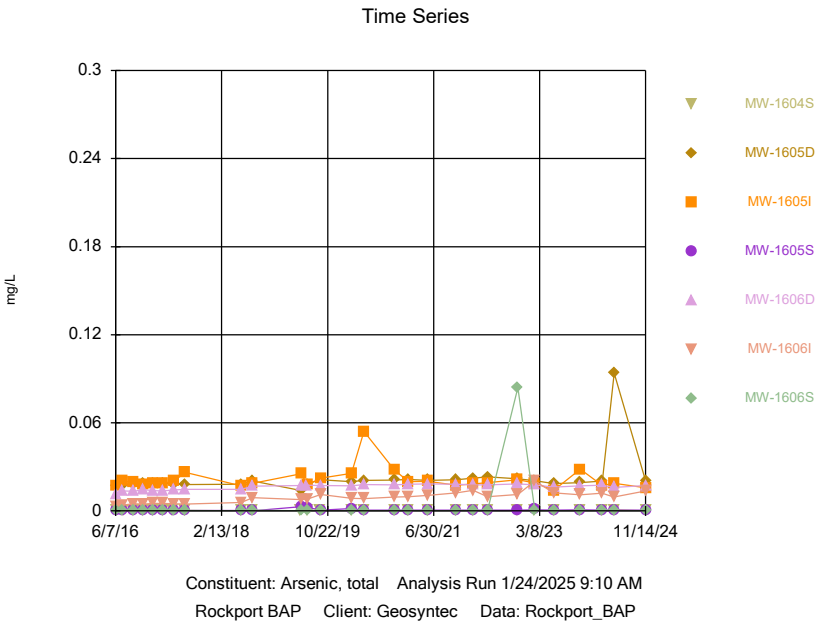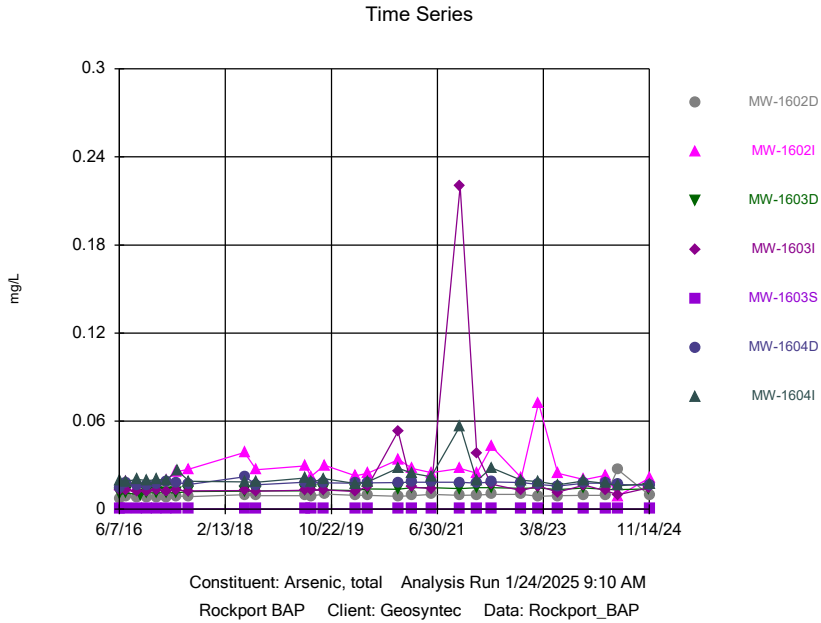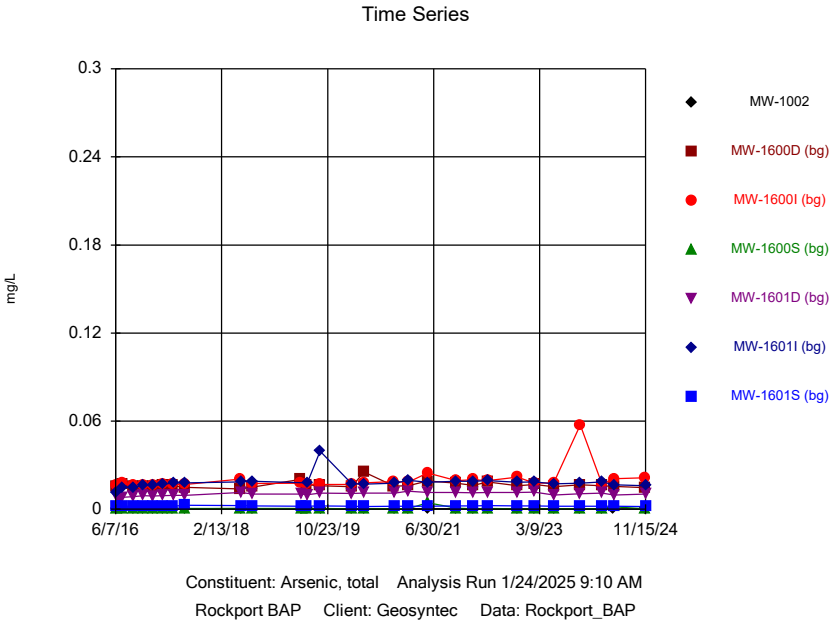


Time Series

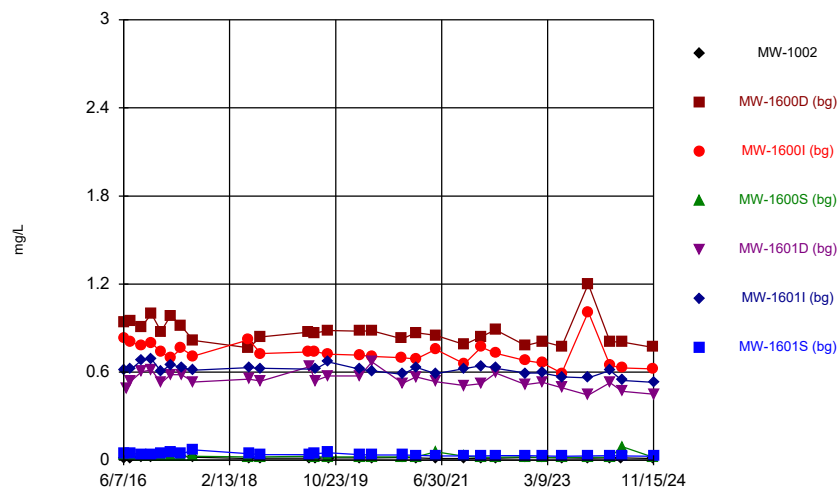


Constituent: Barium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

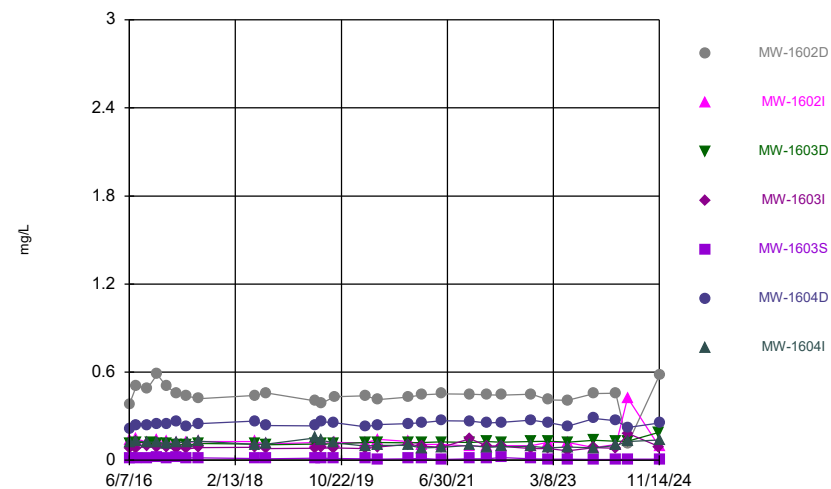


Constituent: Barium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

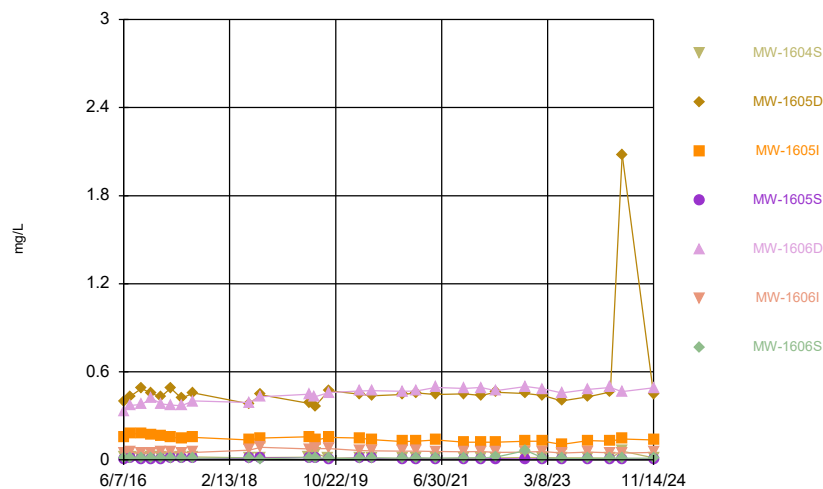


Constituent: Barium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

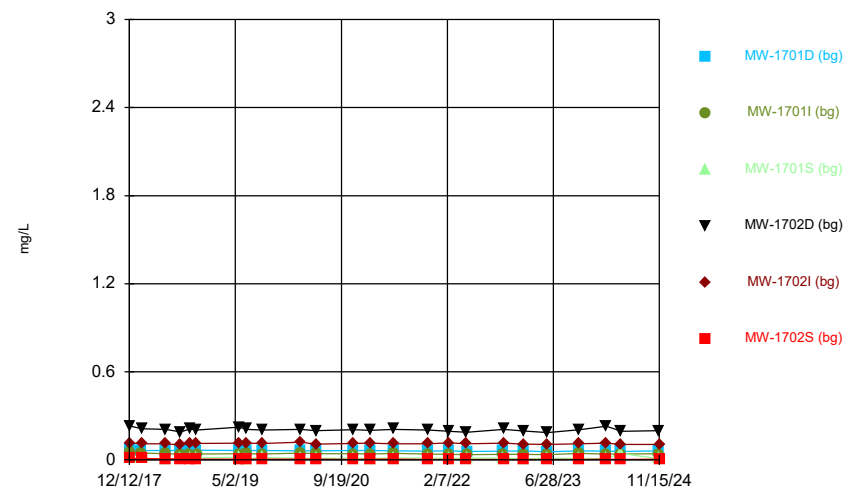


Constituent: Barium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

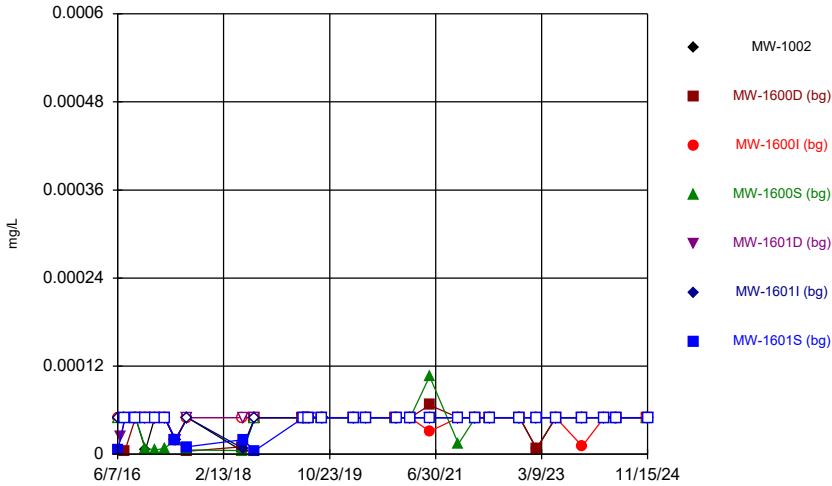


Constituent: Beryllium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

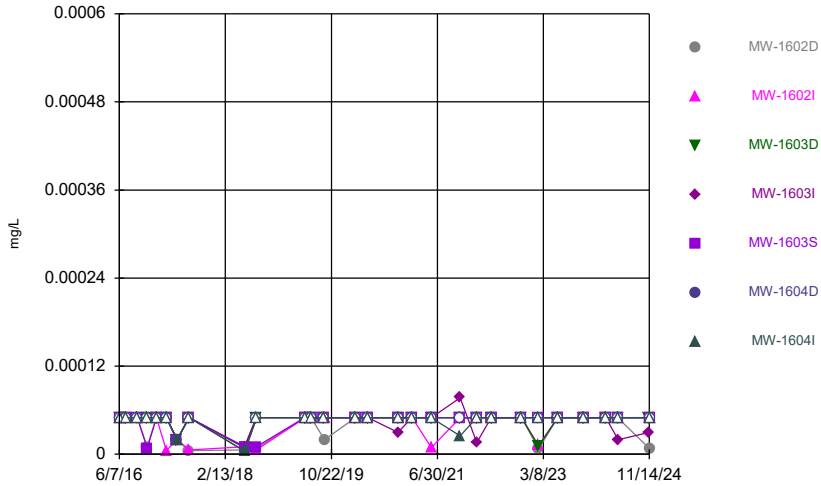


Constituent: Beryllium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

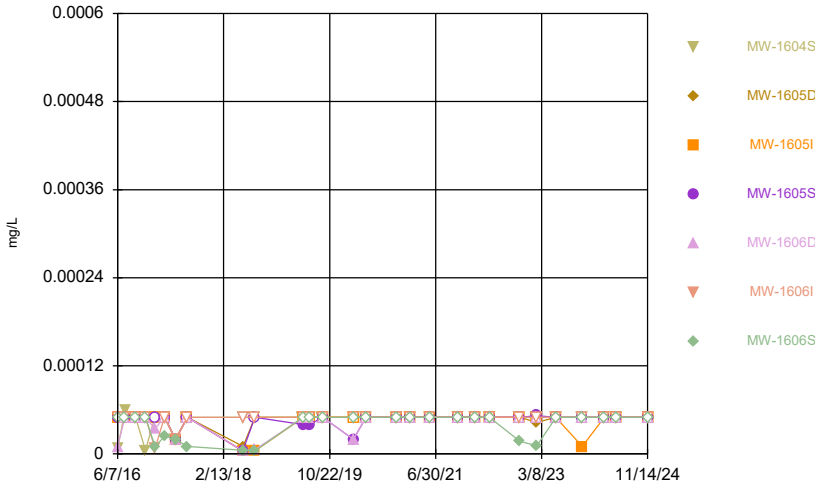


Constituent: Beryllium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

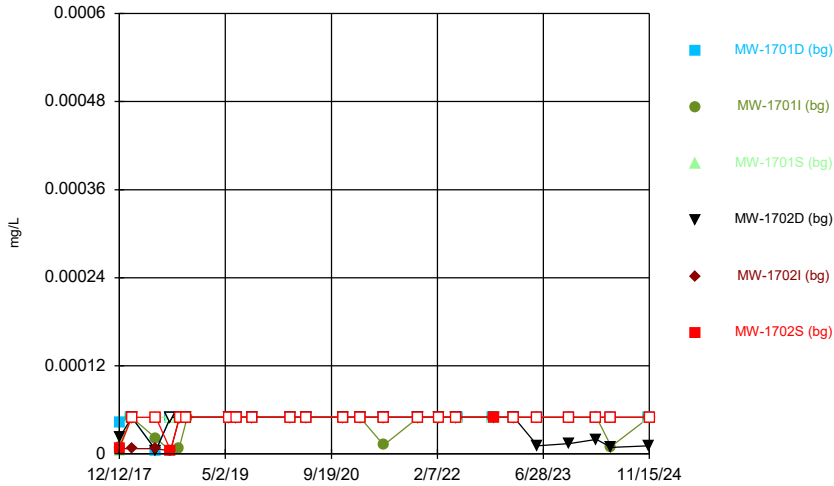


Constituent: Beryllium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

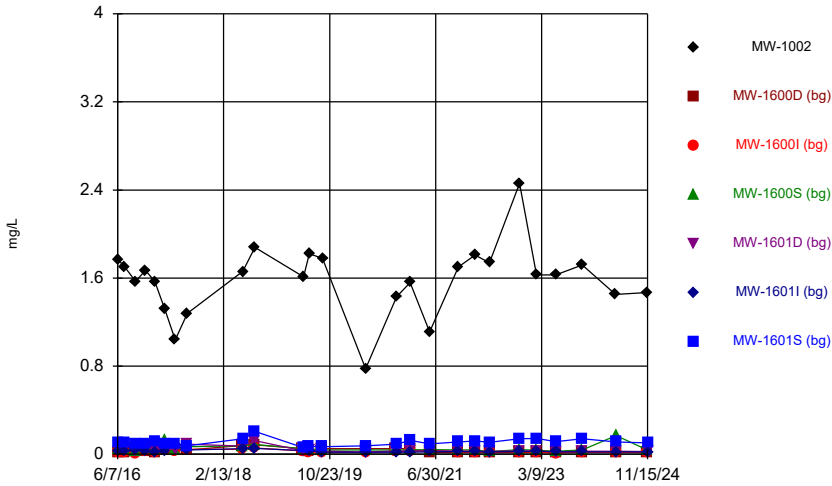


Constituent: Boron, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

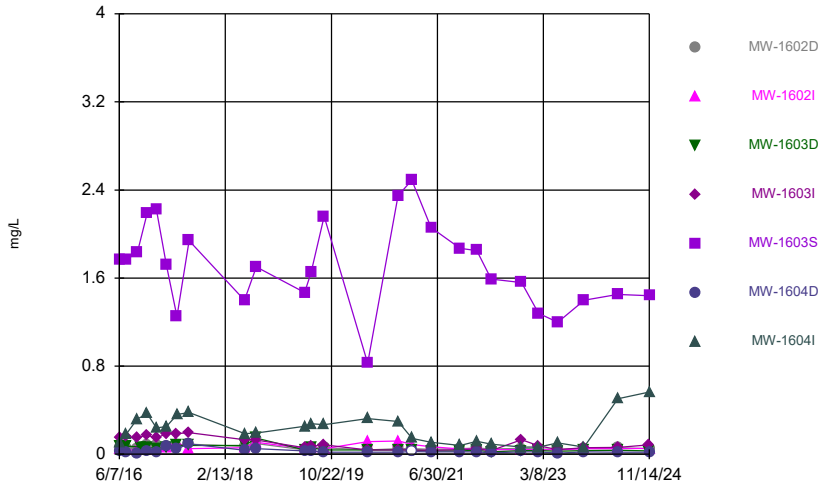


Constituent: Boron, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

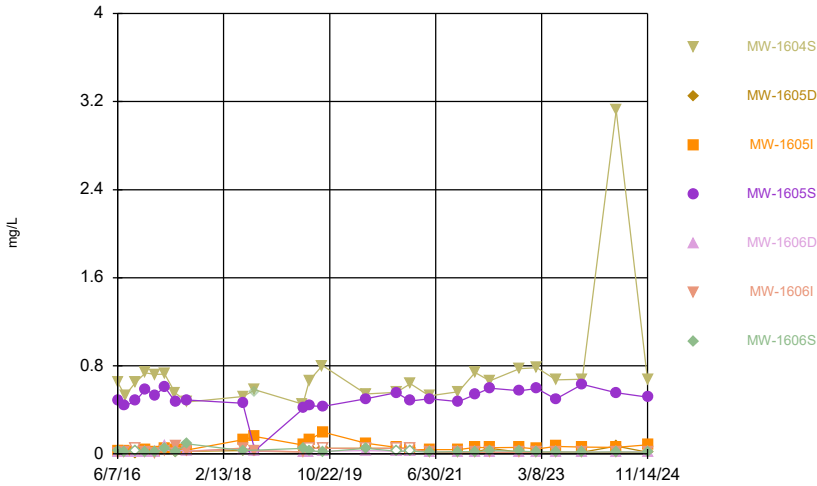


Constituent: Boron, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

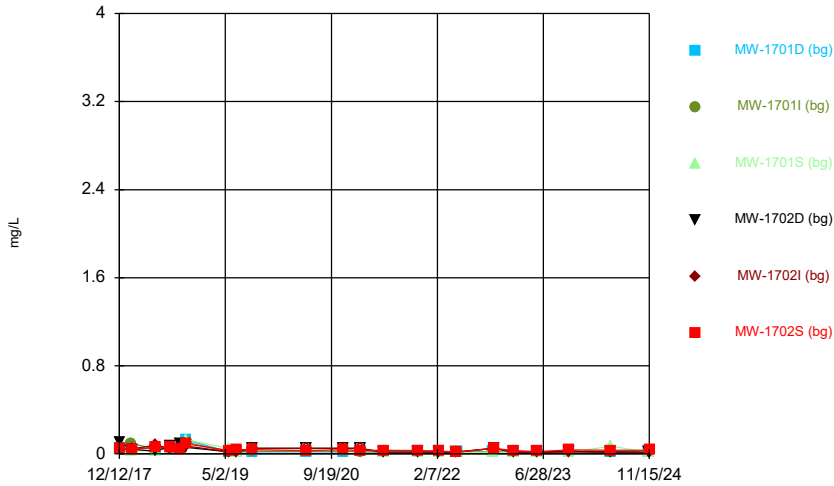


Constituent: Boron, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

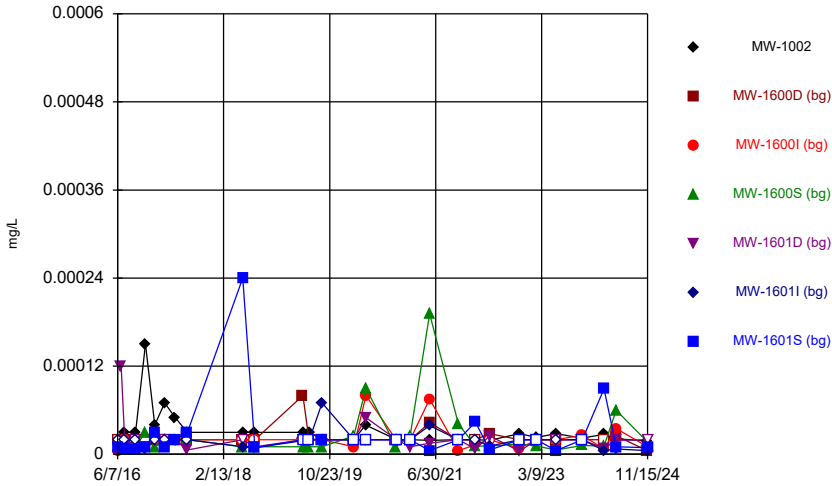


Constituent: Cadmium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

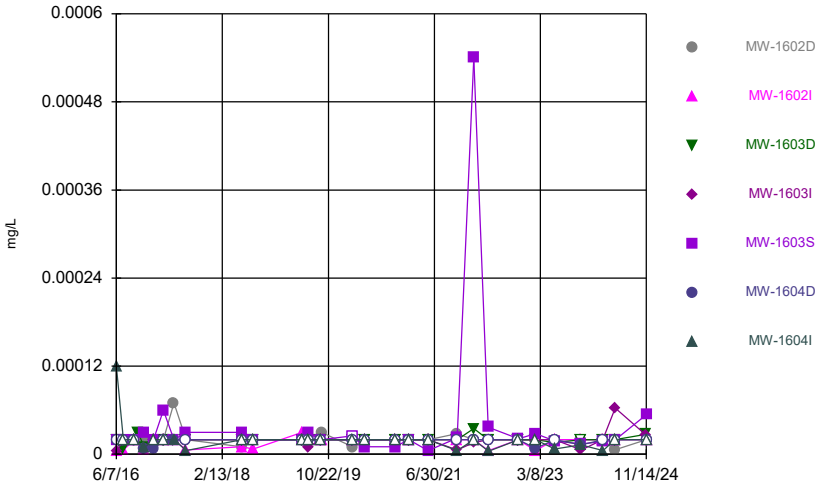


Constituent: Cadmium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

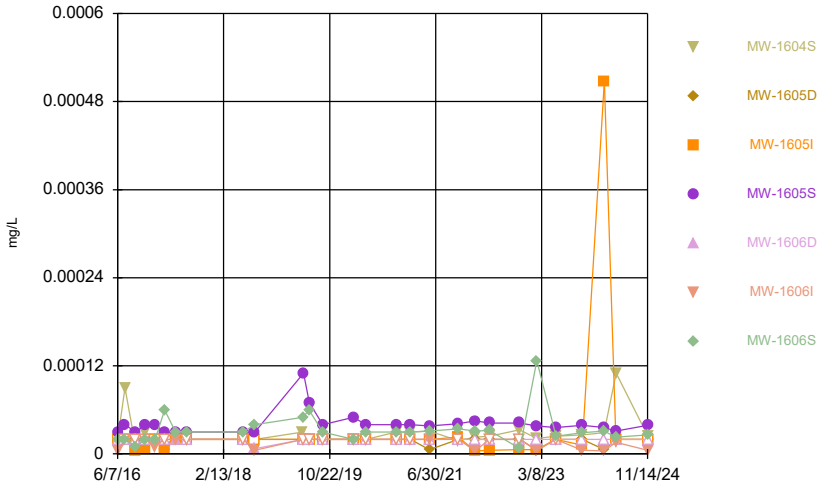


Constituent: Cadmium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

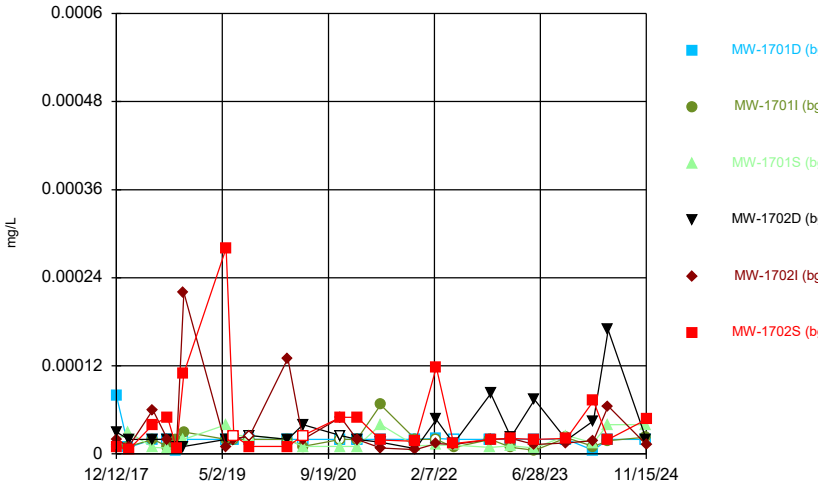


Constituent: Cadmium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Time Series

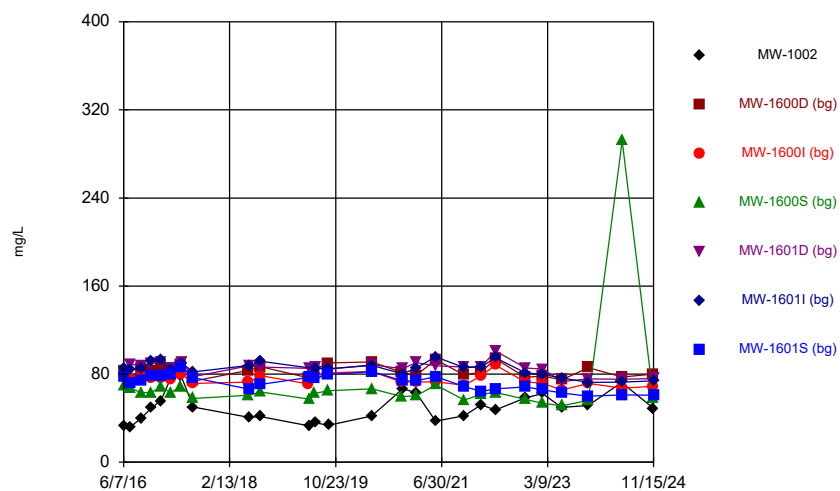


Time Series

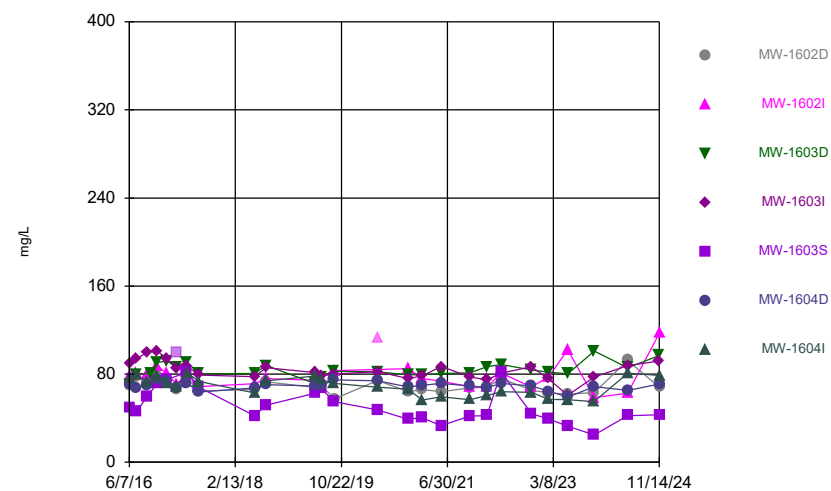


Time Series

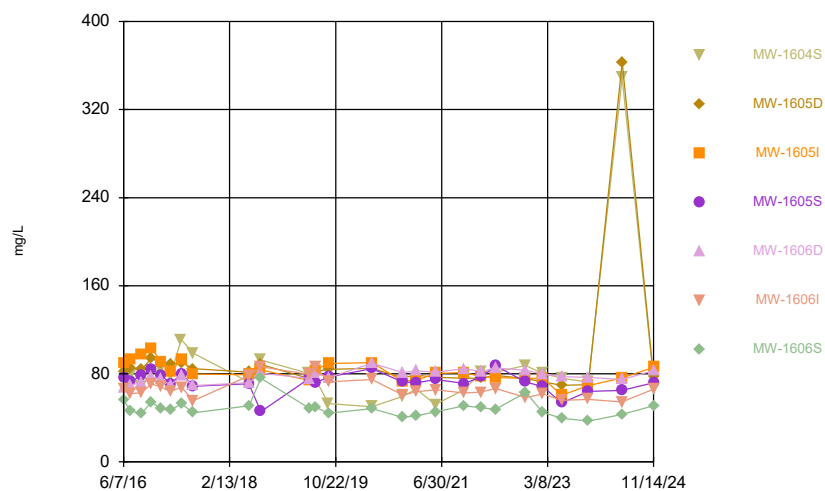


Time Series

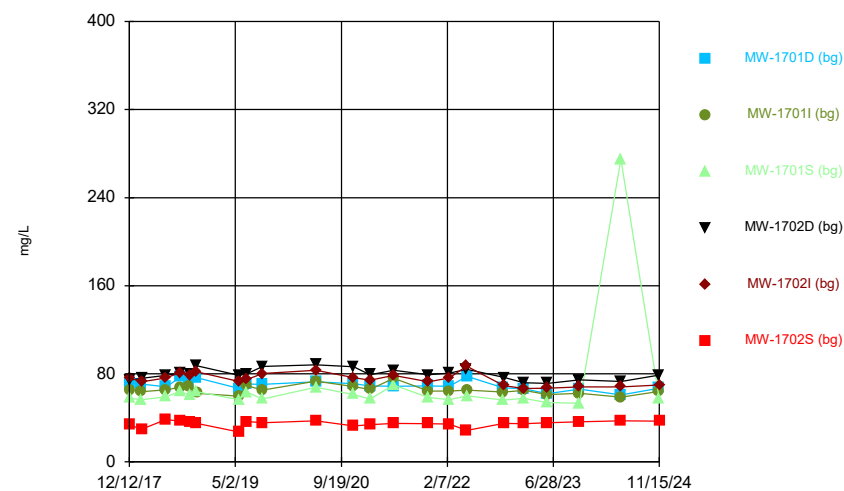


Time Series

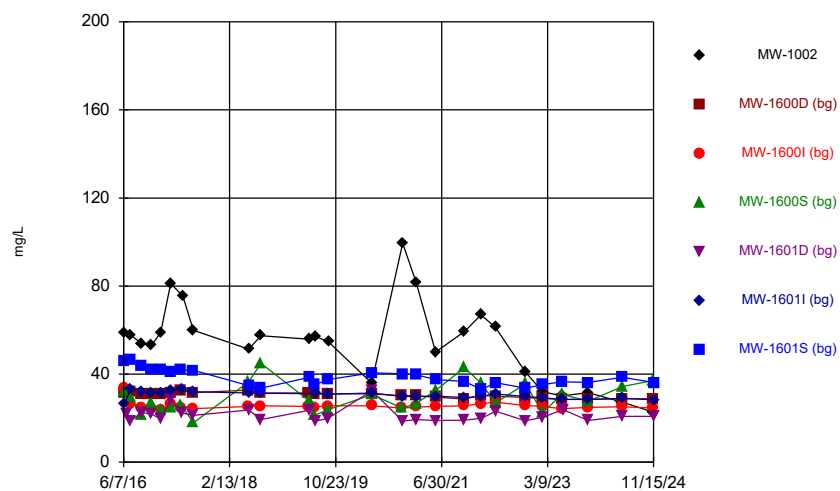


Time Series

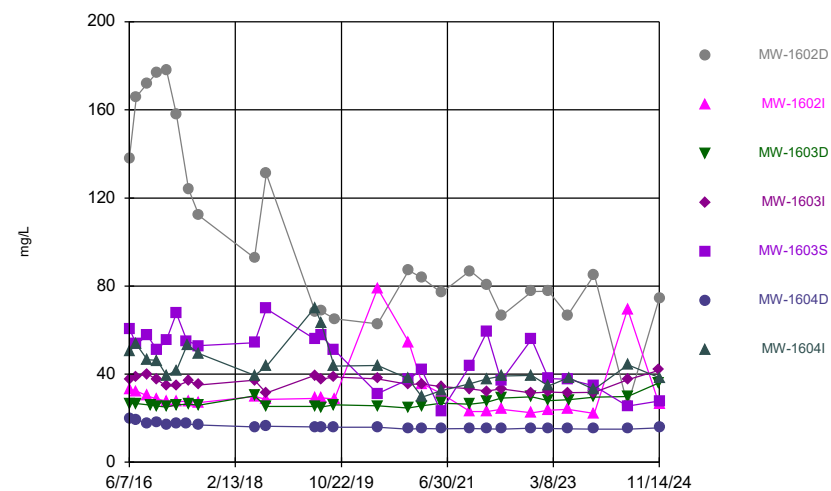


Time Series

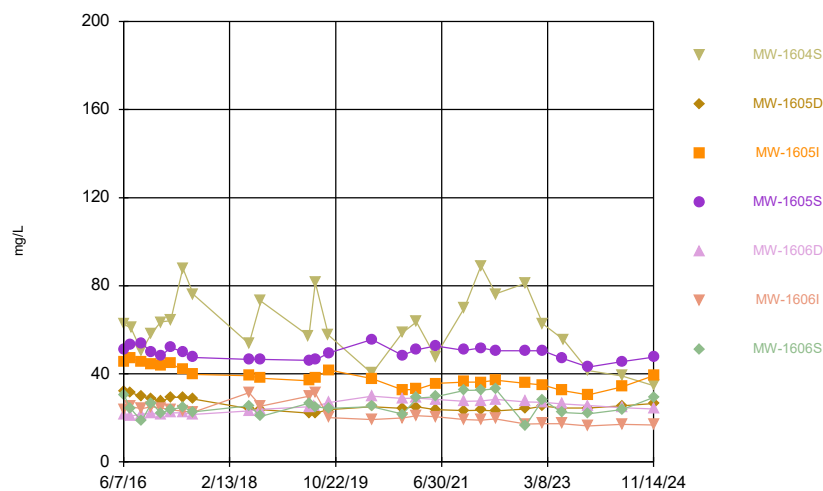

Time Series

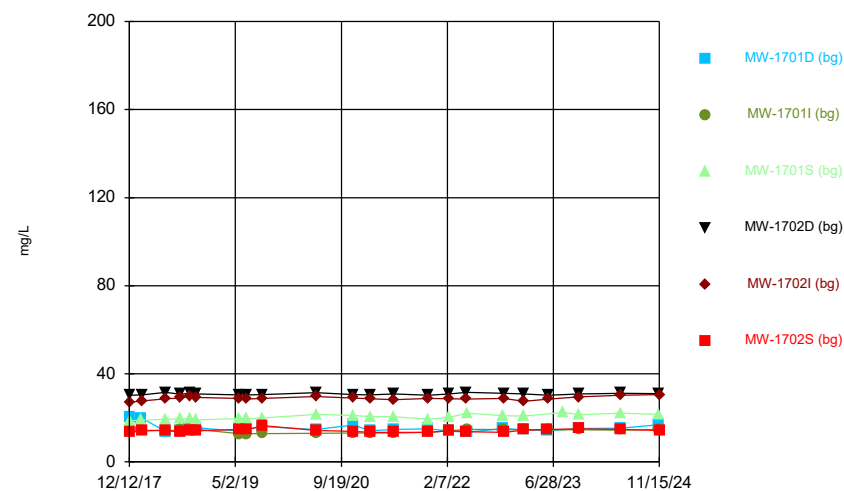


Time Series

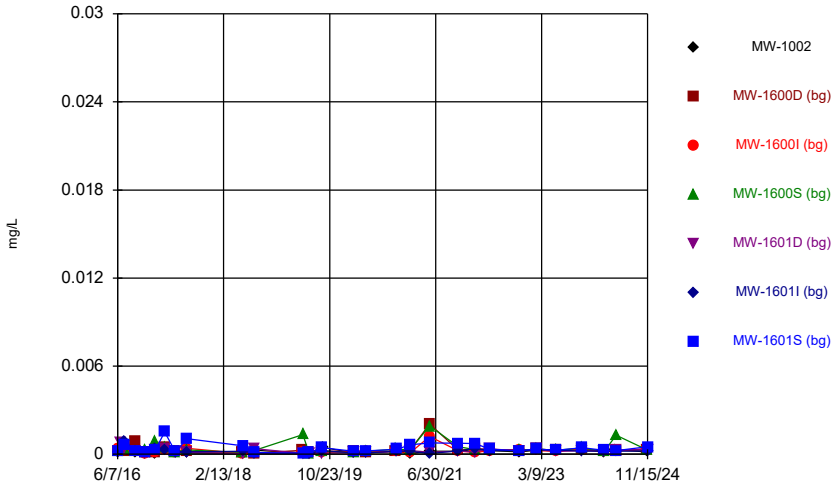


Constituent: Chromium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

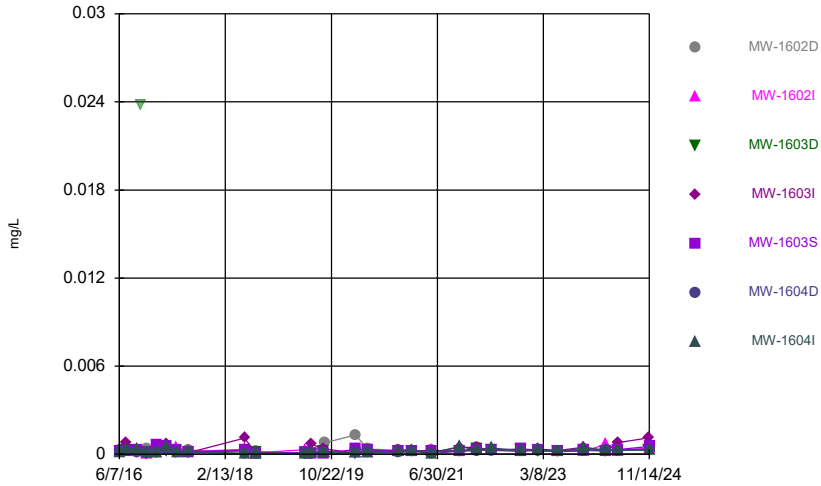


Constituent: Chromium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series




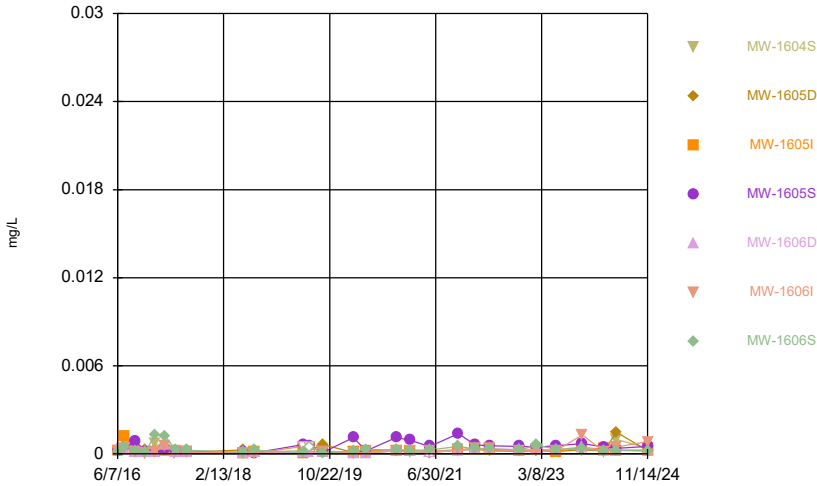


Constituent: Chromium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Time Series

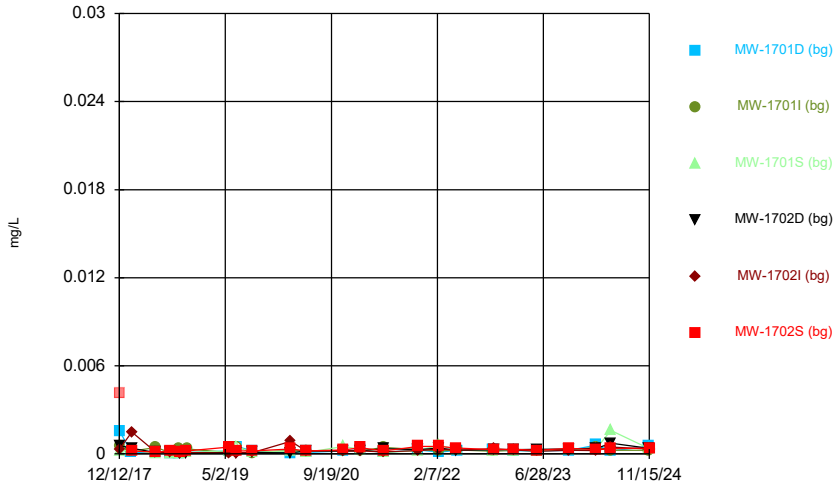

Constituent: Chromium, total Analysis Run 1/24/2025 9:10 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

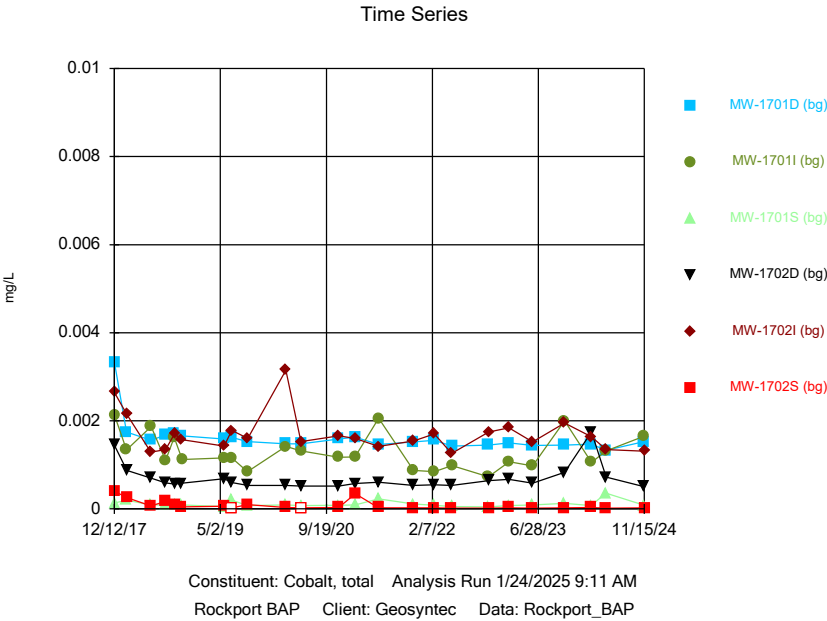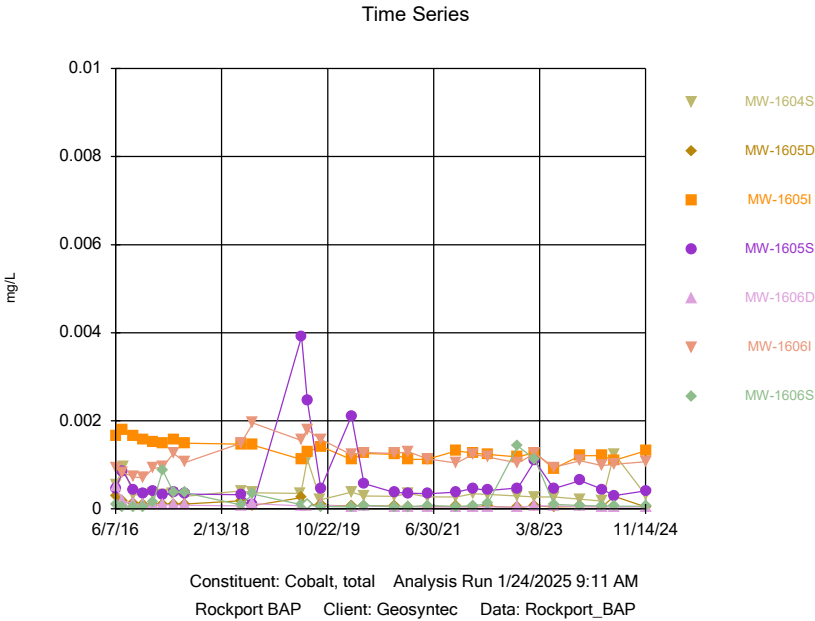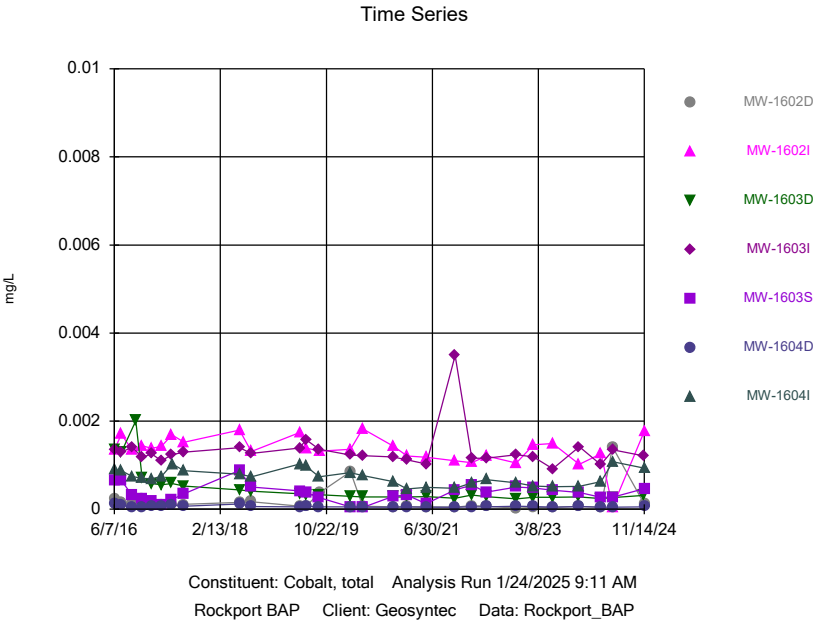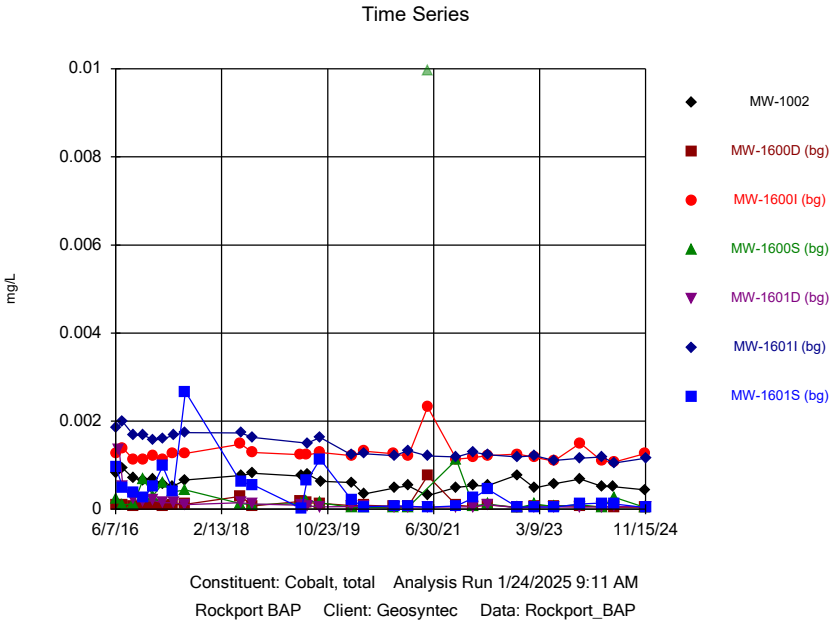


Time Series

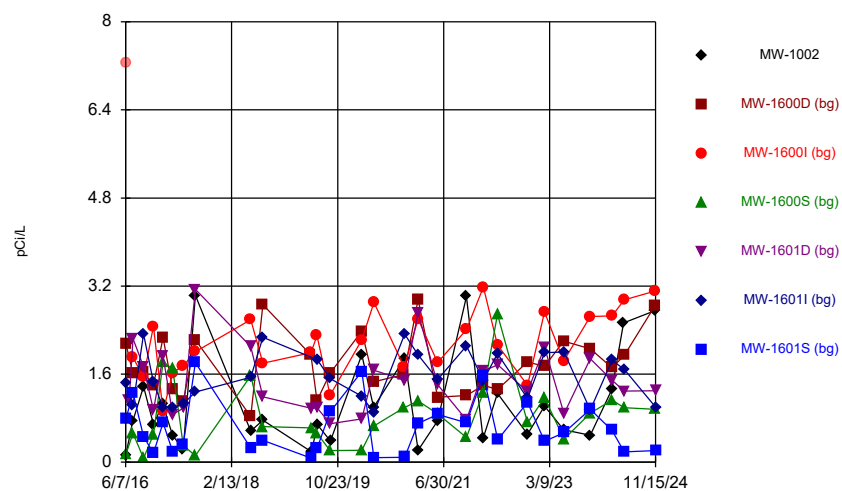


Constituent: Combined Radium 226 + 228 Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

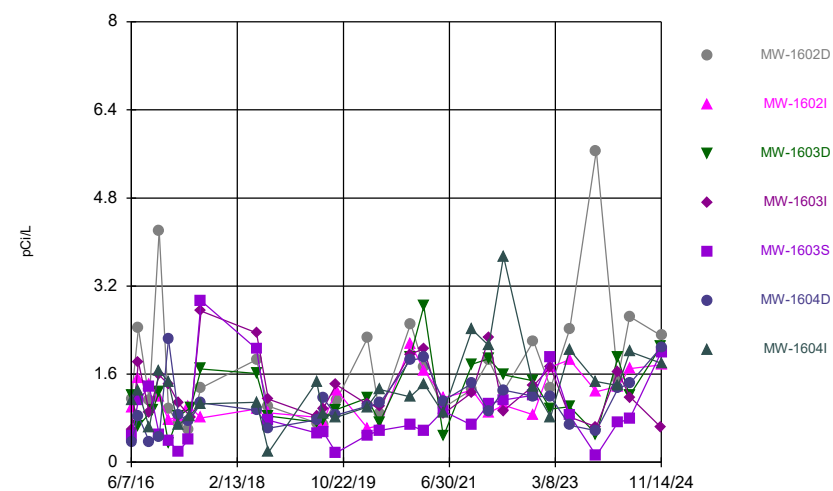


Constituent: Combined Radium 226 + 228 Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

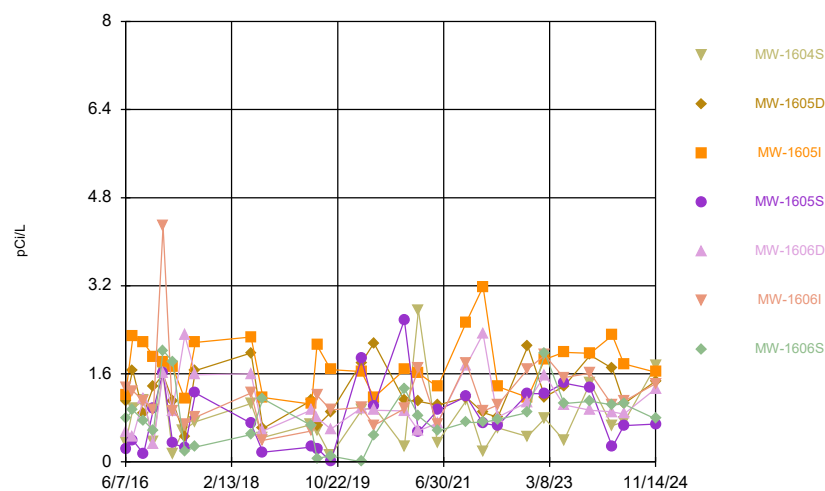


Constituent: Combined Radium 226 + 228 Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

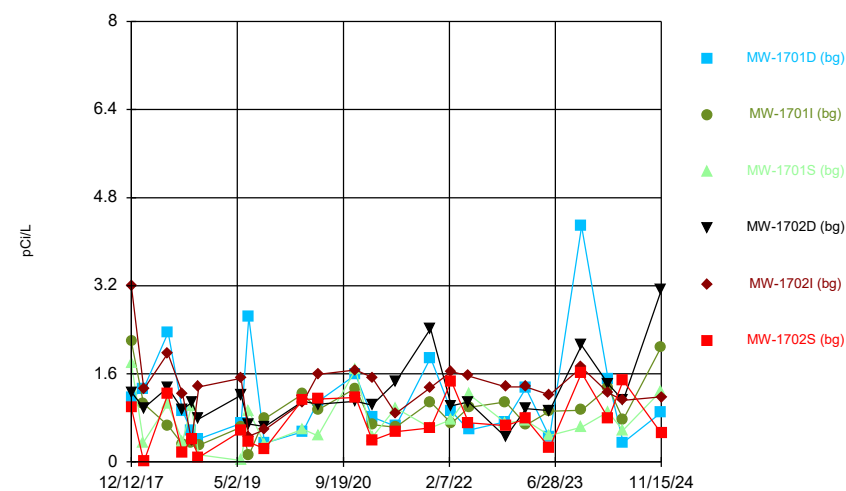


Constituent: Combined Radium 226 + 228 Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Time Series

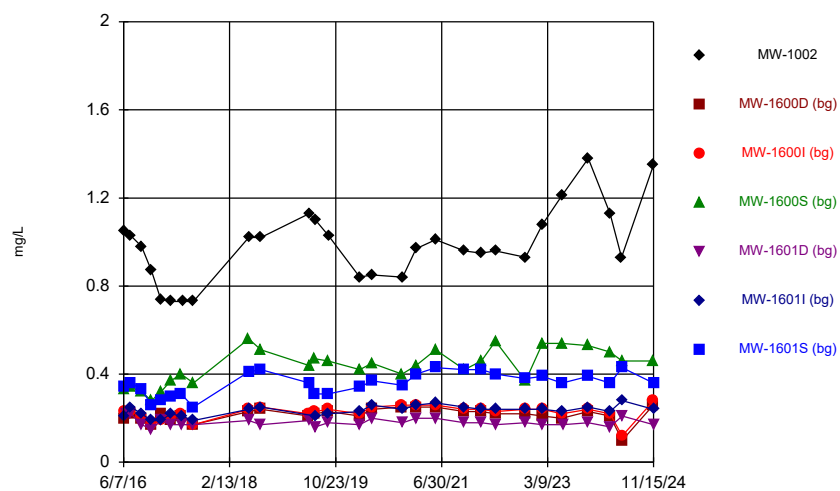


Time Series

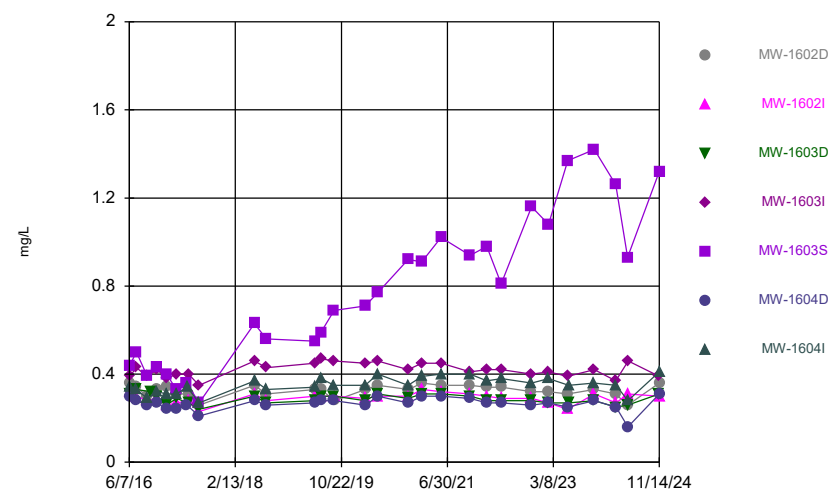


Time Series

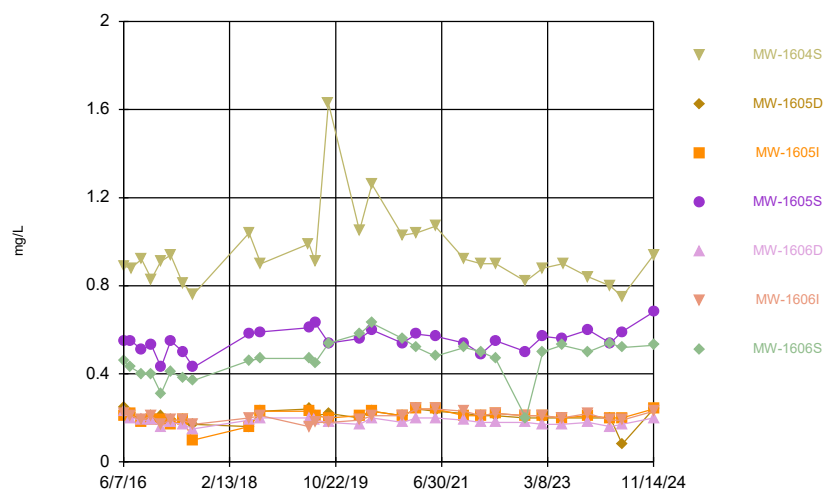


Time Series

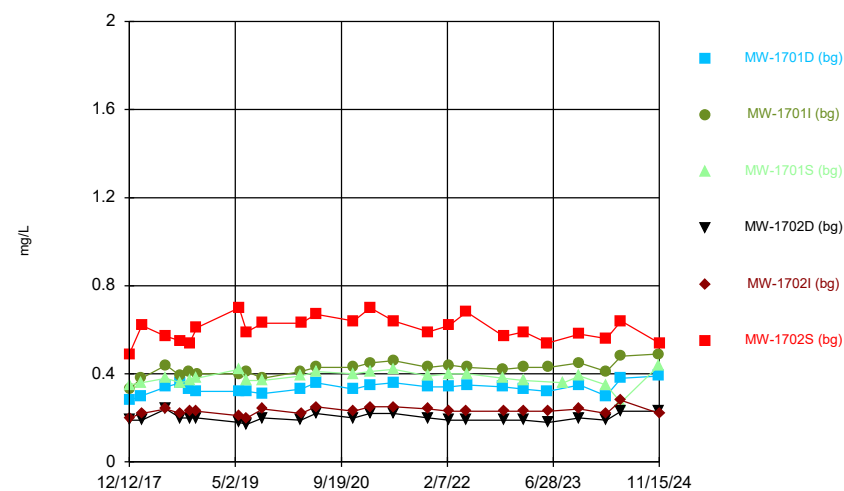


Time Series

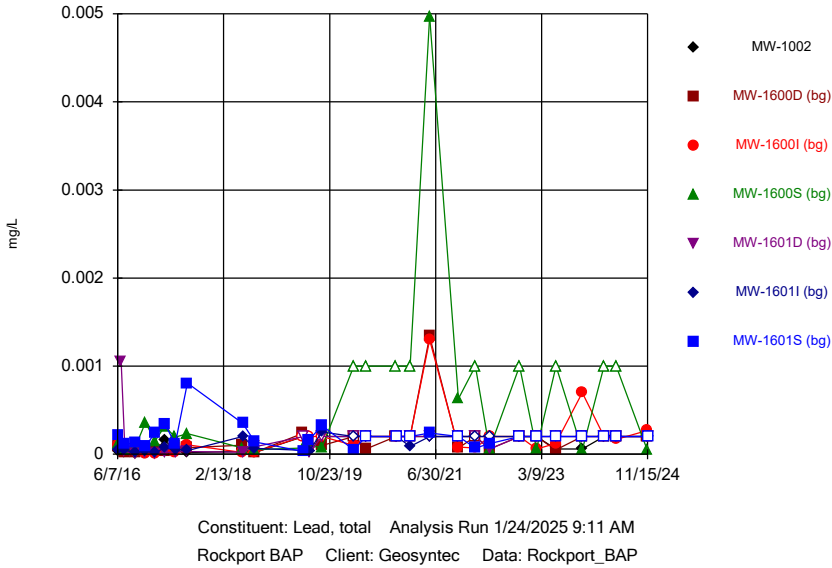


Time Series

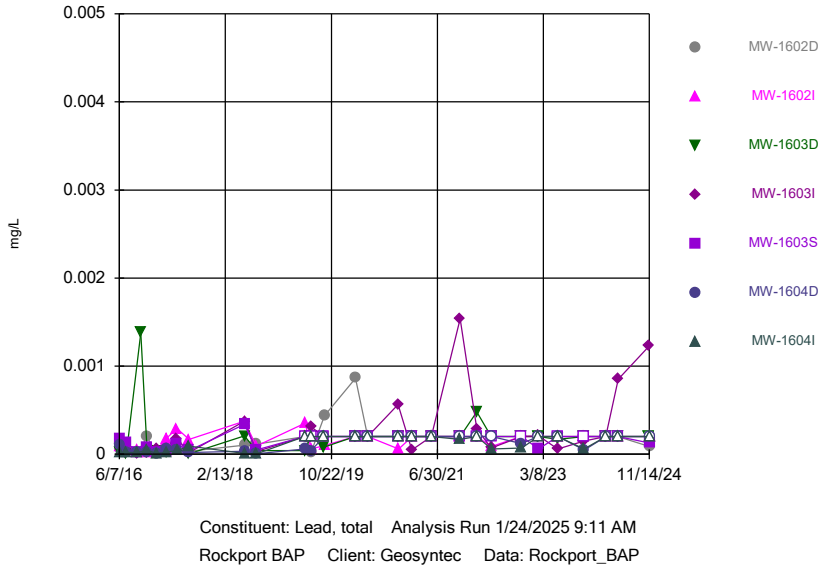


Time Series

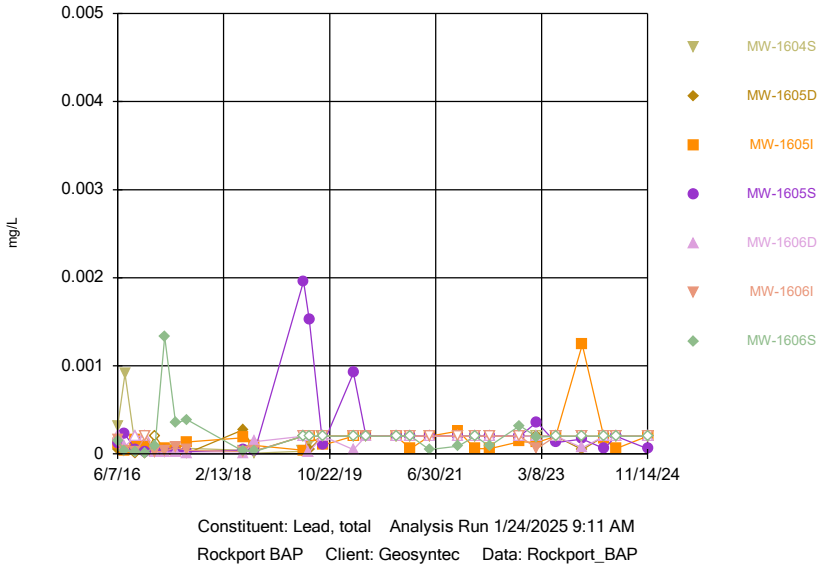


Time Series

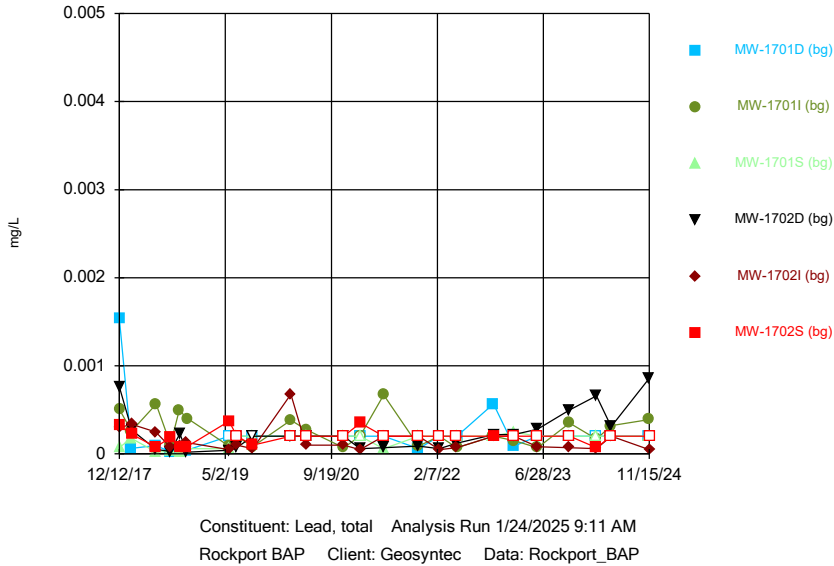


Time Series

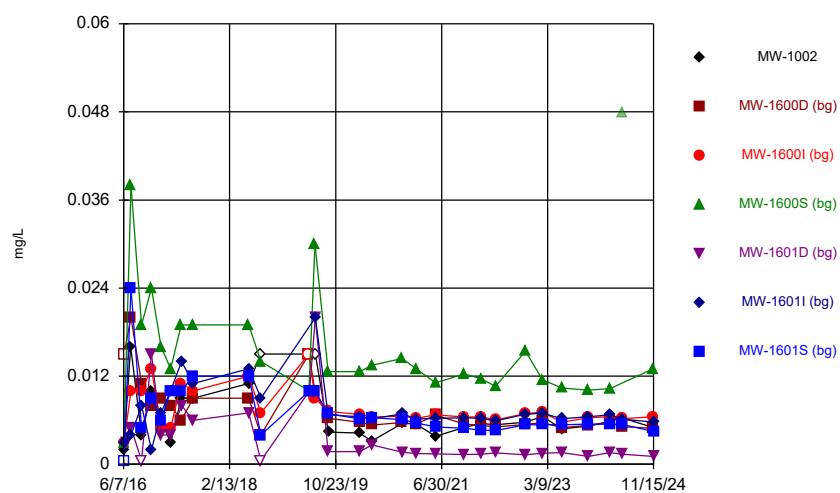


Time Series

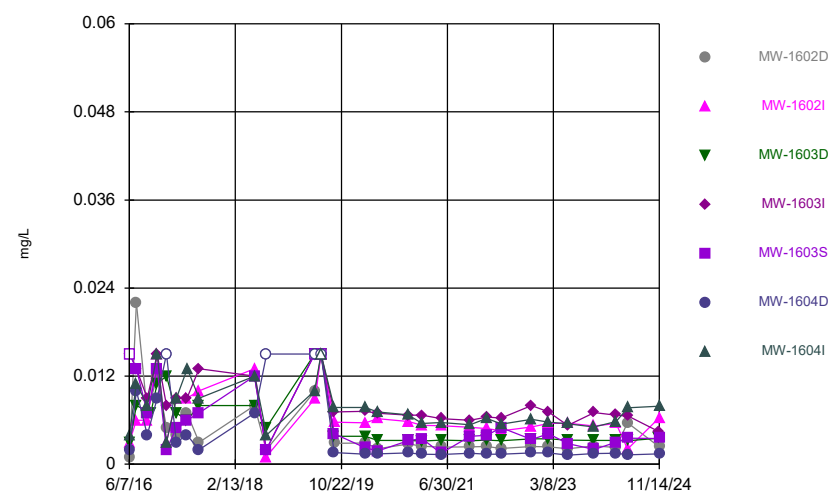


Time Series

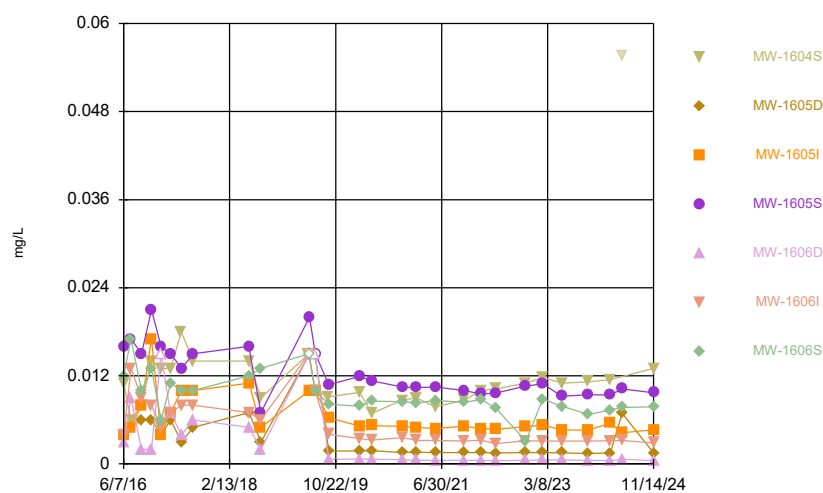

Time Series

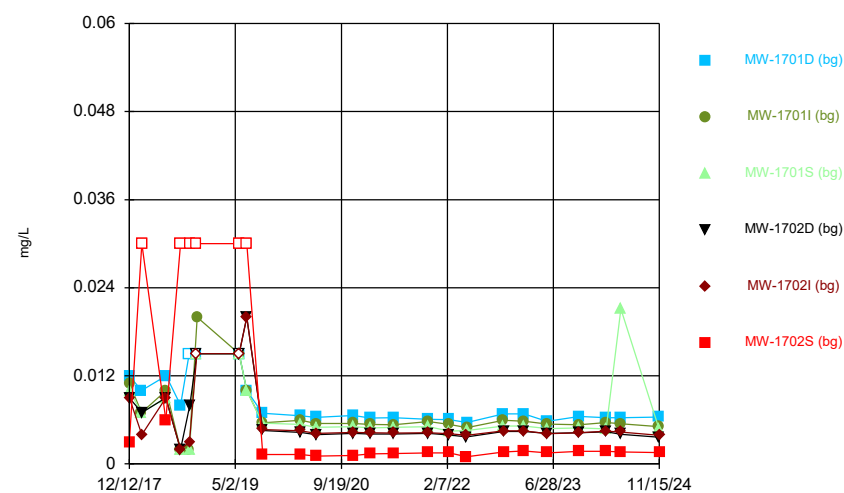


Time Series

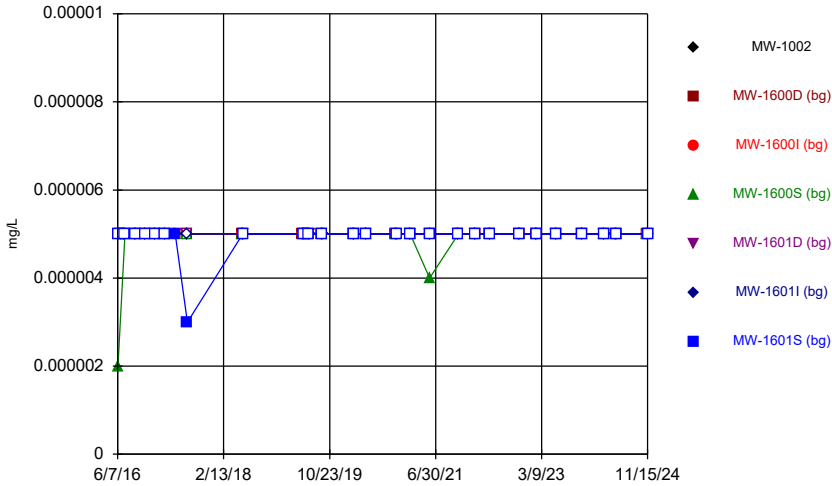


Constituent: Mercury, total Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

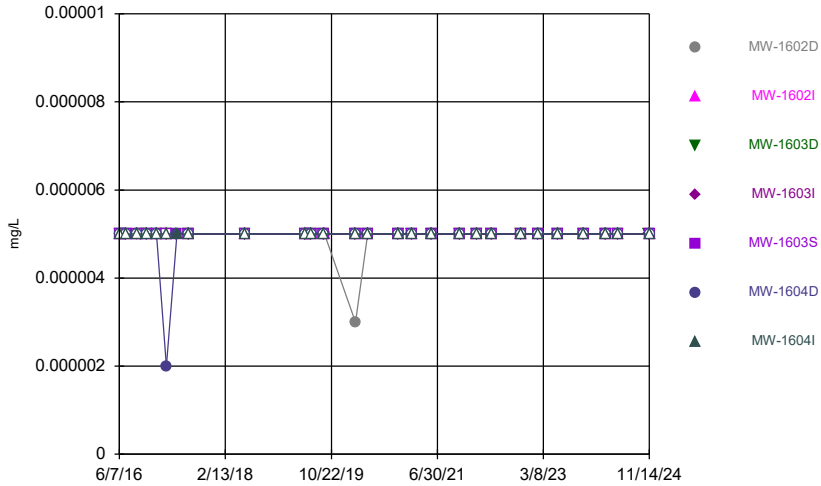


Constituent: Mercury, total Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

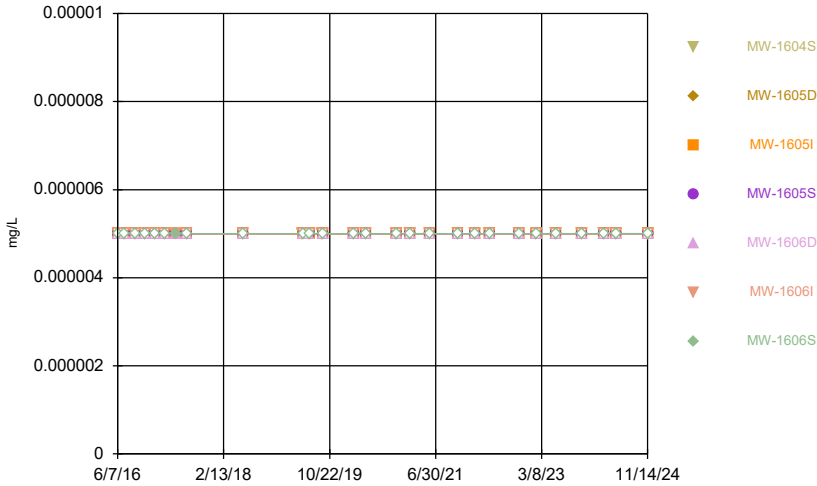


Constituent: Mercury, total Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

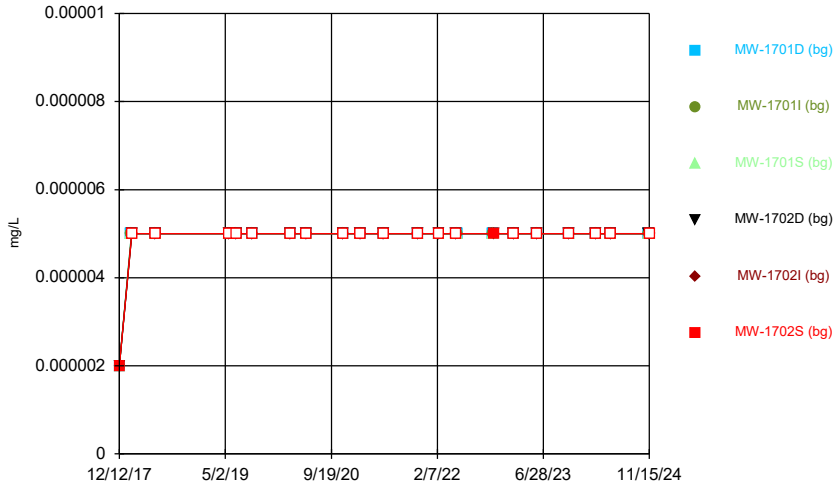


Constituent: Mercury, total Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

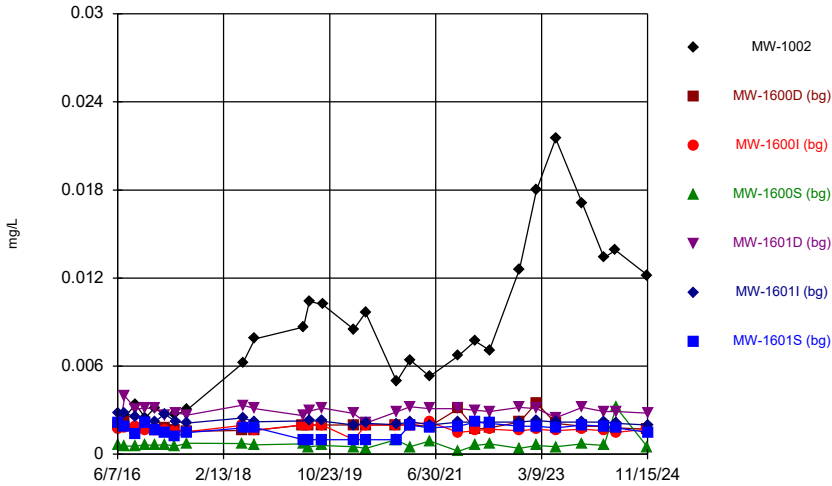


Constituent: Molybdenum, total Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

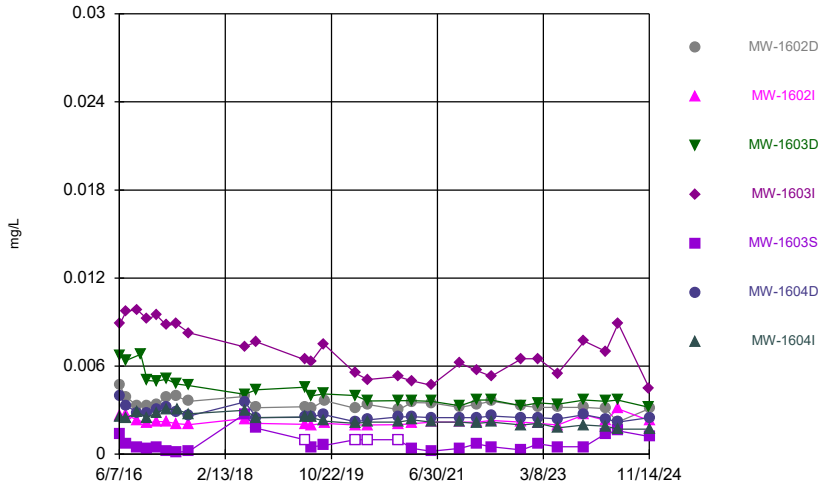


Constituent: Molybdenum, total Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

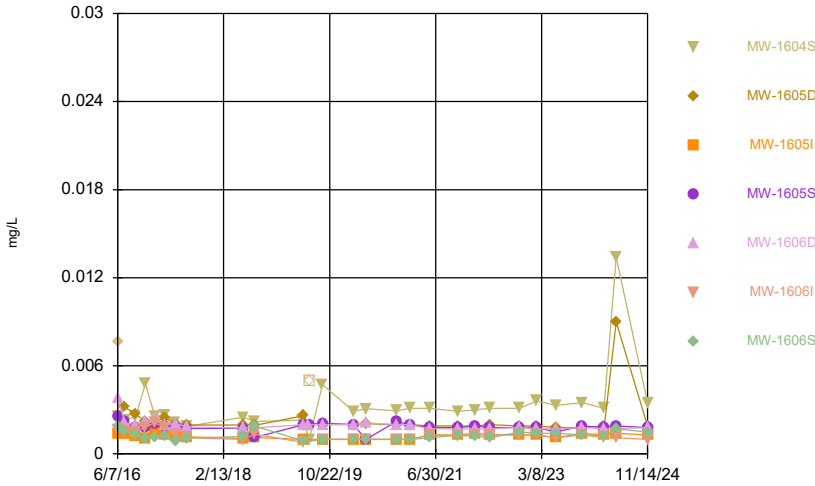


Constituent: Molybdenum, total Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

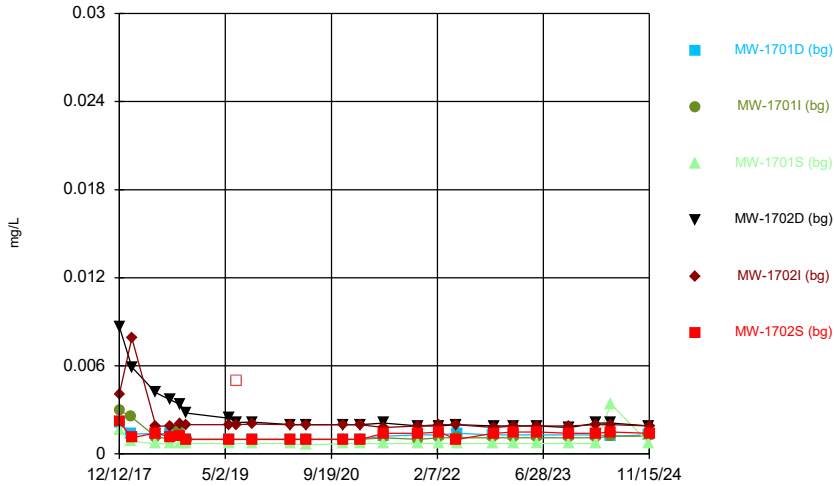


Constituent: Molybdenum, total Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

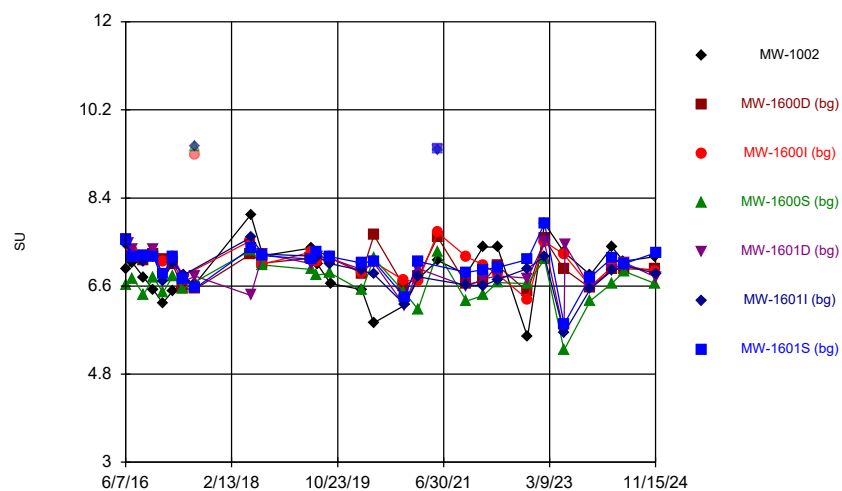


Constituent: pH, field Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

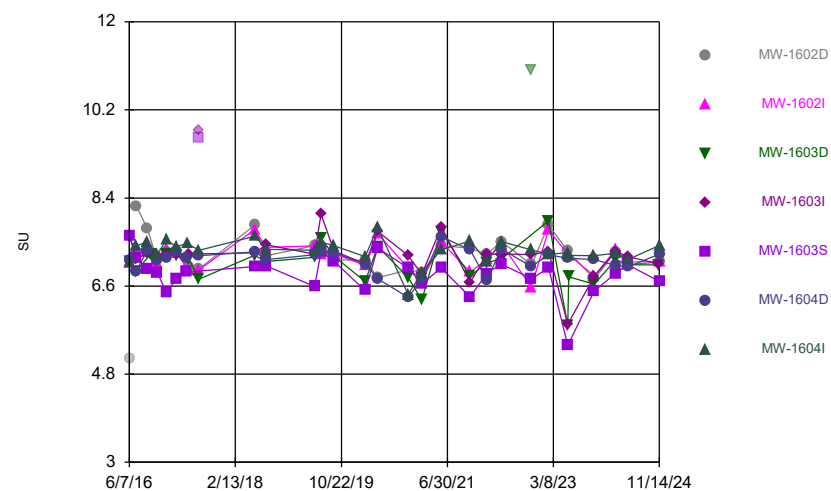


Constituent: pH, field Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

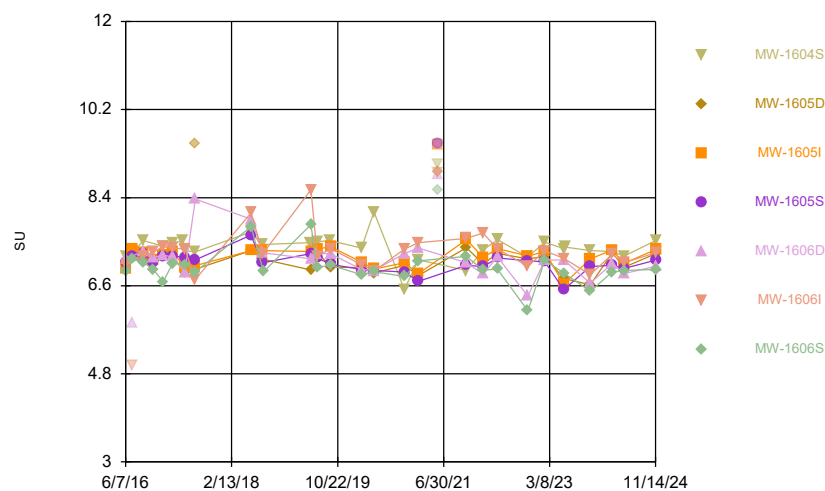


Constituent: pH, field Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

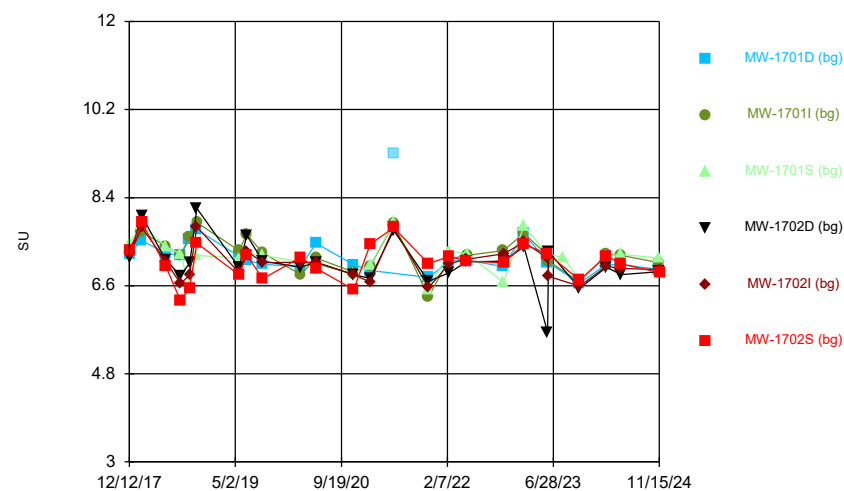


Constituent: pH, field Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

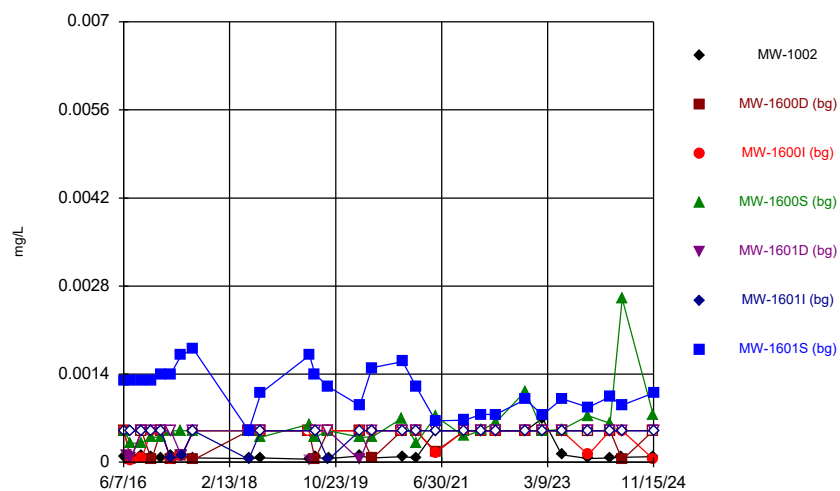


Constituent: Selenium, total Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

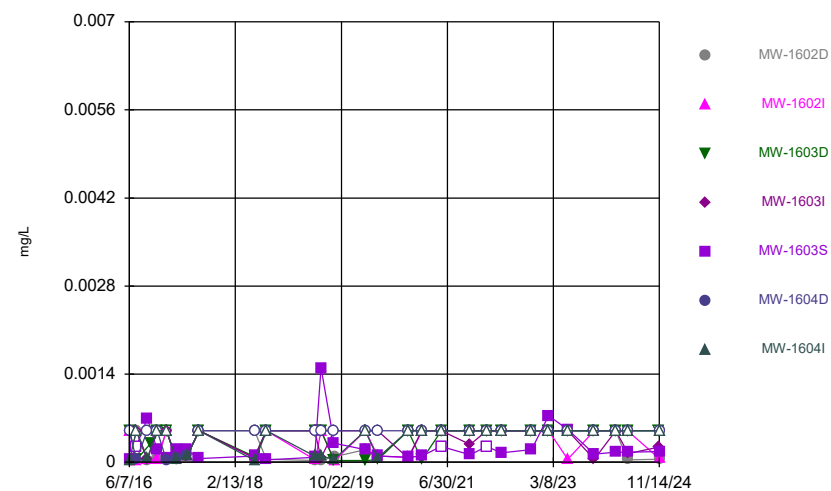


Constituent: Selenium, total Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

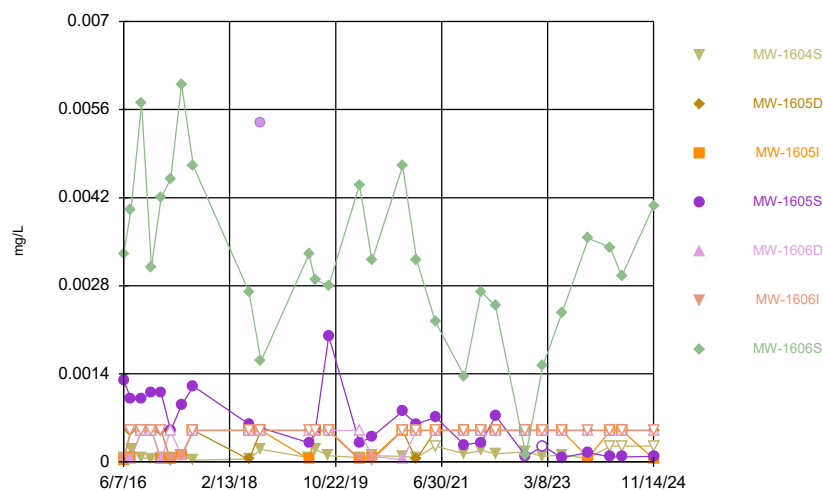


Constituent: Selenium, total Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

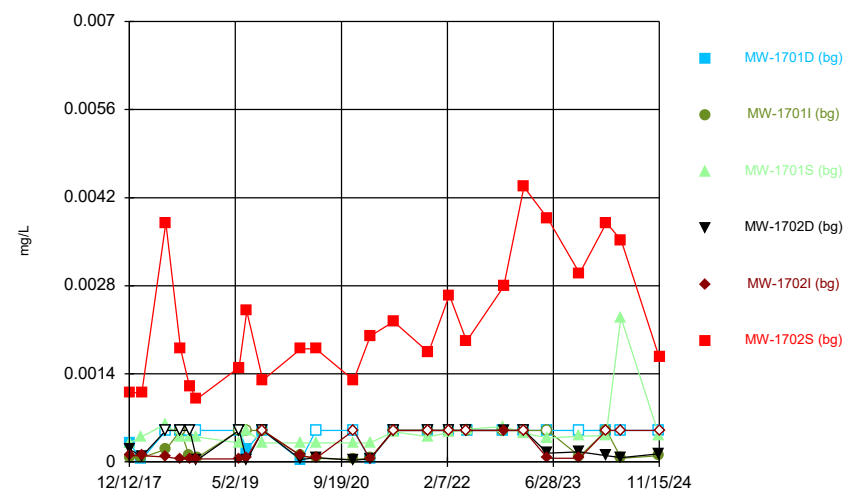


Constituent: Selenium, total Analysis Run 1/24/2025 9:11 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Time Series

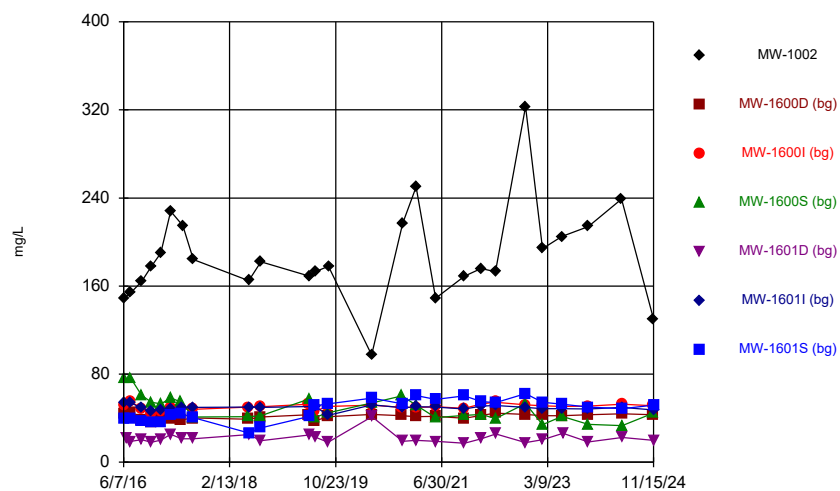


Time Series

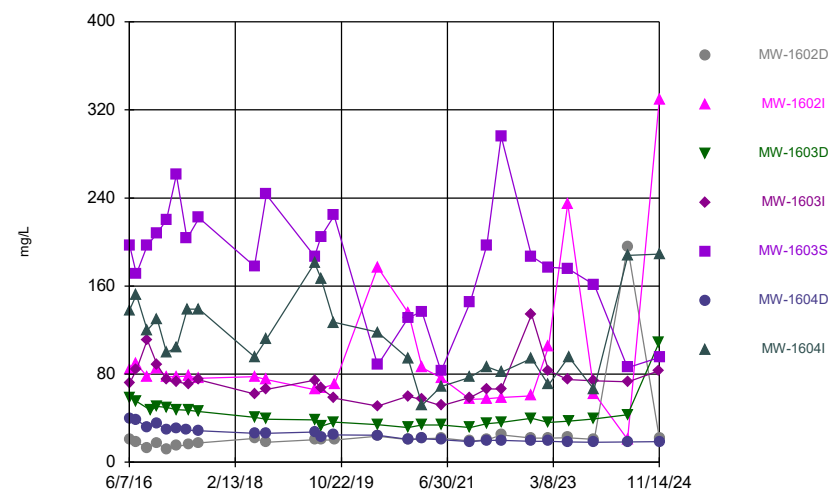


Time Series

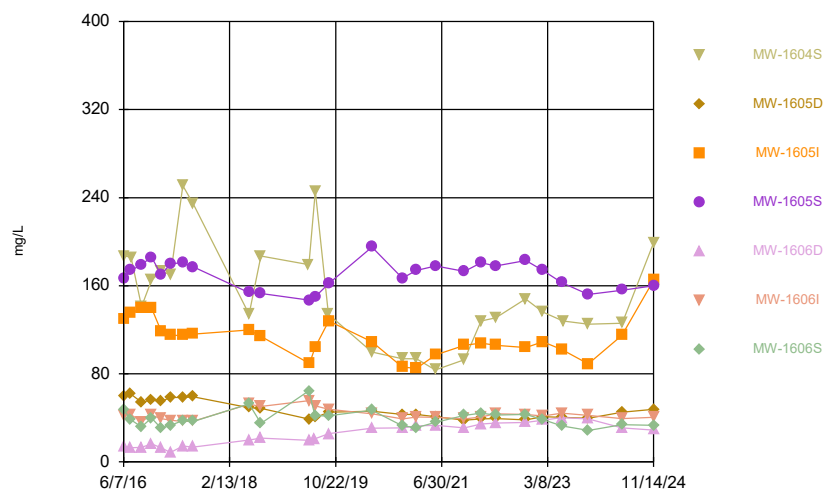

Time Series

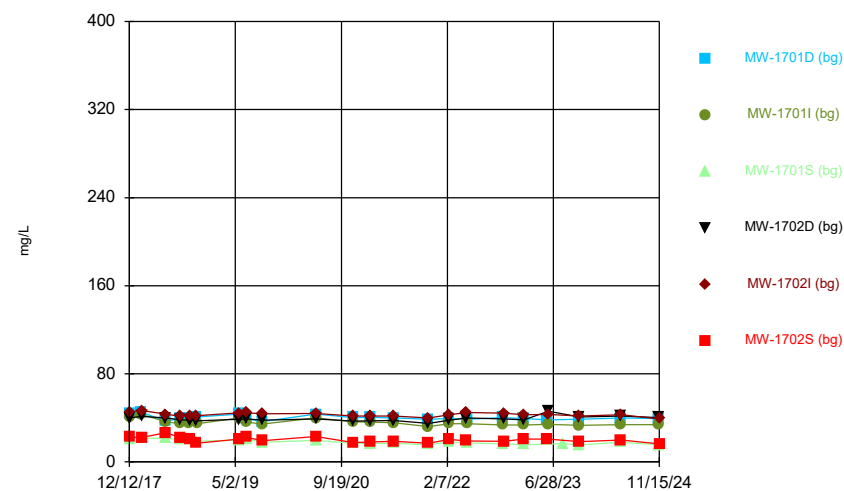


Time Series

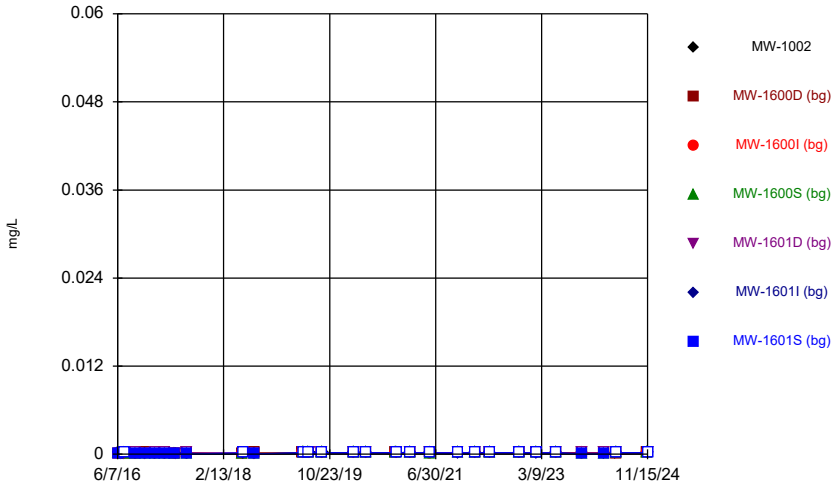


Constituent: Thallium, total Analysis Run 1/24/2025 9:12 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

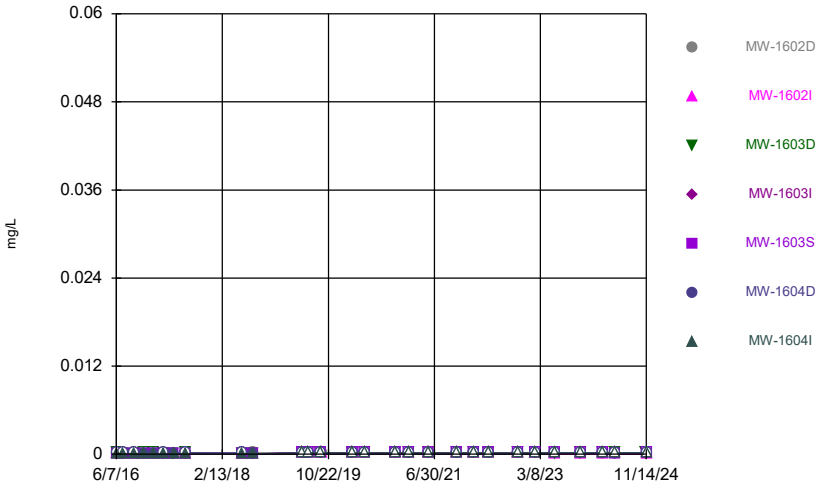


Constituent: Thallium, total Analysis Run 1/24/2025 9:12 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

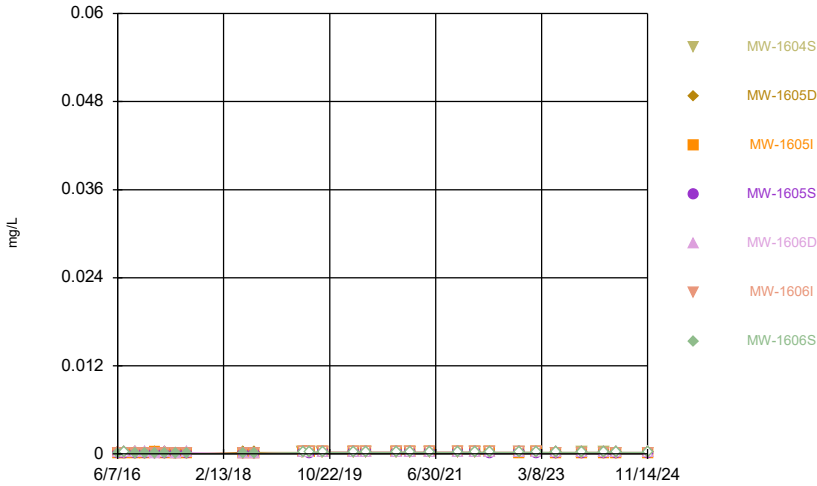

Constituent: Thallium, total Analysis Run 1/24/2025 9:12 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

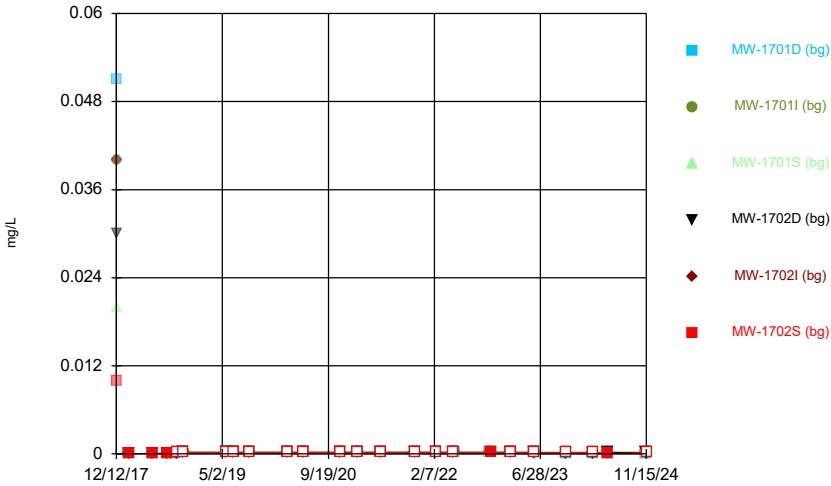

Constituent: Thallium, total Analysis Run 1/24/2025 9:12 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP





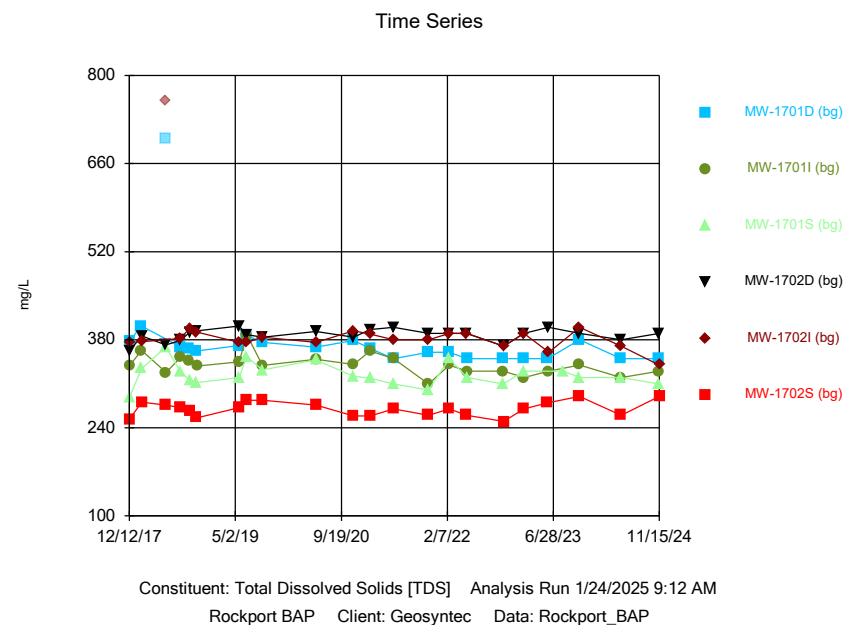


FIGURE B


Box Plots

Box & Whiskers Plot

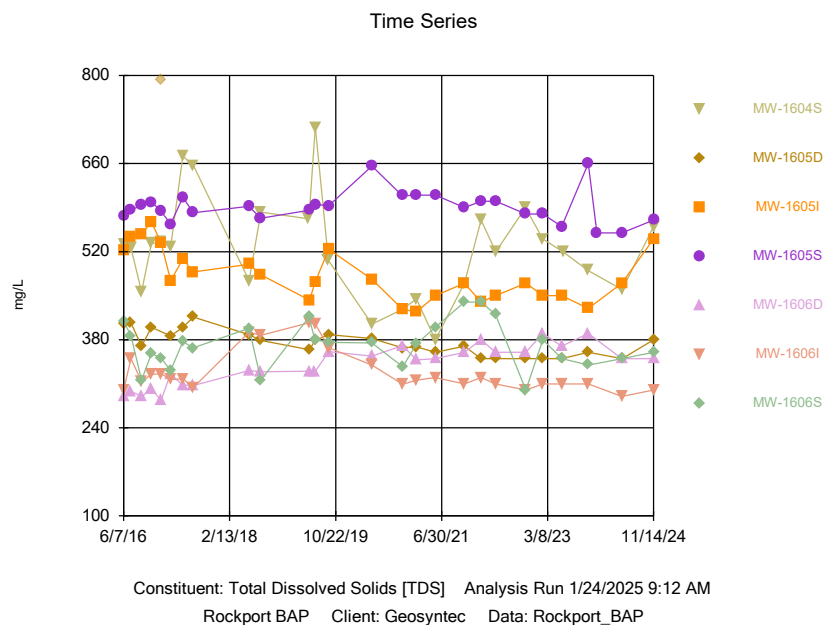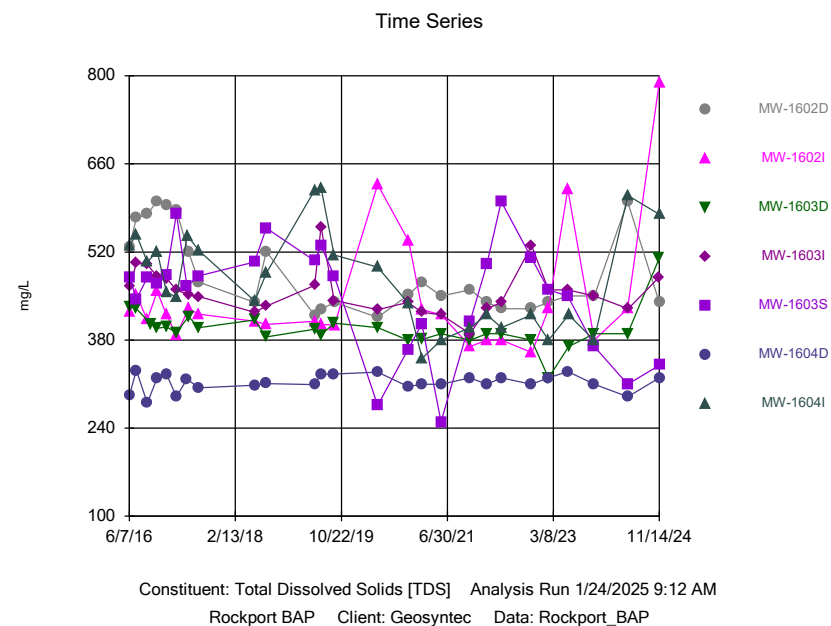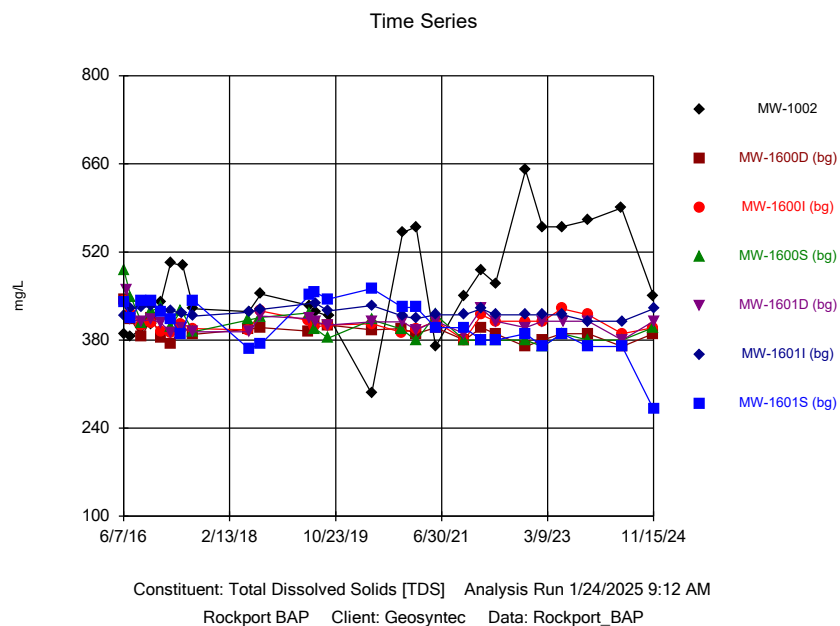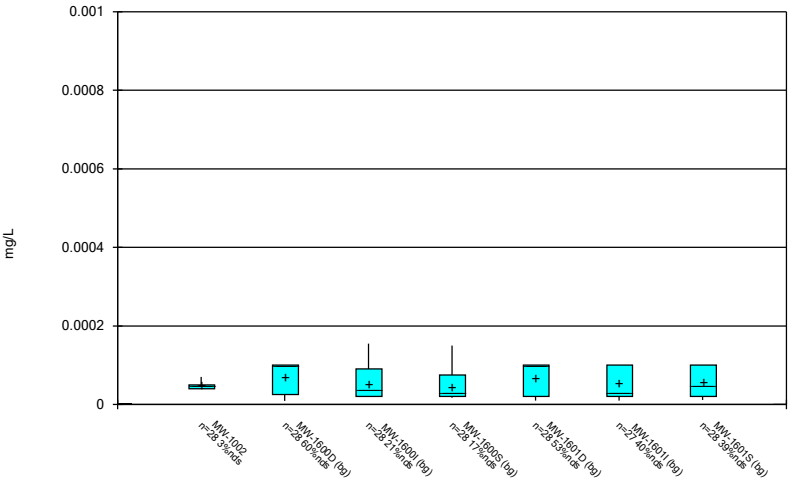


Constituent: Antimony, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

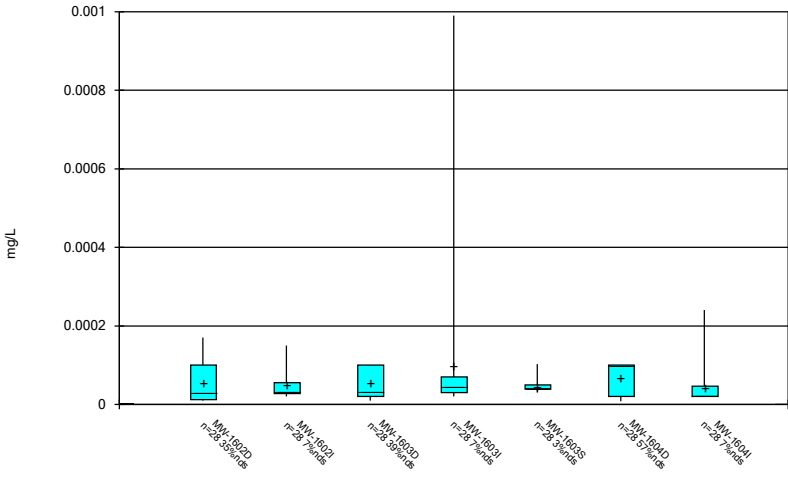


Constituent: Antimony, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

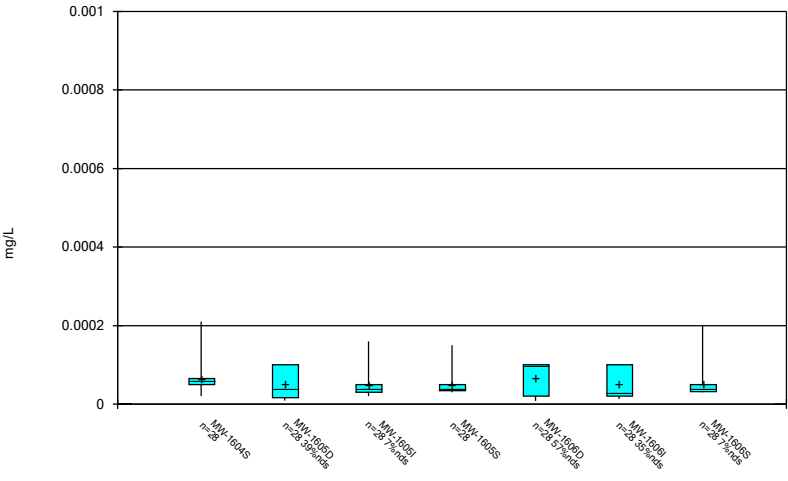


Constituent: Antimony, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

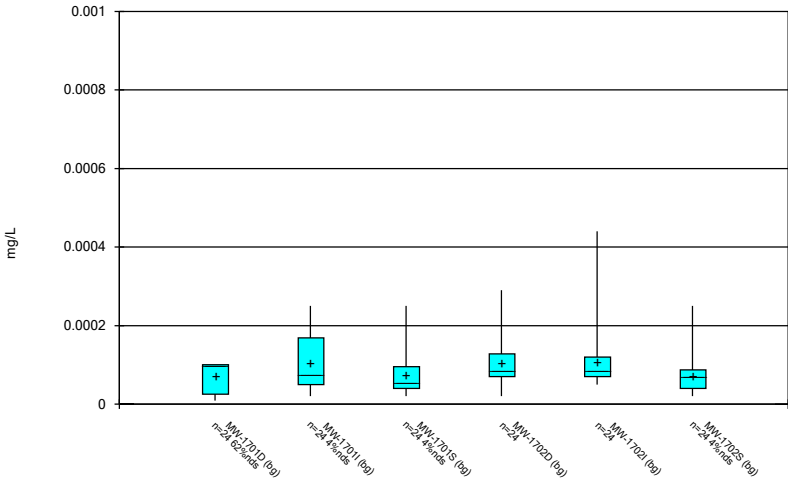


Constituent: Antimony, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

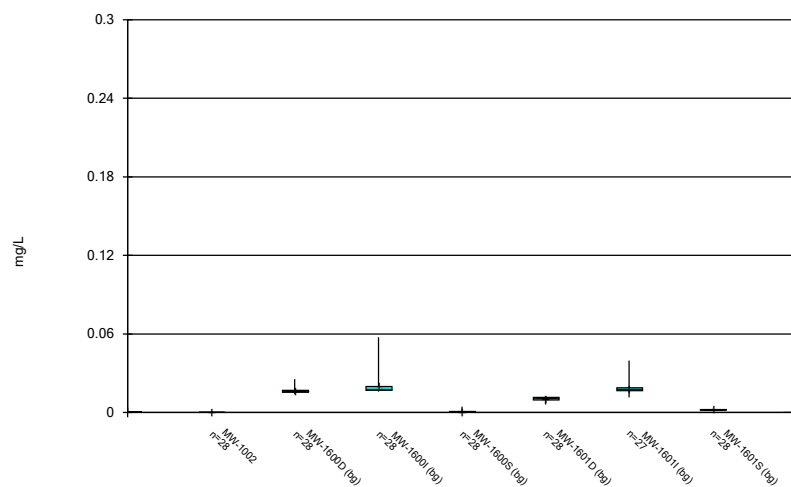


Constituent: Arsenic, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

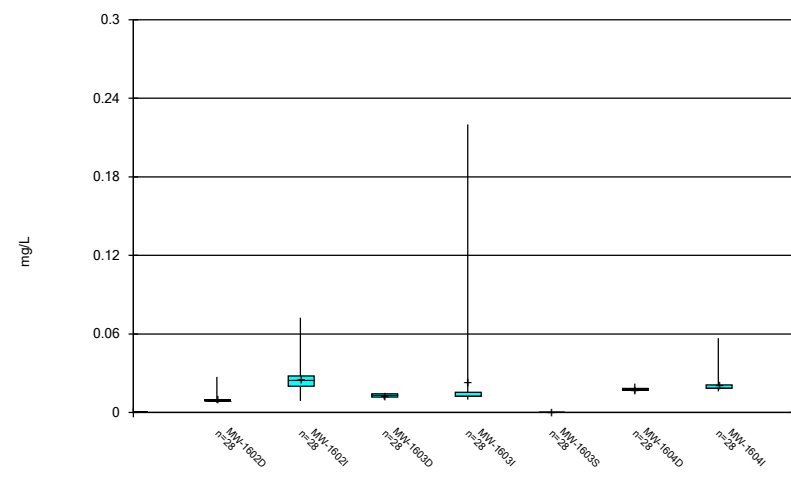


Constituent: Arsenic, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

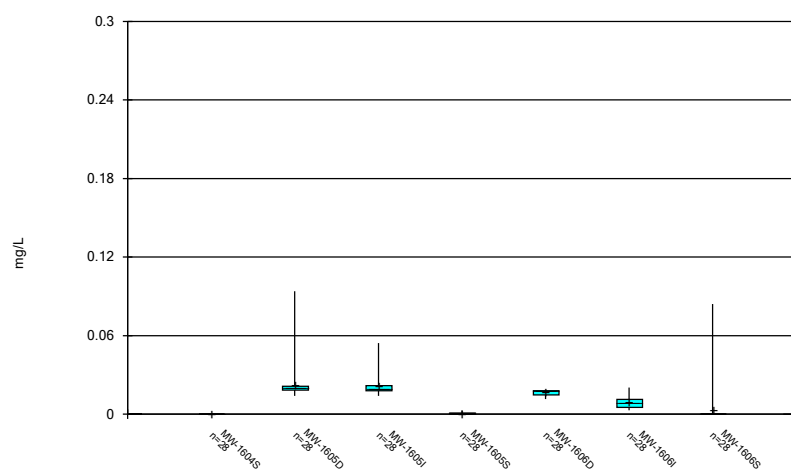


Constituent: Arsenic, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

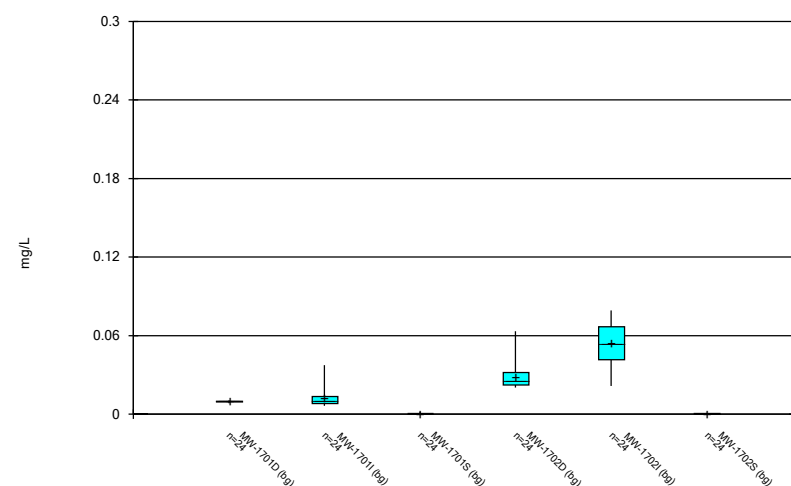


Constituent: Arsenic, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

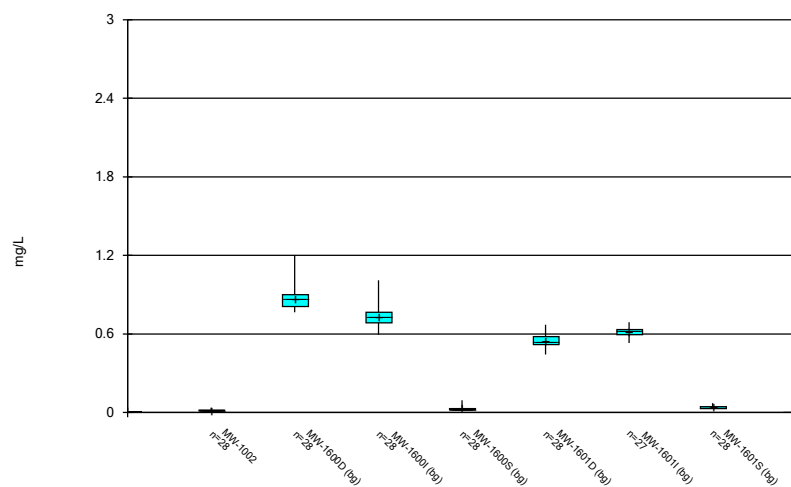


Constituent: Barium, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

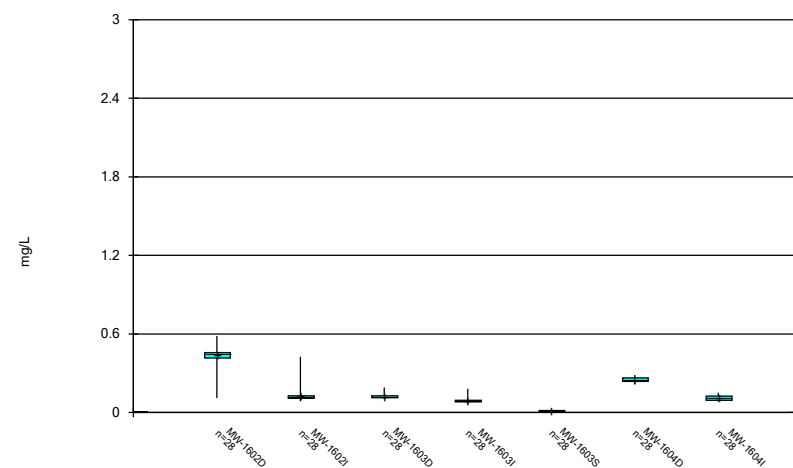


Constituent: Barium, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

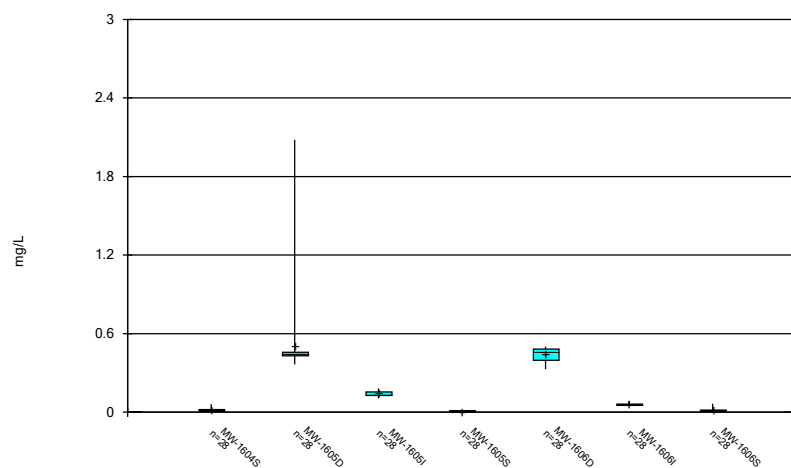


Constituent: Barium, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

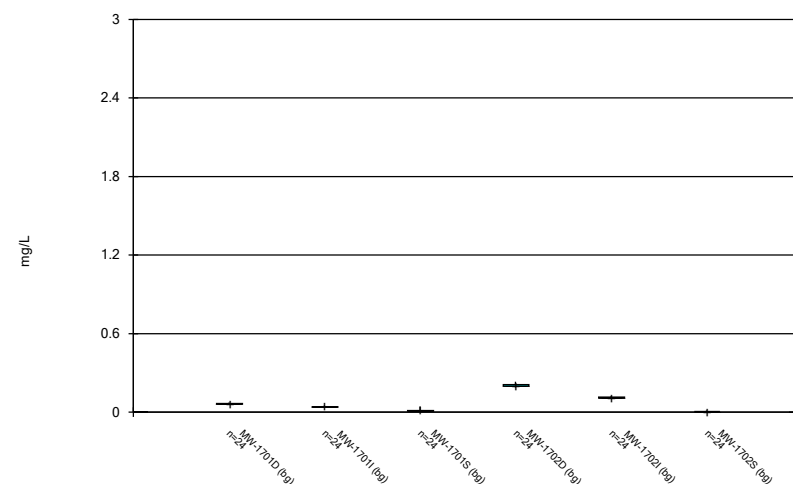


Constituent: Barium, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

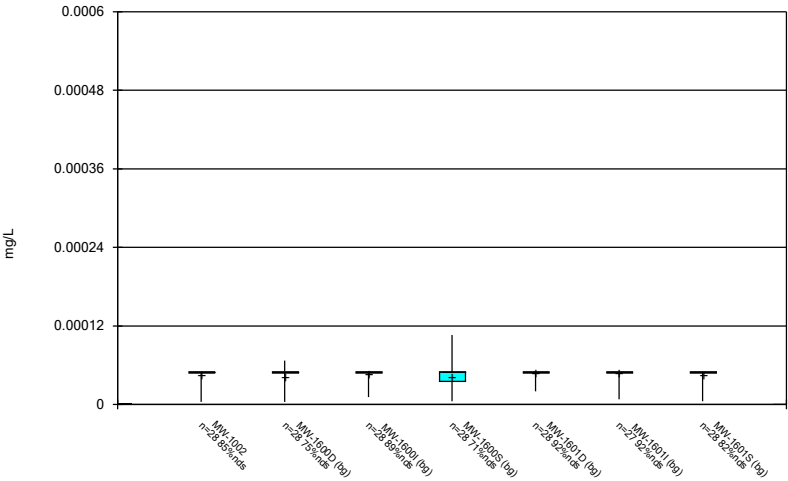


Constituent: Beryllium, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

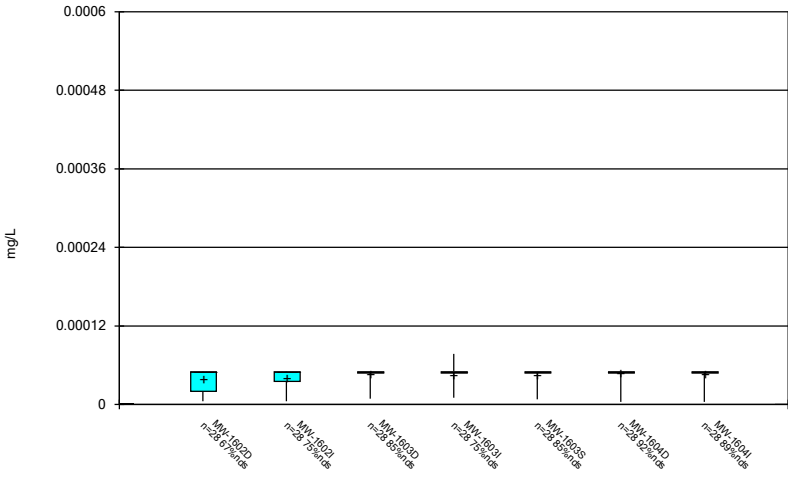


Constituent: Beryllium, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

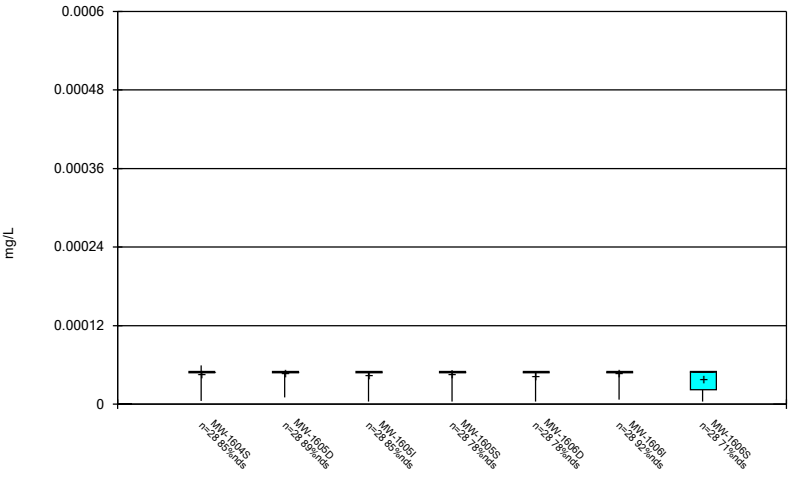


Constituent: Beryllium, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

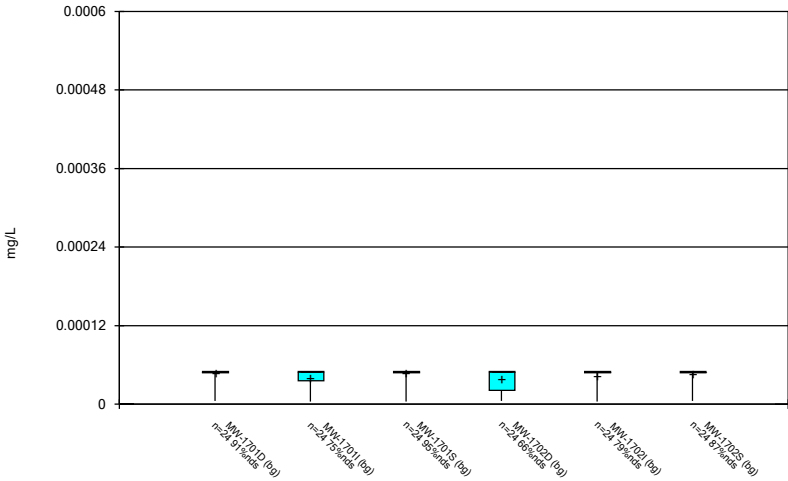


Constituent: Beryllium, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

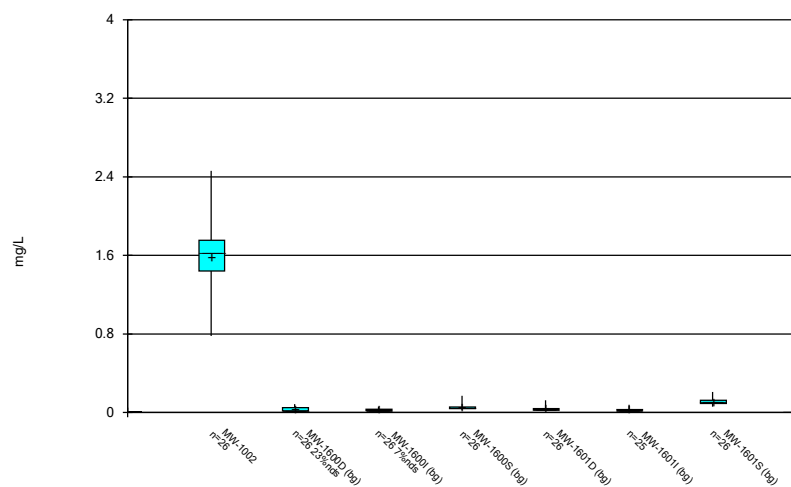


Constituent: Boron, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

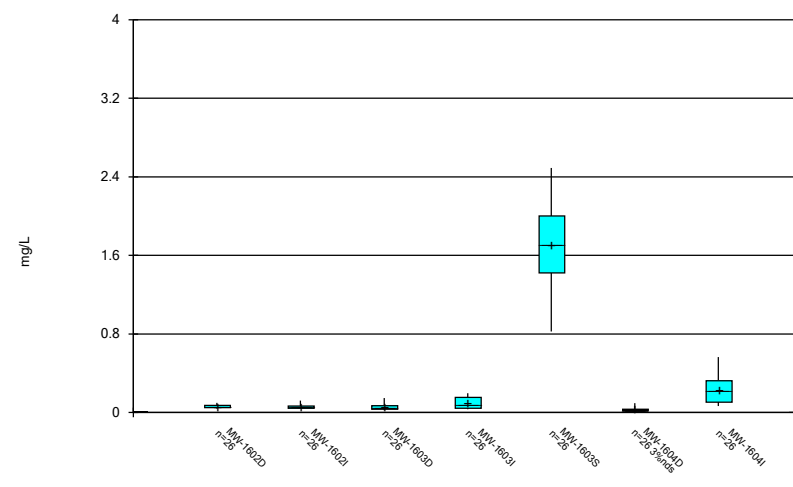


Constituent: Boron, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

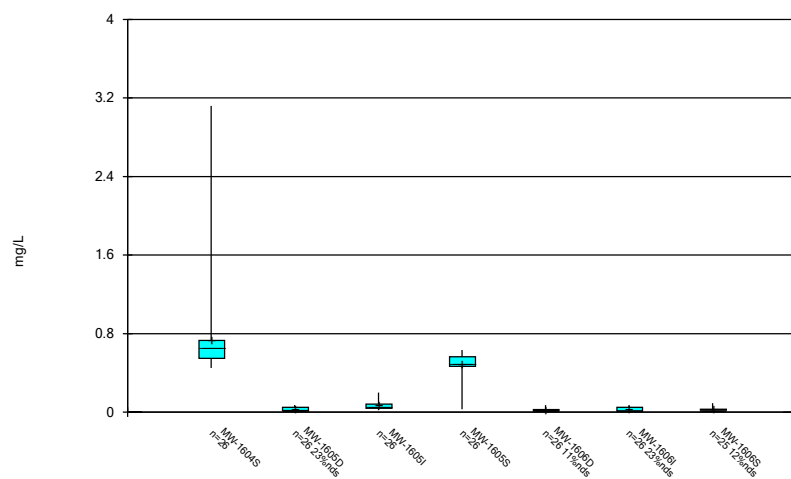


Constituent: Boron, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

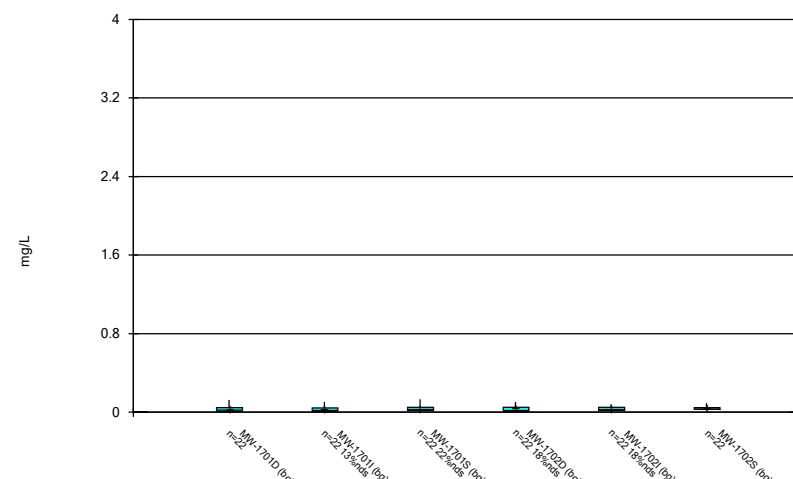


Constituent: Boron, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

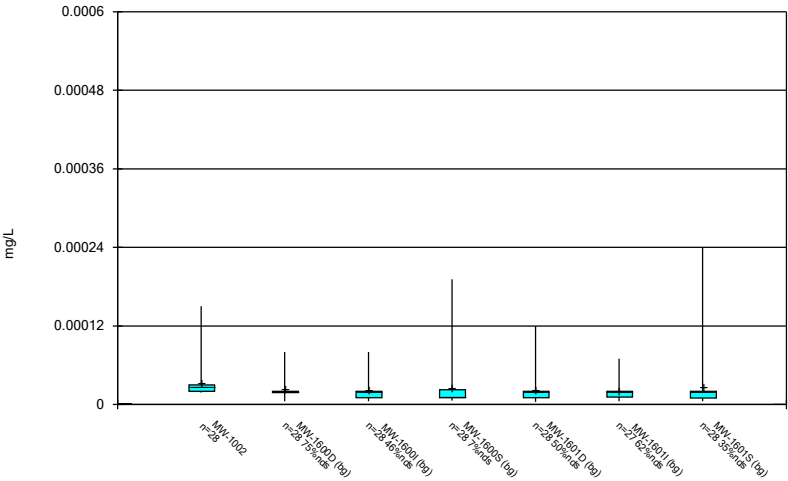


Constituent: Cadmium, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

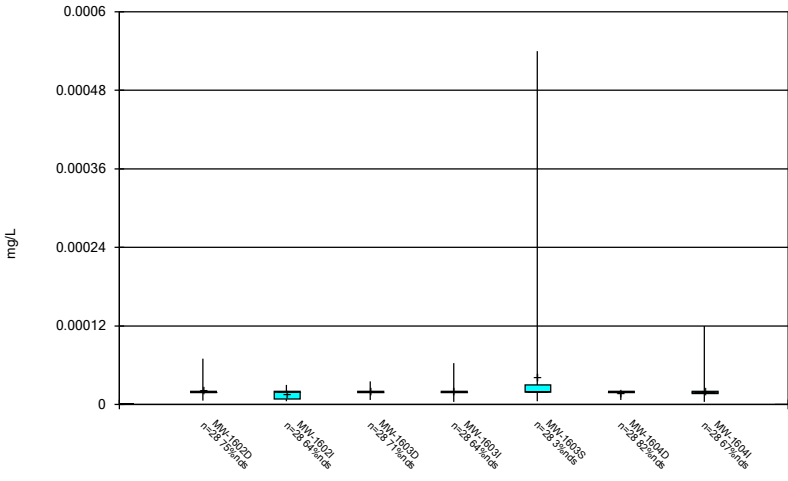


Constituent: Cadmium, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

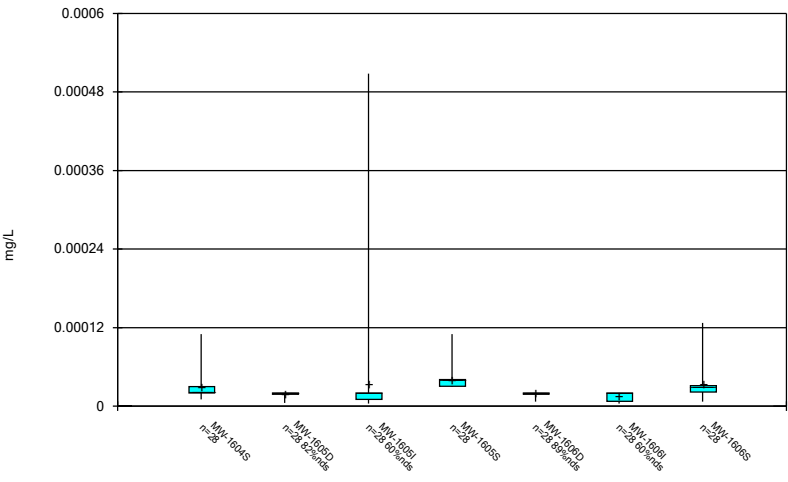


Constituent: Cadmium, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

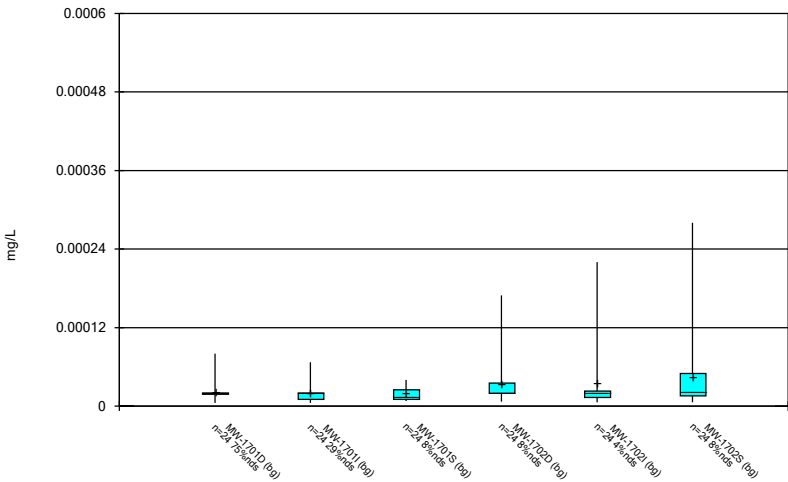


Constituent: Cadmium, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

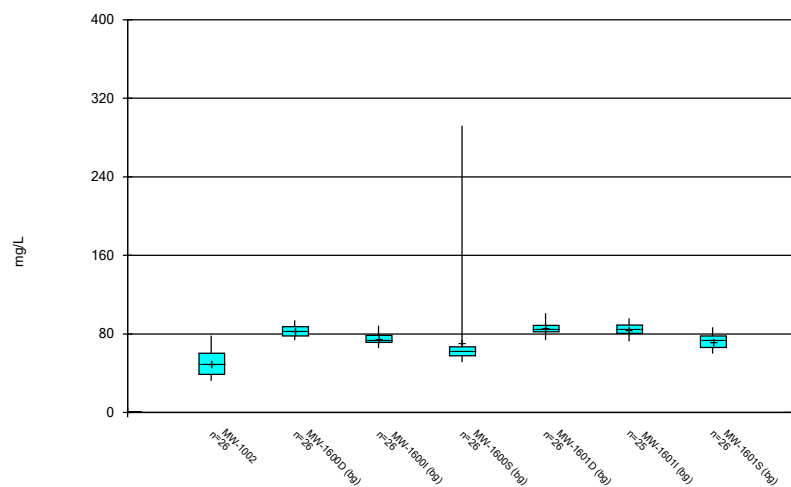


Constituent: Calcium, total Analysis Run 1/24/2025 9:14 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

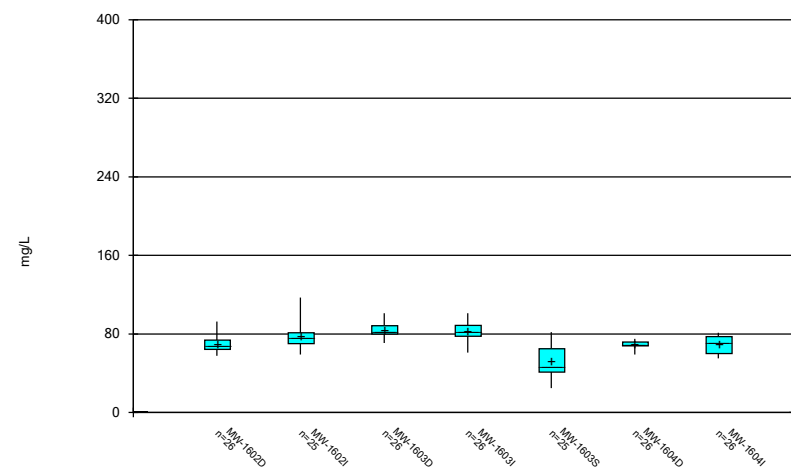


Constituent: Calcium, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

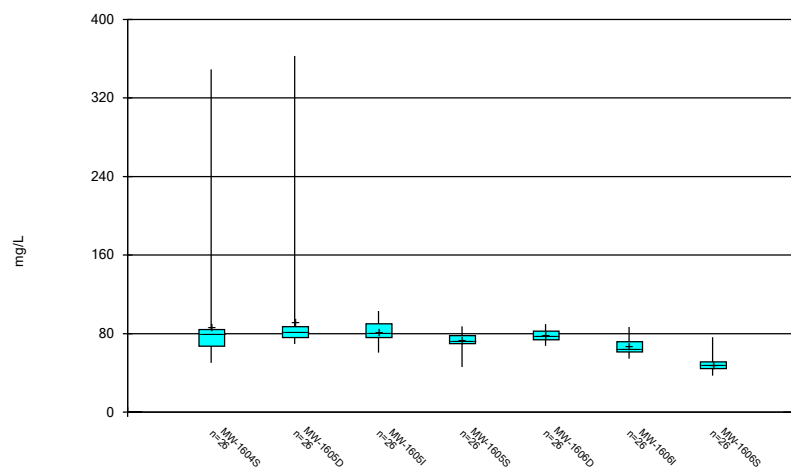


Constituent: Calcium, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

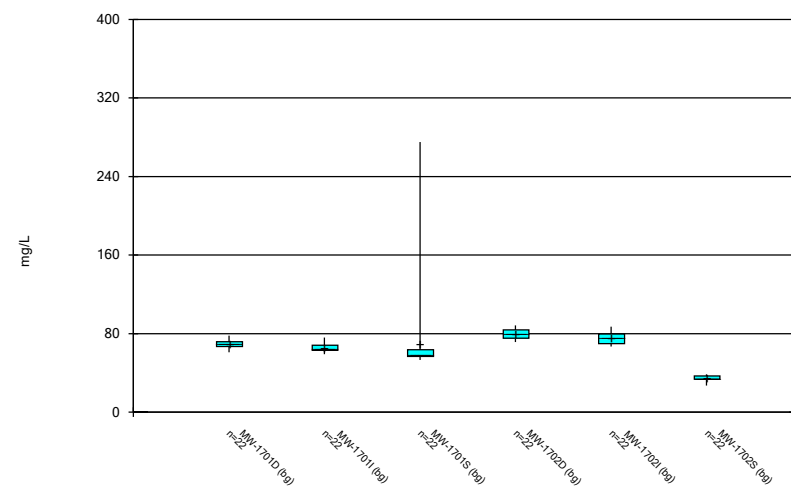


Constituent: Calcium, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

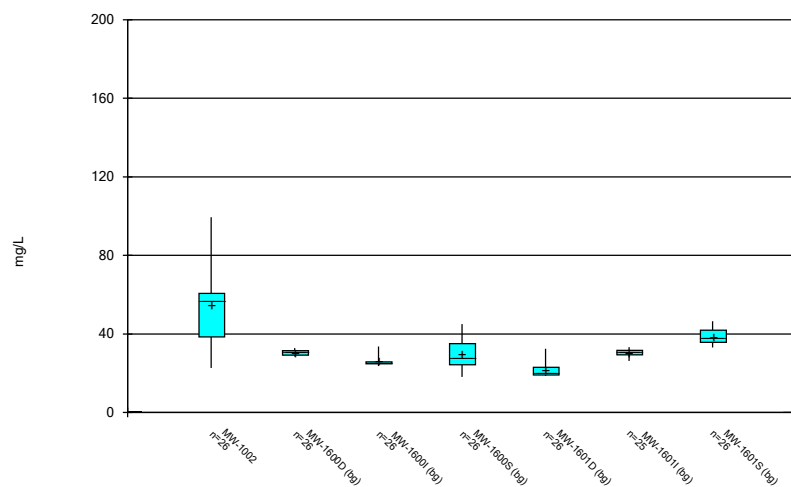


Constituent: Chloride, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

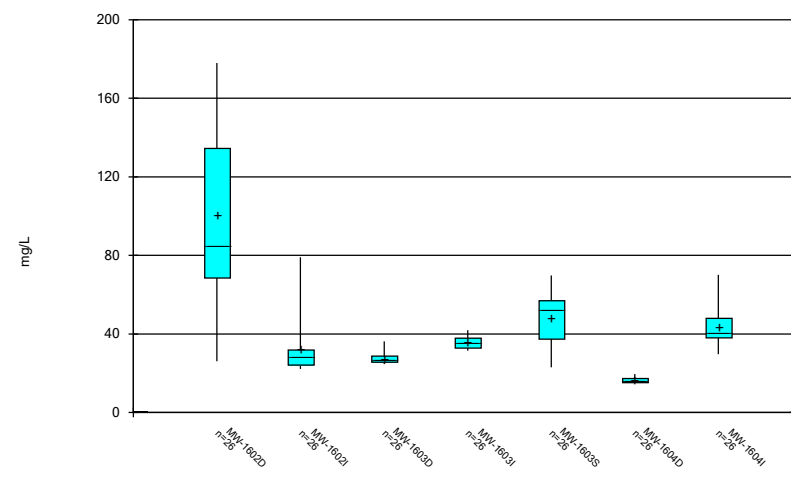


Constituent: Chloride, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

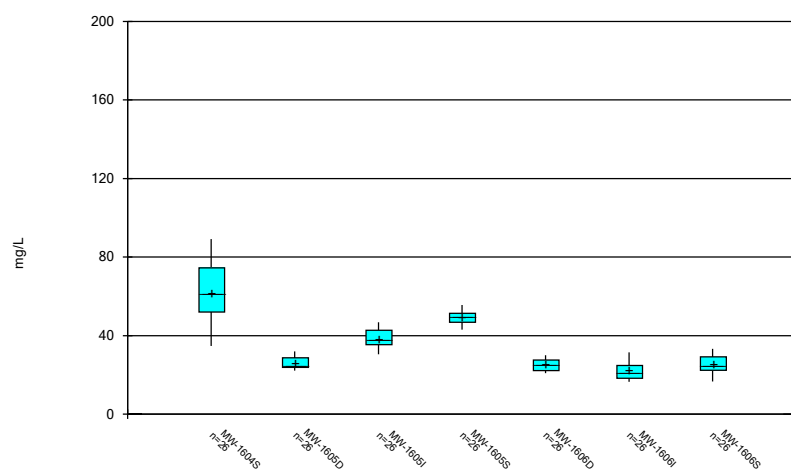


Constituent: Chloride, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

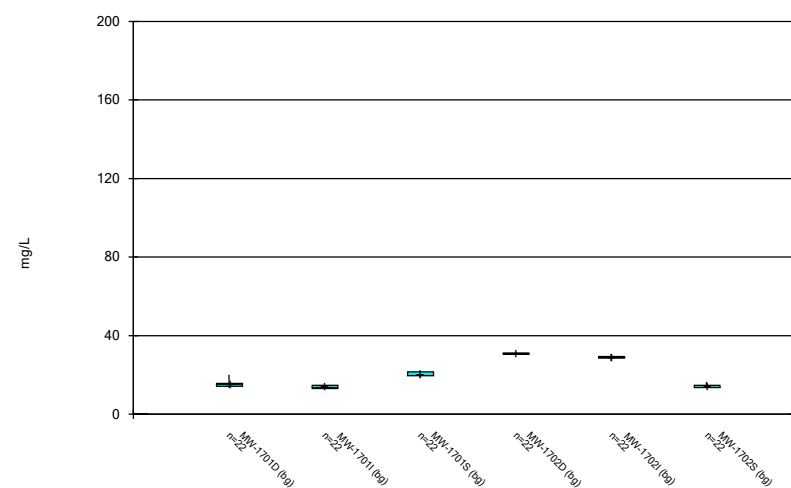


Constituent: Chloride, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Box & Whiskers Plot

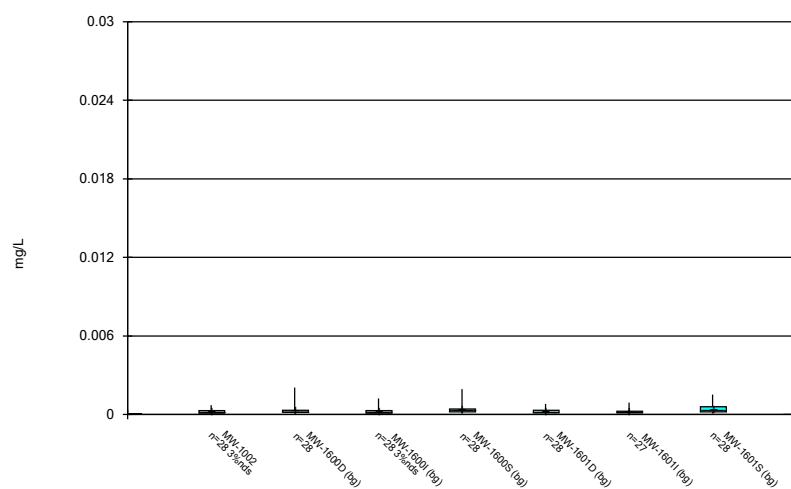


Box & Whiskers Plot

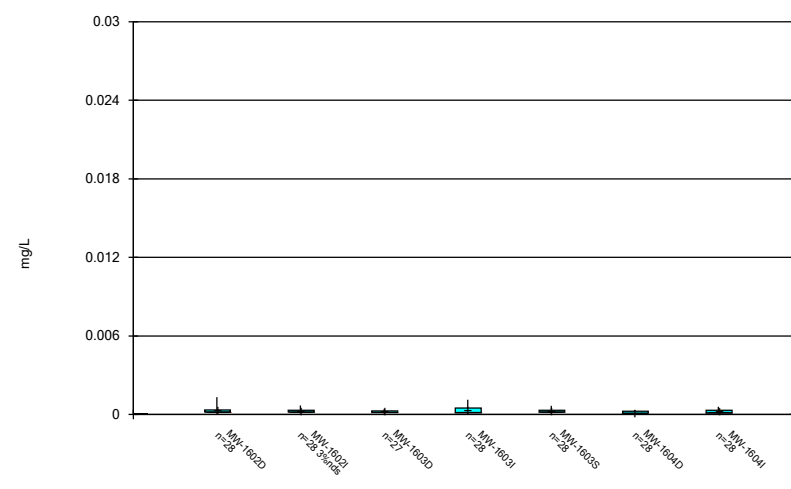


Box & Whiskers Plot

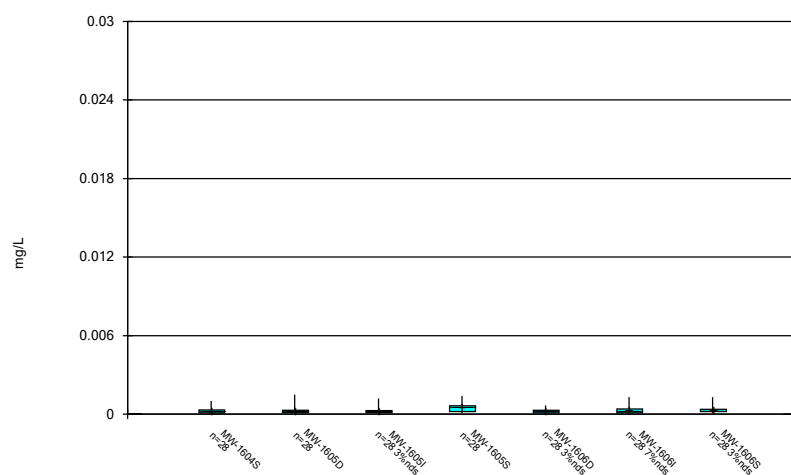


Box & Whiskers Plot

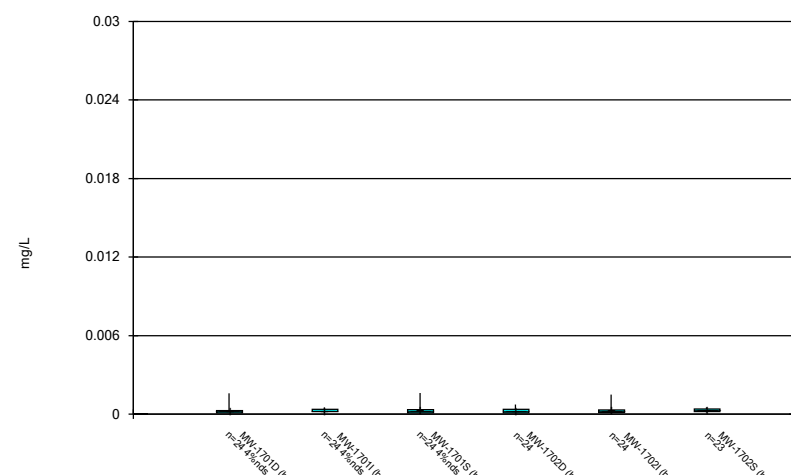


Box & Whiskers Plot

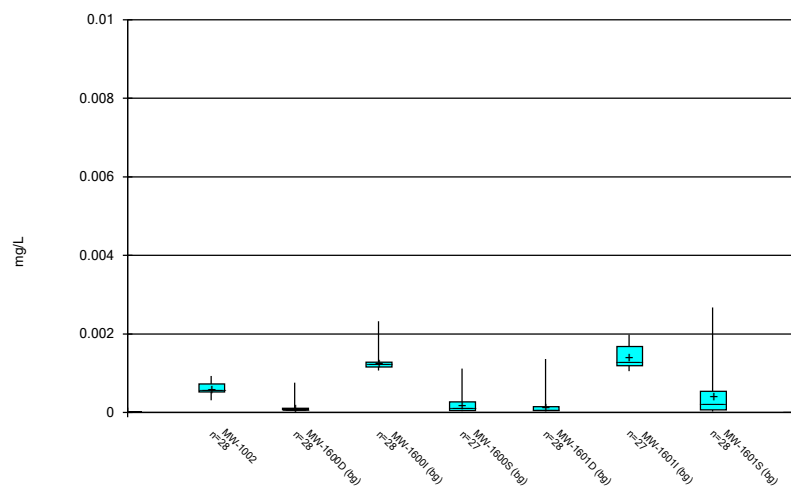


Box & Whiskers Plot

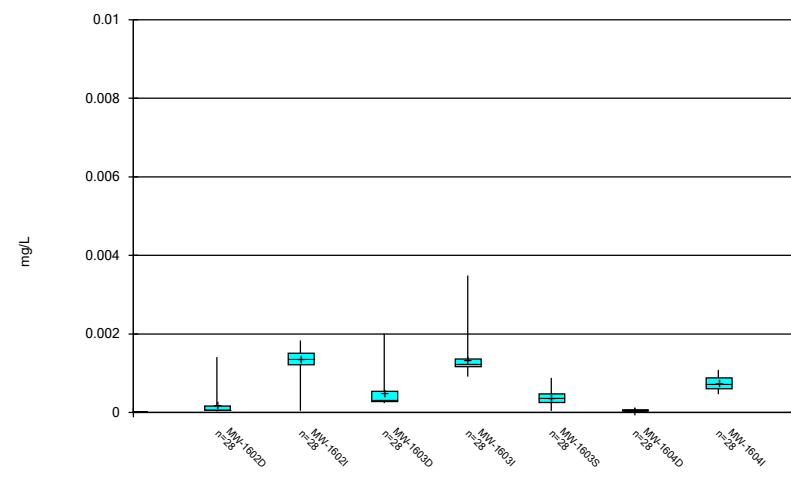


Box & Whiskers Plot

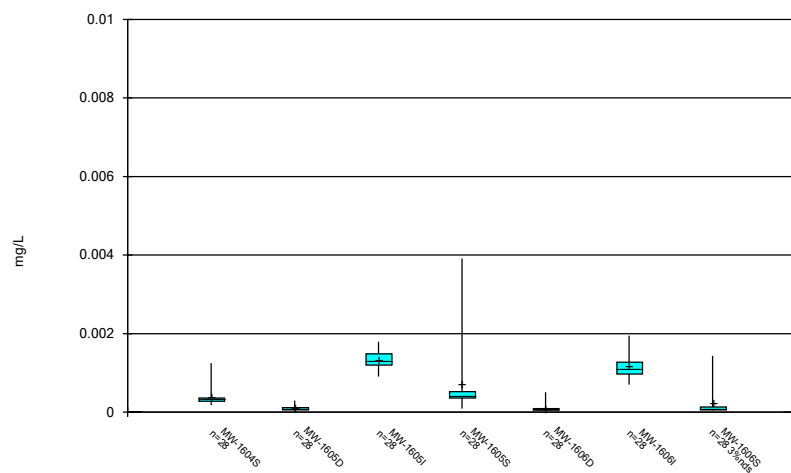

Box & Whiskers Plot

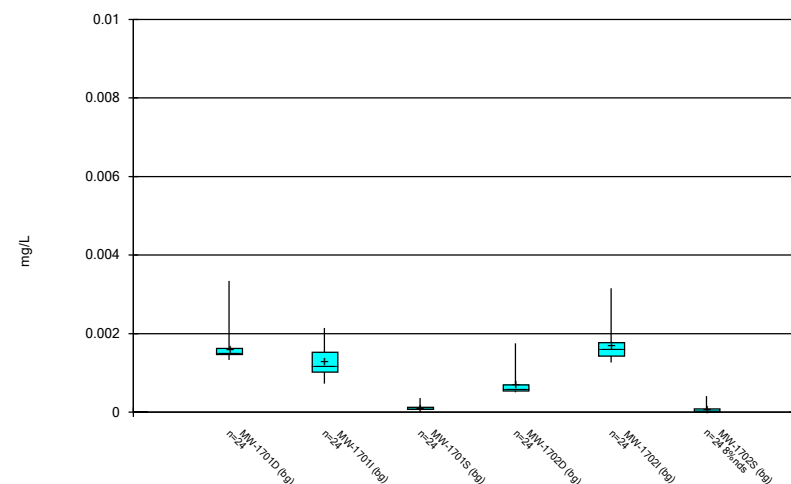


Box & Whiskers Plot

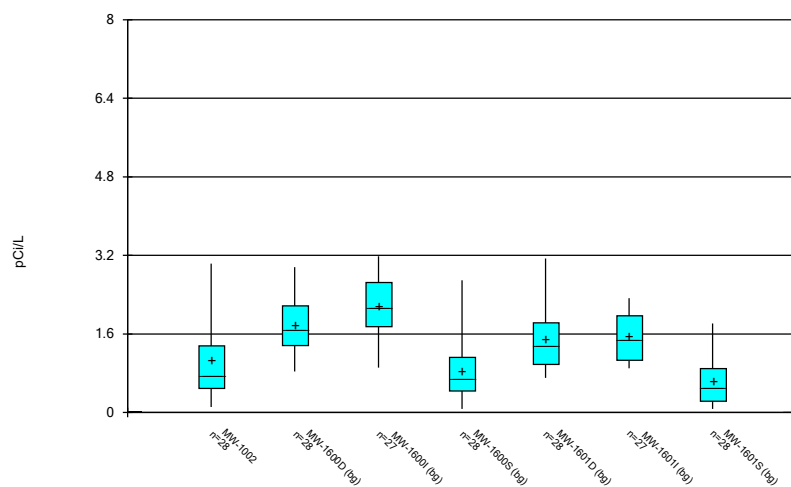


Constituent: Combined Radium 226 + 228 Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

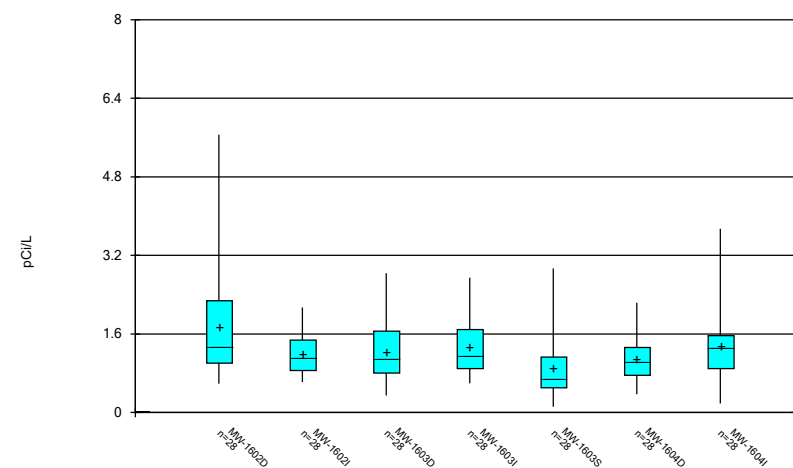


Constituent: Combined Radium 226 + 228 Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

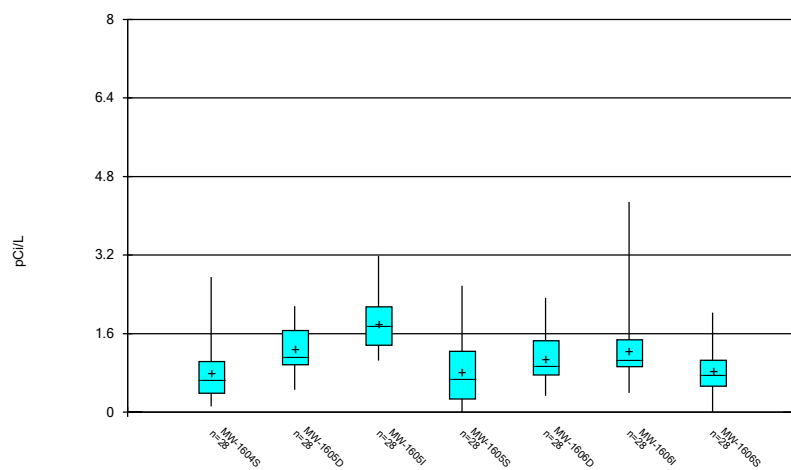


Constituent: Combined Radium 226 + 228 Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

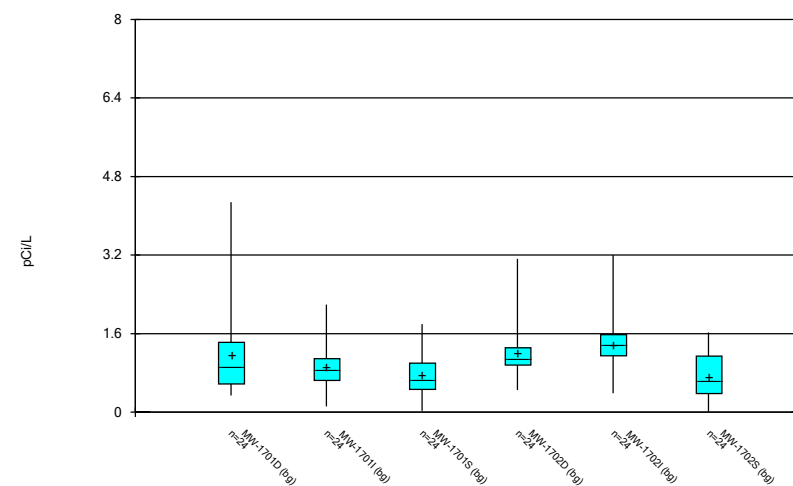


Constituent: Combined Radium 226 + 228 Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

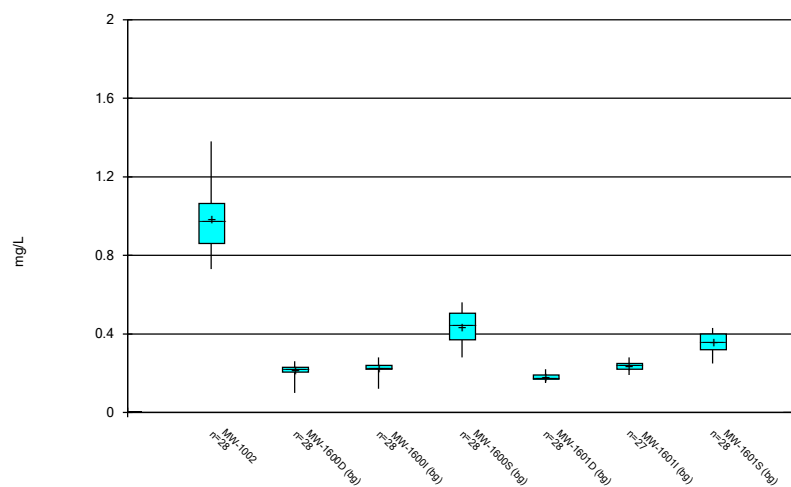


Constituent: Fluoride, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

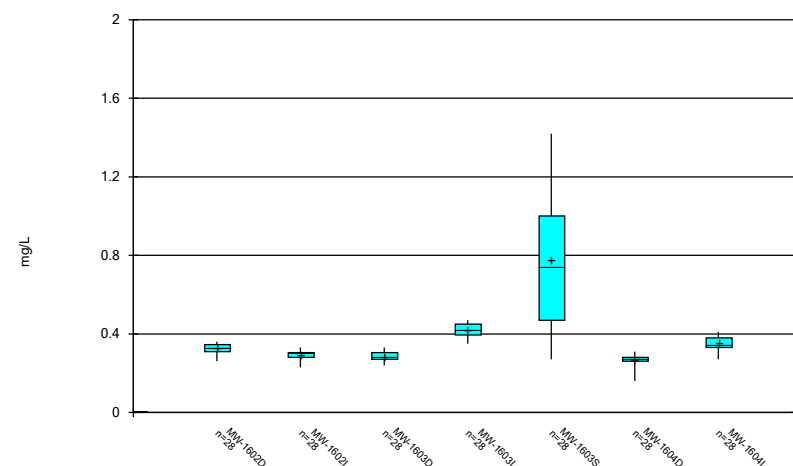


Constituent: Fluoride, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

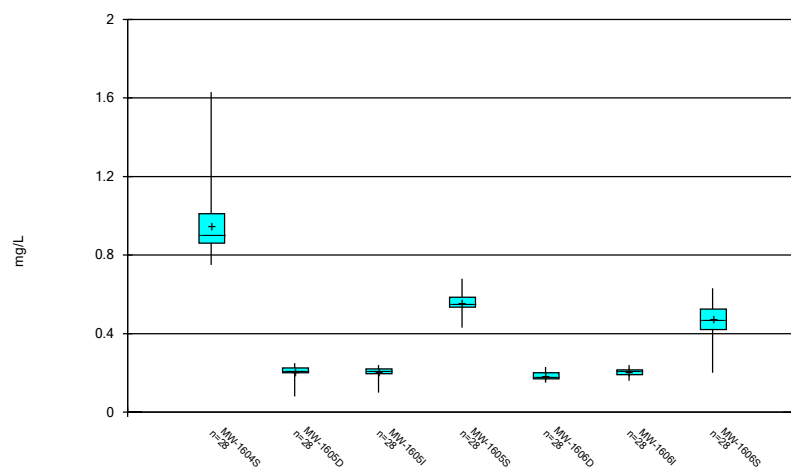


Constituent: Fluoride, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

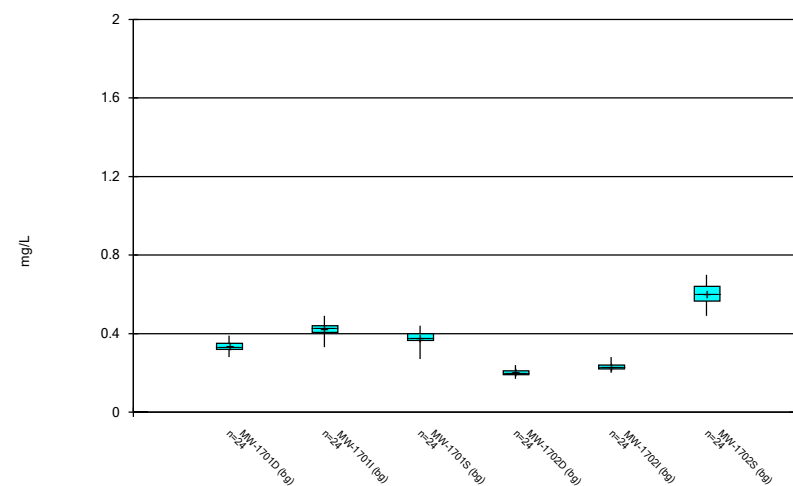


Constituent: Fluoride, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

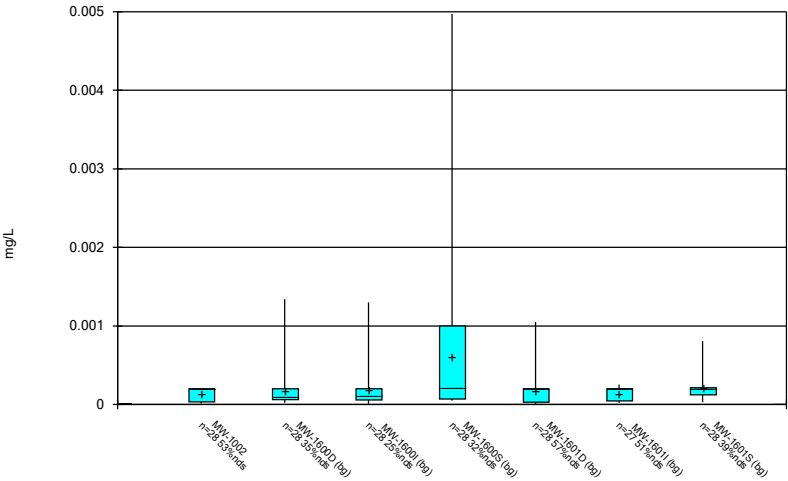


Constituent: Lead, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

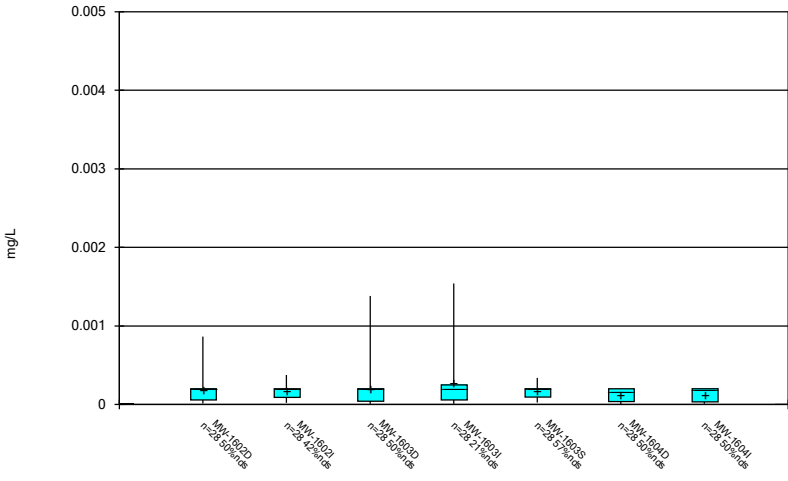


Constituent: Lead, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

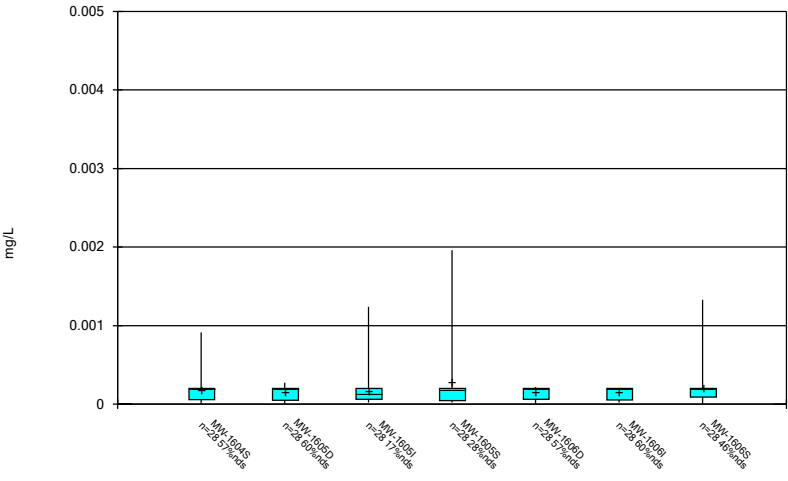


Constituent: Lead, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

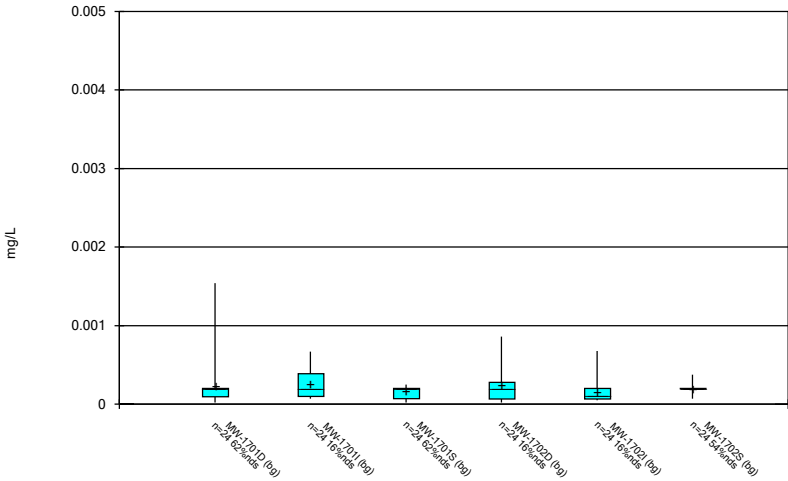


Constituent: Lead, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

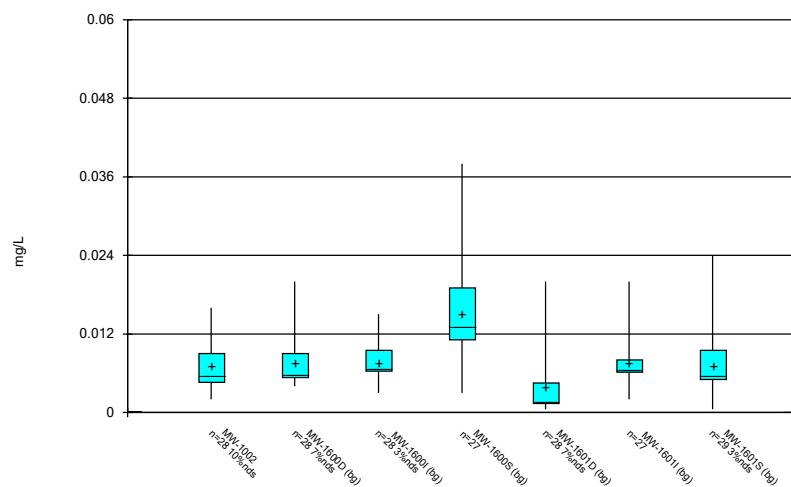


Constituent: Lithium, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

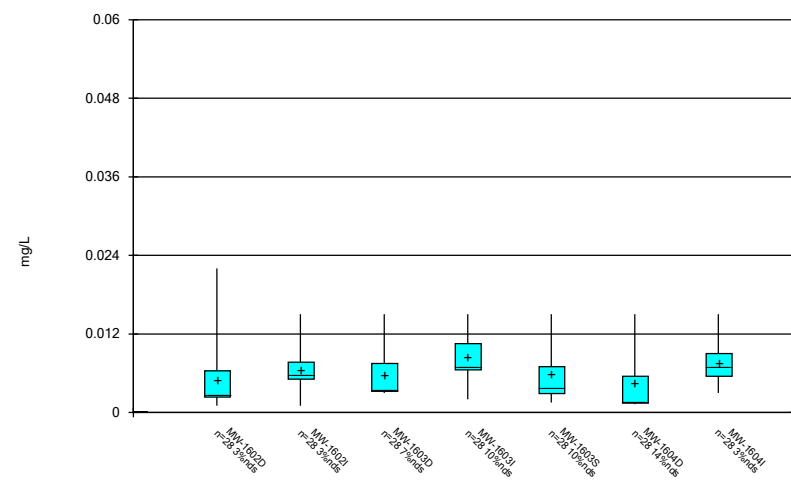


Constituent: Lithium, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

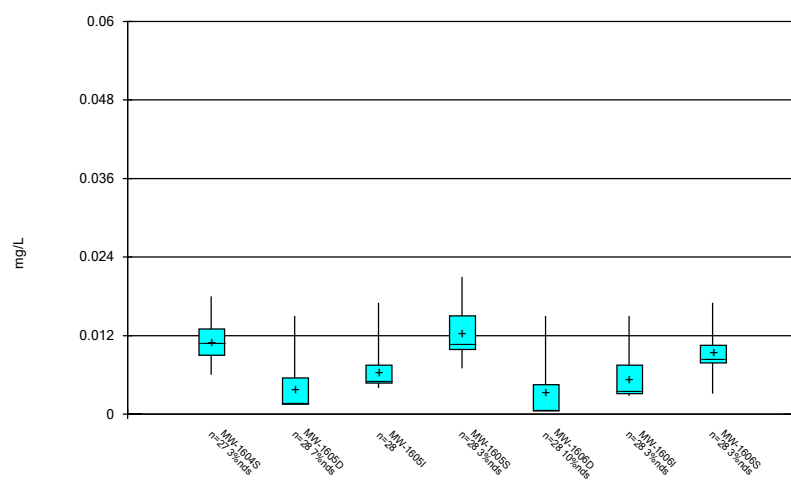


Constituent: Lithium, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

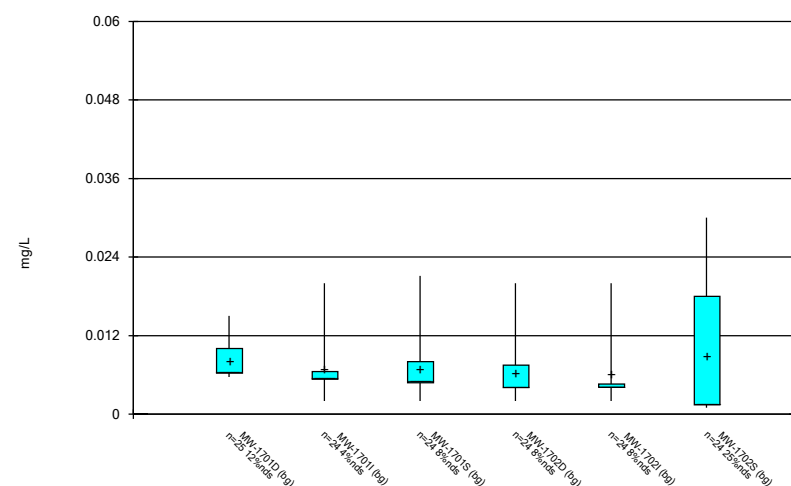


Constituent: Lithium, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

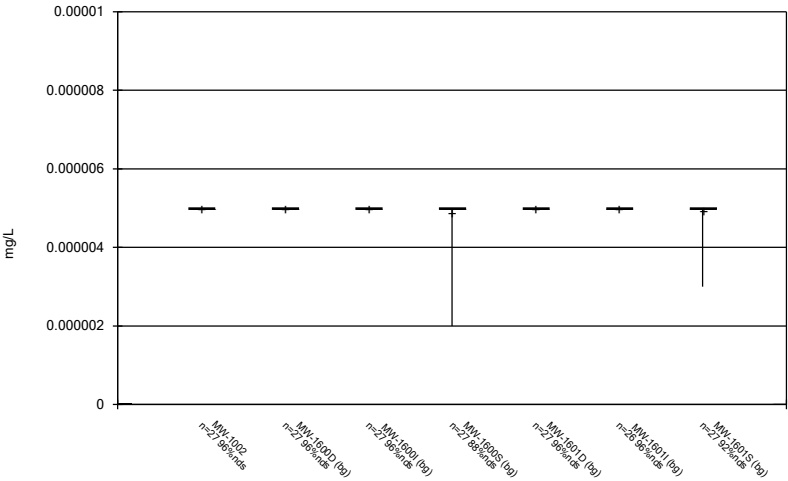


Constituent: Mercury, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

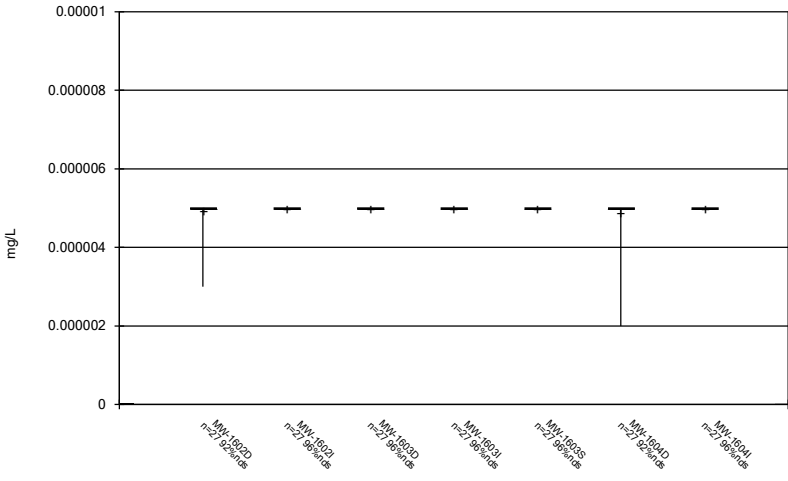


Constituent: Mercury, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

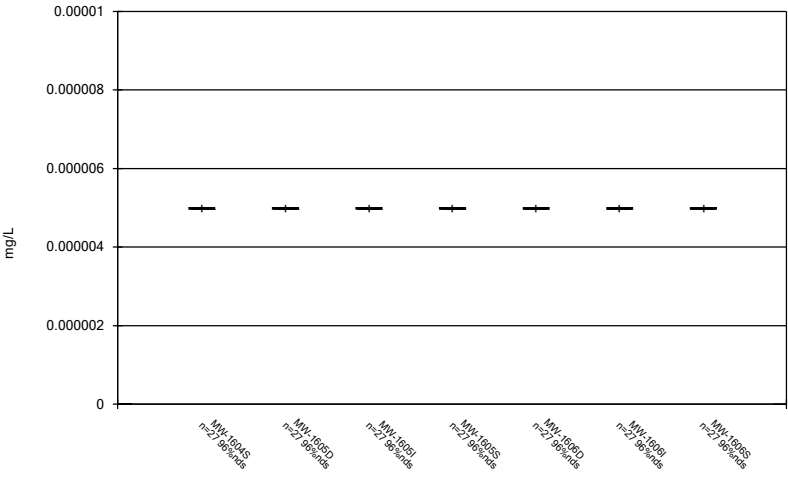


Constituent: Mercury, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

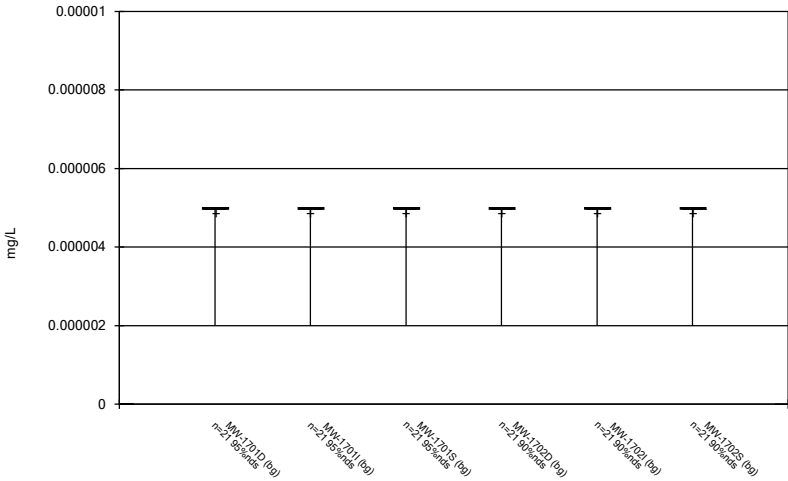


Constituent: Mercury, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

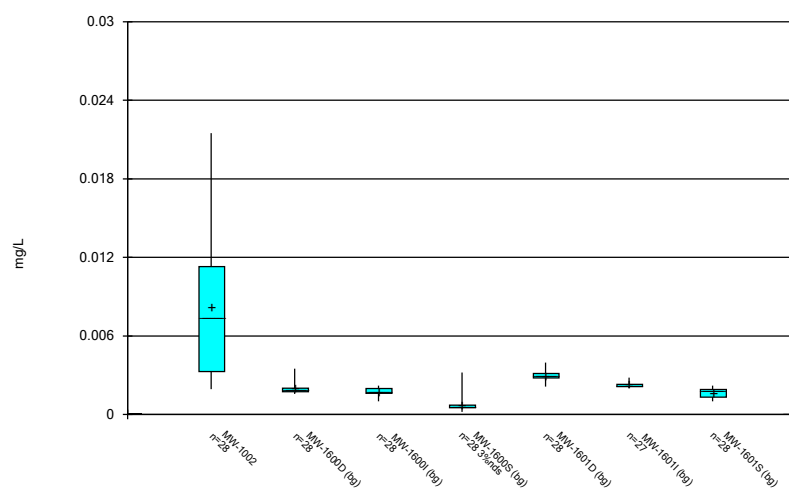


Constituent: Molybdenum, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

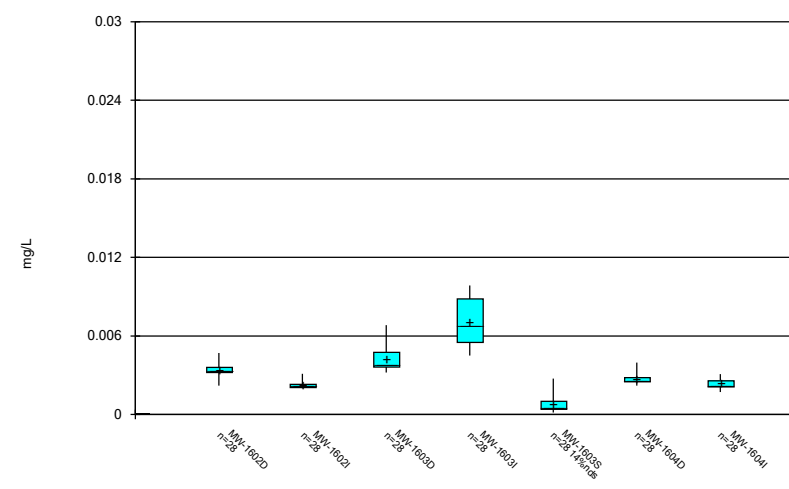


Constituent: Molybdenum, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

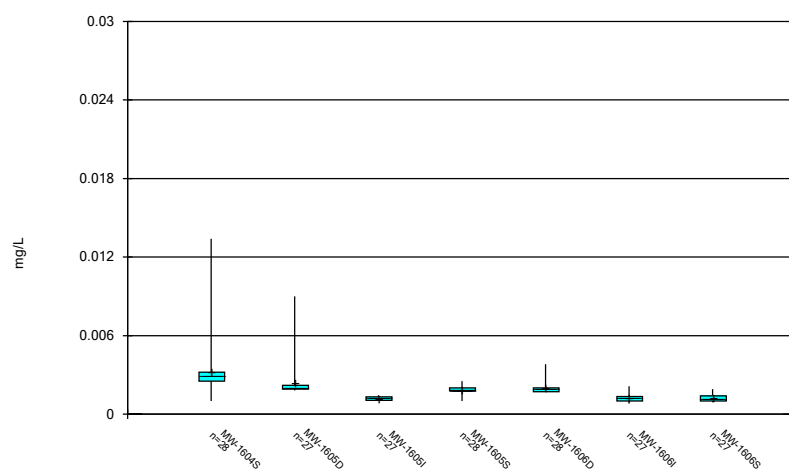


Constituent: Molybdenum, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

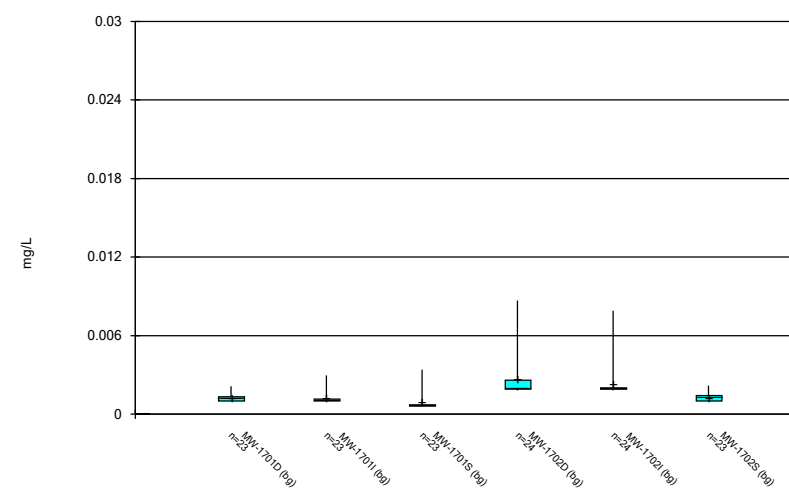


Constituent: Molybdenum, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

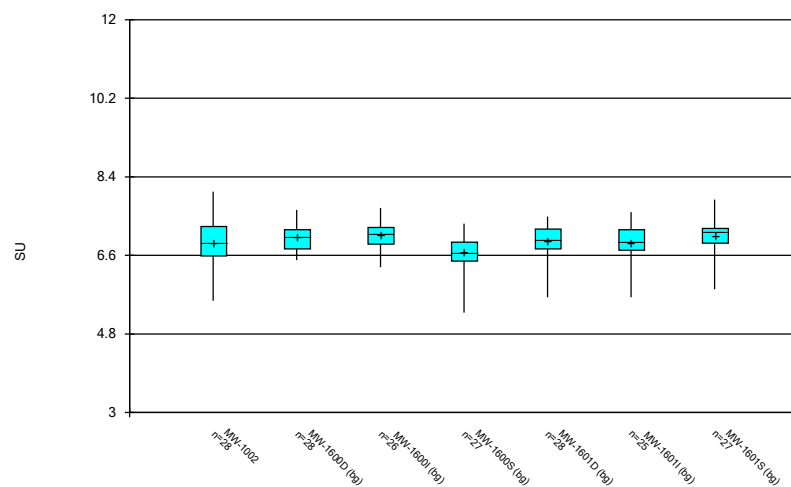


Constituent: pH, field Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

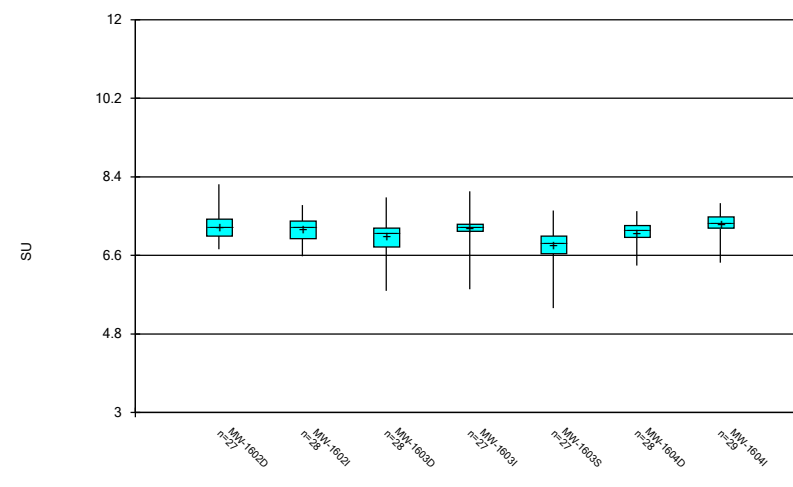


Constituent: pH, field Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

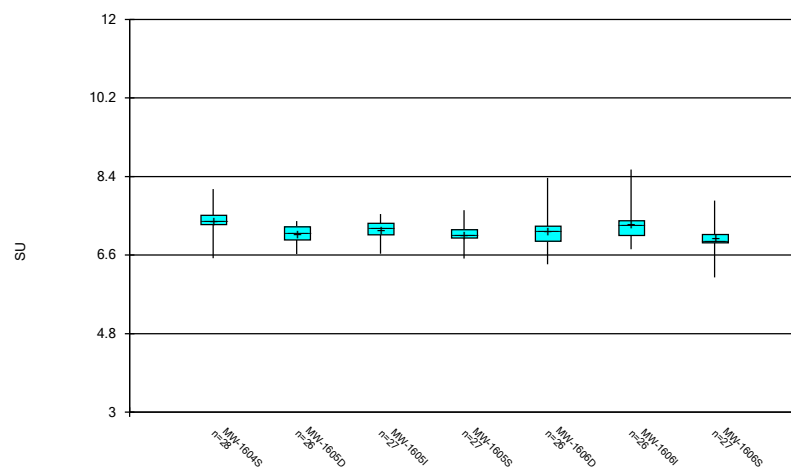


Constituent: pH, field Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

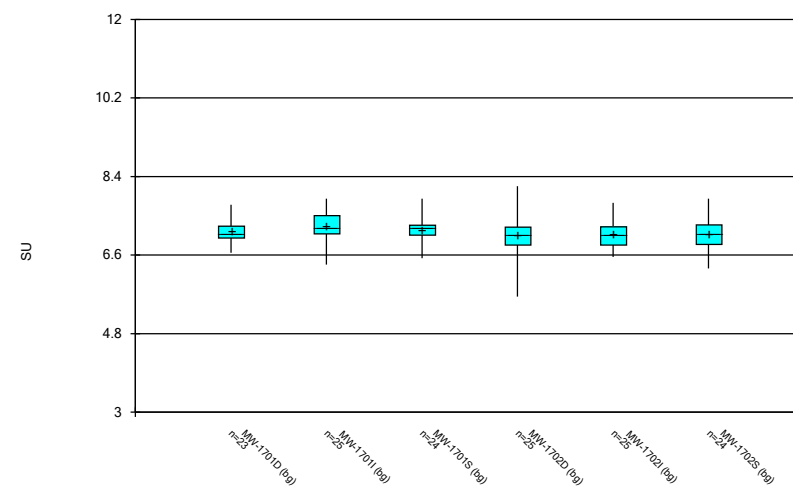


Constituent: pH, field Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Box & Whiskers Plot

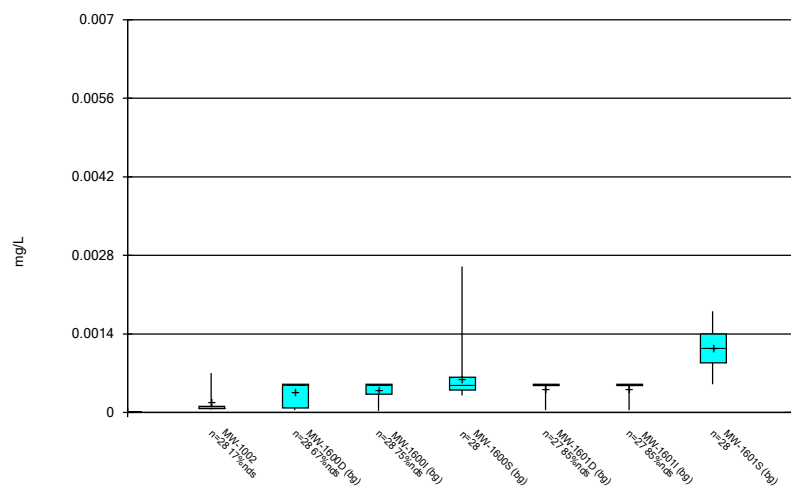


Box & Whiskers Plot

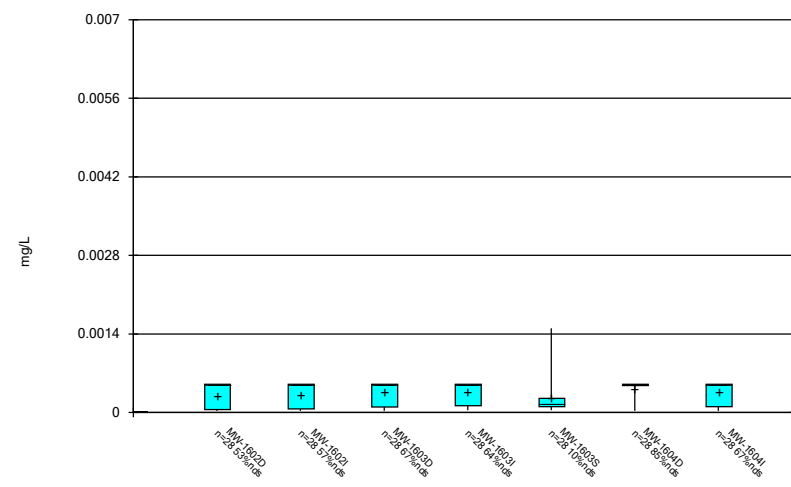


Box & Whiskers Plot

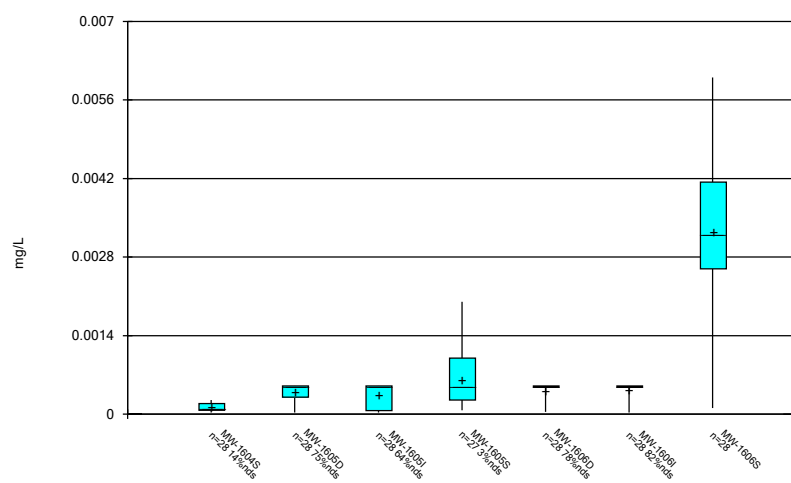

Box & Whiskers Plot

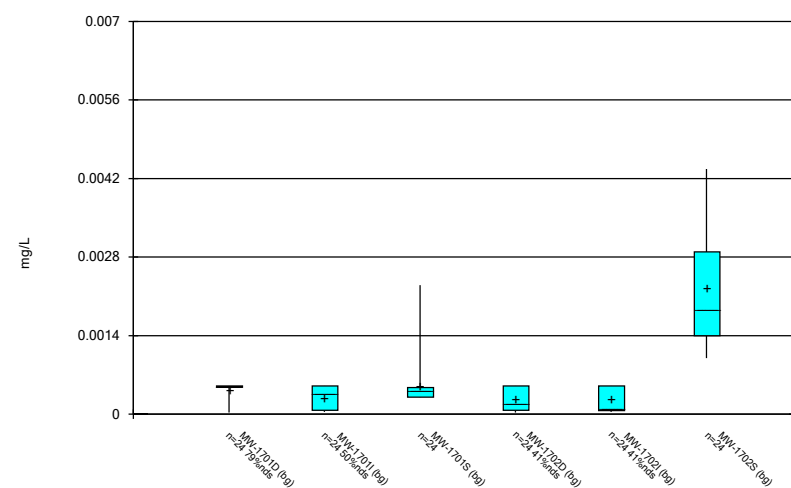


Box & Whiskers Plot

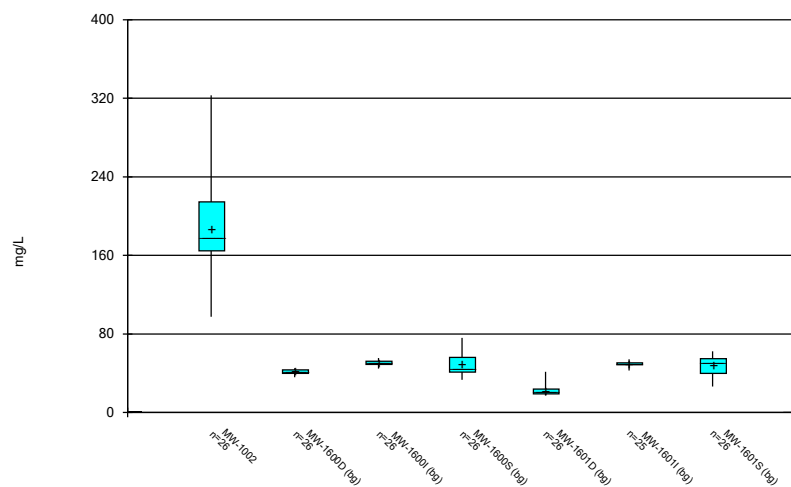


Constituent: Sulfate, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

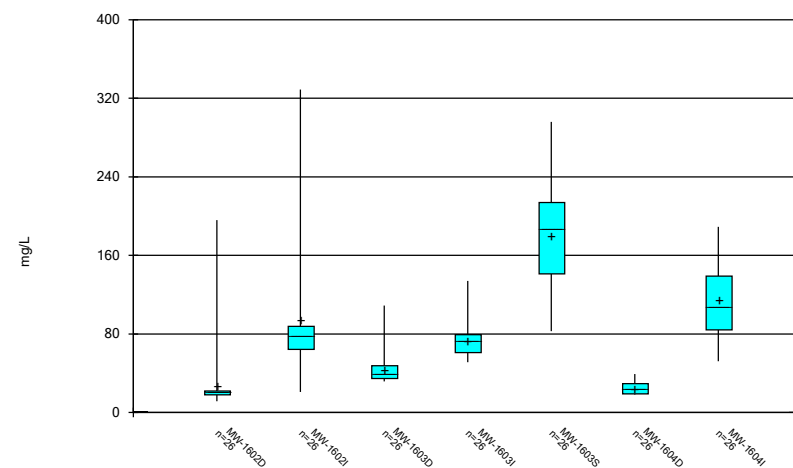


Constituent: Sulfate, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

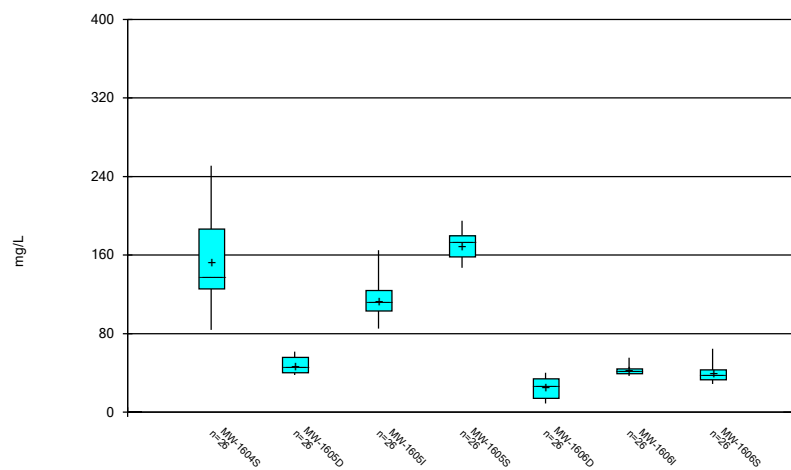


Constituent: Sulfate, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

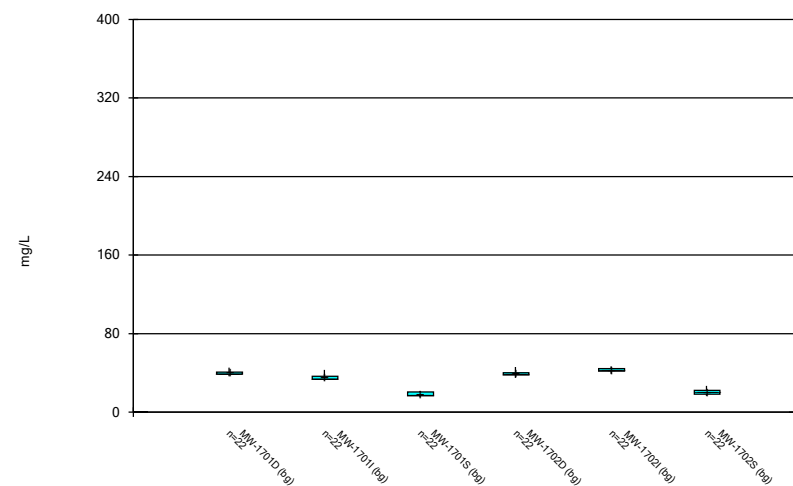


Constituent: Sulfate, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

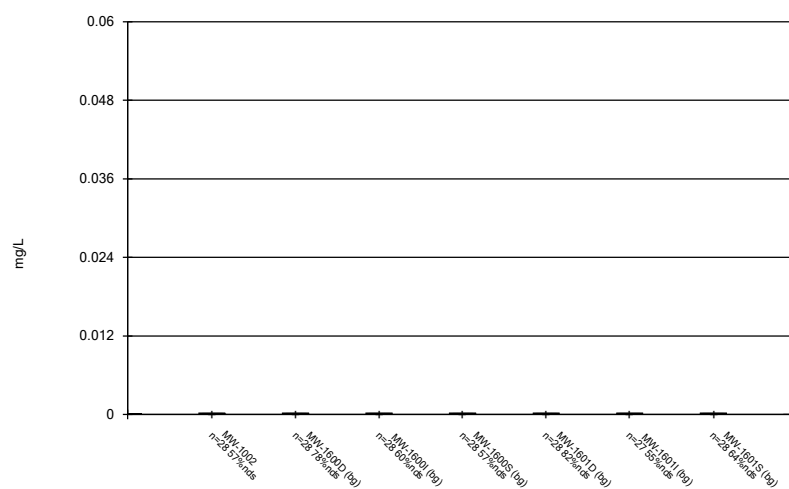


Constituent: Thallium, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

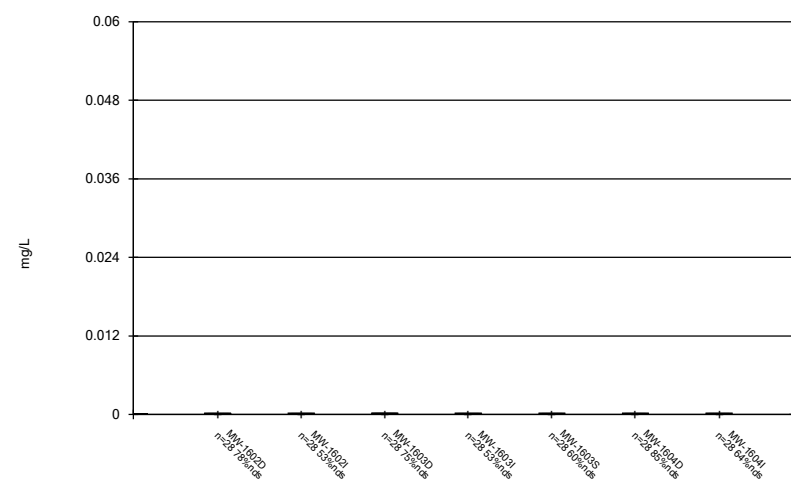


Constituent: Thallium, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

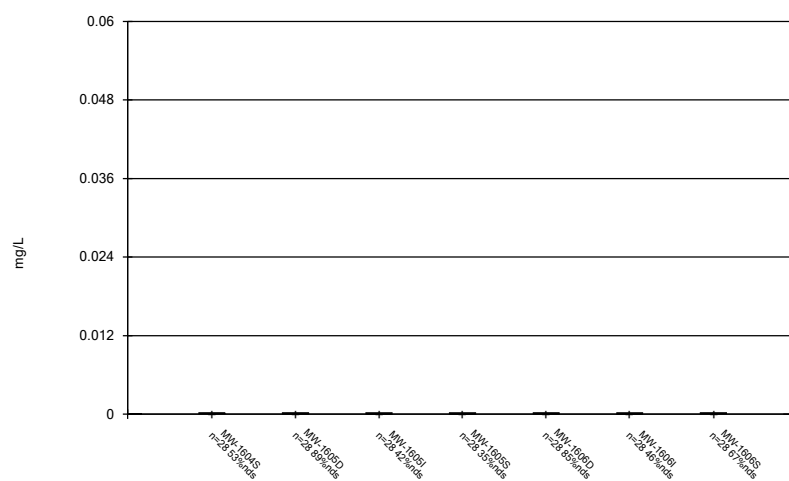


Constituent: Thallium, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

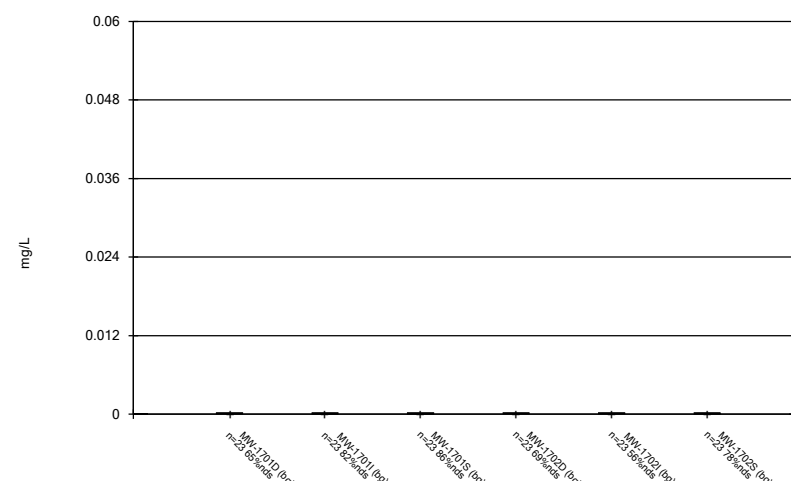


Constituent: Thallium, total Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

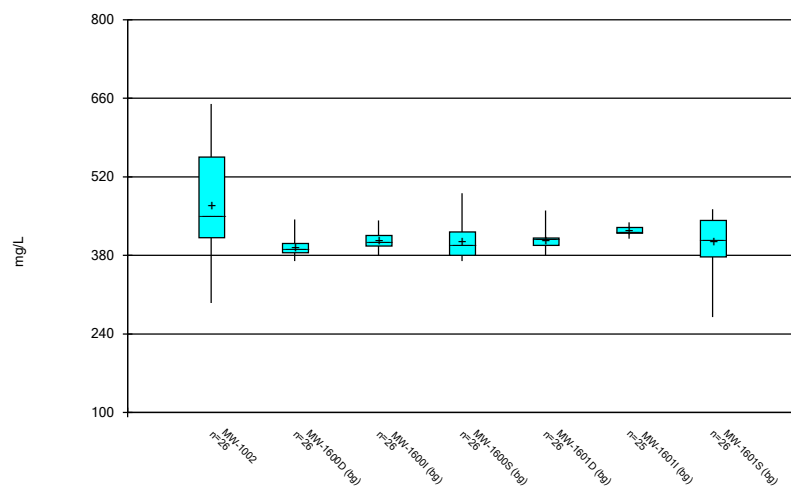


Constituent: Total Dissolved Solids [TDS] Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

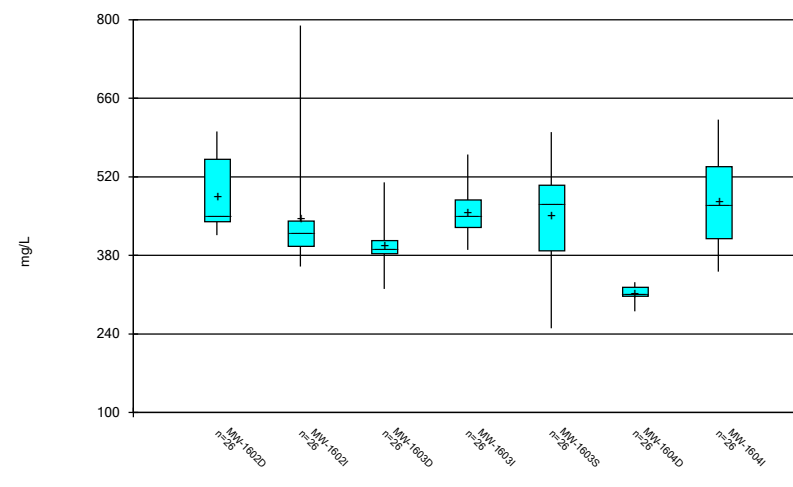


Constituent: Total Dissolved Solids [TDS] Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

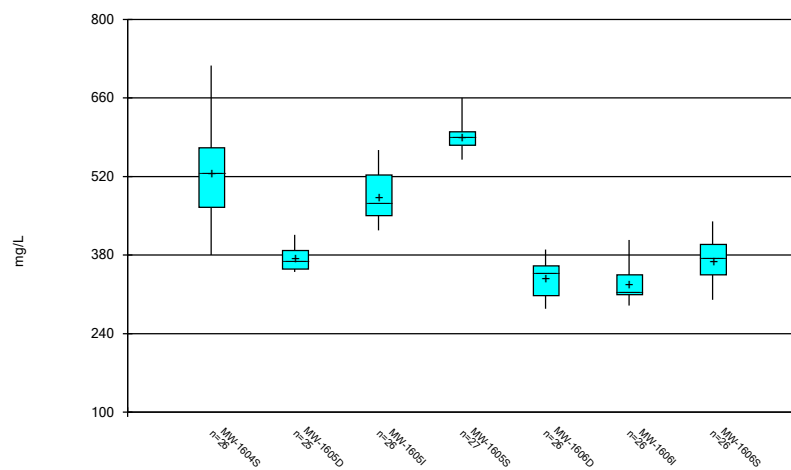

Constituent: Total Dissolved Solids [TDS] Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

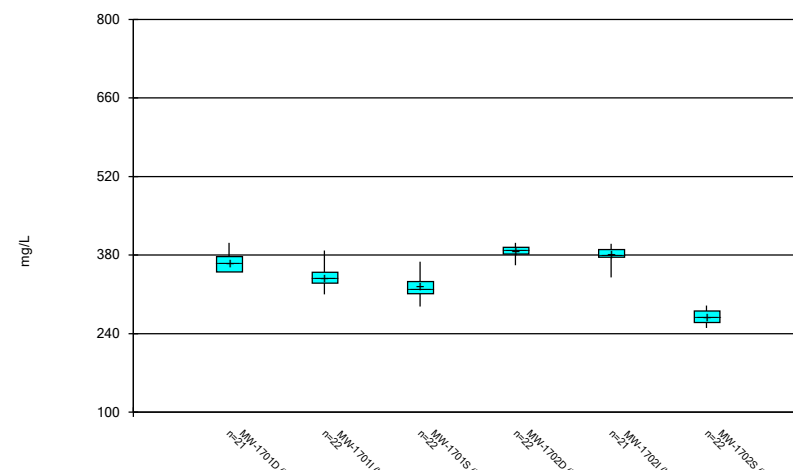

Constituent: Total Dissolved Solids [TDS] Analysis Run 1/24/2025 9:15 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

FIGURE C

Outlier Summary and Tukey's Outlier Test

Outlier Summary

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/24/2025, 9:18 AM

MW-1606S Boron, total (mg/L) MW-1602I Calcium, total (mg/L) MW-1603S Calcium, total (mg/L) MW-1603D Chromium, total (mg/L) MW-1702S Chromium, total (mg/L) MW-1600S Cobalt, total (mg/L) MW-1600I Combined Radium 226 + 228 (pCi/L) MW-1600S Lithium, total (mg/L) MW-1604S Lithium, total (mg/L) MW-1605D Molybdenum, total (mg/L)

6/7/2016									0.00765 (o)
6/8/2016					7.25 (o)				
7/19/2016									
10/10/2016			0.0238 (o)						
1/10/2017									
3/7/2017		99.4 (o)							
7/17/2017									
7/18/2017									
12/12/2017				0.00413 (o)					
6/4/2018									
6/5/2018									
8/15/2018	0.563 (o)								
5/24/2019									
6/25/2019									
5/20/2020		113 (o)							
5/25/2021									
5/26/2021									
5/27/2021					0.00995 (o)				
11/2/2022									
5/15/2024						0.0479 (o)		0.0556 (o)	

6/7/2016								
6/8/2016								
7/19/2016								
10/10/2016								
1/10/2017								
3/7/2017								
7/17/2017						9.29 (o)		9.46 (o)
7/18/2017								
12/12/2017								
6/4/2018								
6/5/2018								
8/15/2018								
5/24/2019								
6/25/2019	<0.01 (o)	<0.01 (o)	<0.01 (o)	<0.01 (o)	<0.01 (o)	<0.01 (o)	<0.01 (o)	
5/20/2020								
5/25/2021								
5/26/2021								9.39 (o)
5/27/2021								
11/2/2022								
5/15/2024								

6/7/2016		5.12 (o)				
6/8/2016						
7/19/2016						
10/10/2016						
1/10/2017						
3/7/2017						
7/17/2017	9.45 (o)		9.78 (o)	9.63 (o)		
7/18/2017					9.51 (o)	
12/12/2017						
6/4/2018						
6/5/2018						
8/15/2018						
5/24/2019						
6/25/2019						
5/20/2020						
5/25/2021				9.09 (o)	8.92 (o)	
5/26/2021	9.38 (o)	9.41 (o)				9.48 (o) 9.51 (o)
5/27/2021						
11/2/2022			11 (o)			
5/15/2024						

Date	Value
6/7/2016	
6/8/2016	
7/19/2016	5.85 (o) 4.98 (o)
10/10/2016	
1/10/2017	
3/7/2017	
7/17/2017	
7/18/2017	
12/12/2017	0.051 (o) 0.04 (o) 0.02 (o) 0.03 (o)
6/4/2018	
6/5/2018	
8/15/2018	0.0054 (o)
5/24/2019	3E-05 (Jo)
6/25/2019	
5/20/2020	
5/25/2021	8.88 (o) 8.91 (o) 8.55 (o)
5/26/2021	9.3 (o)
5/27/2021	
11/2/2022	
5/15/2024	

Outlier Summary

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/24/2025, 9:18 AM

MW-1702I Thallium, total (mg/L)
MW-1702S Thallium, total (mg/L)
MW-1605D Total Dissolved Solids [TDS] (mg/L)
MW-1701D Total Dissolved Solids [TDS] (mg/L)
MW-1702I Total Dissolved Solids [TDS] (mg/L)

6/7/2016
6/8/2016
7/19/2016
10/10/2016
1/10/2017
3/7/2017
7/17/2017
7/18/2017
12/12/2017
6/4/2018
6/5/2018
8/15/2018
5/24/2019
6/25/2019
5/20/2020
5/25/2021
5/26/2021
5/27/2021
11/2/2022
5/15/2024

794 (o)

0.04 (o)

0.01 (o)

760 (o)

700 (o)

Tukey's Outlier Test - Upgradient Wells - Significant Results





Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/14/2025, 10:44 AM





Constituent	Well	Outlier	Value(s)	Method	Alpha	N	Mean	Std. Dev.	Distribution	Normality Test
Arsenic, total (mg/L)	MW-1600D,MW-1600I...	Yes	0.0253,0....	NP	NaN	311	0.01418	0.01561	x^6	ChiSquared
Barium, total (mg/L)	MW-1600D,MW-1600I...	Yes	0.94,0.94...	NP	NaN	311	0.2863	0.3172	x^6	ChiSquared
Boron, total (mg/L)	MW-1600D,MW-1600I...	Yes	0.079,0.0...	NP	NaN	287	0.04074	0.03216	x^6	ChiSquared
Chloride, total (mg/L)	MW-1600D,MW-1600I...	Yes	44.9,43,4...	NP	NaN	287	25.34	7.945	x^5	ChiSquared
Combined Radium 226 + 228 (pCi/L)	MW-1600D,MW-1600I...	Yes	2.148,2.2...	NP	NaN	311	1.245	0.8016	x^6	ChiSquared
Fluoride, total (mg/L)	MW-1600D,MW-1600I...	Yes	0.56,0.56...	NP	NaN	311	0.3155	0.1269	x^6	ChiSquared
Lithium, total (mg/L)	MW-1600D,MW-1600I...	Yes	0.015,0.0...	NP	NaN	313	0.007648	0.005595	x^6	ChiSquared
Sulfate, total (mg/L)	MW-1600D,MW-1600I...	Yes	75.8,76,6...	NP	NaN	287	38.42	12.35	x^6	ChiSquared
Total Dissolved Solids [TDS] (mg/L)	MW-1600D,MW-1600I...	Yes	491,700,760	NP	NaN	287	380.8	54.53	x^6	ChiSquared


Tukey's Outlier Test - Upgradient Wells - All Results

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/14/2025, 10:44 AM


Constituent	Well	Outlier	Value(s)	Method	Alpha	N	Mean	Std. Dev.	Distribution	Normality Test
Antimony, total (mg/L)	MW-1600D,MW-1600I...	n/a	n/a	NP	NaN	311	0.00007083	0.00005104	unknown	ChiSquared
Arsenic, total (mg/L)	MW-1600D,MW-1600I...	Yes	0.0253,0....	NP	NaN	311	0.01418	0.01561	x^6	ChiSquared
Barium, total (mg/L)	MW-1600D,MW-1600I...	Yes	0.94,0.94...	NP	NaN	311	0.2863	0.3172	x^6	ChiSquared
Beryllium, total (mg/L)	MW-1600D,MW-1600I...	n/a	n/a	NP	NaN	311	0.00004449	0.00001449	unknown	ChiSquared
Boron, total (mg/L)	MW-1600D,MW-1600I...	Yes	0.079,0.0...	NP	NaN	287	0.04074	0.03216	x^6	ChiSquared
Cadmium, total (mg/L)	MW-1600D,MW-1600I...	n/a	n/a	NP	NaN	311	0.00002538	0.00003135	unknown	ChiSquared
Chloride, total (mg/L)	MW-1600D,MW-1600I...	Yes	44.9,43.4...	NP	NaN	287	25.34	7.945	x^5	ChiSquared
Chromium, total (mg/L)	MW-1600D,MW-1600I...	n/a	n/a	NP	NaN	311	0.0003114	0.0003503	unknown	ChiSquared
Cobalt, total (mg/L)	MW-1600D,MW-1600I...	n/a	n/a	NP	NaN	311	0.000773	0.0008662	unknown	ChiSquared
Combined Radium 226 + 228 (pCi/L)	MW-1600D,MW-1600I...	Yes	2.148,2.2...	NP	NaN	311	1.245	0.8016	x^6	ChiSquared
Fluoride, total (mg/L)	MW-1600D,MW-1600I...	Yes	0.56,0.56...	NP	NaN	311	0.3155	0.1269	x^6	ChiSquared
Lead, total (mg/L)	MW-1600D,MW-1600I...	n/a	n/a	NP	NaN	311	0.0002028	0.0003281	unknown	ChiSquared
Lithium, total (mg/L)	MW-1600D,MW-1600I...	Yes	0.015,0.0...	NP	NaN	313	0.007648	0.005595	x^6	ChiSquared
Mercury, total (mg/L)	MW-1600D,MW-1600I...	n/a	n/a	NP	NaN	287	0.000004916	4.8e-7	unknown	ChiSquared
Molybdenum, total (mg/L)	MW-1600D,MW-1600I...	n/a	n/a	NP	NaN	311	0.001747	0.0009528	unknown	ChiSquared
Selenium, total (mg/L)	MW-1600D,MW-1600I...	n/a	n/a	NP	NaN	311	0.0006077	0.0006435	unknown	ChiSquared
Sulfate, total (mg/L)	MW-1600D,MW-1600I...	Yes	75.8,76.6...	NP	NaN	287	38.42	12.35	x^6	ChiSquared
Thallium, total (mg/L)	MW-1600D,MW-1600I...	n/a	n/a	NP	NaN	311	0.0007615	0.004762	unknown	ChiSquared
Total Dissolved Solids [TDS] (mg/L)	MW-1600D,MW-1600I...	Yes	491,700,760	NP	NaN	287	380.8	54.53	x^6	ChiSquared

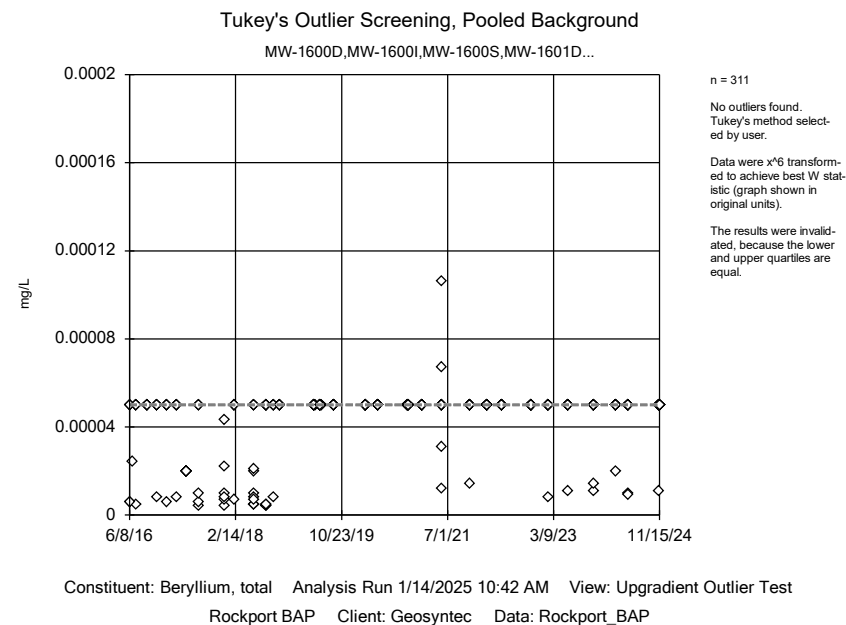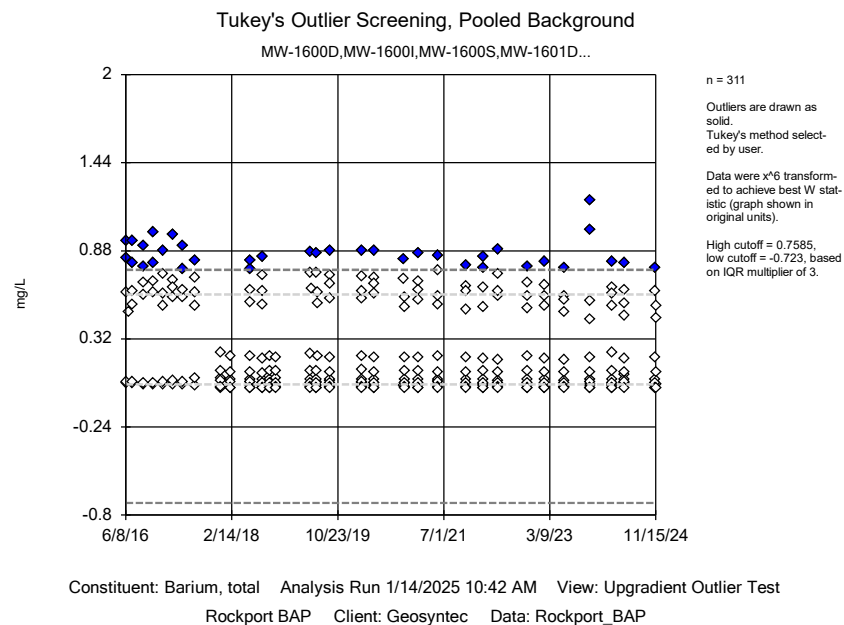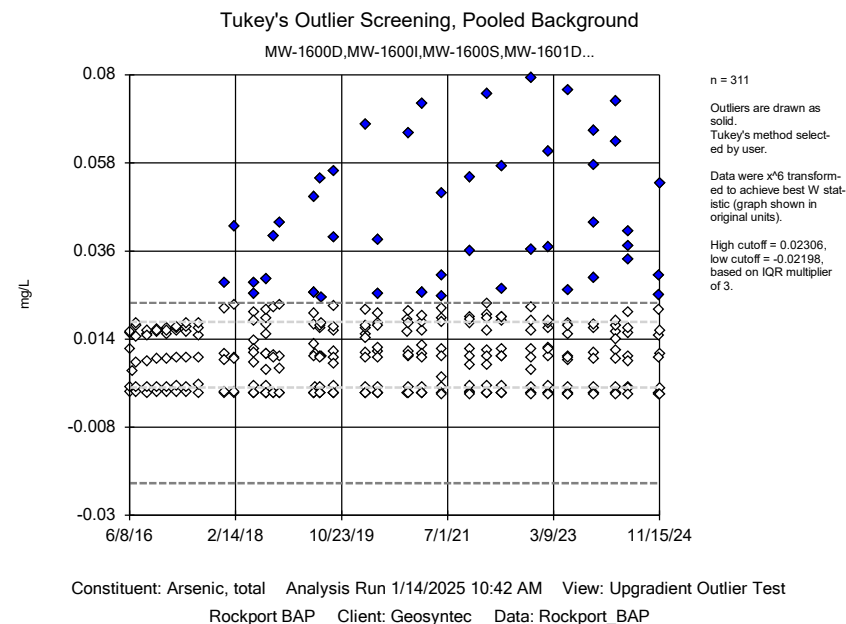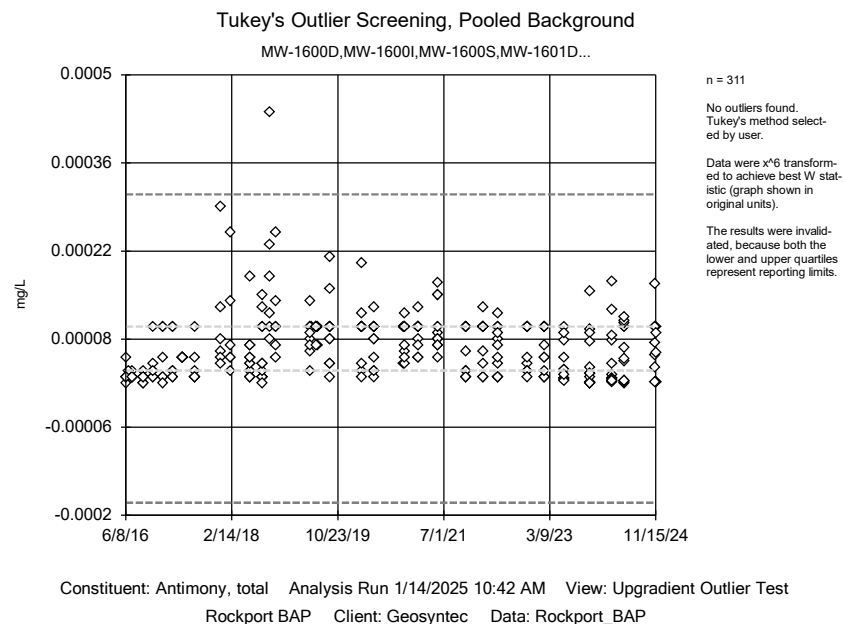

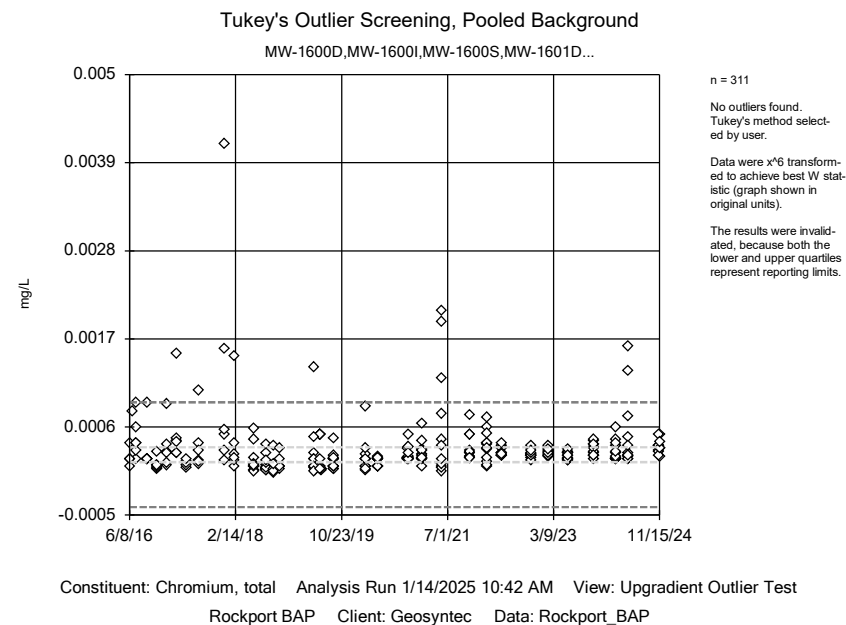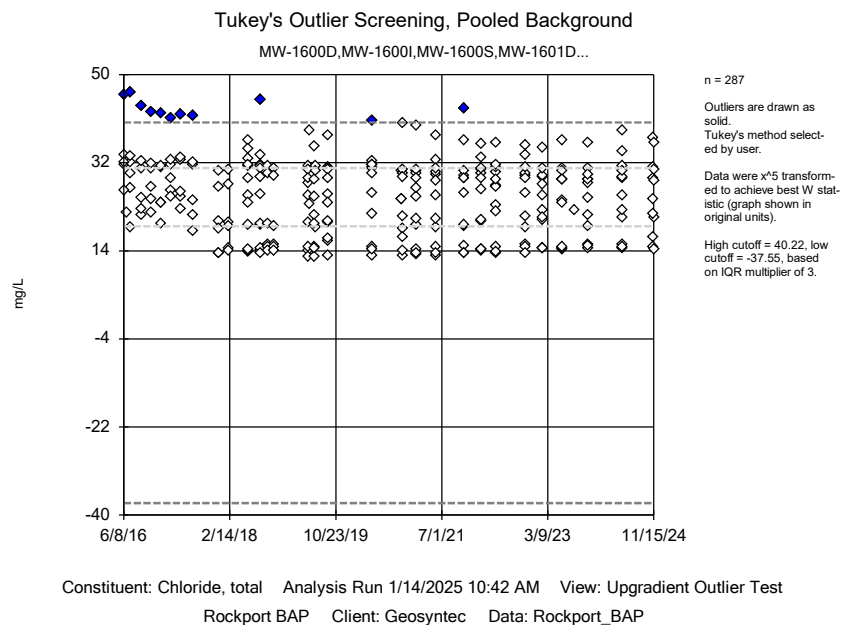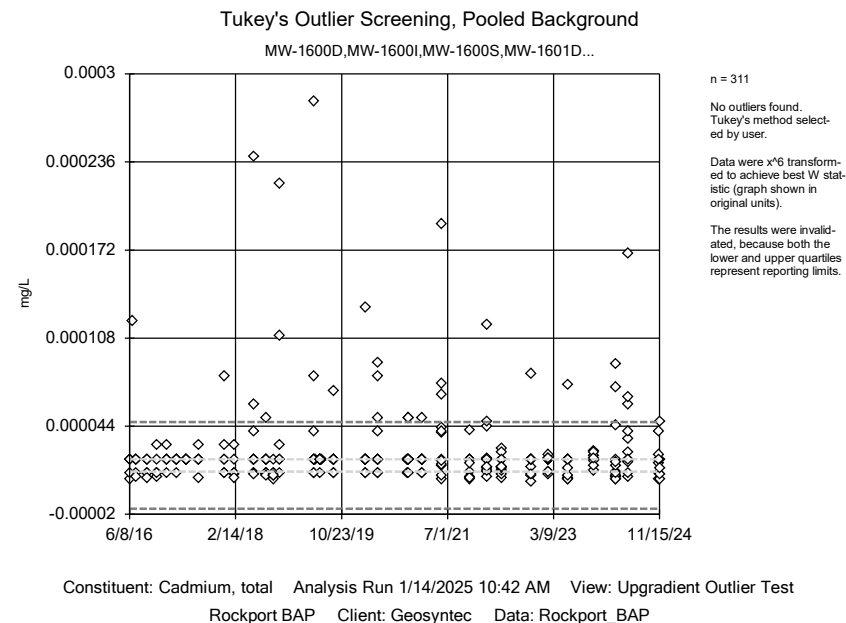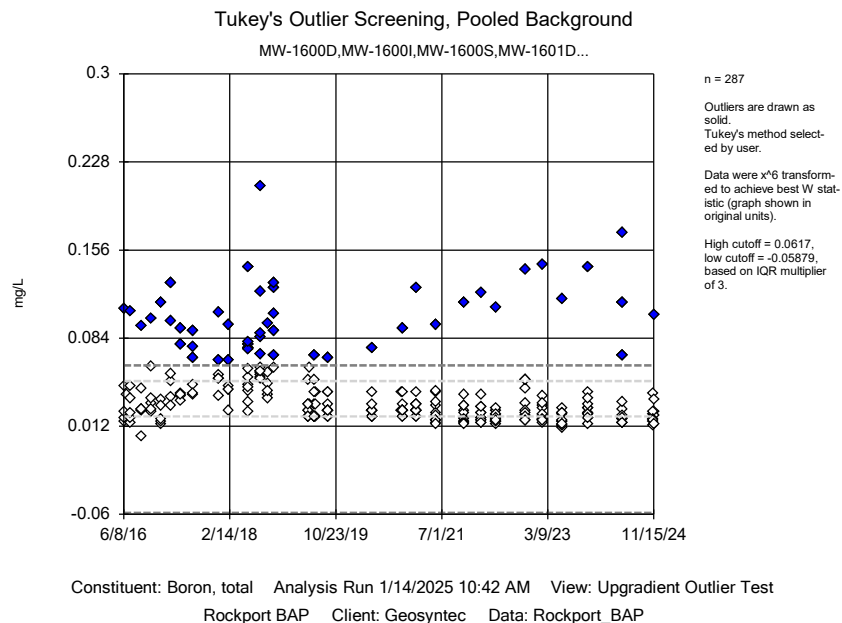


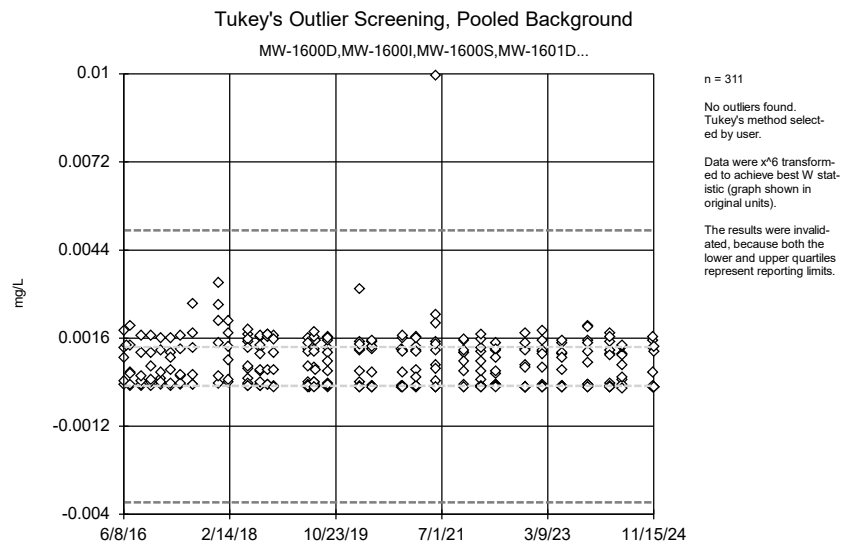


Constituent: Cobalt, total Analysis Run 1/14/2025 10:42 AM View: Upgradient Outlier Test
Rockport BAP Client: Geosyntec Data: Rockport_BAP

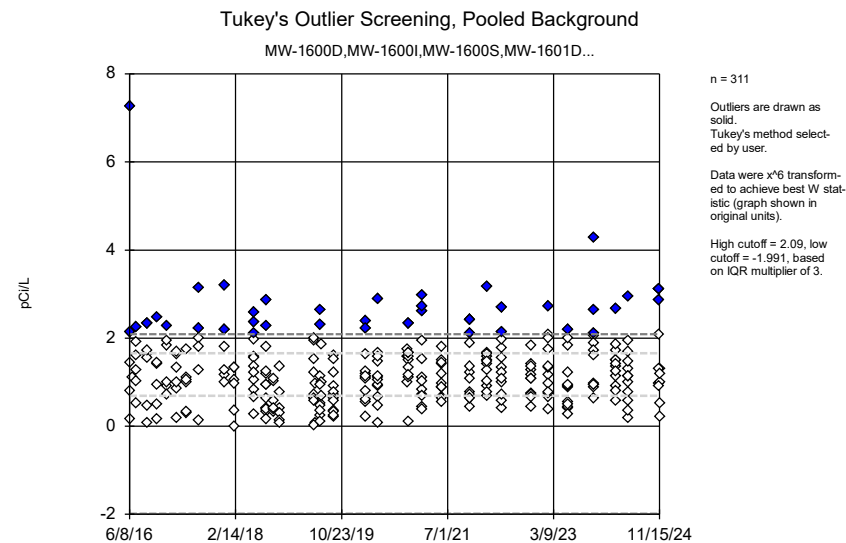





Constituent: Combined Radium 226 + 228 Analysis Run 1/14/2025 10:42 AM View: Upgradient Outlier Test
Rockport BAP Client: Geosyntec Data: Rockport_BAP

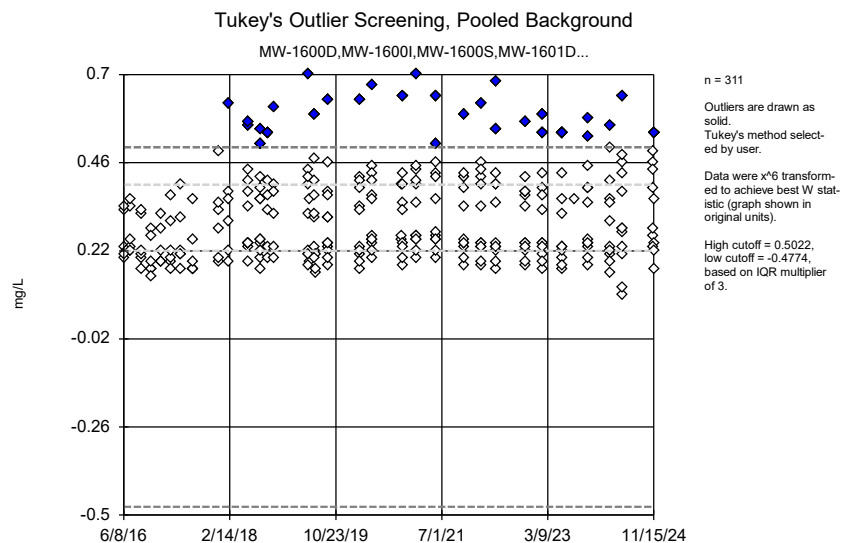

Constituent: Fluoride, total Analysis Run 1/14/2025 10:42 AM View: Upgradient Outlier Test
Rockport BAP Client: Geosyntec Data: Rockport_BAP

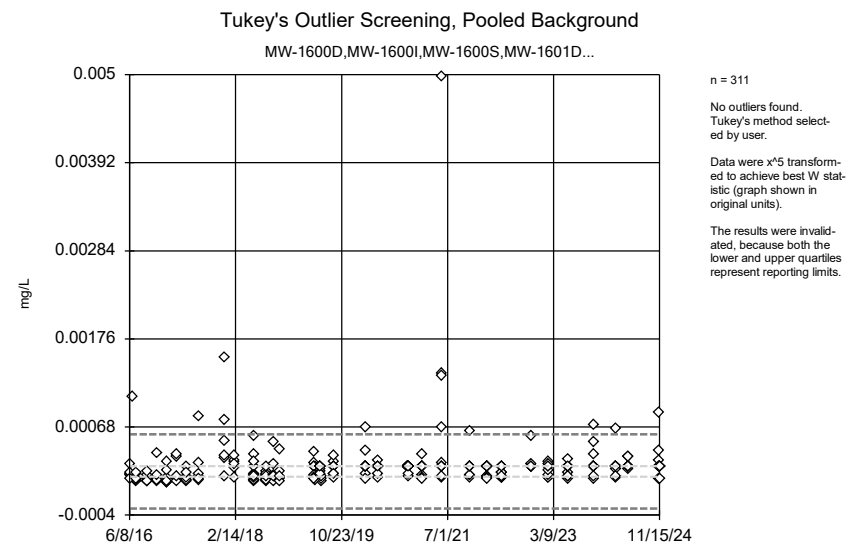

Constituent: Lead, total Analysis Run 1/14/2025 10:42 AM View: Upgradient Outlier Test
Rockport BAP Client: Geosyntec Data: Rockport_BAP

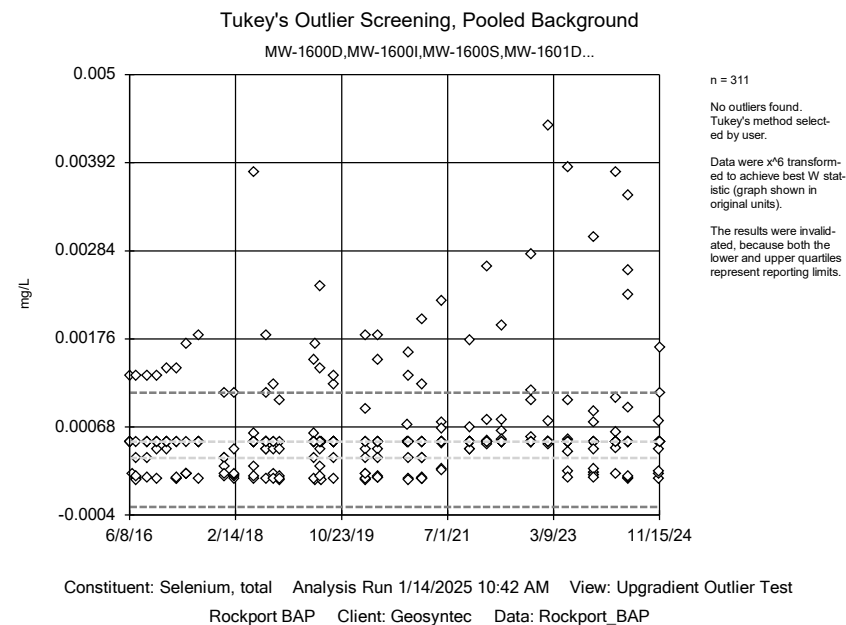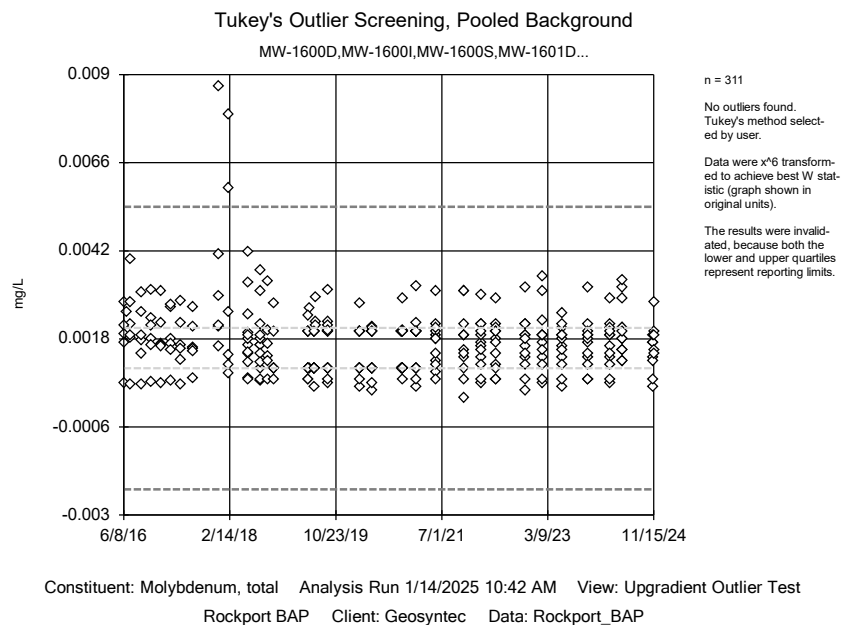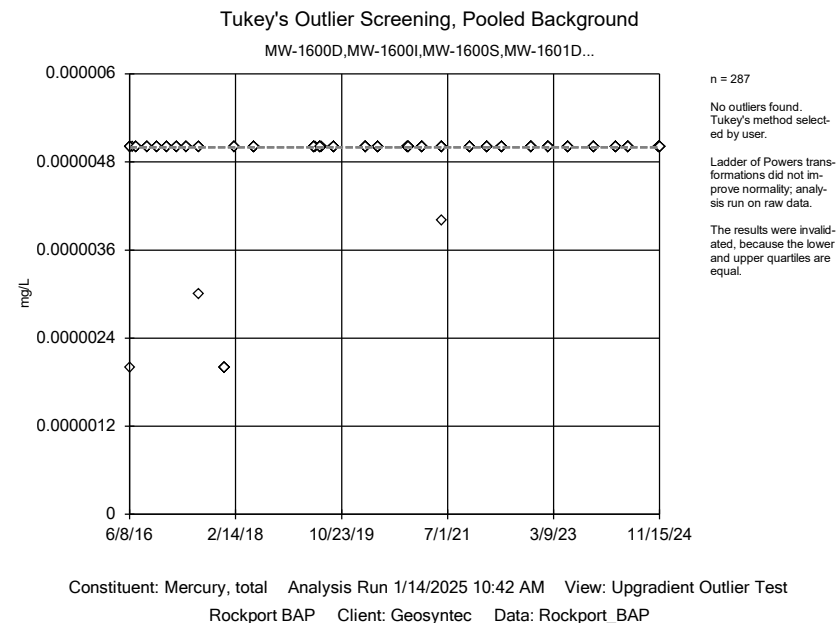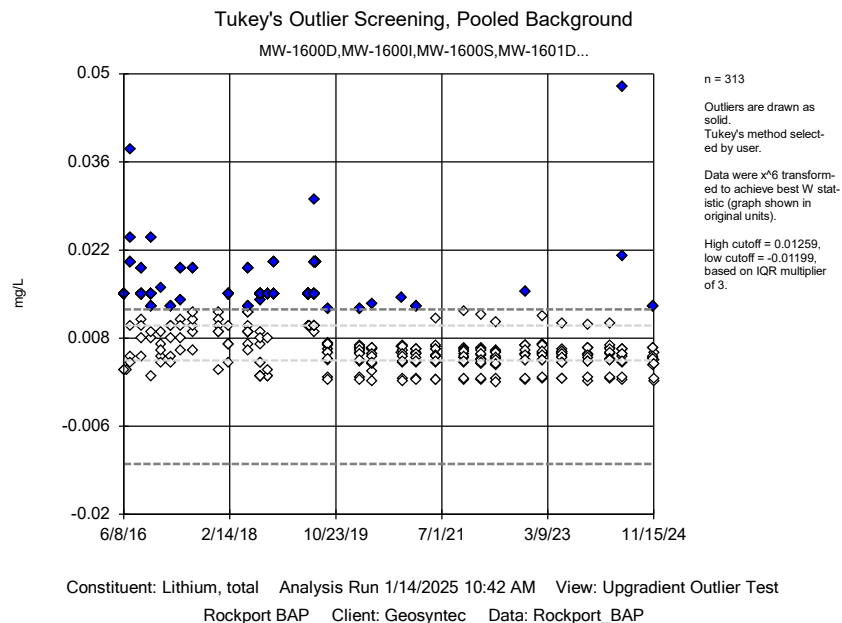

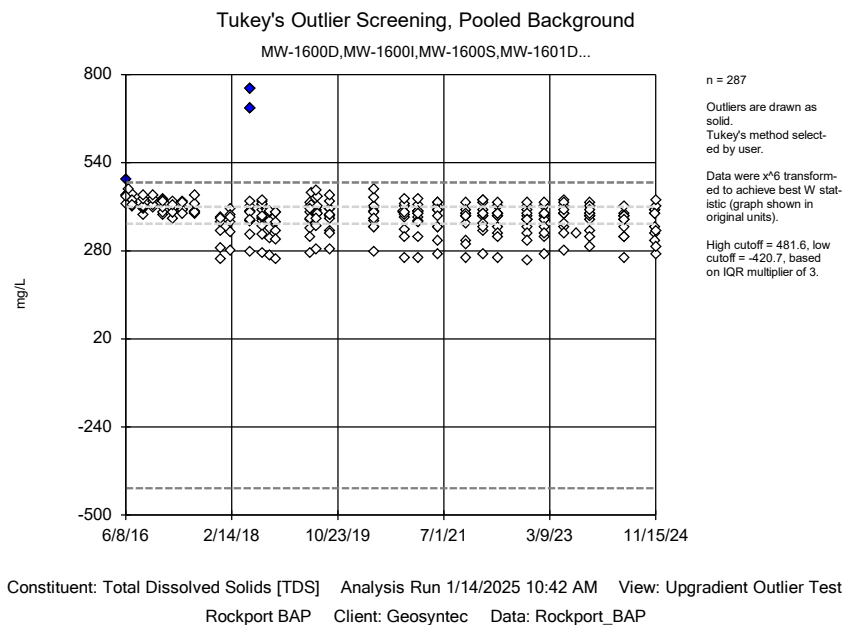
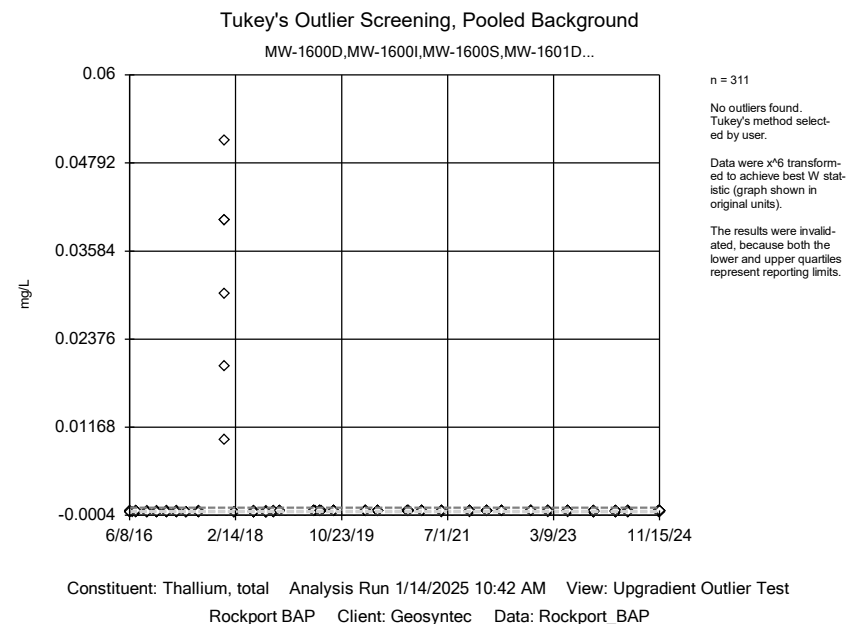
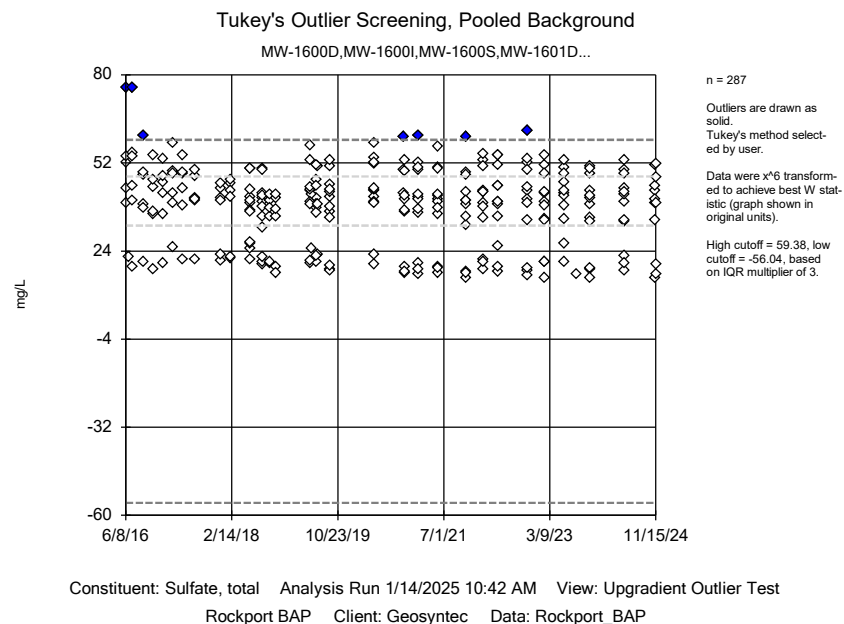


FIGURE D

Upgradient Trend Tests

Upgradient Wells Trend Test - Significant Results





Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/16/2025, 12:28 PM

<u>Constituent</u>	<u>Well</u>	<u>Slope</u>	<u>Calc.</u>	<u>Critical</u>	<u>Sig.</u>	<u>N</u>	<u>%NDs</u>	<u>Normality</u>	<u>Xform</u>	<u>Alpha</u>	<u>Method</u>
Boron, total (mg/L)	MW-1601D (bg)	-0.001447	-129	-111	Yes	25	0	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1701I (bg)	-0.004564	-126	-87	Yes	21	14.29	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1701S (bg)	-0.003025	-89	-87	Yes	21	23.81	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1702D (bg)	-0.006291	-109	-87	Yes	21	19.05	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1702I (bg)	-0.004788	-99	-87	Yes	21	19.05	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1702S (bg)	-0.003202	-89	-87	Yes	21	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1600D (bg)	-0.3911	-198	-111	Yes	25	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1601I (bg)	-0.4677	-174	-105	Yes	24	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1601S (bg)	-1.007	-158	-111	Yes	25	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1701S (bg)	0.4304	151	87	Yes	21	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1600S (bg)	0.02095	159	124	Yes	27	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1601I (bg)	0.004506	120	118	Yes	26	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1601S (bg)	0.01019	131	124	Yes	27	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1701I (bg)	0.01207	135	98	Yes	23	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1600S (bg)	-2.87	-154	-111	Yes	25	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1601S (bg)	2.372	128	111	Yes	25	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1701I (bg)	-0.623	-125	-87	Yes	21	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1701S (bg)	-0.8727	-152	-87	Yes	21	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1600S (bg)	-6.434	-167	-111	Yes	25	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1601S (bg)	-8.768	-113	-111	Yes	25	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1701D (bg)	-4.231	-90	-81	Yes	20	0	n/a	n/a	0.01	NP

Upgradient Wells Trend Test - All Results


Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/16/2025, 12:28 PM

Constituent	Well	Slope	Calc.	Critical	Sig.	N	%NDs	Normality	Xform	Alpha	Method
Boron, total (mg/L)	MW-1600D (bg)	-0.001025	-43	-111	No	25	24	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1600I (bg)	-0.0004184	-24	-111	No	25	8	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1600S (bg)	-0.001097	-59	-111	No	25	0	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1601D (bg)	-0.001447	-129	-111	Yes	25	0	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1601I (bg)	-0.0006422	-55	-105	No	24	0	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1601S (bg)	0.002673	55	111	No	25	0	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1701D (bg)	-0.003841	-71	-87	No	21	0	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1701I (bg)	-0.004564	-126	-87	Yes	21	14.29	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1701S (bg)	-0.003025	-89	-87	Yes	21	23.81	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1702D (bg)	-0.006291	-109	-87	Yes	21	19.05	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1702I (bg)	-0.004788	-99	-87	Yes	21	19.05	n/a	n/a	0.01	NP
Boron, total (mg/L)	MW-1702S (bg)	-0.003202	-89	-87	Yes	21	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1600D (bg)	-0.3911	-198	-111	Yes	25	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1600I (bg)	-0.01666	-15	-111	No	25	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1600S (bg)	0.7282	70	111	No	25	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1601D (bg)	-0.09792	-26	-111	No	25	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1601I (bg)	-0.4677	-174	-105	Yes	24	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1601S (bg)	-1.007	-158	-111	Yes	25	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1701D (bg)	-0.02324	-7	-87	No	21	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1701I (bg)	0.1151	53	87	No	21	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1701S (bg)	0.4304	151	87	Yes	21	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1702D (bg)	0.0582	39	87	No	21	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1702I (bg)	0.1318	38	87	No	21	0	n/a	n/a	0.01	NP
Chloride, total (mg/L)	MW-1702S (bg)	0.09063	43	87	No	21	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1600D (bg)	0.002883	69	124	No	27	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1600I (bg)	0.003751	87	124	No	27	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1600S (bg)	0.02095	159	124	Yes	27	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1601D (bg)	0	-20	-124	No	27	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1601I (bg)	0.004506	120	118	Yes	26	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1601S (bg)	0.01019	131	124	Yes	27	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1701D (bg)	0.006	77	98	No	23	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1701I (bg)	0.01207	135	98	Yes	23	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1701S (bg)	0.002435	30	98	No	23	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1702D (bg)	0	15	98	No	23	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1702I (bg)	0.001998	52	98	No	23	0	n/a	n/a	0.01	NP
Fluoride, total (mg/L)	MW-1702S (bg)	0	6	98	No	23	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1600D (bg)	0.4635	97	111	No	25	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1600I (bg)	0.3997	99	111	No	25	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1600S (bg)	-2.87	-154	-111	Yes	25	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1601D (bg)	0	-1	-111	No	25	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1601I (bg)	-0.05603	-19	-105	No	24	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1601S (bg)	2.372	128	111	Yes	25	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1701D (bg)	-0.2856	-66	-87	No	21	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1701I (bg)	-0.623	-125	-87	Yes	21	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1701S (bg)	-0.8727	-152	-87	Yes	21	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1702D (bg)	0.2275	37	87	No	21	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1702I (bg)	-0.294	-52	-87	No	21	0	n/a	n/a	0.01	NP
Sulfate, total (mg/L)	MW-1702S (bg)	-0.5298	-80	-87	No	21	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1600D (bg)	-2.43	-94	-111	No	25	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1600I (bg)	0	8	111	No	25	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1600S (bg)	-6.434	-167	-111	Yes	25	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1601D (bg)	0	-13	-111	No	25	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1601I (bg)	-1.348	-80	-105	No	24	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1601S (bg)	-8.768	-113	-111	Yes	25	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1701D (bg)	-4.231	-90	-81	Yes	20	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1701I (bg)	-3.051	-71	-87	No	21	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1701S (bg)	-0.8882	-30	-87	No	21	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1702D (bg)	0.9126	34	87	No	21	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1702I (bg)	-0.7228	-20	-81	No	20	0	n/a	n/a	0.01	NP
Total Dissolved Solids [TDS] (mg/L)	MW-1702S (bg)	0.6991	15	87	No	21	0	n/a	n/a	0.01	NP

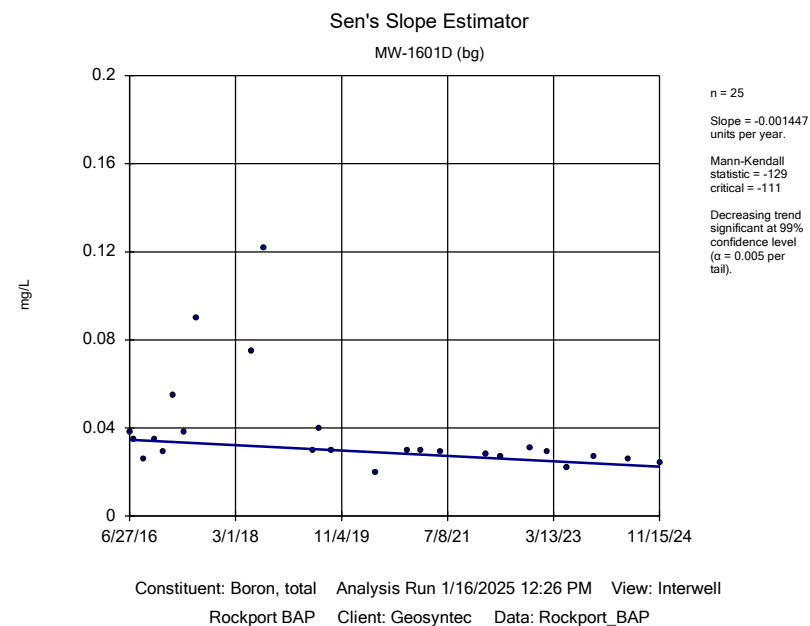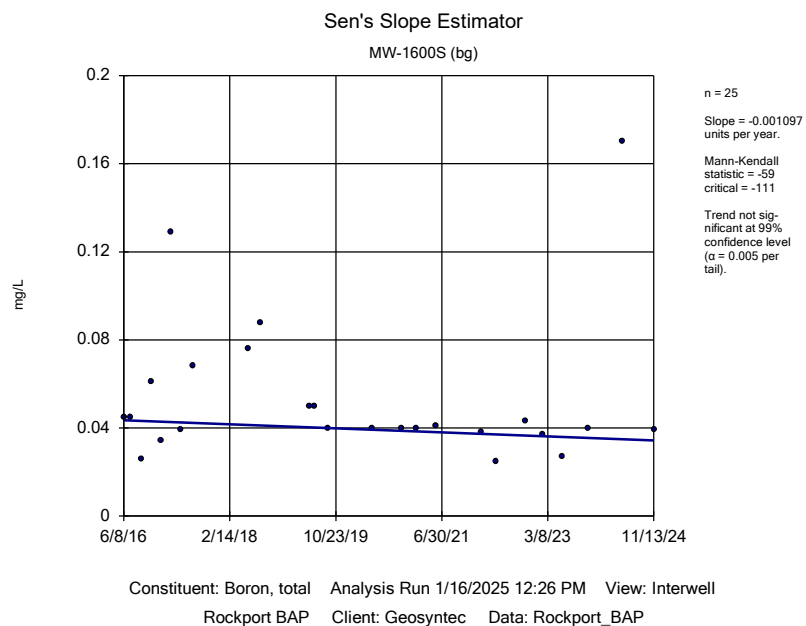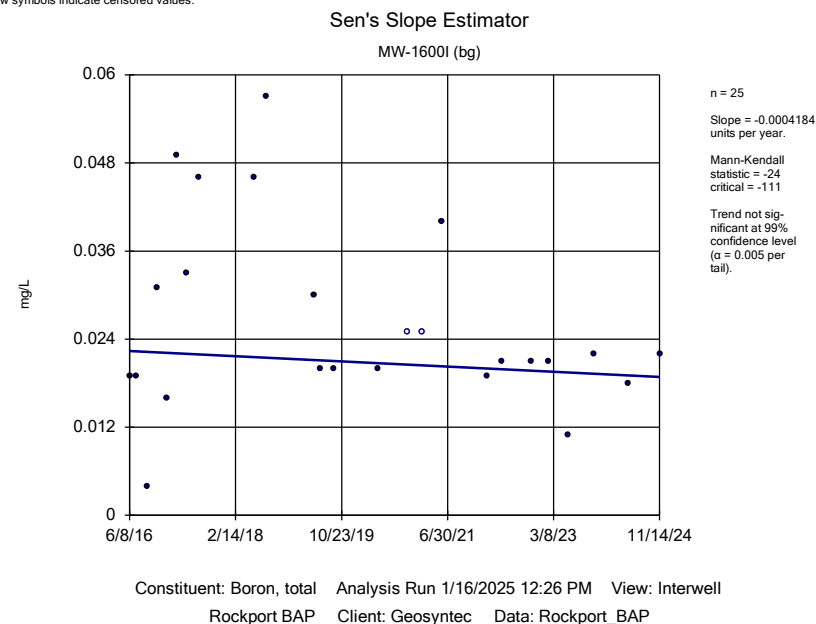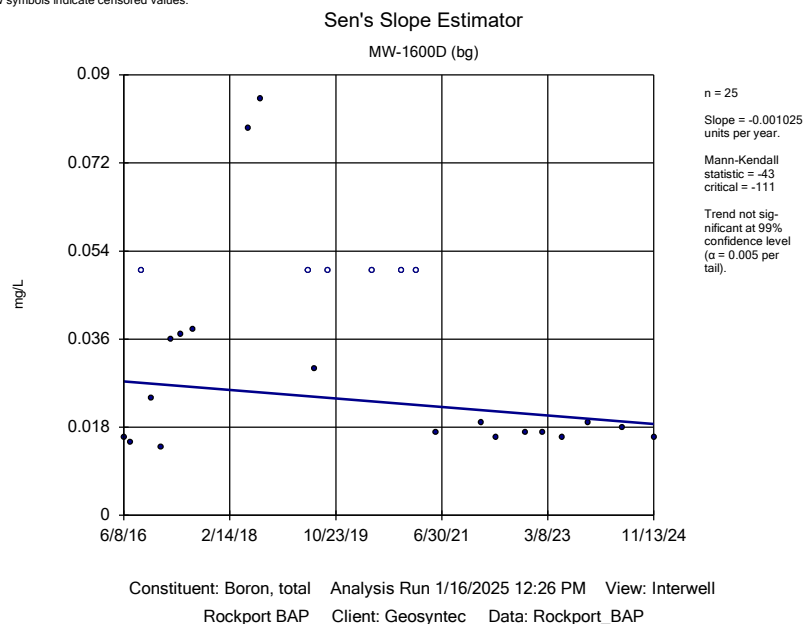

Sen's Slope Estimator


MW-16011 (bg)

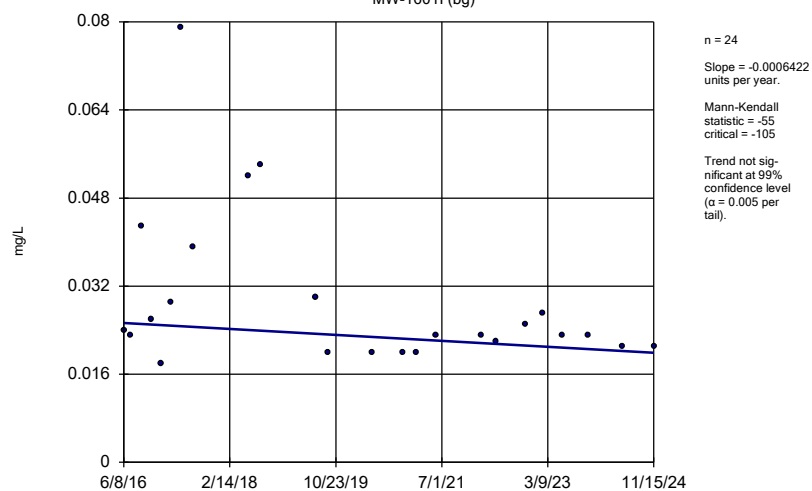

Constituent: Boron, total Analysis Run 1/16/2025 12:26 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-1601S (bg)

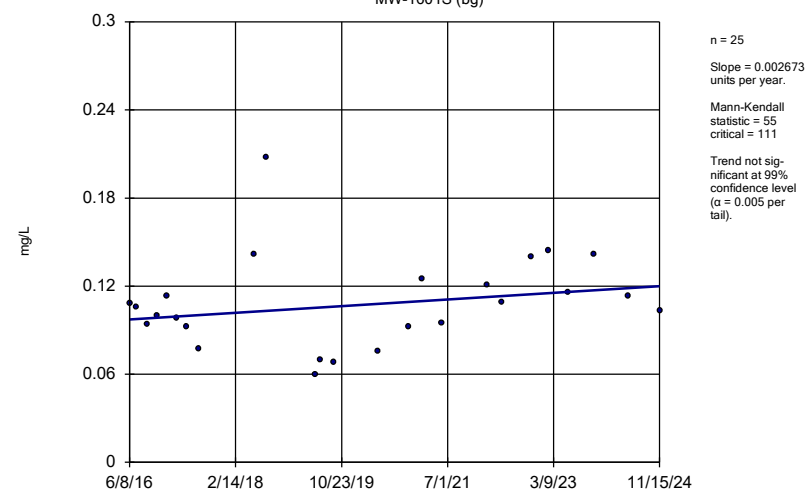

Constituent: Boron, total Analysis Run 1/16/2025 12:26 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-1701D (bg)

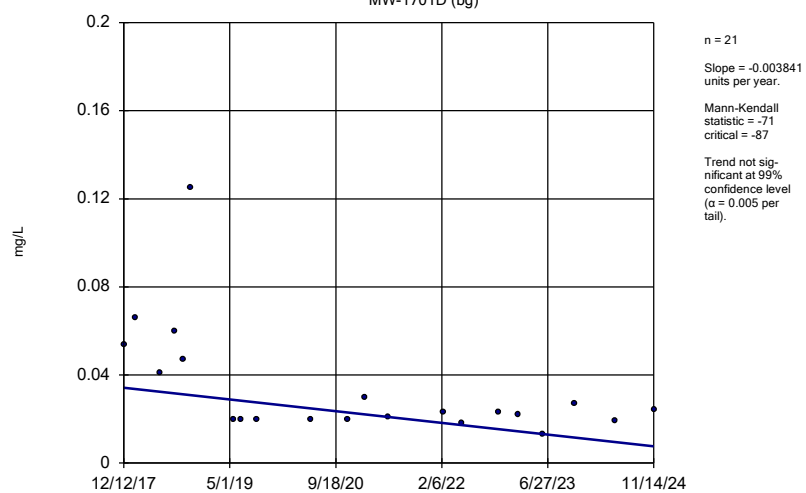

Constituent: Boron, total Analysis Run 1/16/2025 12:26 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-17011 (bg)

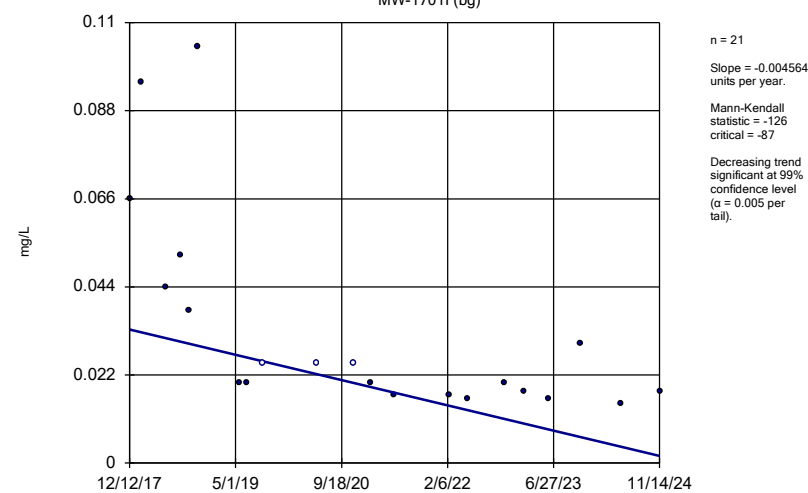

Constituent: Boron, total Analysis Run 1/16/2025 12:26 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-1701S (bg)

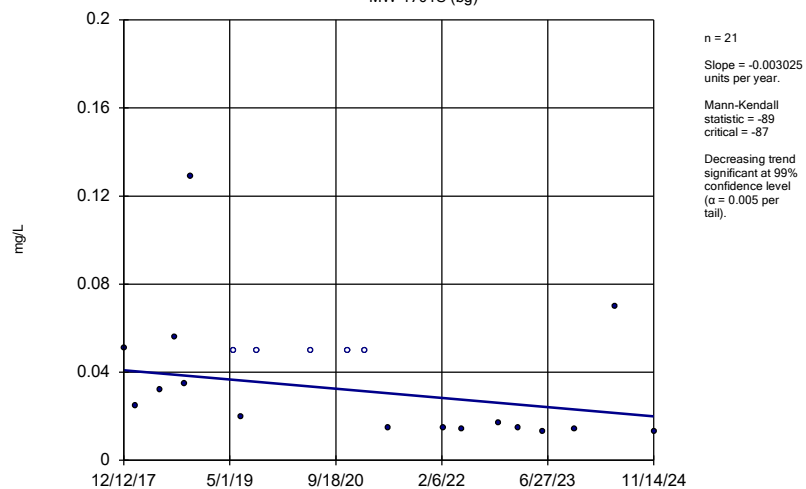

Constituent: Boron, total Analysis Run 1/16/2025 12:26 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-1702D (bg)

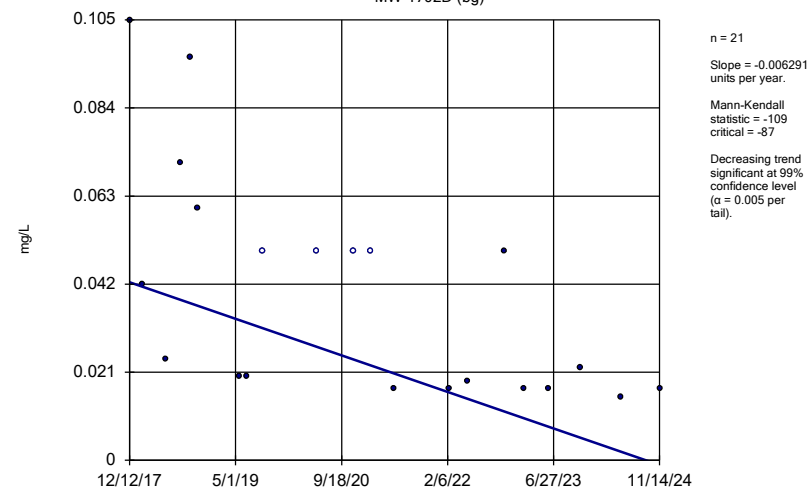

Constituent: Boron, total Analysis Run 1/16/2025 12:26 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-1702I (bg)

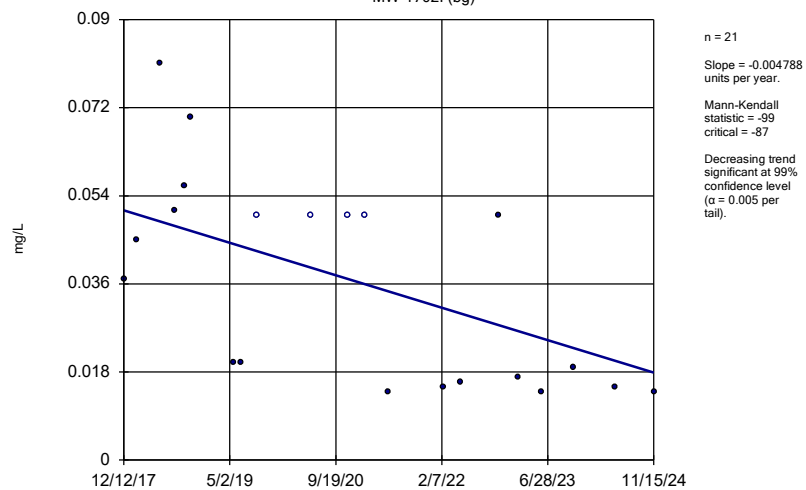





Constituent: Boron, total Analysis Run 1/16/2025 12:26 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator

MW-1702S (bg)

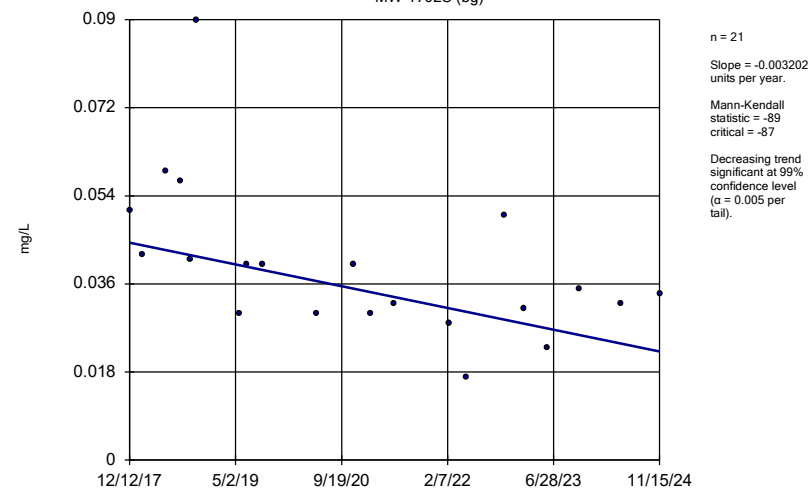


Constituent: Boron, total Analysis Run 1/16/2025 12:26 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

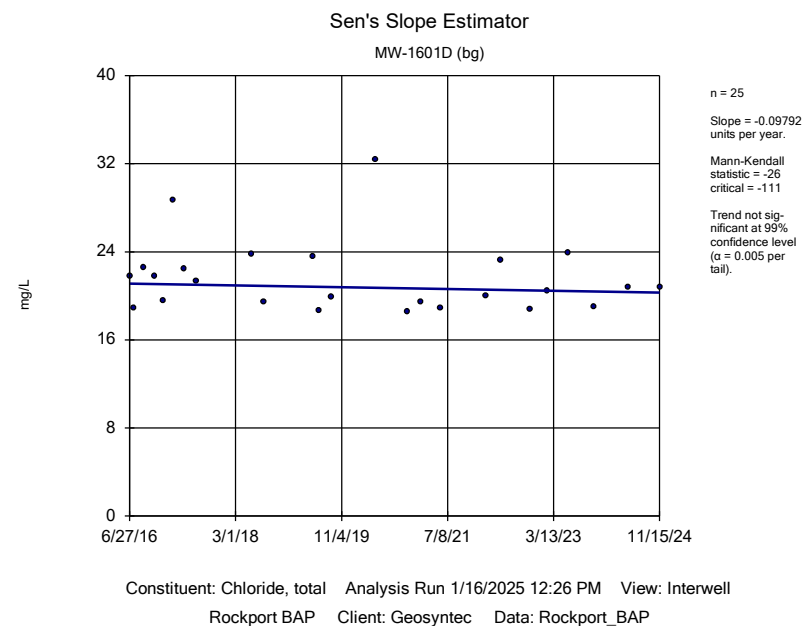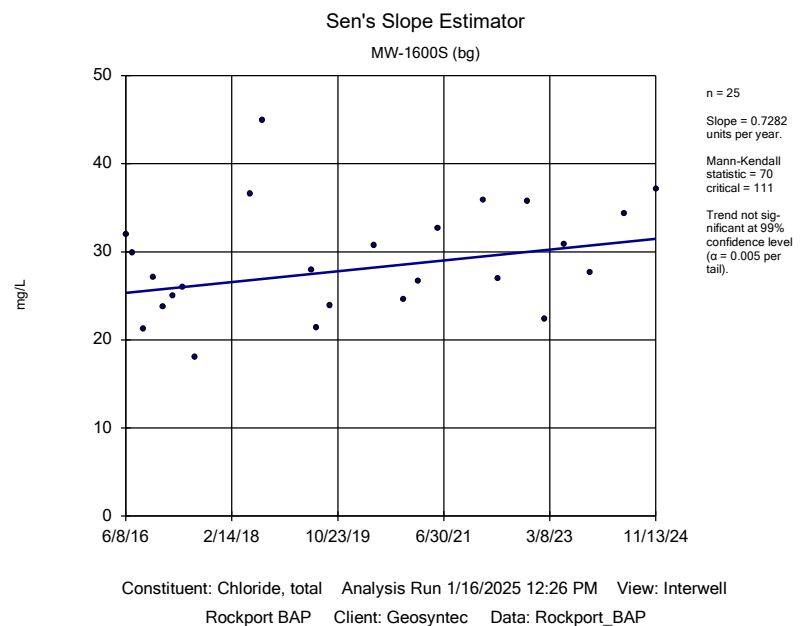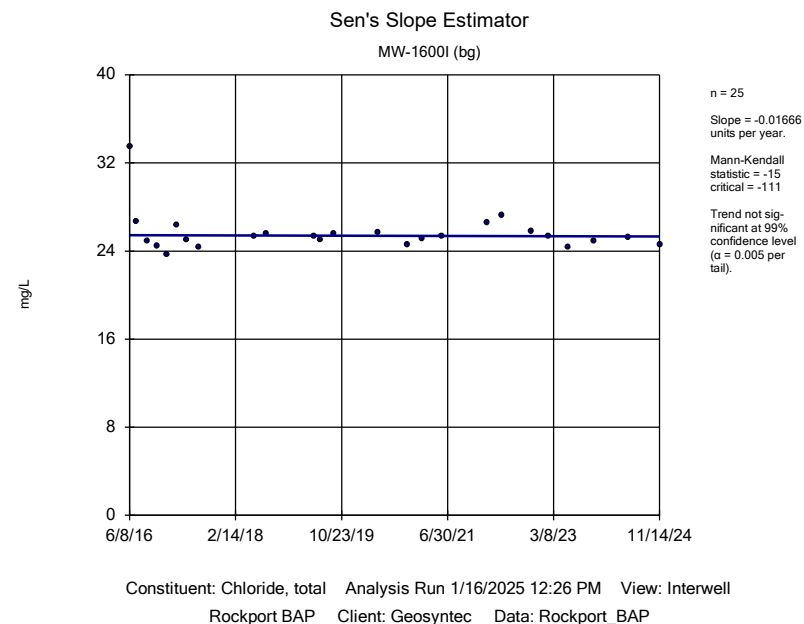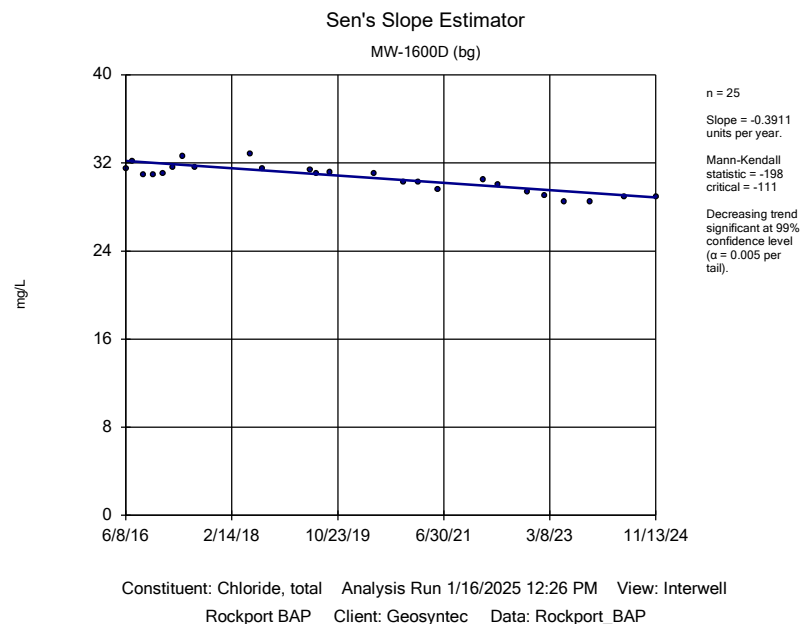

Sen's Slope Estimator


MW-1601I (bg)

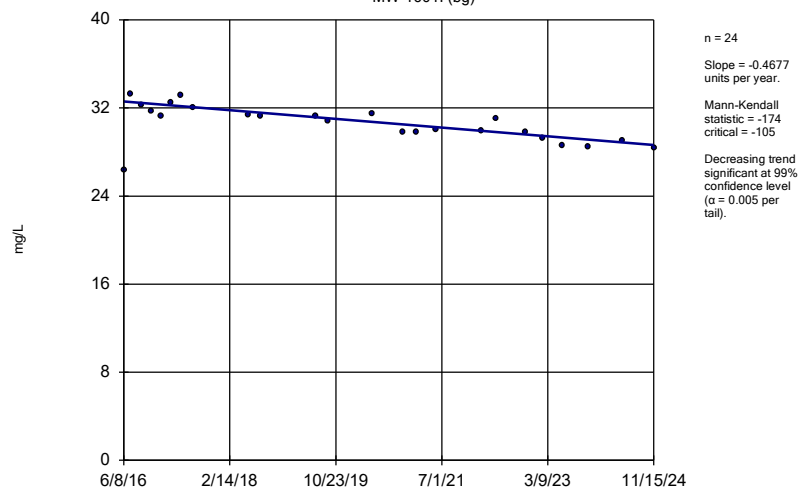

Constituent: Chloride, total Analysis Run 1/16/2025 12:26 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-1601S (bg)

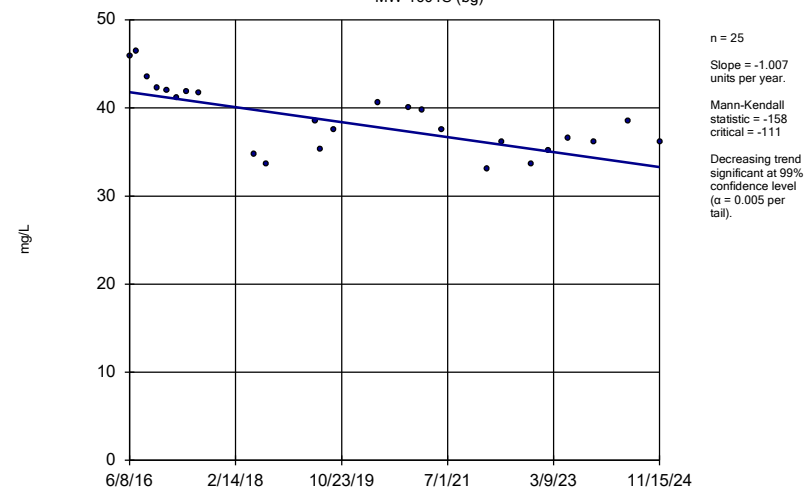

Constituent: Chloride, total Analysis Run 1/16/2025 12:26 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-1701D (bg)

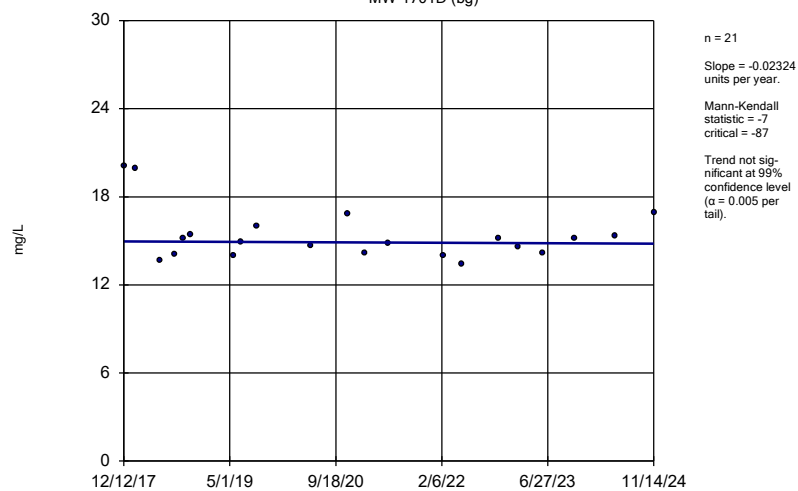





Constituent: Chloride, total Analysis Run 1/16/2025 12:26 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP





Sen's Slope Estimator





MW-1701I (bg)




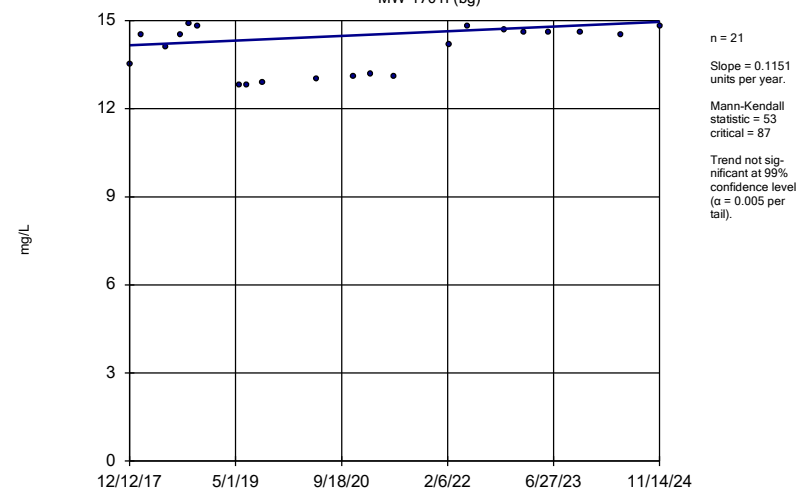






Constituent: Chloride, total Analysis Run 1/16/2025 12:26 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

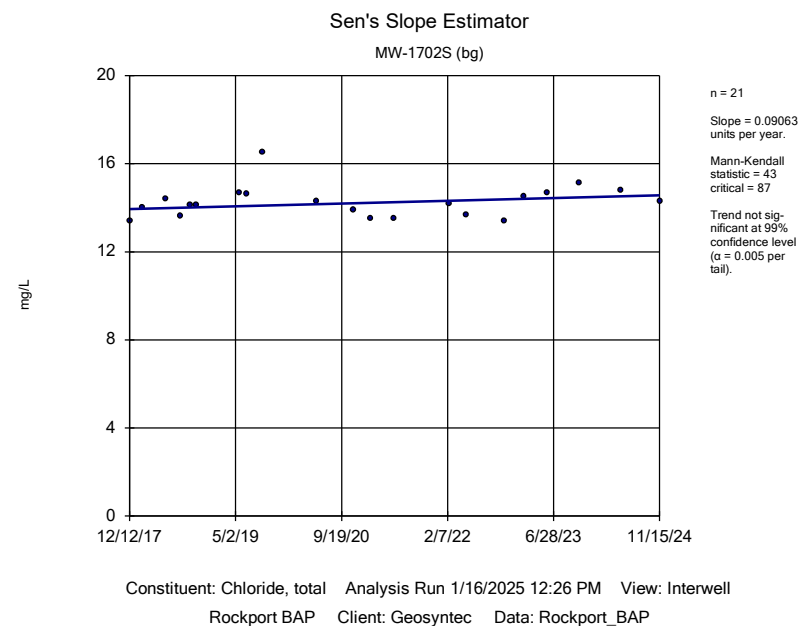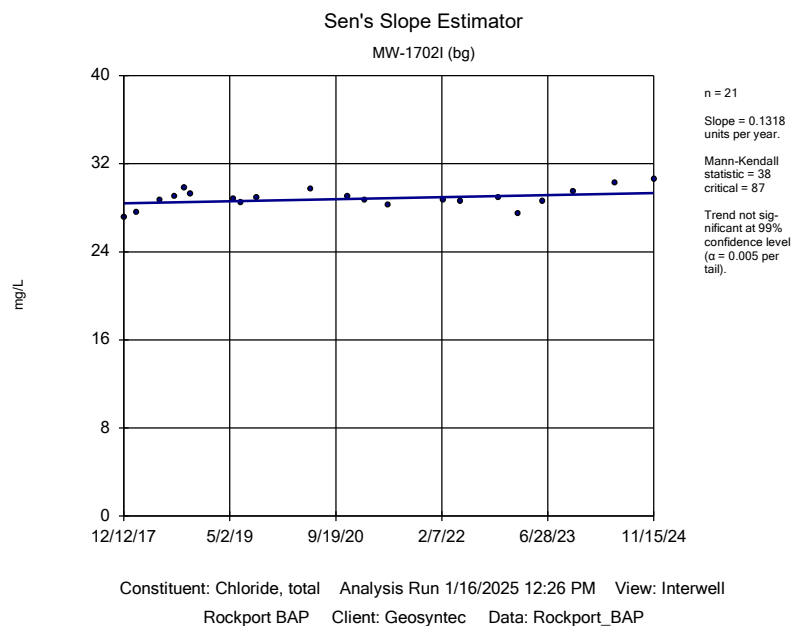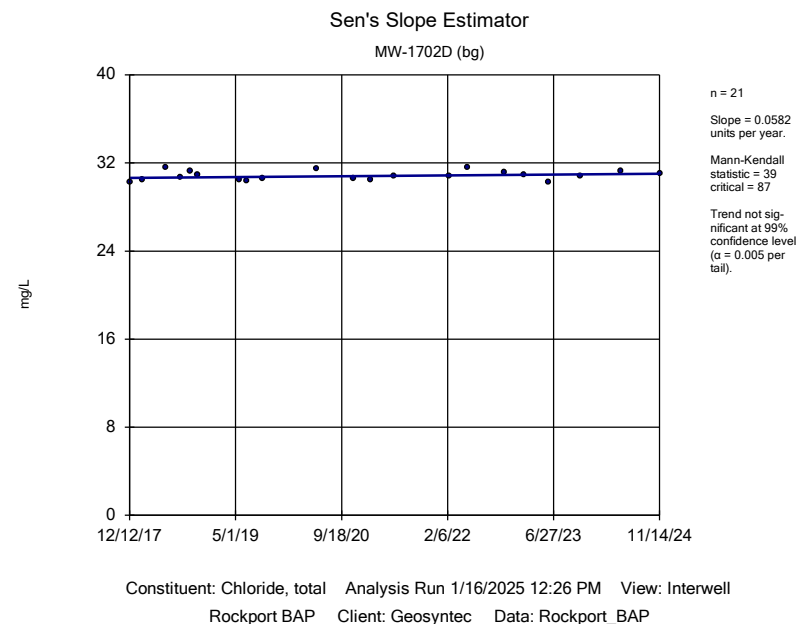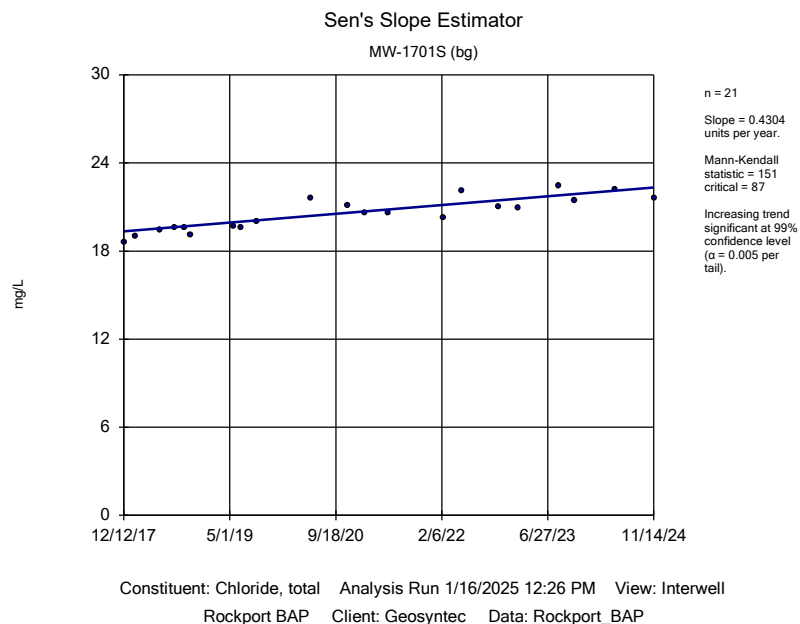

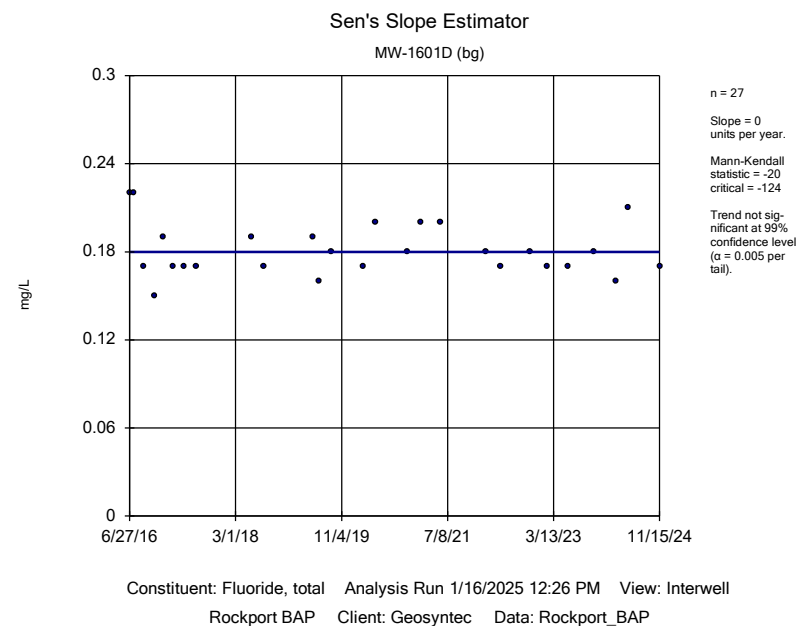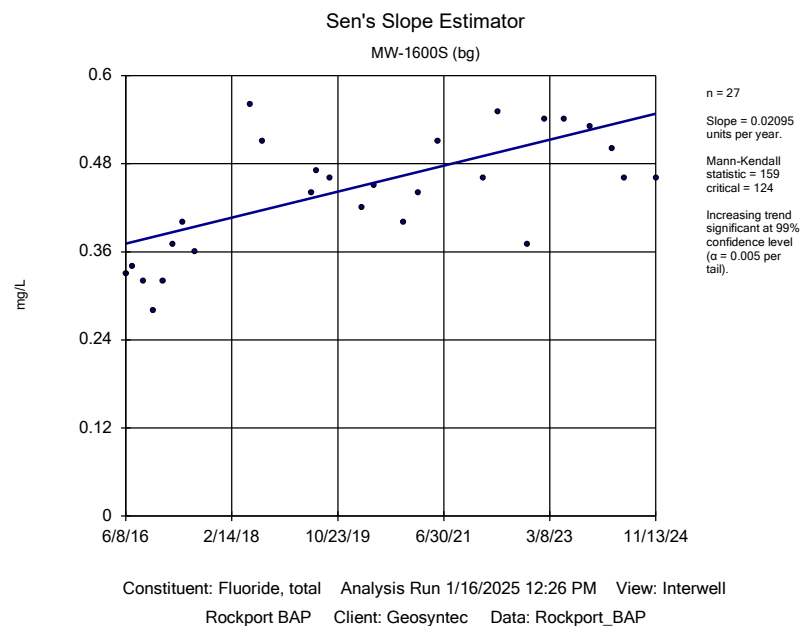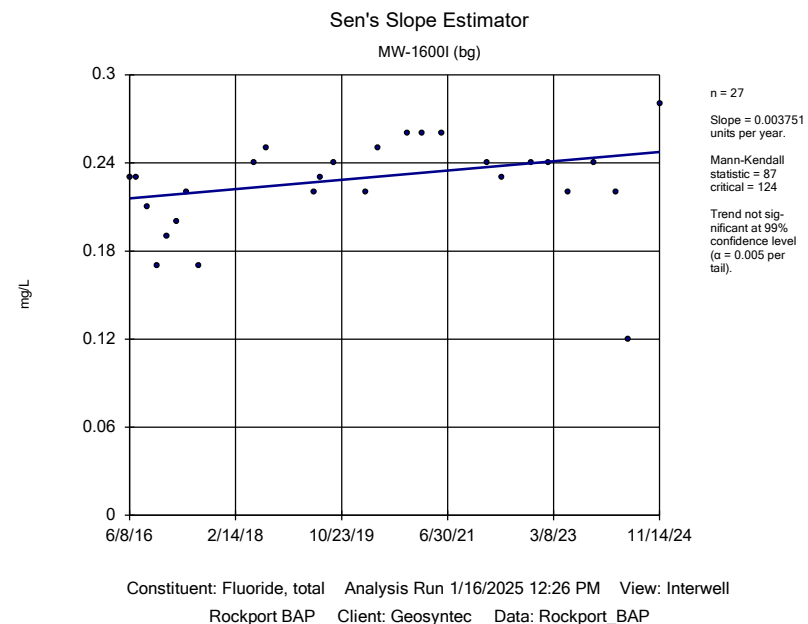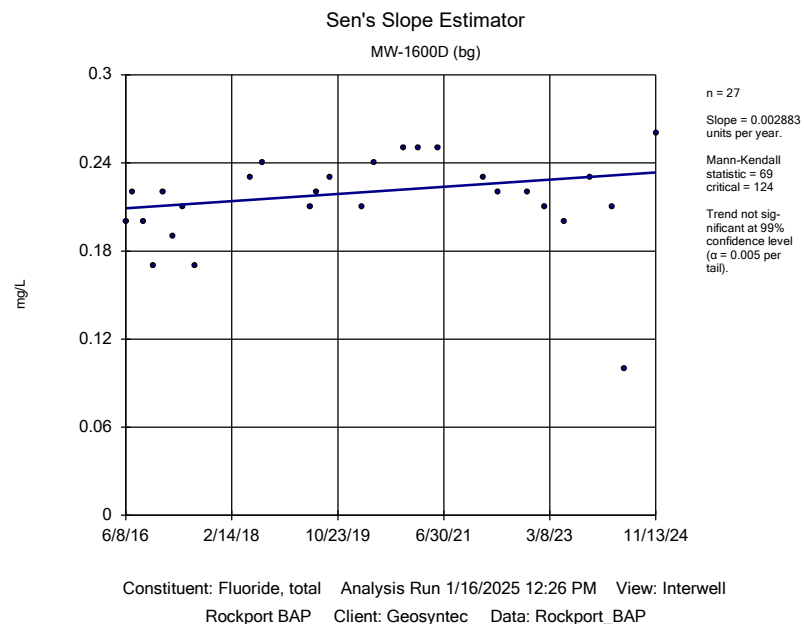

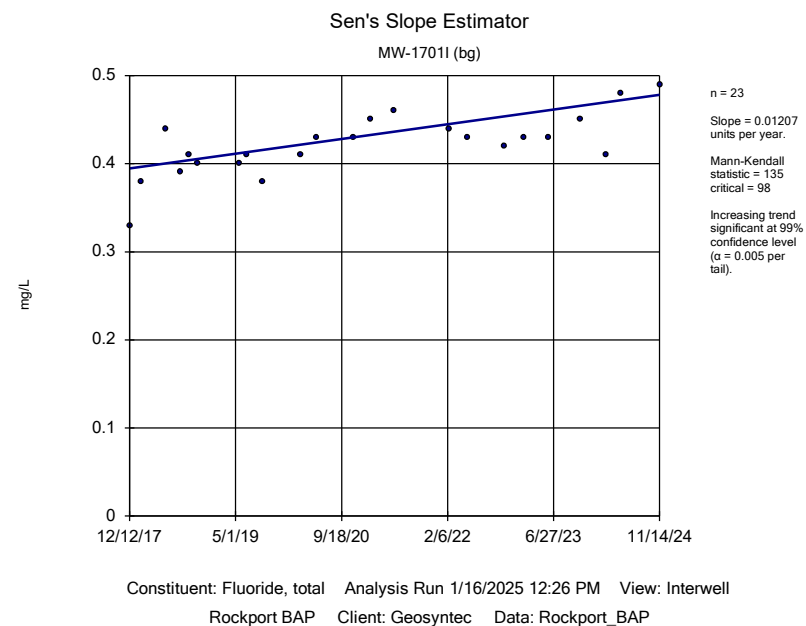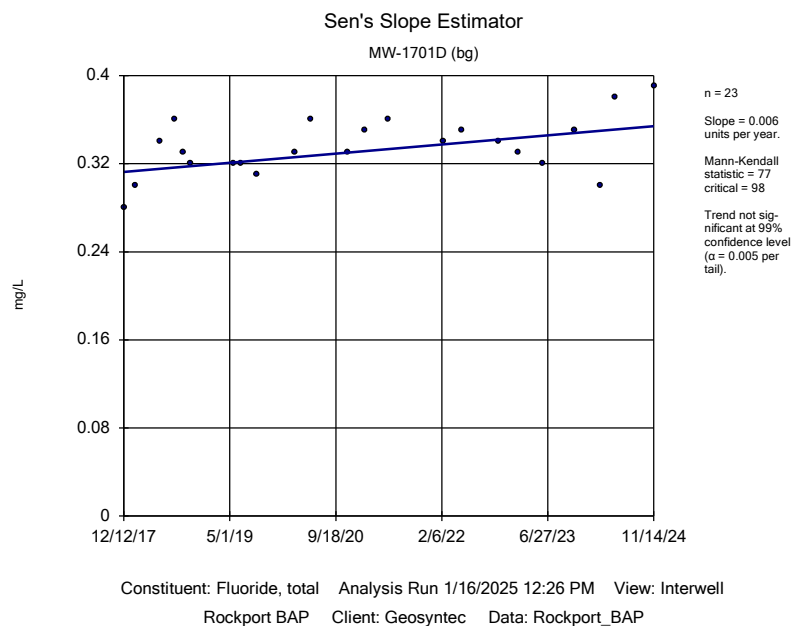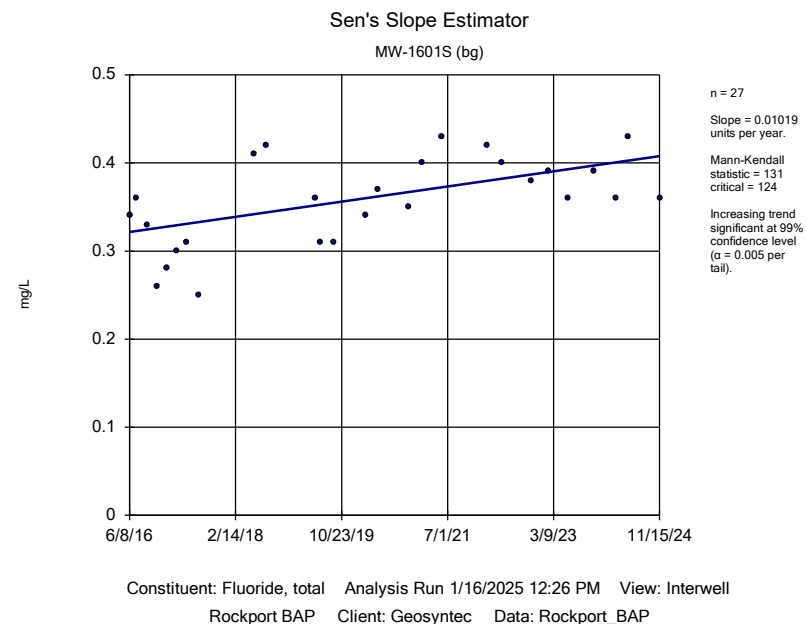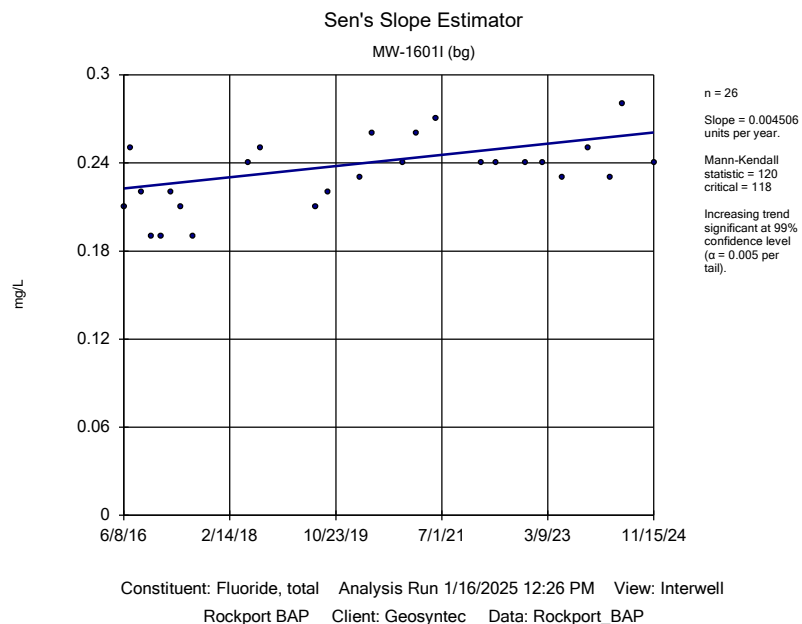


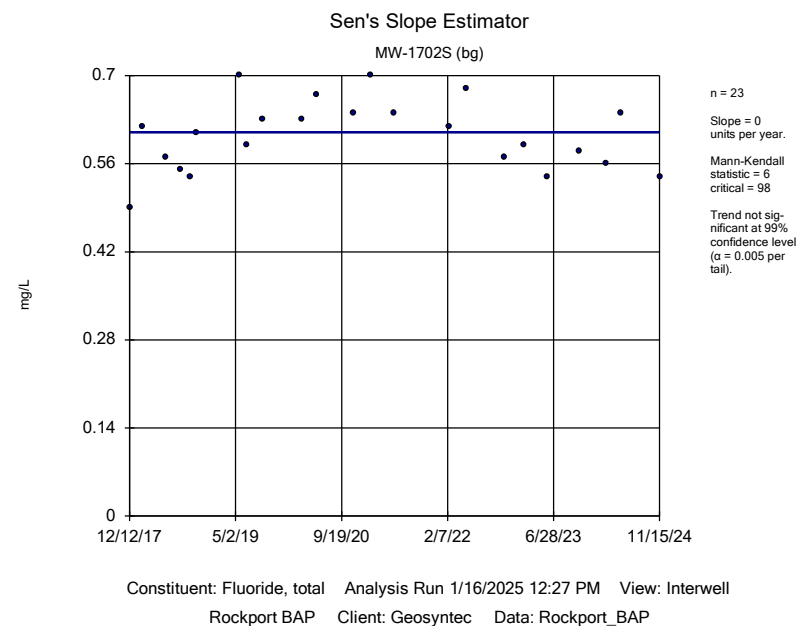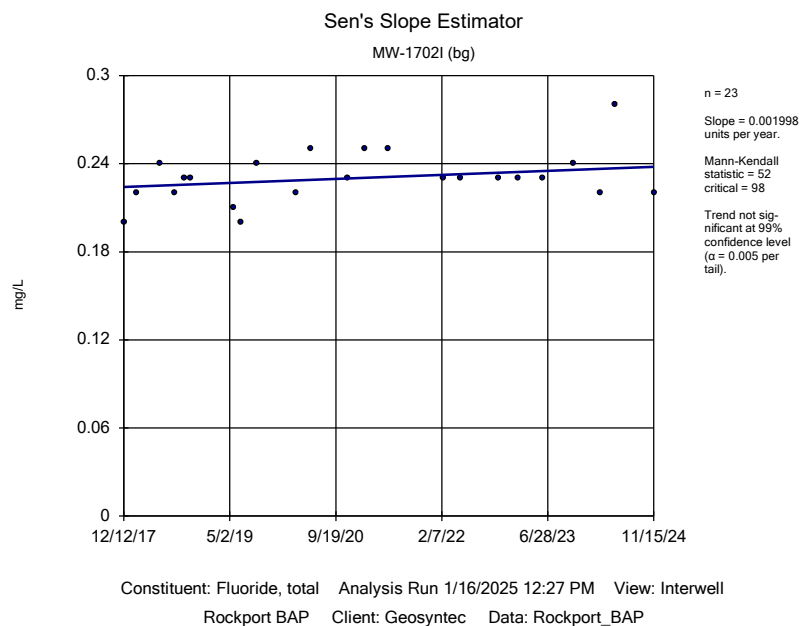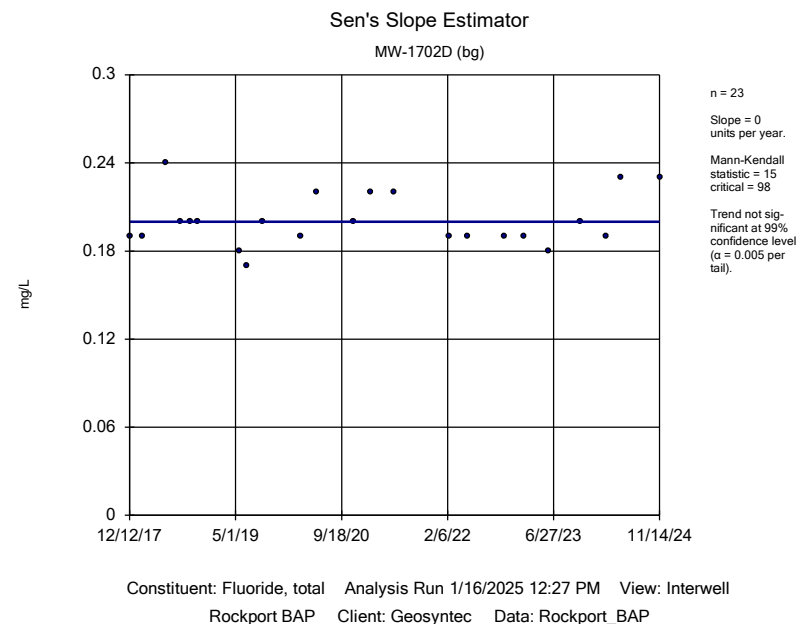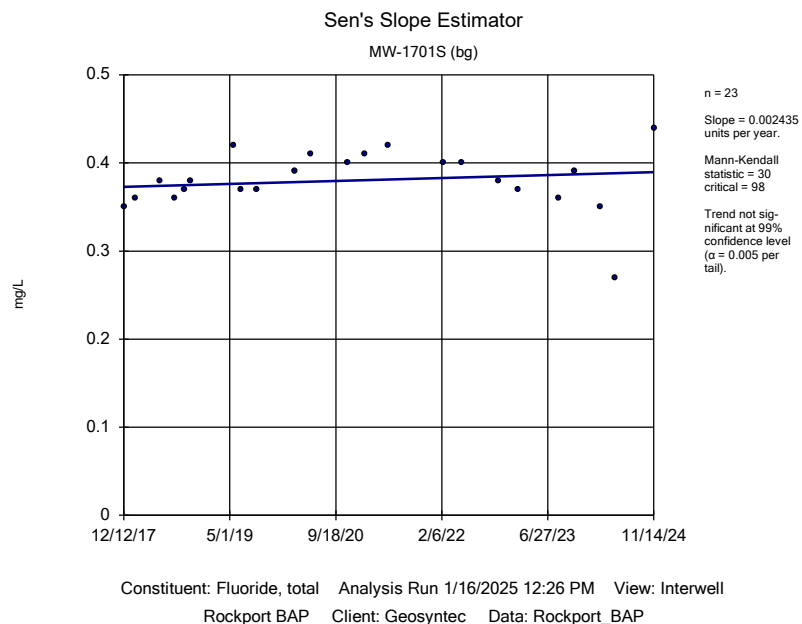

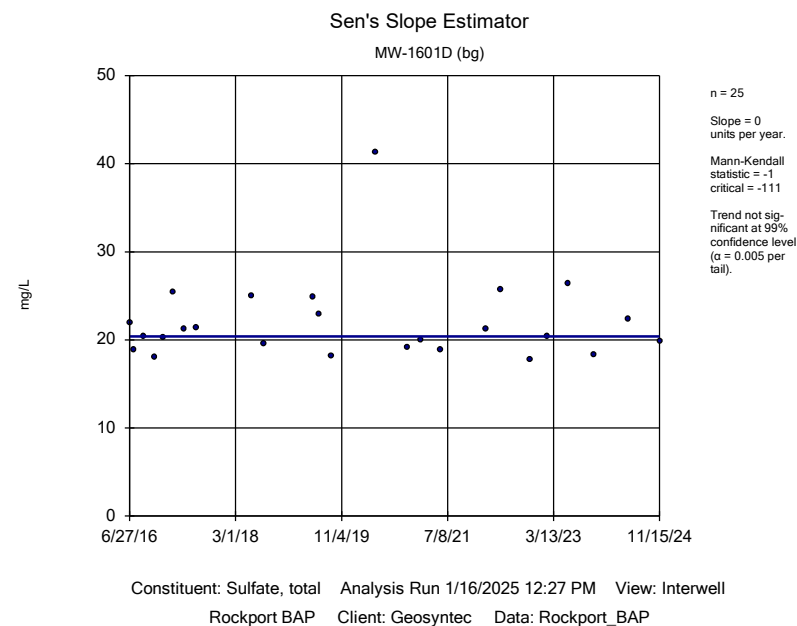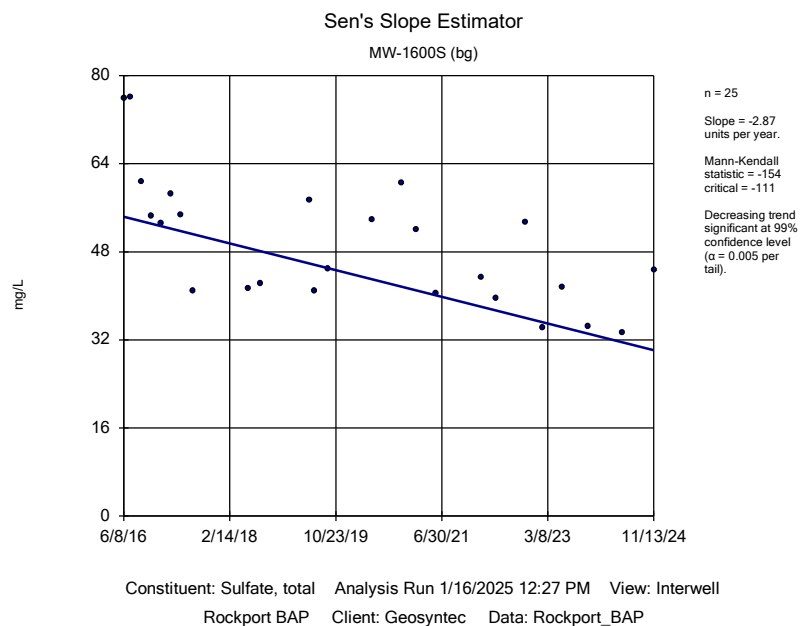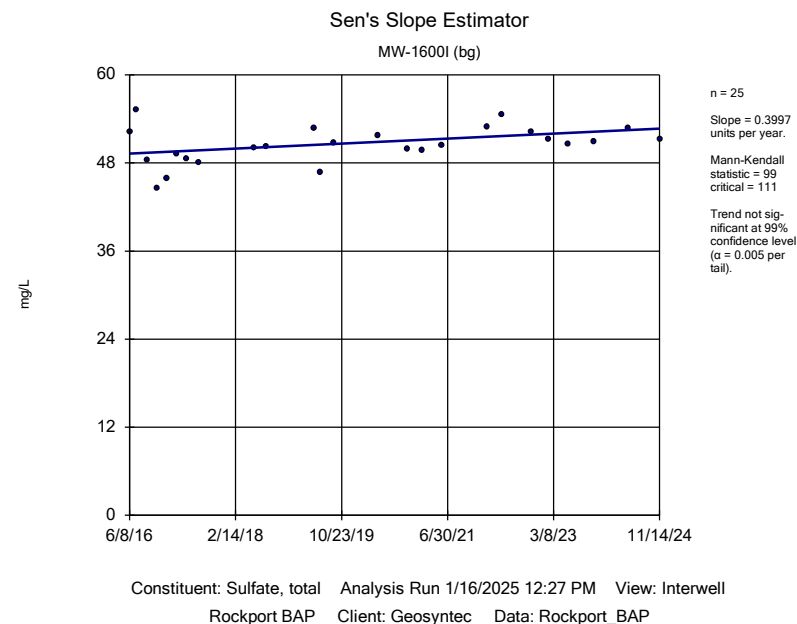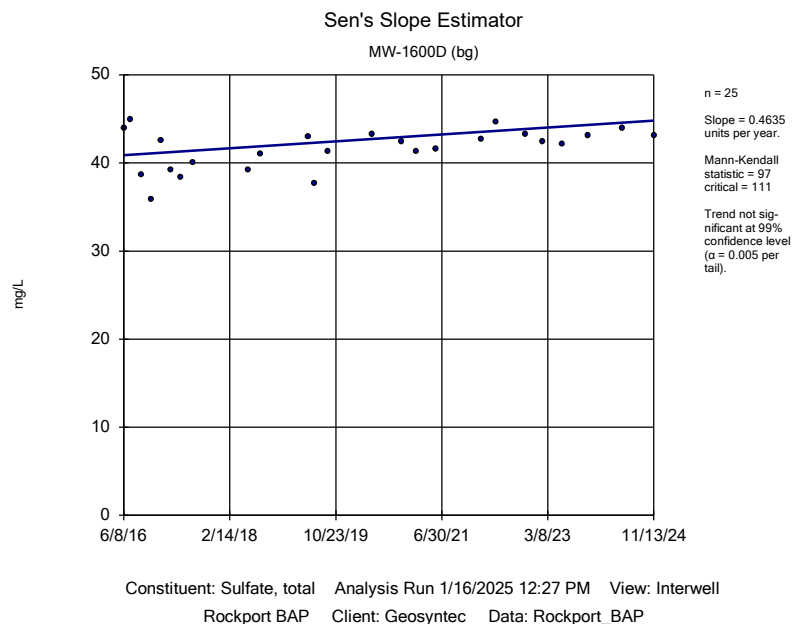

Sen's Slope Estimator


MW-1601I (bg)

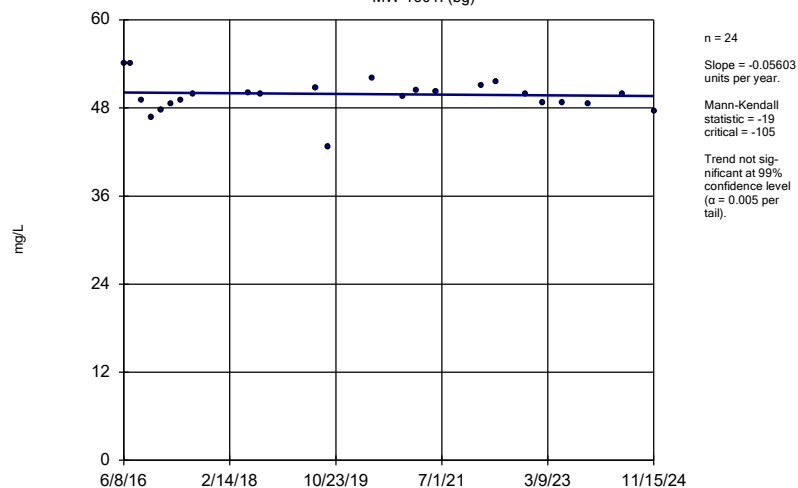

Constituent: Sulfate, total Analysis Run 1/16/2025 12:27 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-1601S (bg)

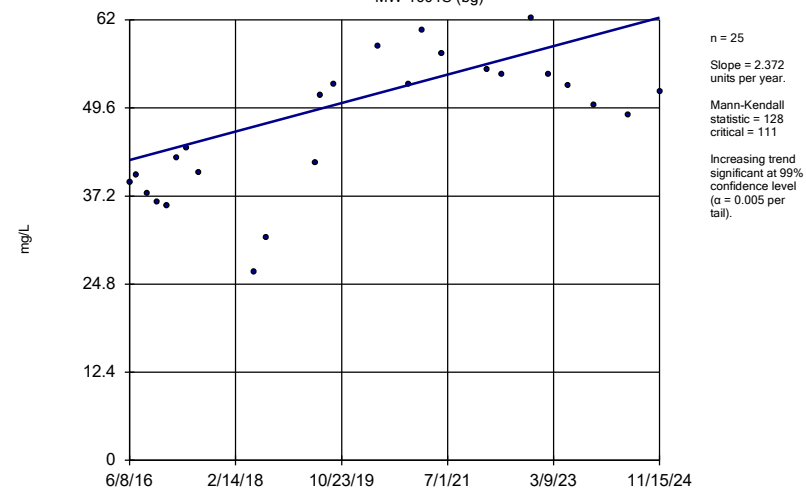

Constituent: Sulfate, total Analysis Run 1/16/2025 12:27 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-1701D (bg)

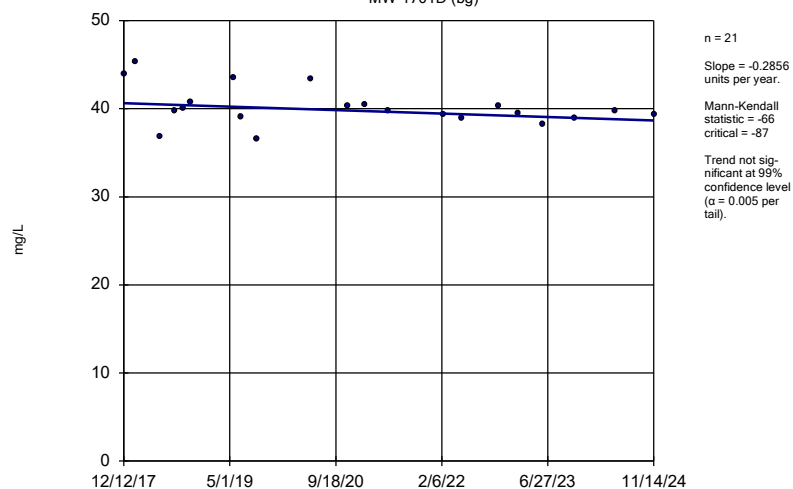

Constituent: Sulfate, total Analysis Run 1/16/2025 12:27 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-1701I (bg)

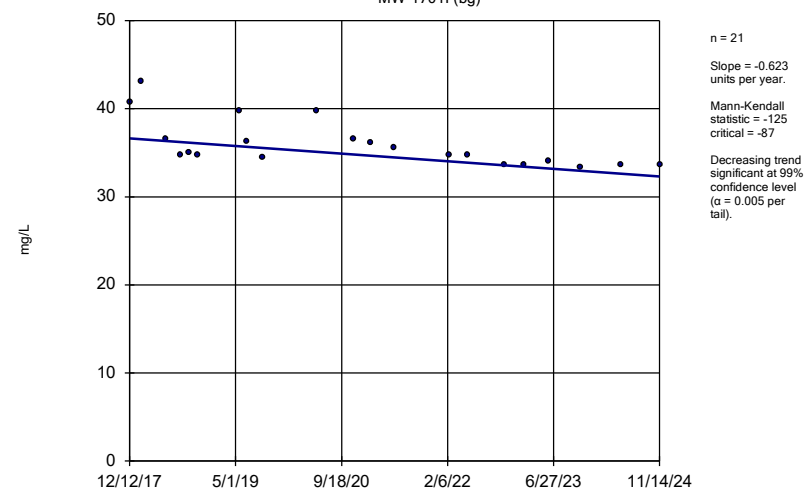

Constituent: Sulfate, total Analysis Run 1/16/2025 12:27 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-1701S (bg)

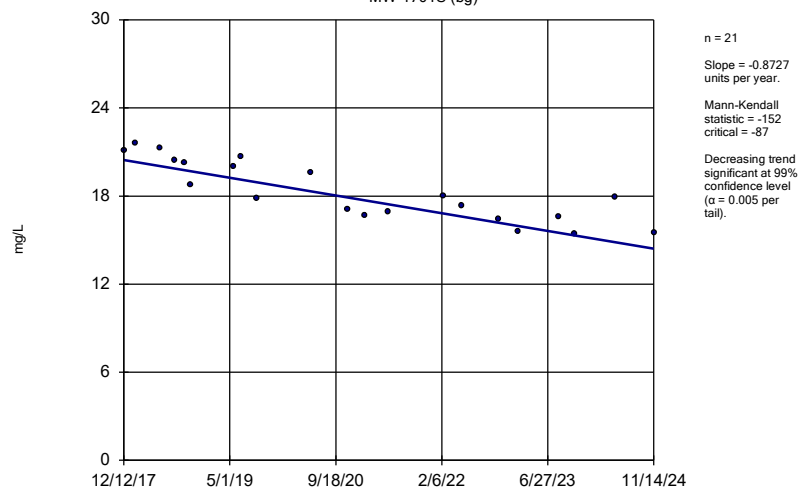

Constituent: Sulfate, total Analysis Run 1/16/2025 12:27 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-1702D (bg)

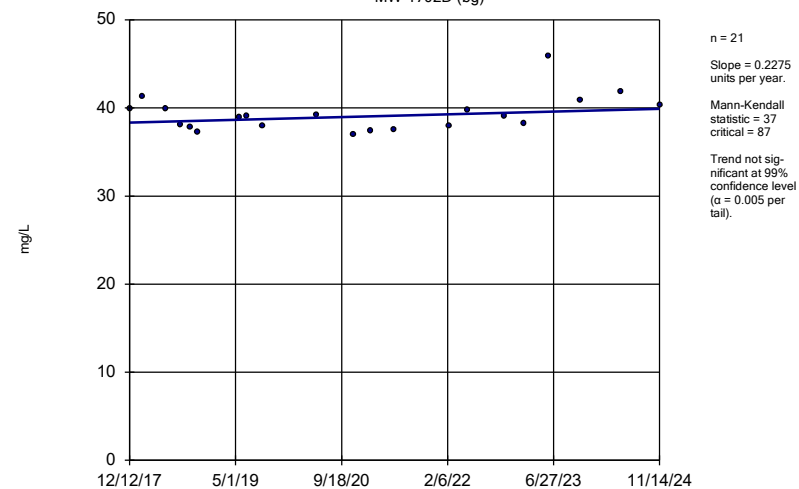

Constituent: Sulfate, total Analysis Run 1/16/2025 12:27 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Sen's Slope Estimator


MW-1702I (bg)

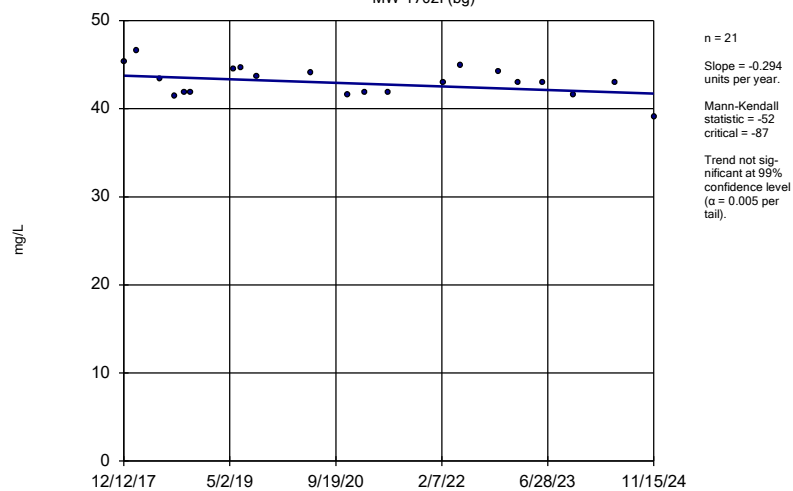





Constituent: Sulfate, total Analysis Run 1/16/2025 12:27 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP





Sen's Slope Estimator

MW-1702S (bg)

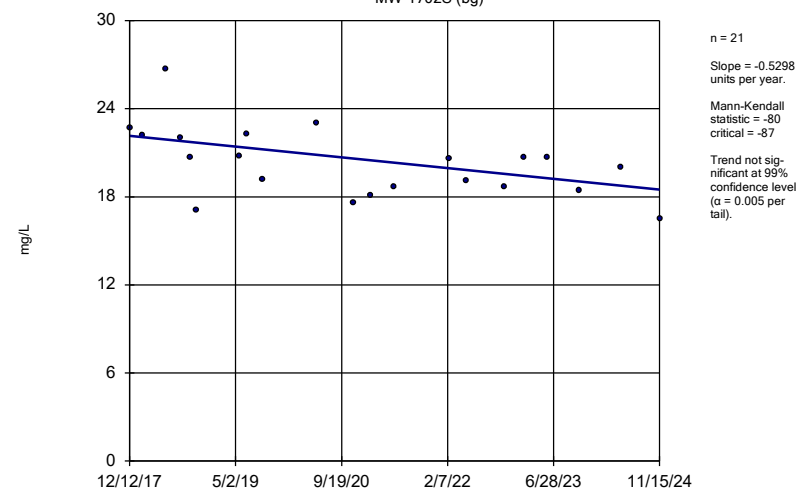

Constituent: Sulfate, total Analysis Run 1/16/2025 12:27 PM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

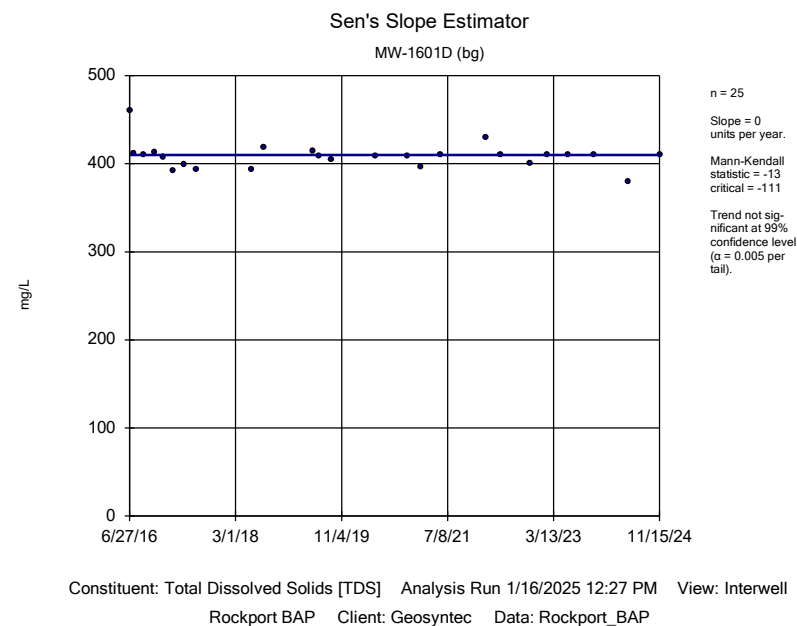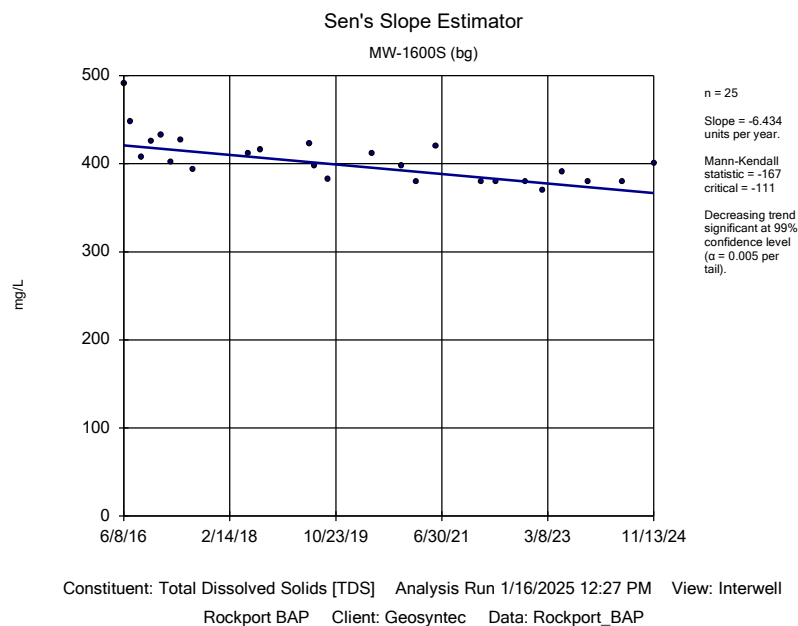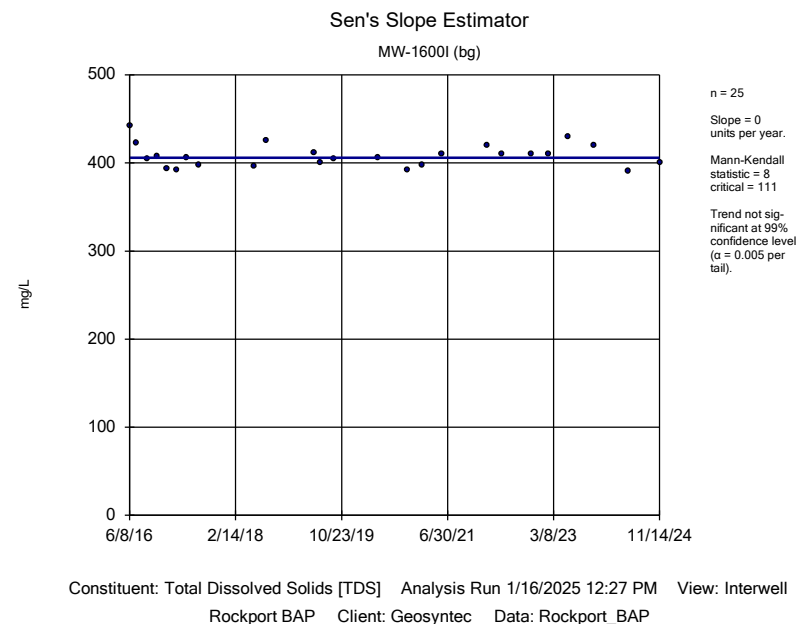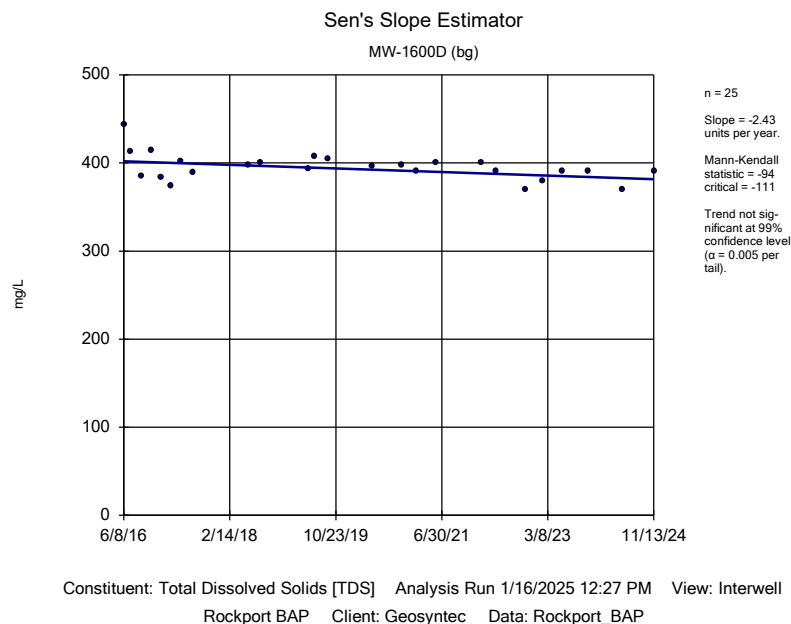

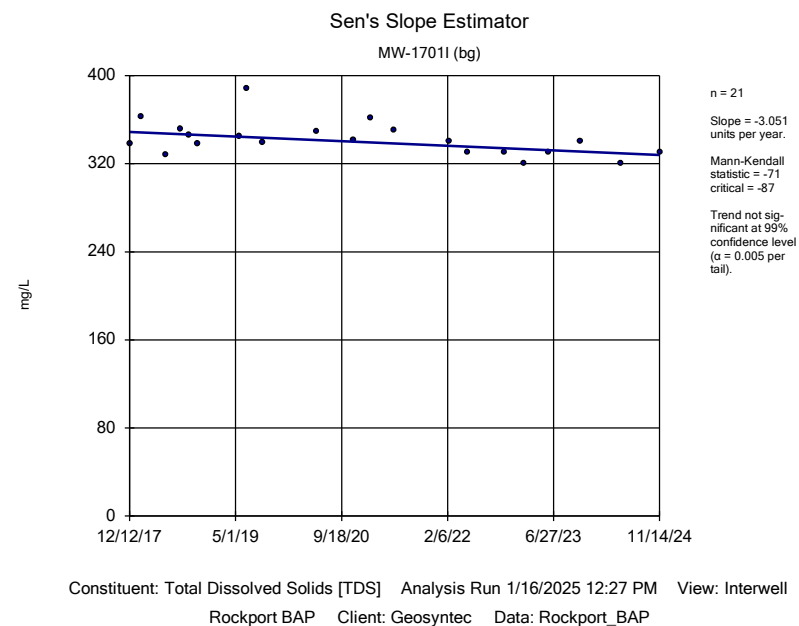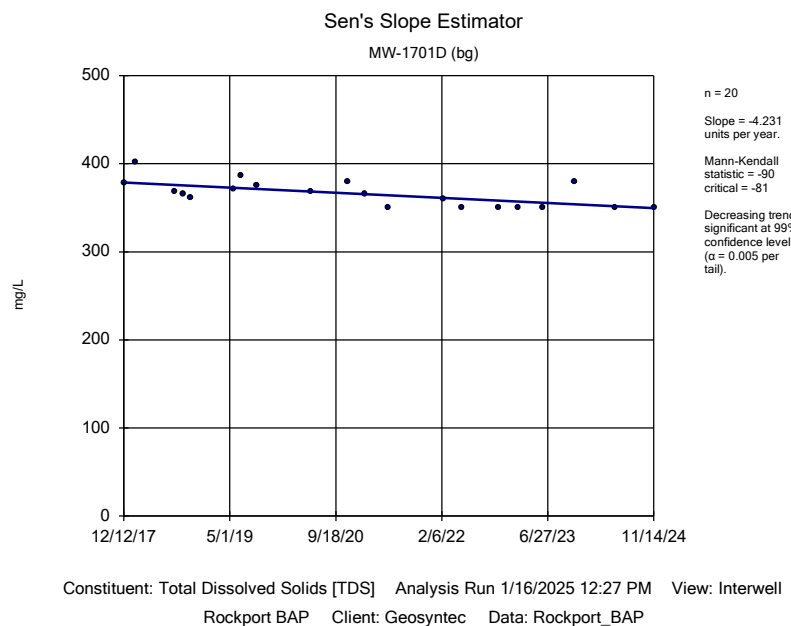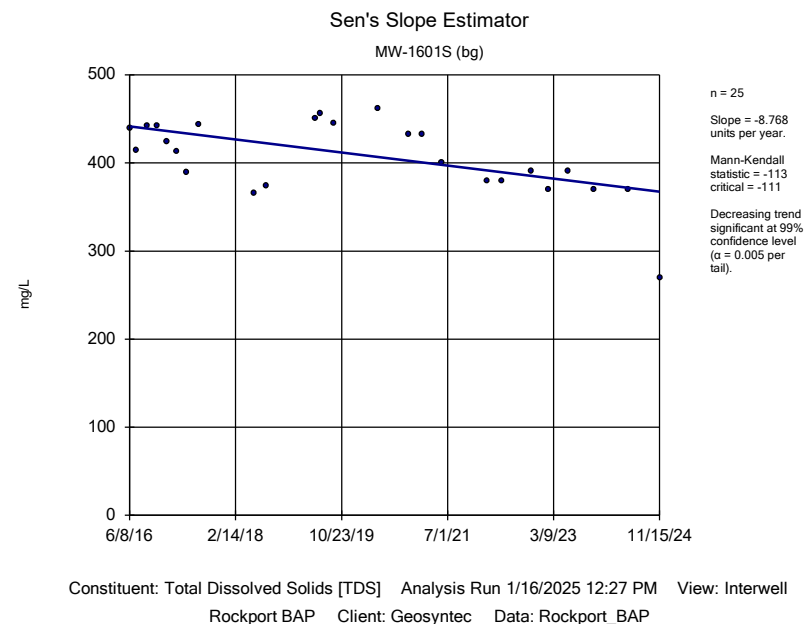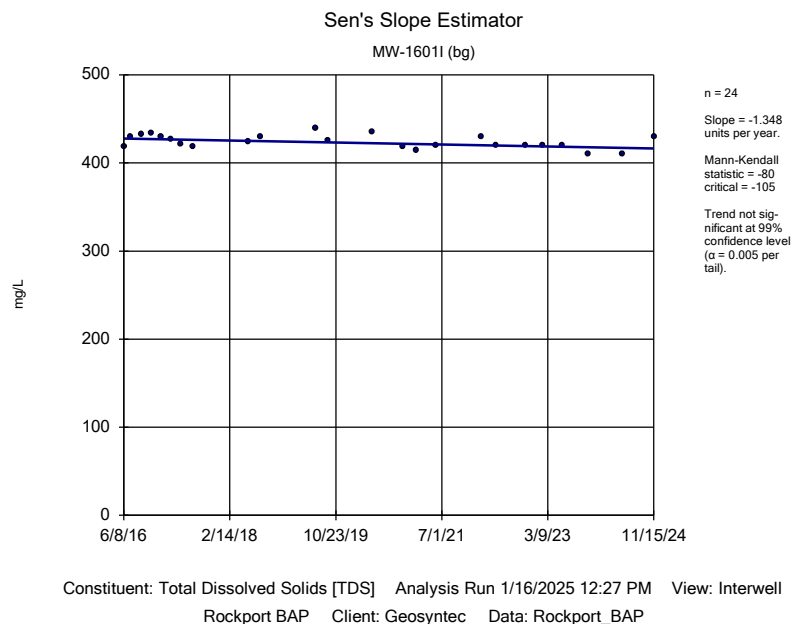

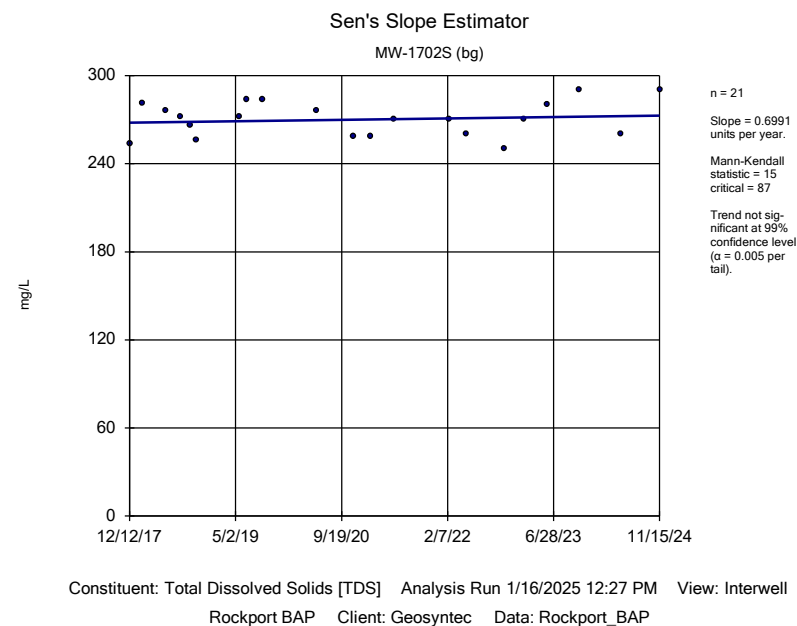
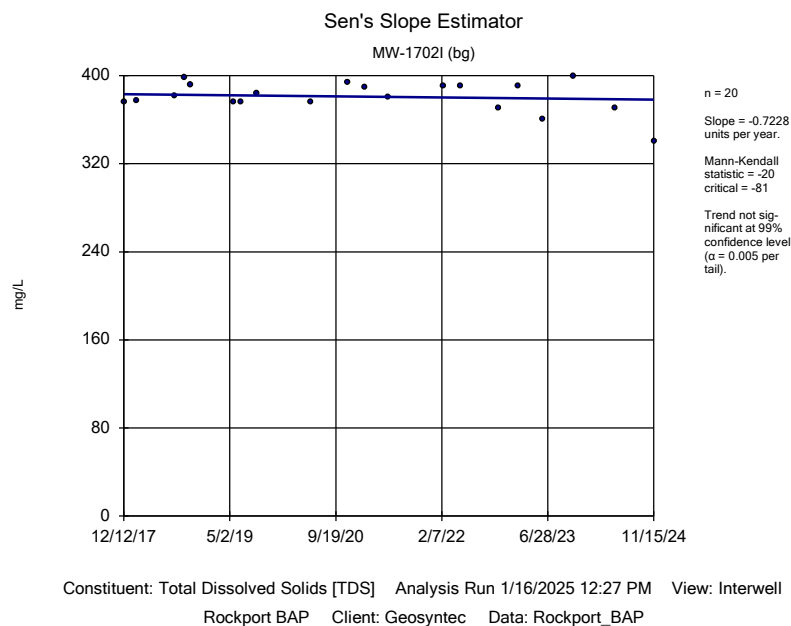
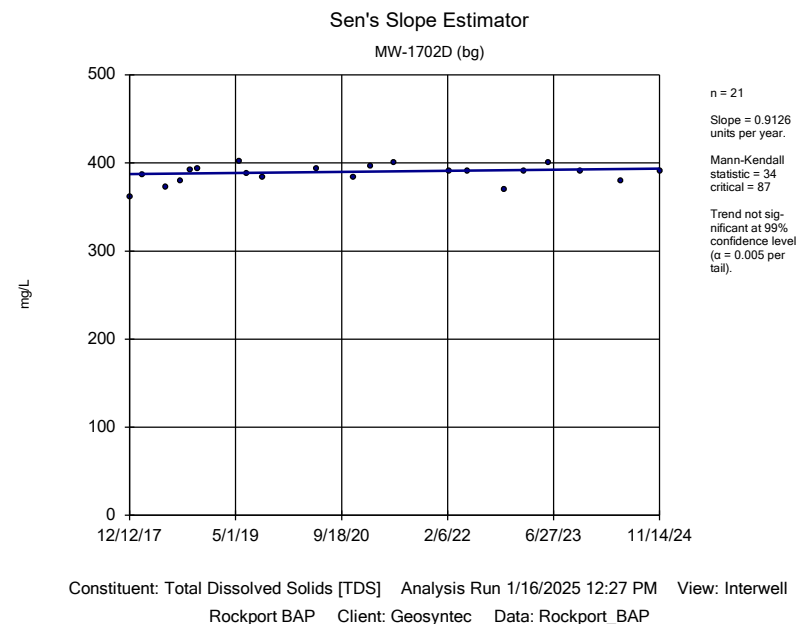
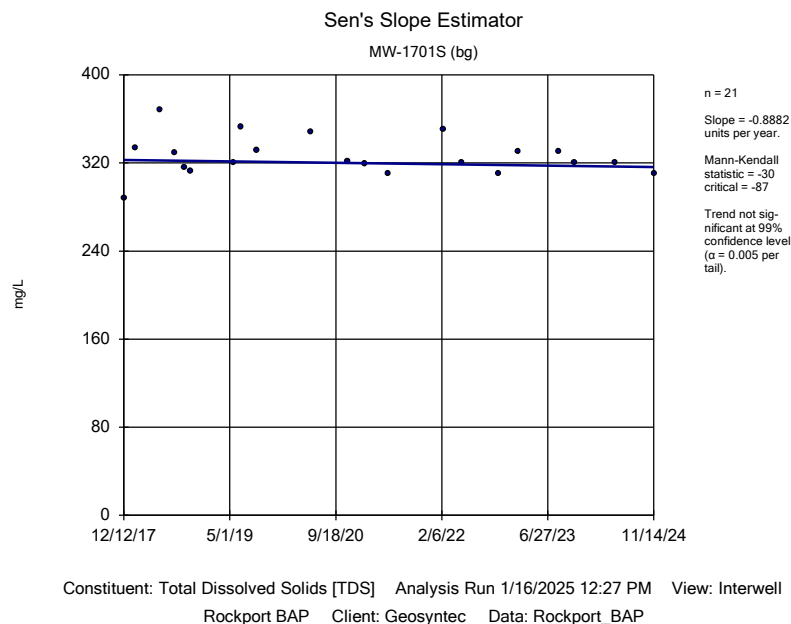



FIGURE E
Intrawell PLs

Intrawell Prediction Limits

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/14/2025, 11:52 AM

Constituent	Well	Upper Lim	Lower Lim	Date	Observ.	Sig.	Bg	N	Bg Mean	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Calcium, total (mg/L)	MW-1002	80.68	n/a	n/a	1 future	n/a	23	48.75	13.6	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1600D	97.17	n/a	n/a	1 future	n/a	23	83.22	5.943	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1600I	87.07	n/a	n/a	1 future	n/a	23	75.68	4.849	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1600S	74.21	n/a	n/a	1 future	n/a	23	62.27	5.086	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1601D	98.66	n/a	n/a	1 future	n/a	23	86.47	5.19	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1601I	98.01	n/a	n/a	1 future	n/a	22	86.29	4.952	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1601S	88.27	n/a	n/a	1 future	n/a	23	73.78	6.171	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1602D	81.2	n/a	n/a	1 future	n/a	23	68.73	5.311	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1602I	96.06	n/a	n/a	1 future	n/a	22	77.68	7.765	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1603D	95.34	n/a	n/a	1 future	n/a	23	82.5	5.47	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1603I	104.1	n/a	n/a	1 future	n/a	23	83.21	8.916	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1603S	89.54	n/a	n/a	1 future	n/a	22	53.34	15.29	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1604D	77.87	n/a	n/a	1 future	n/a	23	69.4	3.611	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1604I	87.64	n/a	n/a	1 future	n/a	23	68.46	8.167	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1604S	111.1	n/a	n/a	1 future	n/a	23	76.65	14.69	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1605D	96.27	n/a	n/a	1 future	n/a	23	81.58	6.258	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1605I	105.1	n/a	n/a	1 future	n/a	23	82.8	9.51	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1605S	91.25	n/a	n/a	1 future	n/a	23	5456	1223	0	None	x^2	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1606D	91.57	n/a	n/a	1 future	n/a	23	77.95	5.803	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1606I	87.85	n/a	n/a	1 future	n/a	23	67.6	8.622	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1606S	68.31	n/a	n/a	1 future	n/a	23	3.889	0.1426	0	None	ln(x)	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1701D	79.75	n/a	n/a	1 future	n/a	19	70.36	3.851	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1701I	75.64	n/a	n/a	1 future	n/a	19	66.03	3.941	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1701S	70.23	n/a	n/a	1 future	n/a	19	59.92	4.23	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1702D	92.15	n/a	n/a	1 future	n/a	19	80.18	4.912	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1702I	89.18	n/a	n/a	1 future	n/a	19	76.13	5.353	0	None	No	No	0.0005016	Param Intra 1 of 2
Calcium, total (mg/L)	MW-1702S	40.58	n/a	n/a	1 future	n/a	19	1180	191.7	0	None	x^2	No	0.0005016	Param Intra 1 of 2
pH, field (SU)	MW-1002	8.216	5.502	n/a	1 future	n/a	24	6.859	0.5825	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1600D	7.852	6.233	n/a	1 future	n/a	24	7.043	0.3475	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1600I	7.827	6.375	n/a	1 future	n/a	22	7.101	0.3067	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1600S	7.694	5.645	n/a	1 future	n/a	23	6.67	0.4361	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1601D	7.948	5.923	n/a	1 future	n/a	24	6.936	0.4347	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1601I	7.932	5.895	n/a	1 future	n/a	21	6.913	0.4267	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1601S	8.005	6.085	n/a	1 future	n/a	23	7.045	0.4088	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1602D	8.139	6.482	n/a	1 future	n/a	23	7.311	0.3528	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1602I	7.93	6.513	n/a	1 future	n/a	24	7.222	0.3043	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1603D	8.084	6.042	n/a	1 future	n/a	24	7.063	0.4384	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1603I	8.07	5.82	n/a	1 future	n/a	23	n/a	n/a	0	n/a	n/a	0.006831	NP Intra (normality) 1 of 2	
pH, field (SU)	MW-1603S	7.778	5.811	n/a	1 future	n/a	23	47.13	5.691	0	None	x^2	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1604D	7.741	6.506	n/a	1 future	n/a	24	7.124	0.2651	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1604I	7.902	6.709	n/a	1 future	n/a	25	53.72	3.772	0	None	x^2	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1604S	8.039	6.712	n/a	1 future	n/a	24	7.375	0.285	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1605D	7.5	6.676	n/a	1 future	n/a	22	7.088	0.174	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1605I	7.67	6.683	n/a	1 future	n/a	23	7.177	0.21	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1605S	7.582	6.574	n/a	1 future	n/a	23	7.078	0.2146	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1606D	8.37	6.39	n/a	1 future	n/a	22	n/a	n/a	0	n/a	n/a	0.007415	NP Intra (normality) 1 of 2	
pH, field (SU)	MW-1606I	8.283	6.476	n/a	1 future	n/a	22	1.944	0.03365	0	None	x^(1/3)	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1606S	7.85	6.09	n/a	1 future	n/a	23	n/a	n/a	0	n/a	n/a	0.006831	NP Intra (normality) 1 of 2	
pH, field (SU)	MW-1701D	7.862	6.565	n/a	1 future	n/a	19	7.214	0.2661	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1701I	8.156	6.429	n/a	1 future	n/a	21	7.292	0.362	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1701S	8.114	6.312	n/a	1 future	n/a	20	7.213	0.3746	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1702D	8.37	5.874	n/a	1 future	n/a	21	7.122	0.523	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1702I	7.992	6.25	n/a	1 future	n/a	21	7.121	0.3649	0	None	No	No	0.0002508	Param Intra 1 of 2
pH, field (SU)	MW-1702S	8.092	6.142	n/a	1 future	n/a	20	7.117	0.4053	0	None	No	No	0.0002508	Param Intra 1 of 2


Prediction Limit
Intrawell Parametric, MW-1002

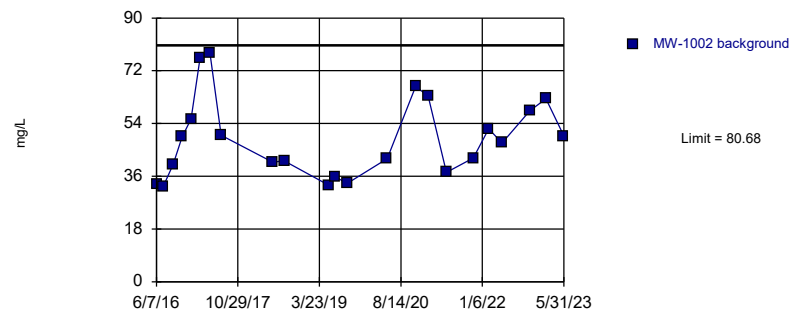

Background Data Summary: Mean=48.75, Std. Dev.=13.6, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9214, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:38 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Prediction Limit
Intrawell Parametric, MW-1600D (bg)

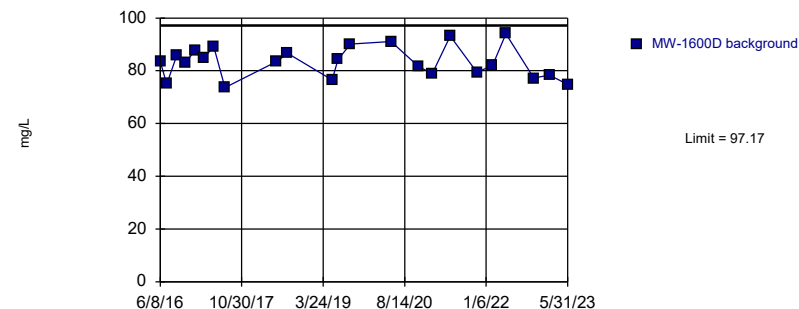

Background Data Summary: Mean=83.22, Std. Dev.=5.943, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9697, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:38 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Prediction Limit
Intrawell Parametric, MW-1600I (bg)

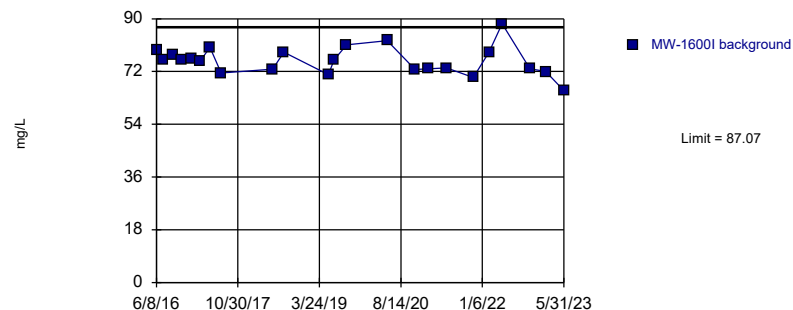

Background Data Summary: Mean=75.68, Std. Dev.=4.849, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9701, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:38 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit
Intrawell Parametric, MW-1600S (bg)

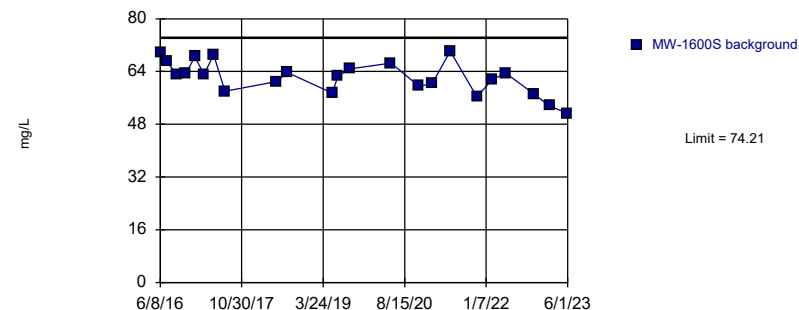


Background Data Summary: Mean=62.27, Std. Dev.=5.086, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9707, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:38 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1601D (bg)

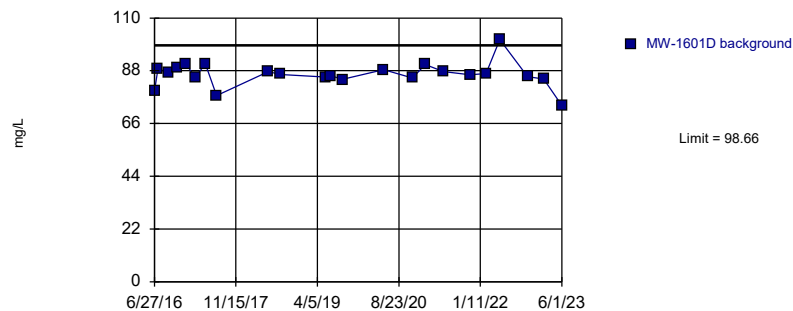


Background Data Summary: Mean=86.47, Std. Dev.=5.19, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.8938, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:38 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1601I (bg)

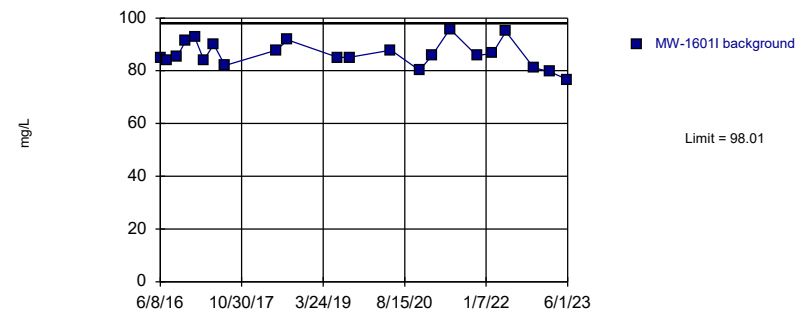


Background Data Summary: Mean=86.29, Std. Dev.=4.952, n=22. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9728, critical = 0.878. Kappa = 2.367 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:38 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1601S (bg)

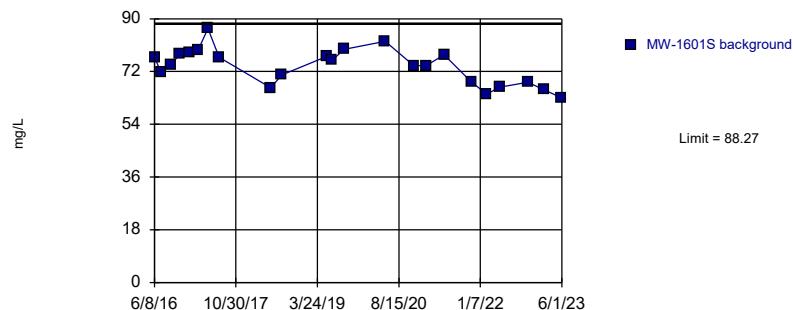


Background Data Summary: Mean=73.78, Std. Dev.=6.171, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9655, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:38 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1602D

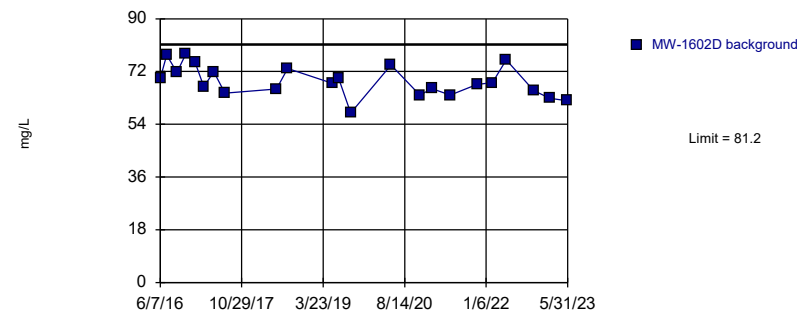


Background Data Summary: Mean=68.73, Std. Dev.=5.311, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9748, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:38 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1602I

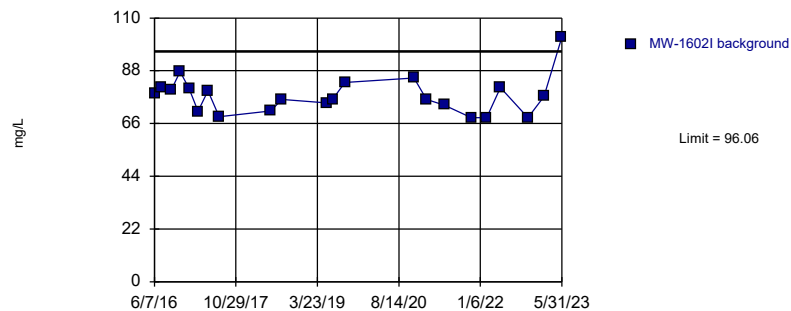


Background Data Summary: Mean=77.68, Std. Dev.=7.765, n=22. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.8877, critical = 0.878. Kappa = 2.367 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:38 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1603D

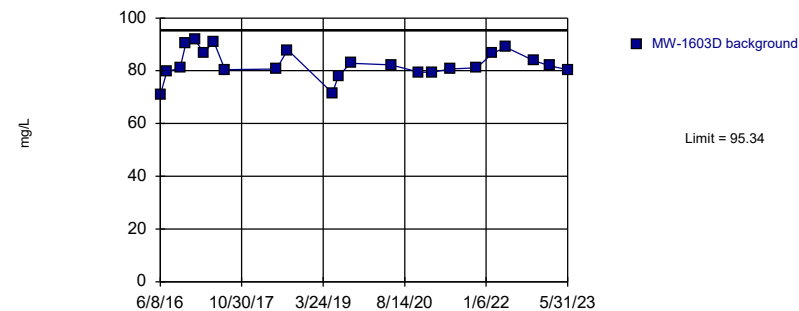


Background Data Summary: Mean=82.5, Std. Dev.=5.47, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9371, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:38 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1603I

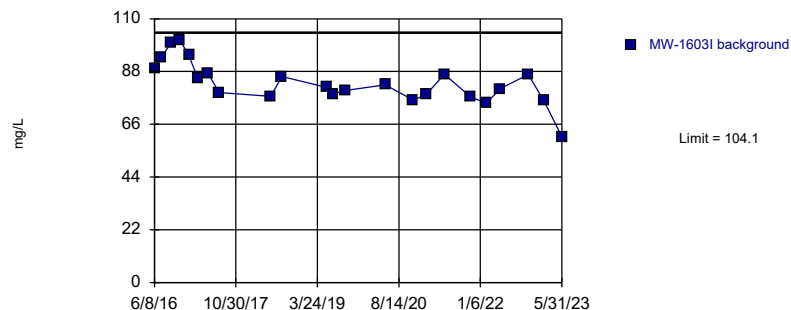


Background Data Summary: Mean=83.21, Std. Dev.=8.916, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9501, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:38 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1603S

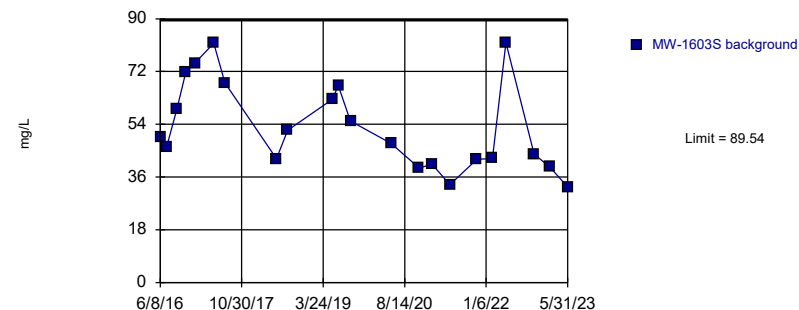


Background Data Summary: Mean=53.34, Std. Dev.=15.29, n=22. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.921, critical = 0.878. Kappa = 2.367 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1604D

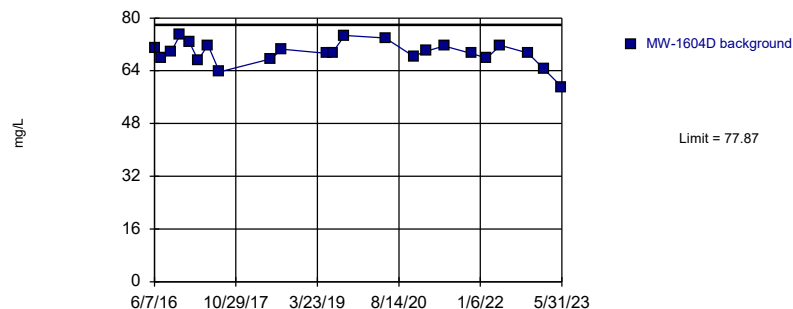


Background Data Summary: Mean=69.4, Std. Dev.=3.611, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9339, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1604I

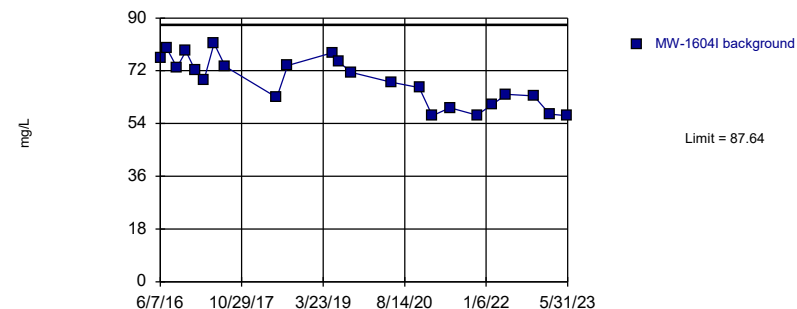


Background Data Summary: Mean=68.46, Std. Dev.=8.167, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9315, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1604S

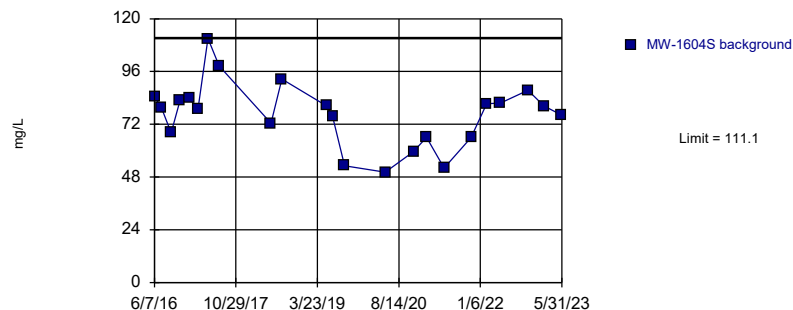


Background Data Summary: Mean=76.65, Std. Dev.=14.69, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.959, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1605D

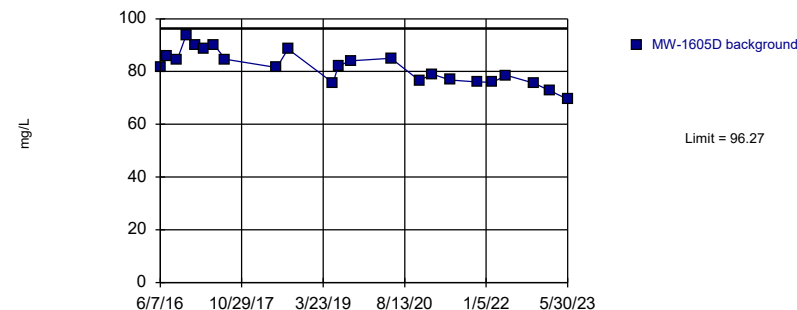


Background Data Summary: Mean=81.58, Std. Dev.=6.258, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9747, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1605I

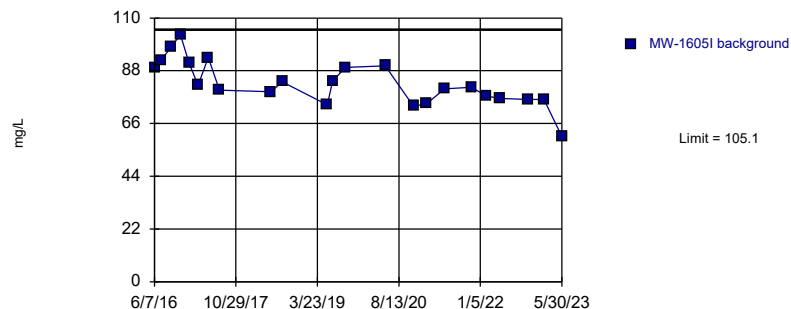


Background Data Summary: Mean=82.8, Std. Dev.=9.51, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9691, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1605S

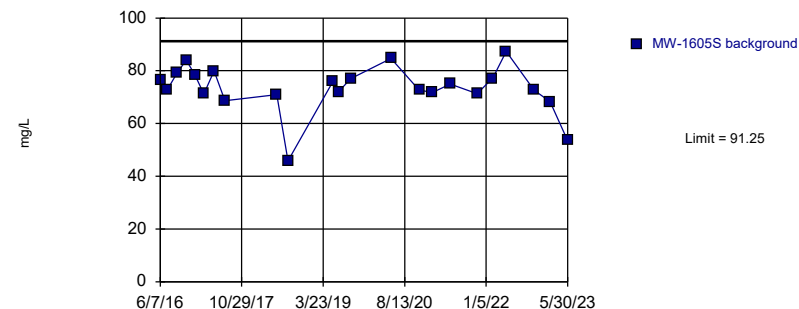


Background Data Summary (based on square transformation): Mean=5456, Std. Dev.=1223, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9077, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1606D

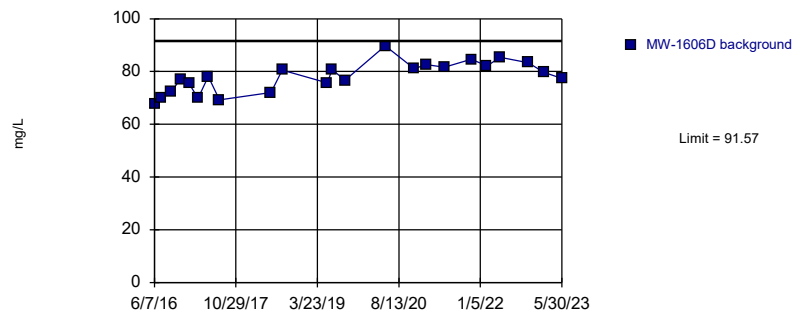


Background Data Summary: Mean=77.95, Std. Dev.=5.803, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9716, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit


Intrawell Parametric, MW-1606I

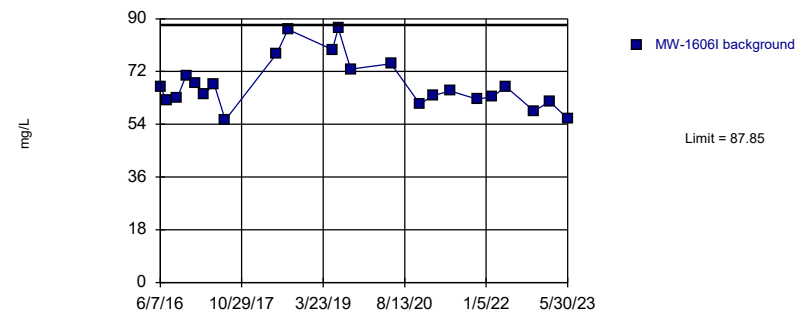

Background Data Summary: Mean=67.6, Std. Dev.=8.622, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9149, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Prediction Limit
Intrawell Parametric, MW-1606S

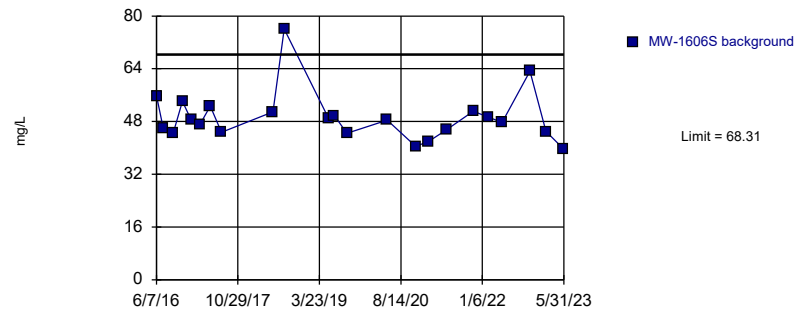

Background Data Summary (based on natural log transformation): Mean=3.889, Std. Dev.=0.1426, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.893, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Prediction Limit
Intrawell Parametric, MW-1701D (bg)

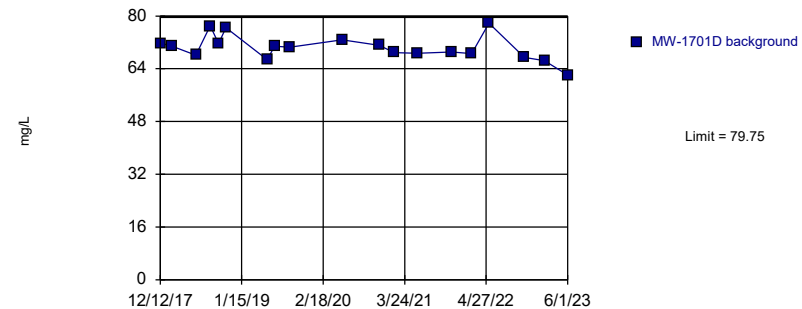

Background Data Summary: Mean=70.36, Std. Dev.=3.851, n=19. Normality test: Shapiro Wilk @alpha = 0.05, calculated = 0.9494, critical = 0.901. Kappa = 2.437 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Prediction Limit
Intrawell Parametric, MW-1701I (bg)

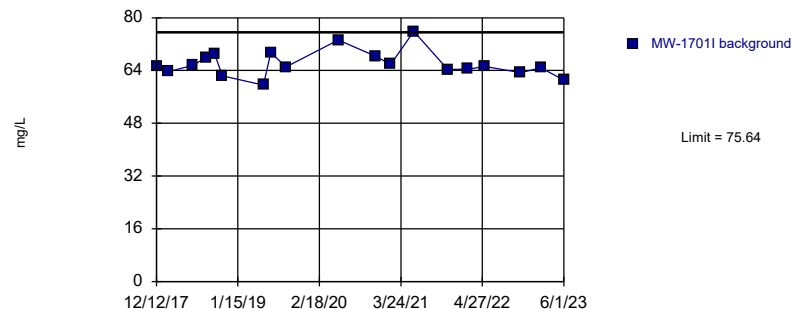

Background Data Summary: Mean=66.03, Std. Dev.=3.941, n=19. Normality test: Shapiro Wilk @alpha = 0.05, calculated = 0.9302, critical = 0.901. Kappa = 2.437 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit
Intrawell Parametric, MW-1701S (bg)

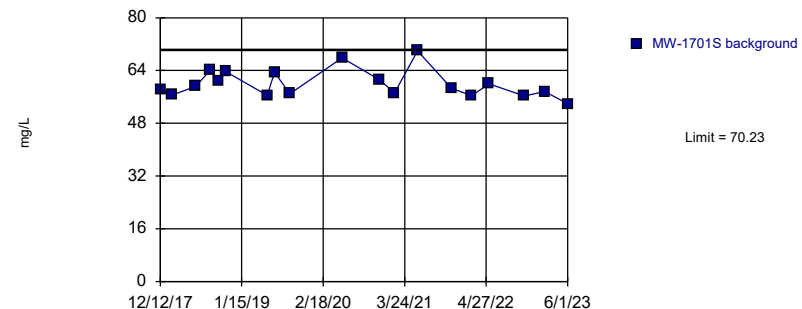


Background Data Summary: Mean=59.92, Std. Dev.=4.23, n=19. Normality test: Shapiro Wilk @alpha = 0.05, calculated = 0.9075, critical = 0.901. Kappa = 2.437 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1702D (bg)

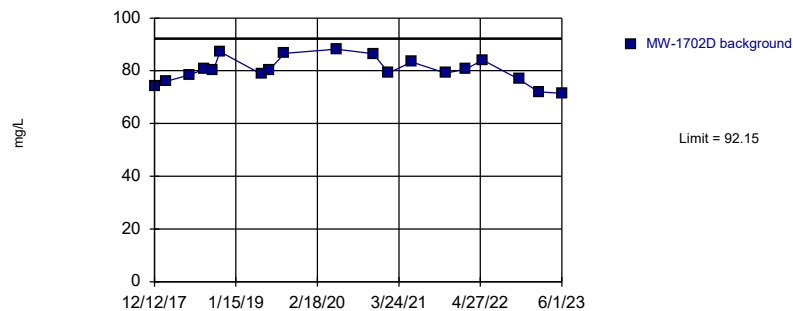


Background Data Summary: Mean=80.18, Std. Dev.=4.912, n=19. Normality test: Shapiro Wilk @alpha = 0.05, calculated = 0.9582, critical = 0.901. Kappa = 2.437 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1702I (bg)

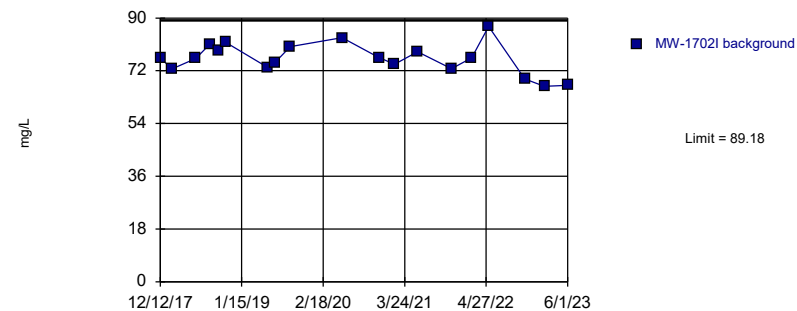


Background Data Summary: Mean=76.13, Std. Dev.=5.353, n=19. Normality test: Shapiro Wilk @alpha = 0.05, calculated = 0.9798, critical = 0.901. Kappa = 2.437 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1702S (bg)

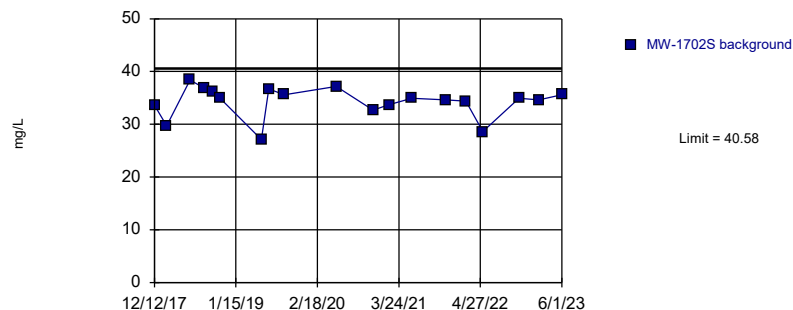


Background Data Summary (based on square transformation): Mean=1180, Std. Dev.=191.7, n=19. Normality test: Shapiro Wilk @alpha = 0.05, calculated = 0.9078, critical = 0.901. Kappa = 2.437 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: Calcium, total Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1002

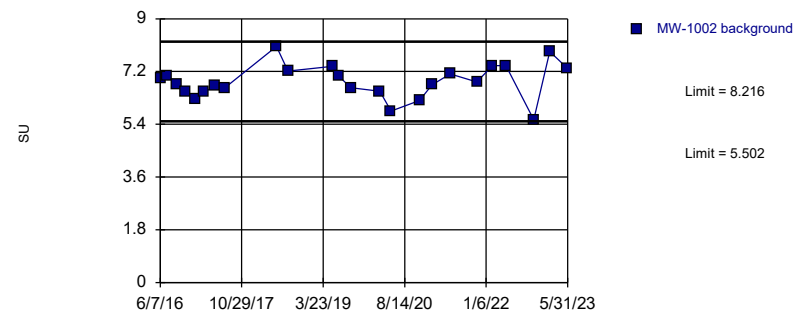


Background Data Summary: Mean=6.859, Std. Dev.=0.5825, n=24. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9835, critical = 0.884. Kappa = 2.329 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1600D (bg)

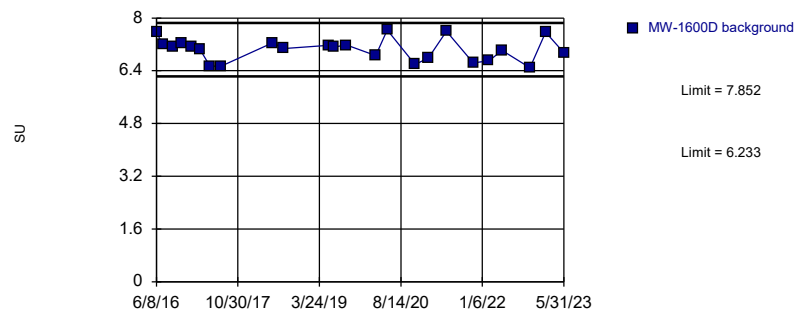


Background Data Summary: Mean=7.043, Std. Dev.=0.3475, n=24. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9409, critical = 0.884. Kappa = 2.329 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1600I (bg)

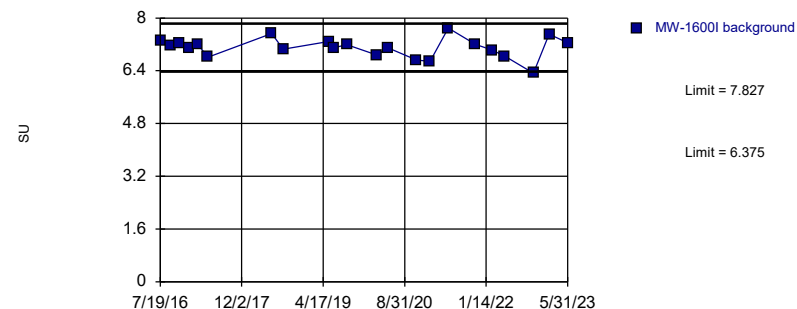


Background Data Summary: Mean=7.101, Std. Dev.=0.3067, n=22. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9689, critical = 0.878. Kappa = 2.367 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1600S (bg)

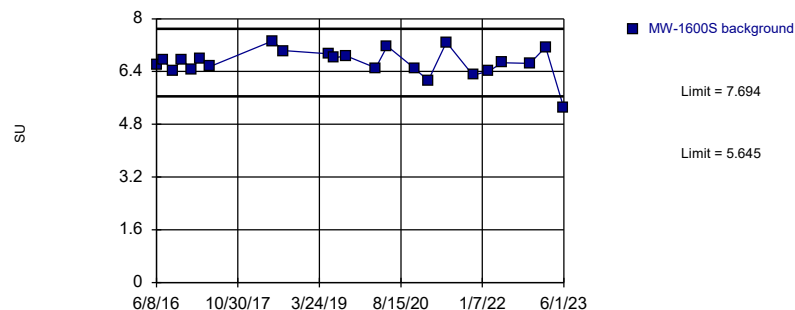


Background Data Summary: Mean=6.67, Std. Dev.=0.4361, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9118, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1601D (bg)

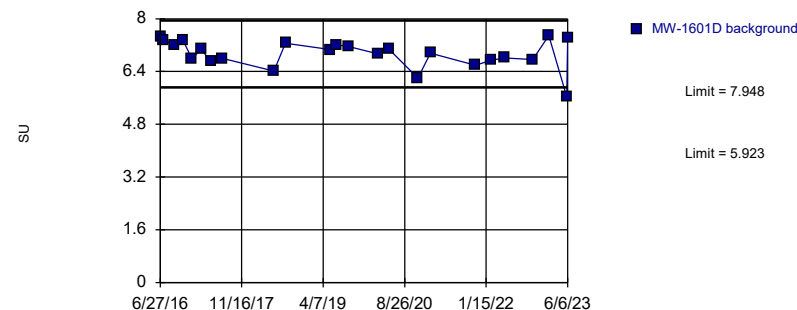


Background Data Summary: Mean=6.936, Std. Dev.=0.4347, n=24. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9137, critical = 0.884. Kappa = 2.329 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-16011 (bg)

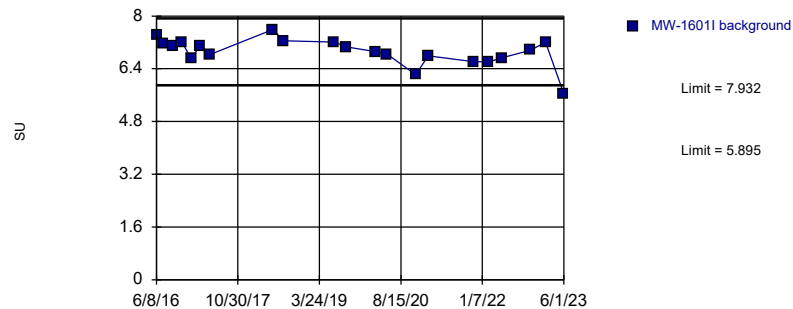


Background Data Summary: Mean=6.913, Std. Dev.=0.4267, n=21. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9052, critical = 0.873. Kappa = 2.386 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1601S (bg)

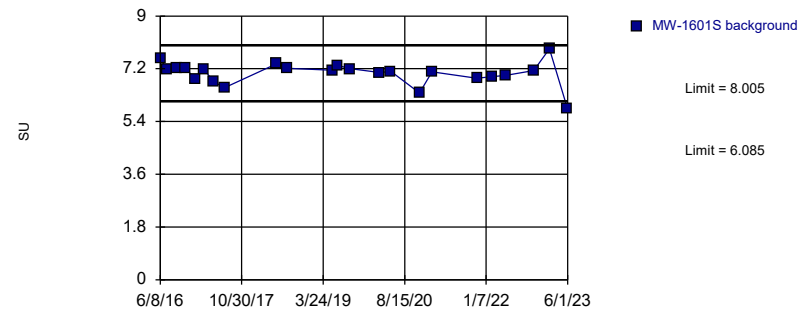


Background Data Summary: Mean=7.045, Std. Dev.=0.4088, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.899, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1602D

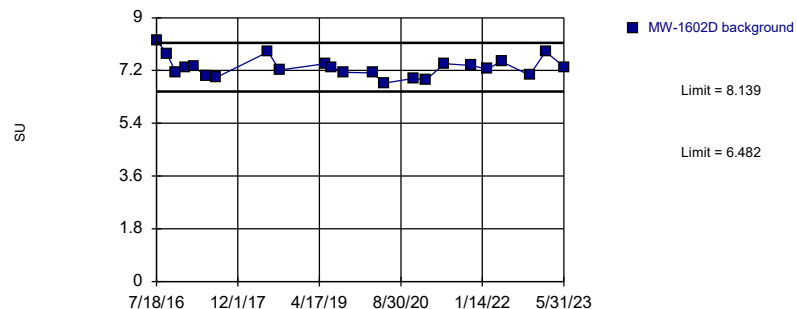


Background Data Summary: Mean=7.311, Std. Dev.=0.3528, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9398, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit


Intrawell Parametric, MW-1602I

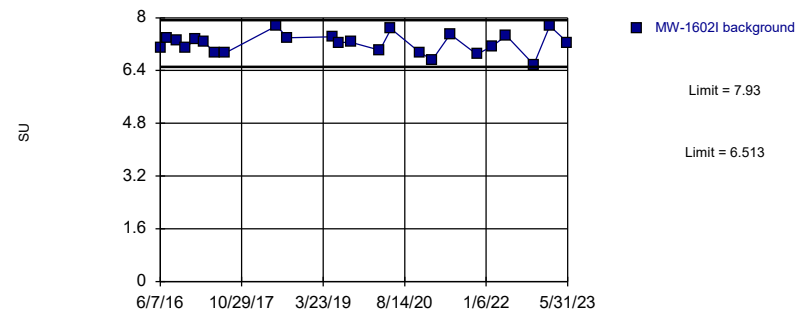

Background Data Summary: Mean=7.222, Std. Dev.=0.3043, n=24. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9767, critical = 0.884. Kappa = 2.329 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Prediction Limit
Intrawell Parametric, MW-1603D

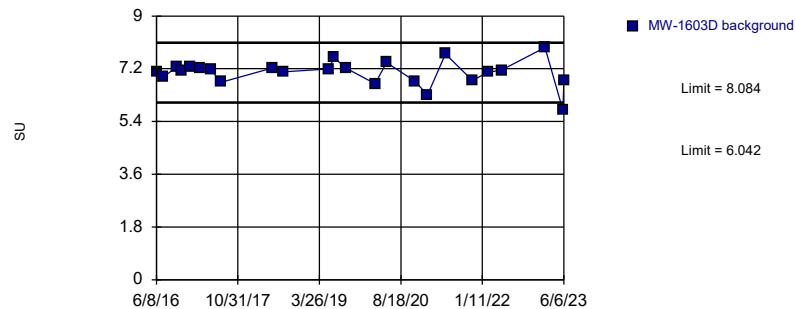

Background Data Summary: Mean=7.063, Std. Dev.=0.4384, n=24. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9249, critical = 0.884. Kappa = 2.329 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Prediction Limit
Intrawell Non-parametric, MW-1603I

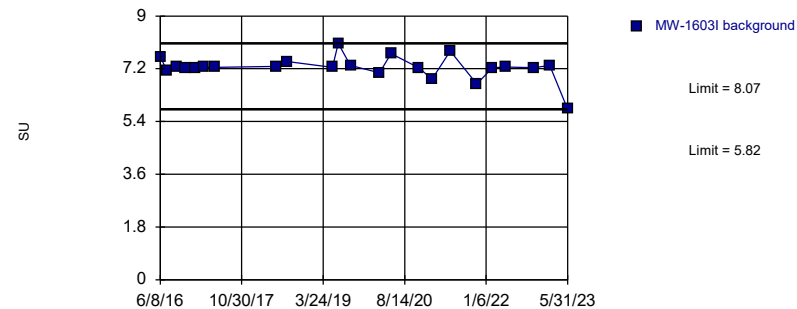

Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limits are highest and lowest of 23 background values. Well-constituent pair annual alpha = 0.01364. Individual comparison alpha = 0.006831 (1 of 2). Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Prediction Limit
Intrawell Parametric, MW-1603S

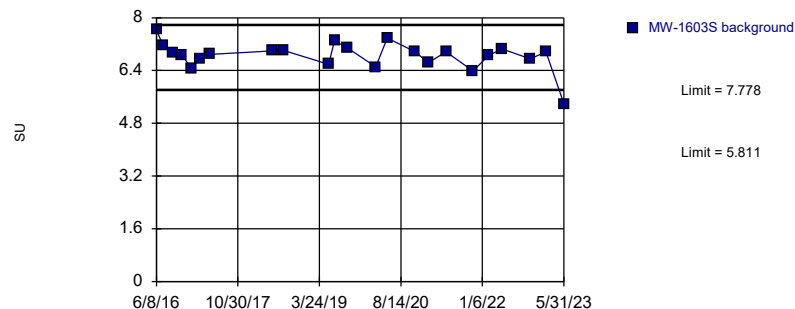

Background Data Summary (based on square transformation): Mean=47.13, Std. Dev.=5.691, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9087, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit
Intrawell Parametric, MW-1604D

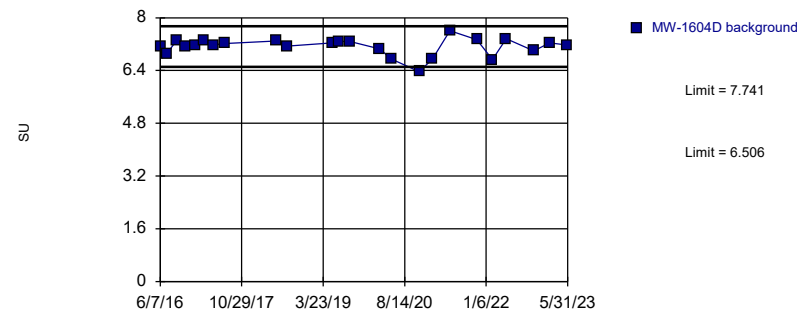


Background Data Summary: Mean=7.124, Std. Dev.=0.2651, n=24. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9015, critical = 0.884. Kappa = 2.329 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1604I

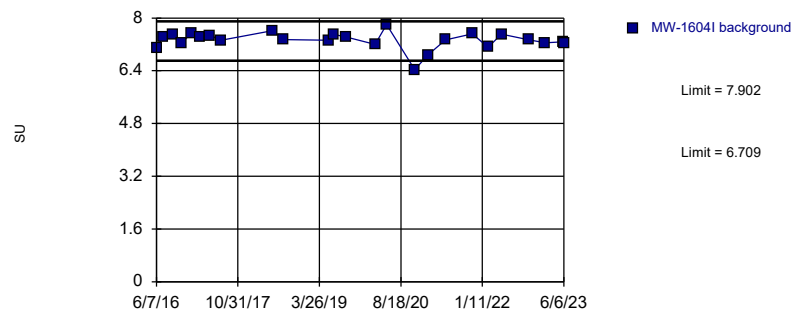


Background Data Summary (based on square transformation): Mean=53.72, Std. Dev.=3.772, n=25. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.8953, critical = 0.888. Kappa = 2.31 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1604S

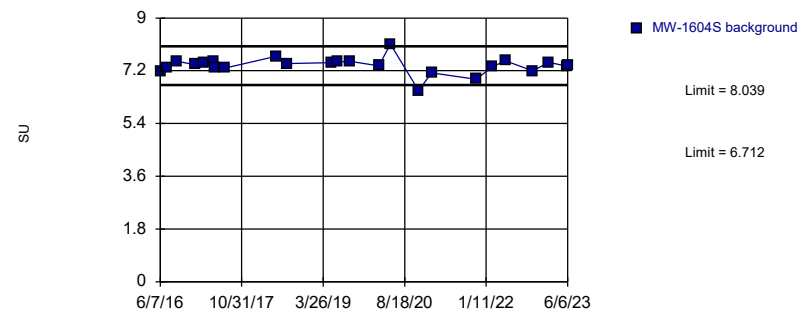


Background Data Summary: Mean=7.375, Std. Dev.=0.285, n=24. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.8859, critical = 0.884. Kappa = 2.329 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1605D

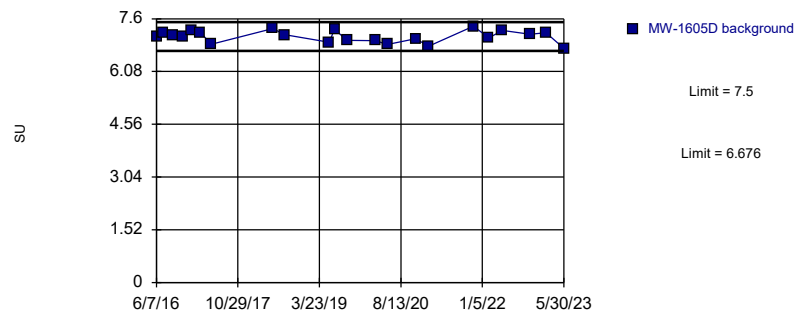


Background Data Summary: Mean=7.088, Std. Dev.=0.174, n=22. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.974, critical = 0.878. Kappa = 2.367 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit


Intrawell Parametric, MW-1605I

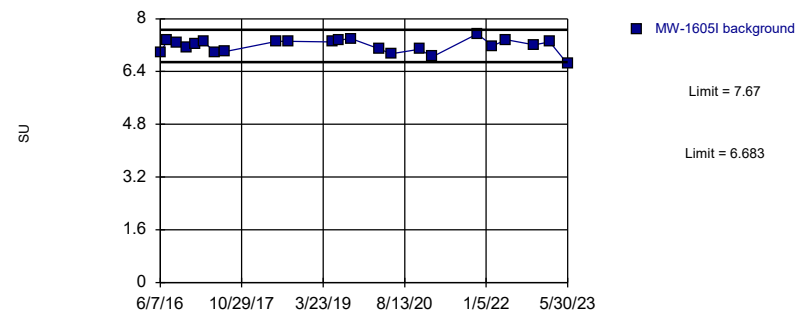

Background Data Summary: Mean=7.177, Std. Dev.=0.21, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.943, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Prediction Limit
Intrawell Parametric, MW-1605S

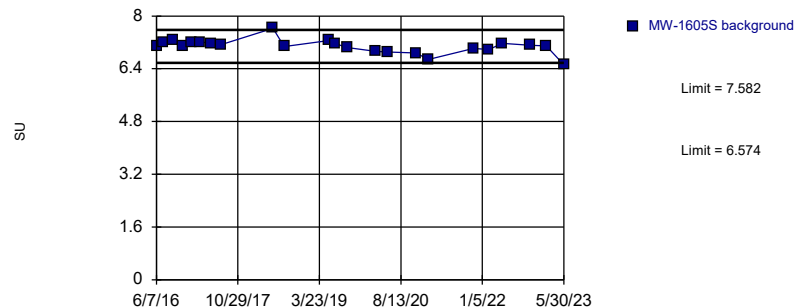

Background Data Summary: Mean=7.078, Std. Dev.=0.2146, n=23. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.92, critical = 0.881. Kappa = 2.348 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Prediction Limit
Intrawell Non-parametric, MW-1606D

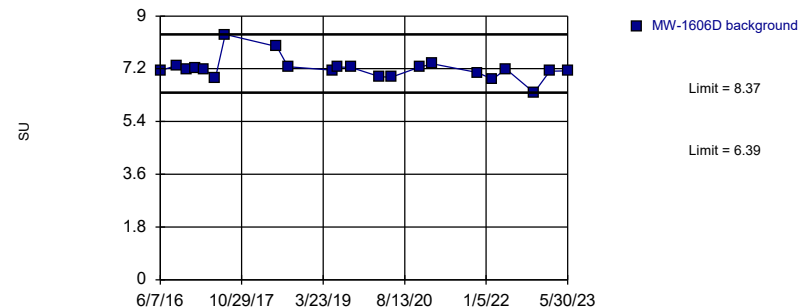

Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limits are highest and lowest of 22 background values. Well-constituent pair annual alpha = 0.0148. Individual comparison alpha = 0.007415 (1 of 2). Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Prediction Limit
Intrawell Parametric, MW-1606I

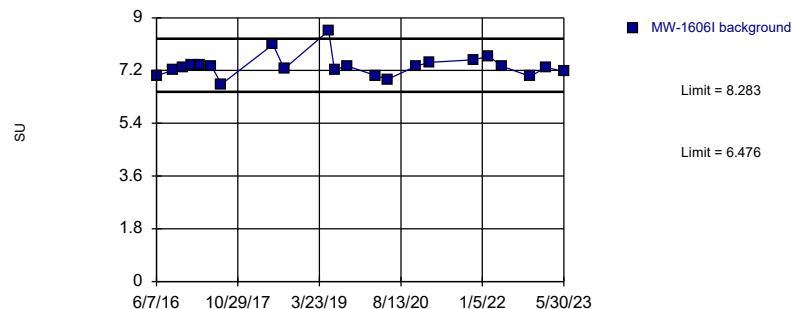

Background Data Summary (based on cube root transformation): Mean=1.944, Std. Dev.=0.03365, n=22. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.8789, critical = 0.878. Kappa = 2.367 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit
Intrawell Non-parametric, MW-1606S

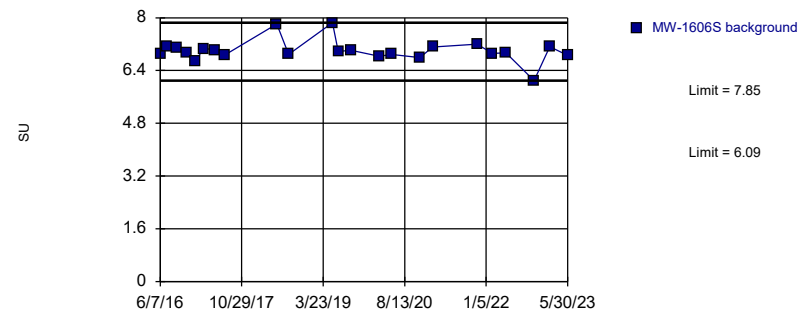


Non-parametric test used in lieu of parametric prediction limit because the Shapiro Wilk normality test showed the data to be non-normal at the 0.01 alpha level. Limits are highest and lowest of 23 background values. Well-constituent pair annual alpha = 0.01364. Individual comparison alpha = 0.006831 (1 of 2). Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1701D (bg)

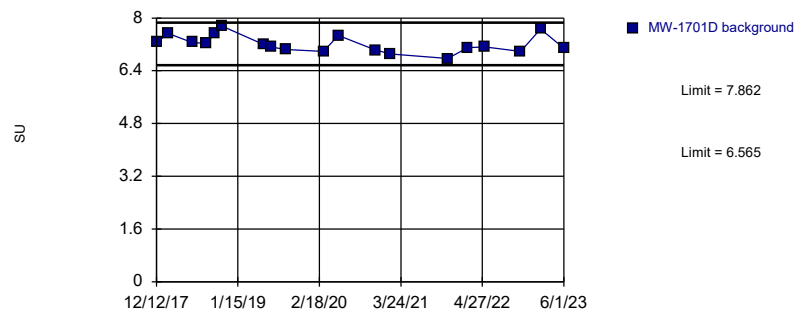


Background Data Summary: Mean=7.214, Std. Dev.=0.2661, n=19. Normality test: Shapiro Wilk @alpha = 0.05, calculated = 0.943, critical = 0.901. Kappa = 2.437 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1701I (bg)

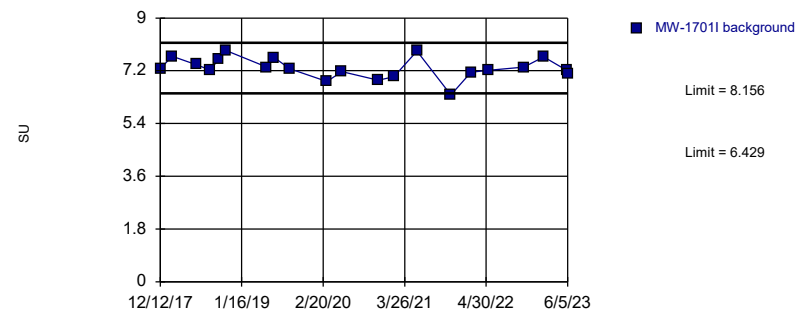


Background Data Summary: Mean=7.292, Std. Dev.=0.362, n=21. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9566, critical = 0.873. Kappa = 2.386 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1701S (bg)

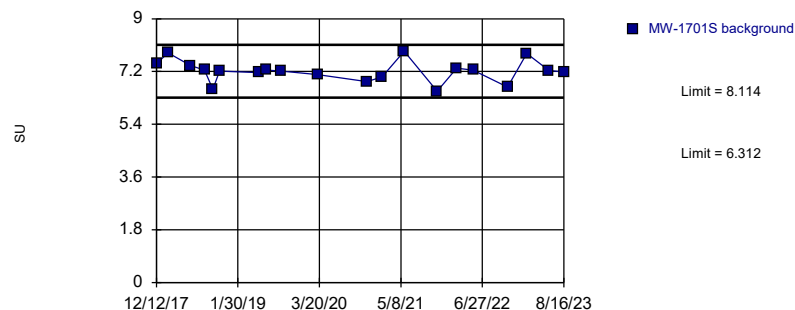


Background Data Summary: Mean=7.213, Std. Dev.=0.3746, n=20. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9323, critical = 0.868. Kappa = 2.406 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1702D (bg)

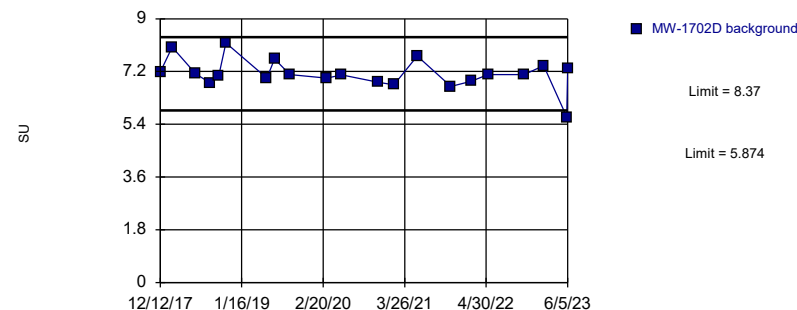


Background Data Summary: Mean=7.122, Std. Dev.=0.523, n=21. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9034, critical = 0.873. Kappa = 2.386 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1702I (bg)

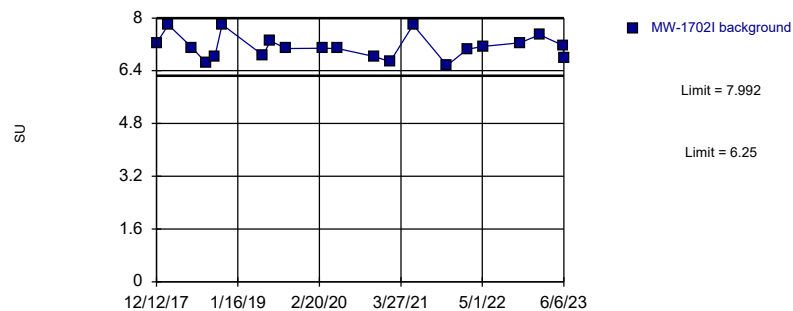


Background Data Summary: Mean=7.121, Std. Dev.=0.3649, n=21. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9316, critical = 0.873. Kappa = 2.386 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
 Rockport BAP Client: Geosyntec Data: Rockport_BAP

Prediction Limit

Intrawell Parametric, MW-1702S (bg)

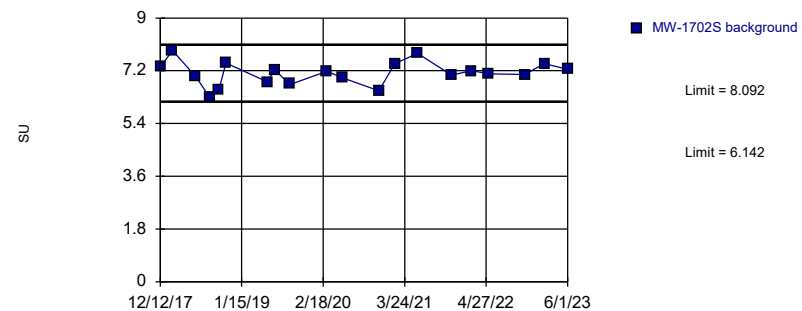

Background Data Summary: Mean=7.117, Std. Dev.=0.4053, n=20. Normality test: Shapiro Wilk @alpha = 0.01, calculated = 0.9808, critical = 0.868. Kappa = 2.406 (c=7, w=15, 1 of 2, event alpha = 0.05132). Report alpha = 0.0005016. Assumes 1 future value.

Constituent: pH, field Analysis Run 1/14/2025 11:39 AM View: Intrawell
 Rockport BAP Client: Geosyntec Data: Rockport_BAP


FIGURE F

Interwell PLs

Interwell Prediction Limits


Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/21/2025, 10:41 AM

<u>Constituent</u>	<u>Well</u>	<u>Upper Lim. Date</u>		<u>Observ.</u>	<u>Sig.</u>	<u>Bg N</u>	<u>Bg Mean</u>	<u>Std. Dev.</u>	<u>%NDs</u>	<u>ND Adj.</u>	<u>Transform</u>	<u>Alpha</u>	<u>Method</u>
Boron, total (mg/L)	n/a	0.208	n/a	15 future	n/a	287	n/a	n/a	8.362	n/a	n/a	0.0000491	NP Inter (normality) 1 of 2
Chloride, total (mg/L)	n/a	46.4	n/a	15 future	n/a	287	n/a	n/a	0	n/a	n/a	0.0000491	NP Inter (normality) 1 of 2
Fluoride, total (mg/L)	n/a	0.7	n/a	15 future	n/a	311	n/a	n/a	0	n/a	n/a	0.0000491	NP Inter (normality) 1 of 2
Sulfate, total (mg/L)	n/a	76	n/a	15 future	n/a	287	n/a	n/a	0	n/a	n/a	0.0000491	NP Inter (normality) 1 of 2
Total Dissolved Solids [TDS] (mg/L)	n/a	445.8	n/a	15 future	n/a	285	8.8e12	4.3e12	0	None	x^5	0.0005016	Param Inter 1 of 2

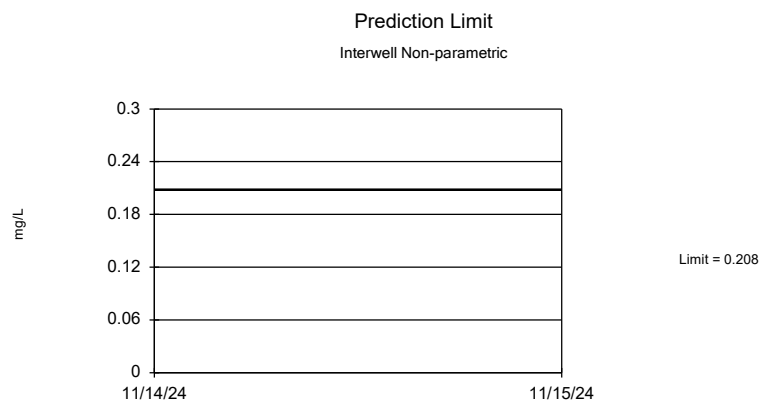


Non-parametric test used in lieu of parametric prediction limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 287 background values. 8.362% NDs. Annual per-constituent alpha = 0.001472. Individual comparison alpha = 0.0000491 (1 of 2). Assumes 15 future values.

Constituent: Boron, total Analysis Run 1/21/2025 10:39 AM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

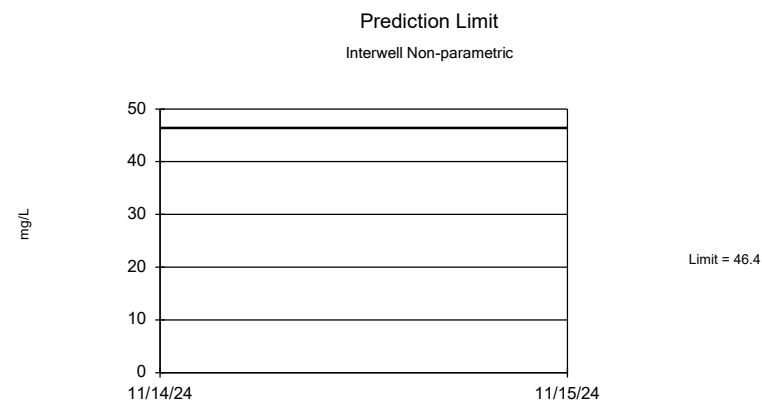


Non-parametric test used in lieu of parametric prediction limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 287 background values. Annual per-constituent alpha = 0.001472. Individual comparison alpha = 0.0000491 (1 of 2). Assumes 15 future values.

Constituent: Chloride, total Analysis Run 1/21/2025 10:39 AM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

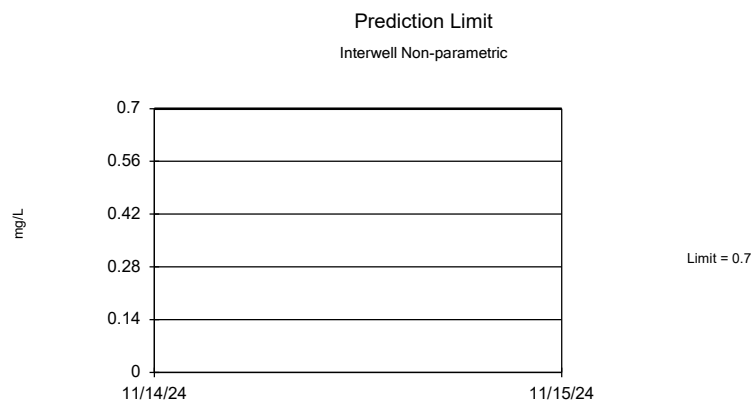


Non-parametric test used in lieu of parametric prediction limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 311 background values. Annual per-constituent alpha = 0.001472. Individual comparison alpha = 0.0000491 (1 of 2). Assumes 15 future values.

Constituent: Fluoride, total Analysis Run 1/21/2025 10:39 AM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

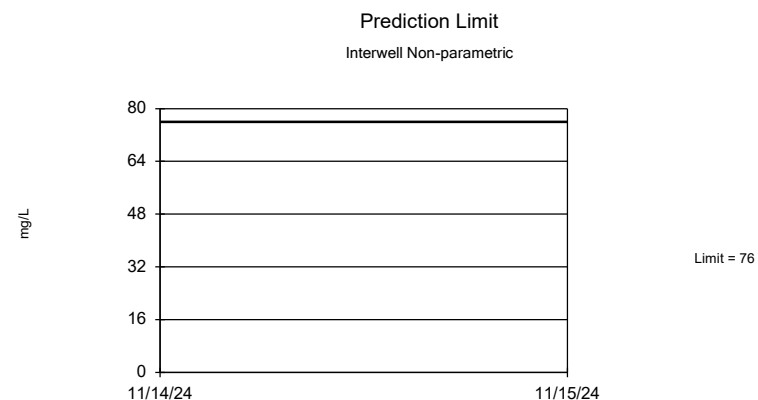

Non-parametric test used in lieu of parametric prediction limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 287 background values. Annual per-constituent alpha = 0.001472. Individual comparison alpha = 0.0000491 (1 of 2). Assumes 15 future values.

Constituent: Sulfate, total Analysis Run 1/21/2025 10:39 AM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

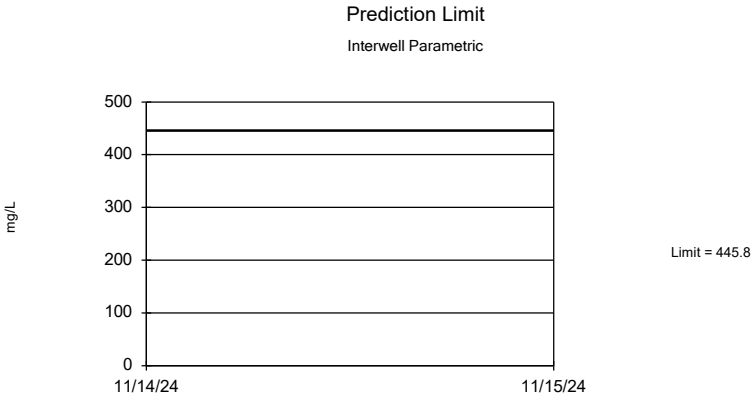

Background Data Summary (based on x^5 transformation): Mean=8.8e12, Std. Dev.=4.3e12, n=285. Normality test: Chi Squared @alpha = 0.01, calculated = 11.18, critical = 14.07. Kappa = 2.038 (c=7, w=15, 1 of 2, event alpha = 0.05132). N exceeds UG tables; Kappa based on n=150. Report alpha = 0.007498. Individual comparison alpha = 0.0005016. Assumes 15 future values.

Constituent: Total Dissolved Solids [TDS] Analysis Run 1/21/2025 10:39 AM View: Interwell
Rockport BAP Client: Geosyntec Data: Rockport_BAP

FIGURE G

UTLs


Upper Tolerance Limits

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/16/2025, 12:34 PM

<u>Constituent</u>	<u>Upper Lim.</u>	<u>Date</u>	<u>Observ.</u>	<u>Sig.</u>	<u>Bq N</u>	<u>%NDs</u>	<u>Transform</u>	<u>Alpha</u>	<u>Method</u>
Antimony, total (mg/L)	0.00044	n/a	n/a	n/a	311	26.69	n/a	NaN	NP Inter(normality)
Arsenic, total (mg/L)	0.0791	n/a	n/a	n/a	311	0	n/a	NaN	NP Inter(normality)
Barium, total (mg/L)	1.2	n/a	n/a	n/a	311	0	n/a	NaN	NP Inter(normality)
Beryllium, total (mg/L)	0.000106	n/a	n/a	n/a	311	83.28	n/a	NaN	NP Inter(NDs)
Cadmium, total (mg/L)	0.00028	n/a	n/a	n/a	311	35.05	n/a	NaN	NP Inter(normality)
Chromium, total (mg/L)	0.00205	n/a	n/a	n/a	310	1.29	n/a	NaN	NP Inter(normality)
Cobalt, total (mg/L)	0.00334	n/a	n/a	n/a	310	0.6452	n/a	NaN	NP Inter(normality)
Combined Radium 226 + 228 (pCi/L)	2.785	n/a	n/a	n/a	310	0	sqrt(x)	0.05	Inter
Fluoride, total (mg/L)	0.7	n/a	n/a	n/a	311	0	n/a	NaN	NP Inter(normality)
Lead, total (mg/L)	0.00497	n/a	n/a	n/a	311	39.23	n/a	NaN	NP Inter(normality)
Lithium, total (mg/L)	0.038	n/a	n/a	n/a	312	7.051	n/a	NaN	NP Inter(normality)
Mercury, total (mg/L)	0.000005	n/a	n/a	n/a	287	93.73	n/a	NaN	NP Inter(NDs)
Molybdenum, total (mg/L)	0.00867	n/a	n/a	n/a	307	0.3257	n/a	NaN	NP Inter(normality)
Selenium, total (mg/L)	0.00437	n/a	n/a	n/a	310	44.19	n/a	NaN	NP Inter(normality)
Thallium, total (mg/L)	0.0002	n/a	n/a	n/a	305	69.51	n/a	NaN	NP Inter(NDs)

Tolerance Limit

Interwell Non-parametric

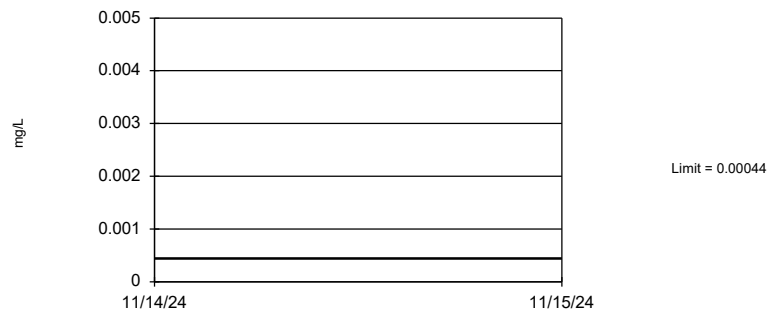

Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 311 background values. 26.69% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Antimony, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric



Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 311 background values. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Arsenic, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric



Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 311 background values. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Barium, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric



Non-parametric test used in lieu of parametric tolerance limit because censored data exceeded 50%. Limit is highest of 311 background values. 83.28% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Beryllium, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric




Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 311 background values. 35.05% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Cadmium, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric

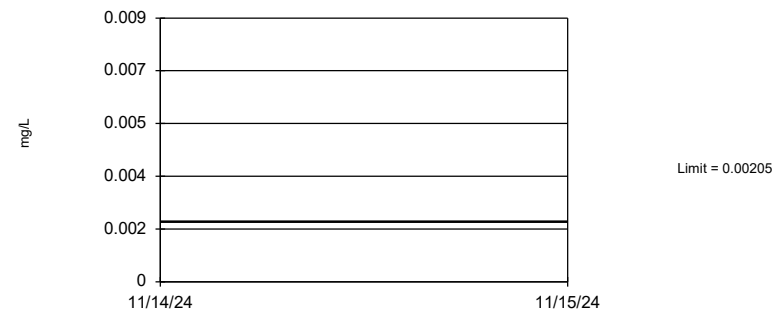


Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 310 background values. 1.29% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Chromium, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric

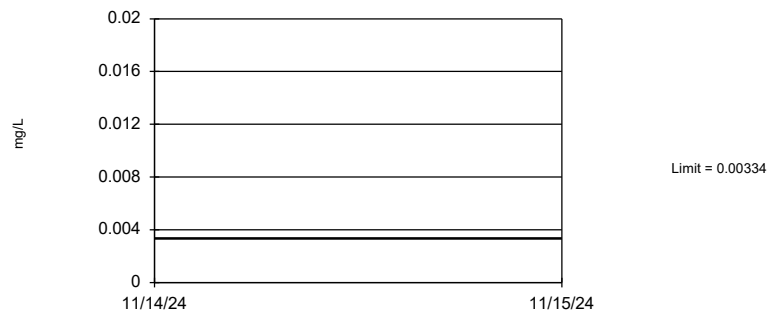


Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 310 background values. 0.6452% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Cobalt, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Parametric

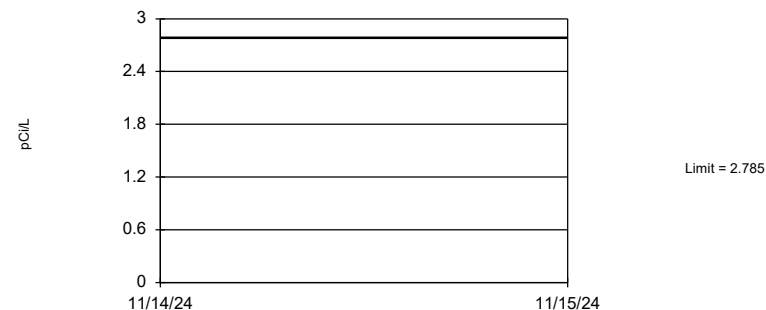

95% coverage. Background Data Summary (based on square root transformation): Mean=1.053, Std. Dev.=0.343, n=310. Normality test: Chi Squared @alpha = 0.01, calculated = 3.226, critical = 14.07. Report alpha = 0.05.

Constituent: Combined Radium 226 + 228 Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric



Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 311 background values. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Fluoride, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric




Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 311 background values. 39.23% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Lead, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric

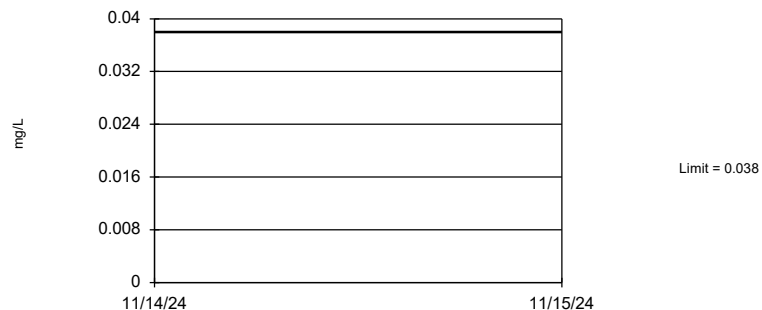

Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 312 background values. 7.051% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Lithium, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric




Non-parametric test used in lieu of parametric tolerance limit because censored data exceeded 50%. Limit is highest of 287 background values. 93.73% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Mercury, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric

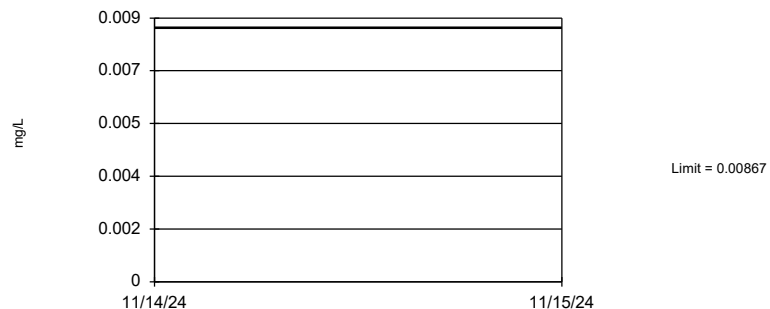

Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 307 background values. 0.3257% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Molybdenum, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric



Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 310 background values. 44.19% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Selenium, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric



Non-parametric test used in lieu of parametric tolerance limit because censored data exceeded 50%. Limit is highest of 305 background values. 69.51% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Thallium, total Analysis Run 1/16/2025 12:32 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

FIGURE H
GWPS

ROCKPORT BAP GWPS				
Constituent Name	MCL	CCR Rule Specified	Background Limit	GWPS
Antimony, Total (mg/L)	0.006		0.00044	0.006
Arsenic, Total (mg/L)	0.01		0.079	0.079
Barium, Total (mg/L)	2		1.2	2
Beryllium, Total (mg/L)	0.004		0.00011	0.004
Cadmium, Total (mg/L)	0.005		0.00028	0.005
Chromium, Total (mg/L)	0.1		0.0021	0.1
Cobalt, Total (mg/L)		0.006	0.0033	0.006
Combined Radium, Total (pCi/L)	5		2.79	5
Fluoride, Total (mg/L)	4		0.7	4
Lead, Total (mg/L)	0.015		0.005	0.015
Lithium, Total (mg/L)		0.04	0.038	0.04
Mercury, Total (mg/L)	0.002		0.000005	0.002
Molybdenum, Total (mg/L)		0.1	0.0087	0.1
Selenium, Total (mg/L)	0.05		0.0044	0.05
Thallium, Total (mg/L)	0.002		0.0002	0.002

**Grey cell indicates background is higher than MCL or CCR Rule Specified Level*

**MCL = Maximum Contaminant Level*

**CCR = Coal Combustion Residual*

**GWPS = Groundwater Protection Standard*

FIGURE I

Confidence Intervals

Confidence Intervals - All Results (No Significant)

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/24/2025, 9:04 AM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig.	N	%NDs	Transform	Alpha	Method
Antimony, total (mg/L)	MW-1002	0.00005	0.000044	0.006	No	28	3.571	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1602D	0.0001	0.000013	0.006	No	28	35.71	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1602I	0.00005361	0.00003031	0.006	No	28	7.143	ln(x)	0.01	Param.
Antimony, total (mg/L)	MW-1603D	0.0001	0.00002	0.006	No	28	39.29	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1603I	0.00007	0.00003	0.006	No	28	7.143	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1603S	0.00005	0.00004	0.006	No	28	3.571	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1604D	0.0001	0.00002	0.006	No	28	57.14	No	0.01	NP (NDs)
Antimony, total (mg/L)	MW-1604I	0.000043	0.00002	0.006	No	28	7.143	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1604S	0.00007	0.00005	0.006	No	28	0	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1605D	0.0001	0.000016	0.006	No	28	39.29	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1605I	0.00005	0.00003	0.006	No	28	7.143	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1605S	0.00005	0.000036	0.006	No	28	0	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1606D	0.0001	0.00002	0.006	No	28	57.14	No	0.01	NP (NDs)
Antimony, total (mg/L)	MW-1606I	0.0001	0.00002	0.006	No	28	35.71	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1606S	0.00005	0.000032	0.006	No	28	7.143	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1002	0.0002668	0.0002282	0.079	No	28	0	ln(x)	0.01	Param.
Arsenic, total (mg/L)	MW-1602D	0.00962	0.00882	0.079	No	28	0	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1602I	0.02949	0.02061	0.079	No	28	0	x^(1/3)	0.01	Param.
Arsenic, total (mg/L)	MW-1603D	0.0136	0.01228	0.079	No	28	0	No	0.01	Param.
Arsenic, total (mg/L)	MW-1603I	0.0151	0.0125	0.079	No	28	0	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1603S	0.0002136	0.0001684	0.079	No	28	0	ln(x)	0.01	Param.
Arsenic, total (mg/L)	MW-1604D	0.0182	0.0168	0.079	No	28	0	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1604I	0.0207	0.0187	0.079	No	28	0	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1604S	0.00026	0.00017	0.079	No	28	0	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1605D	0.0211	0.0183	0.079	No	28	0	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1605I	0.0212	0.018	0.079	No	28	0	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1605S	0.00059	0.00045	0.079	No	28	0	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1606D	0.01741	0.01603	0.079	No	28	0	x^6	0.01	Param.
Arsenic, total (mg/L)	MW-1606I	0.01075	0.007156	0.079	No	28	0	No	0.01	Param.
Arsenic, total (mg/L)	MW-1606S	0.00023	0.00017	0.079	No	28	0	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1002	0.018	0.0138	2	No	28	0	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1602D	0.457	0.419	2	No	28	0	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1602I	0.127	0.107	2	No	28	0	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1603D	0.125	0.112	2	No	28	0	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1603I	0.0919	0.0811	2	No	28	0	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1603S	0.0138	0.009532	2	No	28	0	No	0.01	Param.
Barium, total (mg/L)	MW-1604D	0.258	0.2419	2	No	28	0	No	0.01	Param.
Barium, total (mg/L)	MW-1604I	0.119	0.1013	2	No	28	0	No	0.01	Param.
Barium, total (mg/L)	MW-1604S	0.0185	0.013	2	No	28	0	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1605D	0.457	0.431	2	No	28	0	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1605I	0.1498	0.1329	2	No	28	0	No	0.01	Param.
Barium, total (mg/L)	MW-1605S	0.008753	0.006653	2	No	28	0	sqrt(x)	0.01	Param.
Barium, total (mg/L)	MW-1606D	0.4662	0.4223	2	No	28	0	x^2	0.01	Param.
Barium, total (mg/L)	MW-1606I	0.06149	0.05264	2	No	28	0	ln(x)	0.01	Param.
Barium, total (mg/L)	MW-1606S	0.0139	0.0111	2	No	28	0	No	0.01	NP (normality)
Beryllium, total (mg/L)	MW-1002	0.00005	0.00002	0.004	No	28	85.71	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1602D	0.00005	0.00002	0.004	No	28	67.86	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1602I	0.00005	0.00002	0.004	No	28	75	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1603D	0.00005	0.000049	0.004	No	28	85.71	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1603I	0.00005	0.00003	0.004	No	28	75	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1603S	0.00005	0.00002	0.004	No	28	85.71	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1604D	0.00005	0.00002	0.004	No	28	92.86	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1604I	0.00005	0.000025	0.004	No	28	89.29	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1604S	0.00005	0.00002	0.004	No	28	85.71	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1605D	0.00005	0.000043	0.004	No	28	89.29	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1605I	0.00005	0.00002	0.004	No	28	85.71	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1605S	0.00005	0.00004	0.004	No	28	78.57	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1606D	0.00005	0.000034	0.004	No	28	78.57	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1606I	0.00005	0.00002	0.004	No	28	92.86	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1606S	0.00005	0.000024	0.004	No	28	71.43	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1002	0.00003	0.00002	0.005	No	28	0	No	0.01	NP (normality)
Cadmium, total (mg/L)	MW-1602D	0.00002	0.00001	0.005	No	28	75	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1602I	0.00002	0.00001	0.005	No	28	64.29	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1603D	0.00002	0.000016	0.005	No	28	71.43	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1603I	0.00002	0.000016	0.005	No	28	64.29	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1603S	0.000028	0.000019	0.005	No	28	3.571	No	0.01	NP (normality)
Cadmium, total (mg/L)	MW-1604D	0.00002	0.000013	0.005	No	28	82.14	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1604I	0.00002	0.000013	0.005	No	28	67.86	No	0.01	NP (NDs)

Confidence Intervals - All Results (No Significant)

Page 2

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/24/2025, 9:04 AM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig.	N	%NDs	Transform	Alpha	Method
Cadmium, total (mg/L)	MW-1604S	0.000029	0.00002	0.005	No	28	0	No	0.01	NP (normality)
Cadmium, total (mg/L)	MW-1605D	0.00002	0.000006	0.005	No	28	82.14	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1605I	0.00002	0.000012	0.005	No	28	60.71	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1605S	0.000041	0.000031	0.005	No	28	0	No	0.01	NP (normality)
Cadmium, total (mg/L)	MW-1606D	0.00002	0.00002	0.005	No	28	89.29	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1606I	0.00002	0.00001	0.005	No	28	60.71	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1606S	0.00003668	0.00002231	0.005	No	28	0	ln(x)	0.01	Param.
Chromium, total (mg/L)	MW-1002	0.0002538	0.0001333	0.1	No	28	3.571	sqrt(x)	0.01	Param.
Chromium, total (mg/L)	MW-1602D	0.000338	0.00021	0.1	No	28	0	No	0.01	NP (normality)
Chromium, total (mg/L)	MW-1602I	0.0002998	0.0001809	0.1	No	28	3.571	sqrt(x)	0.01	Param.
Chromium, total (mg/L)	MW-1603D	0.0002542	0.0001699	0.1	No	27	0	No	0.01	Param.
Chromium, total (mg/L)	MW-1603I	0.0004513	0.0002038	0.1	No	28	0	sqrt(x)	0.01	Param.
Chromium, total (mg/L)	MW-1603S	0.0003289	0.0001949	0.1	No	28	0	No	0.01	Param.
Chromium, total (mg/L)	MW-1604D	0.0002137	0.0001315	0.1	No	28	0	No	0.01	Param.
Chromium, total (mg/L)	MW-1604I	0.0002975	0.0001582	0.1	No	28	0	No	0.01	Param.
Chromium, total (mg/L)	MW-1604S	0.0003229	0.0001576	0.1	No	28	0	sqrt(x)	0.01	Param.
Chromium, total (mg/L)	MW-1605D	0.0002773	0.0001505	0.1	No	28	0	ln(x)	0.01	Param.
Chromium, total (mg/L)	MW-1605I	0.0002774	0.0001424	0.1	No	28	3.571	x^(1/3)	0.01	Param.
Chromium, total (mg/L)	MW-1605S	0.0006588	0.0003335	0.1	No	28	0	No	0.01	Param.
Chromium, total (mg/L)	MW-1606D	0.0002976	0.0001583	0.1	No	28	3.571	No	0.01	Param.
Chromium, total (mg/L)	MW-1606I	0.0003553	0.0001586	0.1	No	28	7.143	sqrt(x)	0.01	Param.
Chromium, total (mg/L)	MW-1606S	0.0003797	0.0002048	0.1	No	28	3.571	ln(x)	0.01	Param.
Cobalt, total (mg/L)	MW-1002	0.0006845	0.0005433	0.006	No	28	0	No	0.01	Param.
Cobalt, total (mg/L)	MW-1602D	0.000157	0.000057	0.006	No	28	0	No	0.01	NP (normality)
Cobalt, total (mg/L)	MW-1602I	0.001518	0.00126	0.006	No	28	0	x^2	0.01	Param.
Cobalt, total (mg/L)	MW-1603D	0.000525	0.00028	0.006	No	28	0	No	0.01	NP (normality)
Cobalt, total (mg/L)	MW-1603I	0.00136	0.00117	0.006	No	28	0	No	0.01	NP (normality)
Cobalt, total (mg/L)	MW-1603S	0.0004524	0.0002739	0.006	No	28	0	No	0.01	Param.
Cobalt, total (mg/L)	MW-1604D	0.000067	0.00005	0.006	No	28	0	No	0.01	NP (normality)
Cobalt, total (mg/L)	MW-1604I	0.0008183	0.0006502	0.006	No	28	0	No	0.01	Param.
Cobalt, total (mg/L)	MW-1604S	0.000355	0.000285	0.006	No	28	0	No	0.01	NP (normality)
Cobalt, total (mg/L)	MW-1605D	0.0001116	0.00006475	0.006	No	28	0	ln(x)	0.01	Param.
Cobalt, total (mg/L)	MW-1605I	0.001433	0.001239	0.006	No	28	0	No	0.01	Param.
Cobalt, total (mg/L)	MW-1605S	0.000472	0.000361	0.006	No	28	0	No	0.01	NP (normality)
Cobalt, total (mg/L)	MW-1606D	0.000086	0.00005	0.006	No	28	0	No	0.01	NP (normality)
Cobalt, total (mg/L)	MW-1606I	0.001311	0.001034	0.006	No	28	0	No	0.01	Param.
Cobalt, total (mg/L)	MW-1606S	0.000112	0.000054	0.006	No	28	3.571	No	0.01	NP (normality)
Combined Radium 226 + 228 (pCi/L)	MW-1002	1.311	0.5988	5	No	28	0	sqrt(x)	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1602D	2.082	1.199	5	No	28	0	sqrt(x)	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1602I	1.383	1.001	5	No	28	0	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1603D	1.5	0.9571	5	No	28	0	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1603I	1.59	1.061	5	No	28	0	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1603S	1.092	0.5577	5	No	28	0	sqrt(x)	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1604D	1.315	0.8581	5	No	28	0	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1604I	1.603	1.004	5	No	28	0	sqrt(x)	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1604S	0.9622	0.4903	5	No	28	0	sqrt(x)	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1605D	1.5	1.069	5	No	28	0	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1605I	2.017	1.553	5	No	28	0	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1605S	1.105	0.5365	5	No	28	0	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1606D	1.318	0.8387	5	No	28	0	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1606I	1.433	0.9148	5	No	28	0	x^(1/3)	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1606S	1.069	0.5841	5	No	28	0	No	0.01	Param.
Fluoride, total (mg/L)	MW-1002	1.062	0.9059	4	No	28	0	No	0.01	Param.
Fluoride, total (mg/L)	MW-1602D	0.3379	0.3128	4	No	28	0	No	0.01	Param.
Fluoride, total (mg/L)	MW-1602I	0.3018	0.2803	4	No	28	0	No	0.01	Param.
Fluoride, total (mg/L)	MW-1603D	0.2977	0.2773	4	No	28	0	No	0.01	Param.
Fluoride, total (mg/L)	MW-1603I	0.4343	0.4049	4	No	28	0	No	0.01	Param.
Fluoride, total (mg/L)	MW-1603S	0.9353	0.6175	4	No	28	0	No	0.01	Param.
Fluoride, total (mg/L)	MW-1604D	0.281	0.2553	4	No	28	0	x^2	0.01	Param.
Fluoride, total (mg/L)	MW-1604I	0.3675	0.3332	4	No	28	0	No	0.01	Param.
Fluoride, total (mg/L)	MW-1604S	0.99	0.88	4	No	28	0	No	0.01	NP (normality)
Fluoride, total (mg/L)	MW-1605D	0.2205	0.195	4	No	28	0	x^2	0.01	Param.
Fluoride, total (mg/L)	MW-1605I	0.2176	0.1941	4	No	28	0	x^2	0.01	Param.
Fluoride, total (mg/L)	MW-1605S	0.5775	0.5275	4	No	28	0	No	0.01	Param.
Fluoride, total (mg/L)	MW-1606D	0.1921	0.1765	4	No	28	0	No	0.01	Param.
Fluoride, total (mg/L)	MW-1606I	0.2125	0.1932	4	No	28	0	No	0.01	Param.
Fluoride, total (mg/L)	MW-1606S	0.5097	0.4282	4	No	28	0	No	0.01	Param.
Lead, total (mg/L)	MW-1002	0.0002	0.000031	0.015	No	28	53.57	No	0.01	NP (NDs)

Confidence Intervals - All Results (No Significant)

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/24/2025, 9:04 AM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig.	N	%NDs	Transform	Alpha	Method
Lead, total (mg/L)	MW-1602D	0.0002	0.000061	0.015	No	28	50	No	0.01	NP (normality)
Lead, total (mg/L)	MW-1602I	0.0001322	0.00005899	0.015	No	28	42.86	sqrt(x)	0.01	Param.
Lead, total (mg/L)	MW-1603D	0.0002	0.00004	0.015	No	28	50	No	0.01	NP (normality)
Lead, total (mg/L)	MW-1603I	0.0002433	0.00006285	0.015	No	28	21.43	x^(1/3)	0.01	Param.
Lead, total (mg/L)	MW-1603S	0.0002	0.000116	0.015	No	28	57.14	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1604D	0.0002	0.00004	0.015	No	28	50	No	0.01	NP (normality)
Lead, total (mg/L)	MW-1604I	0.0002	0.000043	0.015	No	28	50	No	0.01	NP (normality)
Lead, total (mg/L)	MW-1604S	0.0002	0.00006	0.015	No	28	57.14	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1605D	0.0002	0.00005	0.015	No	28	60.71	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1605I	0.0001237	0.00005387	0.015	No	28	17.86	ln(x)	0.01	Param.
Lead, total (mg/L)	MW-1605S	0.0001407	0.00004239	0.015	No	28	28.57	ln(x)	0.01	Param.
Lead, total (mg/L)	MW-1606D	0.0002	0.00007	0.015	No	28	57.14	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1606I	0.0002	0.00006	0.015	No	28	60.71	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1606S	0.0002	0.00009	0.015	No	28	46.43	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1002	0.008167	0.004955	0.04	No	28	10.71	x^(1/3)	0.01	Param.
Lithium, total (mg/L)	MW-1602D	0.00566	0.00236	0.04	No	28	3.571	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1602I	0.007715	0.004723	0.04	No	28	3.571	sqrt(x)	0.01	Param.
Lithium, total (mg/L)	MW-1603D	0.007	0.00323	0.04	No	28	7.143	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1603I	0.009894	0.006688	0.04	No	28	10.71	sqrt(x)	0.01	Param.
Lithium, total (mg/L)	MW-1603S	0.006308	0.003269	0.04	No	28	10.71	ln(x)	0.01	Param.
Lithium, total (mg/L)	MW-1604D	0.004	0.0014	0.04	No	28	14.29	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1604I	0.009131	0.006196	0.04	No	28	3.571	No	0.01	Param.
Lithium, total (mg/L)	MW-1604S	0.01221	0.009614	0.04	No	27	3.704	No	0.01	Param.
Lithium, total (mg/L)	MW-1605D	0.005	0.00154	0.04	No	28	7.143	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1605I	0.007	0.00479	0.04	No	28	0	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1605S	0.0139	0.01076	0.04	No	28	3.571	sqrt(x)	0.01	Param.
Lithium, total (mg/L)	MW-1606D	0.004	0.000505	0.04	No	28	10.71	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1606I	0.007	0.00316	0.04	No	28	3.571	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1606S	0.01072	0.00808	0.04	No	28	3.571	No	0.01	Param.
Mercury, total (mg/L)	MW-1002	0.000005	0.000005	0.002	No	27	96.3	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1602D	0.000005	0.000003	0.002	No	27	92.59	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1602I	0.000005	0.000005	0.002	No	27	96.3	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1603D	0.000005	0.000005	0.002	No	27	96.3	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1603I	0.000005	0.000005	0.002	No	27	96.3	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1603S	0.000005	0.000005	0.002	No	27	96.3	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1604D	0.000005	0.000002	0.002	No	27	92.59	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1604I	0.000005	0.000005	0.002	No	27	96.3	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1604S	0.000005	0.000005	0.002	No	27	96.3	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1605D	0.000005	0.000005	0.002	No	27	96.3	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1605I	0.000005	0.000005	0.002	No	27	96.3	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1605S	0.000005	0.000005	0.002	No	27	96.3	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1606D	0.000005	0.000005	0.002	No	27	96.3	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1606I	0.000005	0.000005	0.002	No	27	96.3	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1606S	0.000005	0.000005	0.002	No	27	96.3	No	0.01	NP (NDs)
Molybdenum, total (mg/L)	MW-1002	0.01065	0.005796	0.1	No	28	0	No	0.01	Param.
Molybdenum, total (mg/L)	MW-1602D	0.003599	0.003196	0.1	No	28	0	No	0.01	Param.
Molybdenum, total (mg/L)	MW-1602I	0.0023	0.00208	0.1	No	28	0	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1603D	0.00468	0.00362	0.1	No	28	0	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1603I	0.007845	0.006274	0.1	No	28	0	No	0.01	Param.
Molybdenum, total (mg/L)	MW-1603S	0.0009559	0.0004839	0.1	No	28	14.29	sqrt(x)	0.01	Param.
Molybdenum, total (mg/L)	MW-1604D	0.0028	0.0025	0.1	No	28	0	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1604I	0.002528	0.002161	0.1	No	28	0	No	0.01	Param.
Molybdenum, total (mg/L)	MW-1604S	0.0033	0.00251	0.1	No	28	0	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1605D	0.00221	0.0019	0.1	No	27	0	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1605I	0.00133	0.00106	0.1	No	27	0	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1605S	0.002	0.00179	0.1	No	28	0	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1606D	0.00207	0.00177	0.1	No	28	0	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1606I	0.001414	0.001122	0.1	No	27	0	No	0.01	Param.
Molybdenum, total (mg/L)	MW-1606S	0.001385	0.001118	0.1	No	27	0	No	0.01	Param.
Selenium, total (mg/L)	MW-1002	0.00012	0.00007	0.05	No	28	17.86	No	0.01	NP (normality)
Selenium, total (mg/L)	MW-1602D	0.0005	0.00005	0.05	No	28	53.57	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1602I	0.0005	0.00006	0.05	No	28	57.14	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1603D	0.0005	0.0001	0.05	No	28	67.86	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1603I	0.0005	0.00014	0.05	No	28	64.29	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1603S	0.0002512	0.0001133	0.05	No	28	10.71	ln(x)	0.01	Param.
Selenium, total (mg/L)	MW-1604D	0.0005	0.0001	0.05	No	28	85.71	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1604I	0.0005	0.0001	0.05	No	28	67.86	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1604S	0.0001474	0.00008535	0.05	No	28	14.29	sqrt(x)	0.01	Param.

Confidence Intervals - All Results (No Significant)


Page 4

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/24/2025, 9:04 AM

<u>Constituent</u>	<u>Well</u>	<u>Upper Lim.</u>	<u>Lower Lim.</u>	<u>Compliance</u>	<u>Sig.</u>	<u>N</u>	<u>%NDs</u>	<u>Transform</u>	<u>Alpha</u>	<u>Method</u>
Selenium, total (mg/L)	MW-1605D	0.0005	0.0001	0.05	No	28	75	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1605I	0.0005	0.00007	0.05	No	28	64.29	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1605S	0.0008355	0.0003815	0.05	No	27	3.704	No	0.01	Param.
Selenium, total (mg/L)	MW-1606D	0.0005	0.0001	0.05	No	28	78.57	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1606I	0.0005	0.0001	0.05	No	28	82.14	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1606S	0.003859	0.002646	0.05	No	28	0	No	0.01	Param.
Thallium, total (mg/L)	MW-1002	0.0002	0.00003	0.002	No	28	57.14	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1602D	0.0002	0.000066	0.002	No	28	78.57	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1602I	0.0002	0.00003	0.002	No	28	53.57	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1603D	0.0002	0.000068	0.002	No	28	75	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1603I	0.0002	0.00004	0.002	No	28	53.57	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1603S	0.0002	0.00004	0.002	No	28	60.71	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1604D	0.0002	0.000095	0.002	No	28	85.71	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1604I	0.0002	0.00005	0.002	No	28	64.29	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1604S	0.0002	0.00004	0.002	No	28	53.57	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1605D	0.0002	0.00005	0.002	No	28	89.29	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1605I	0.0002	0.00003	0.002	No	28	42.86	No	0.01	NP (normality)
Thallium, total (mg/L)	MW-1605S	0.0002	0.00003	0.002	No	28	35.71	No	0.01	NP (normality)
Thallium, total (mg/L)	MW-1606D	0.0002	0.000124	0.002	No	28	85.71	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1606I	0.0002	0.00004	0.002	No	28	46.43	No	0.01	NP (normality)
Thallium, total (mg/L)	MW-1606S	0.0002	0.00005	0.002	No	28	67.86	No	0.01	NP (NDs)

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

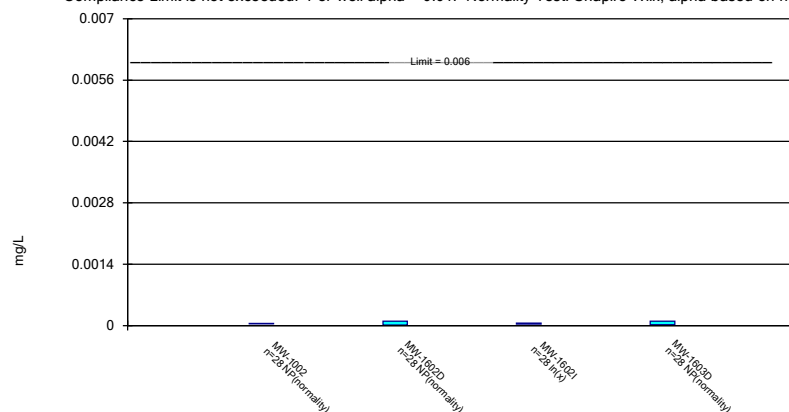

Constituent: Antimony, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

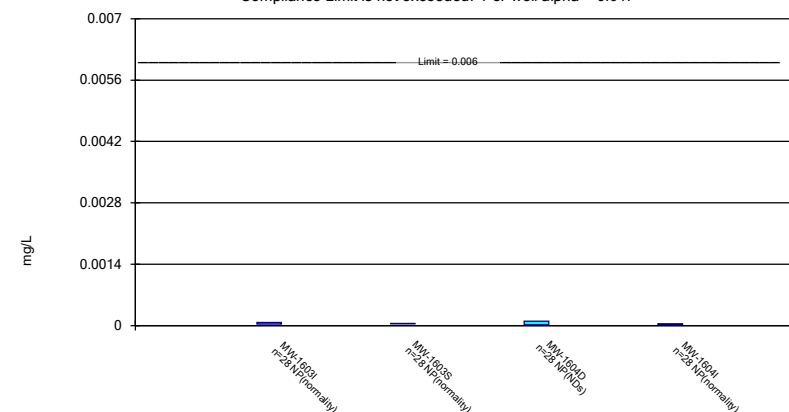

Constituent: Antimony, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

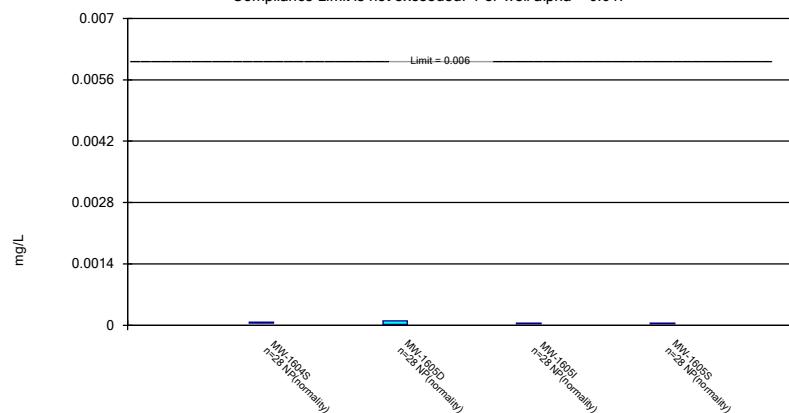

Constituent: Antimony, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

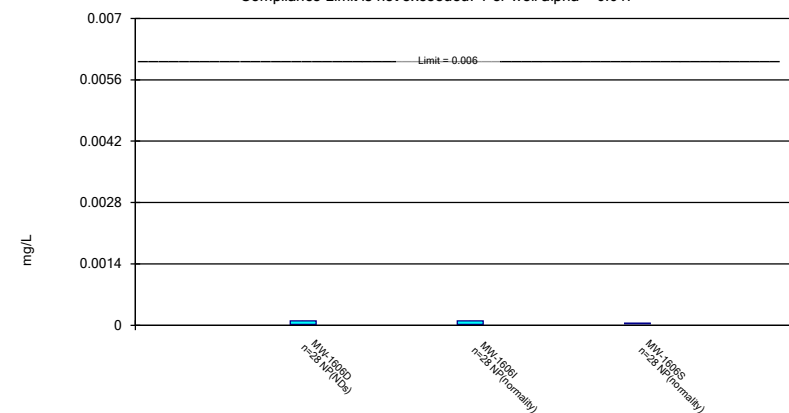

Constituent: Antimony, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

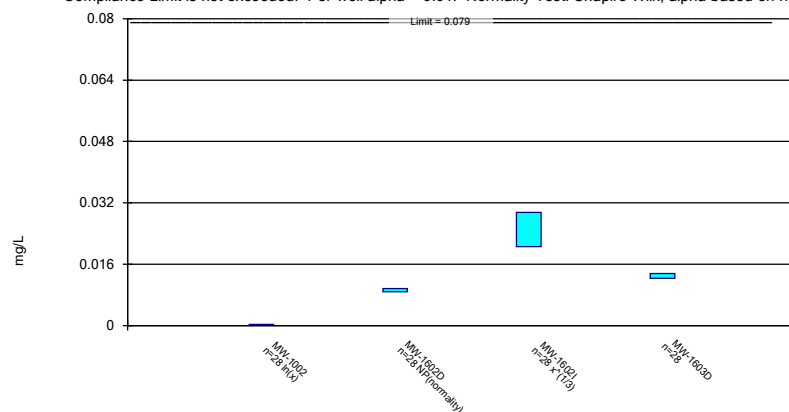

Constituent: Arsenic, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

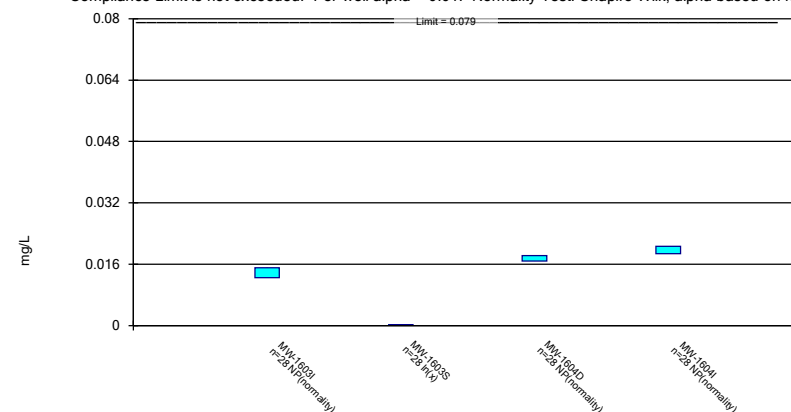

Constituent: Arsenic, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

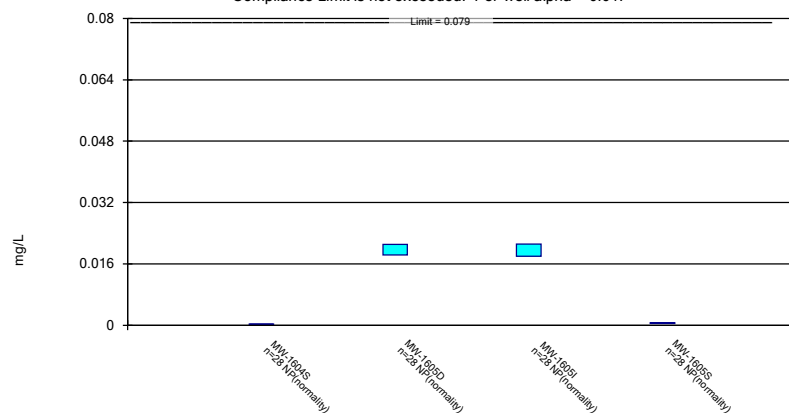

Constituent: Arsenic, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

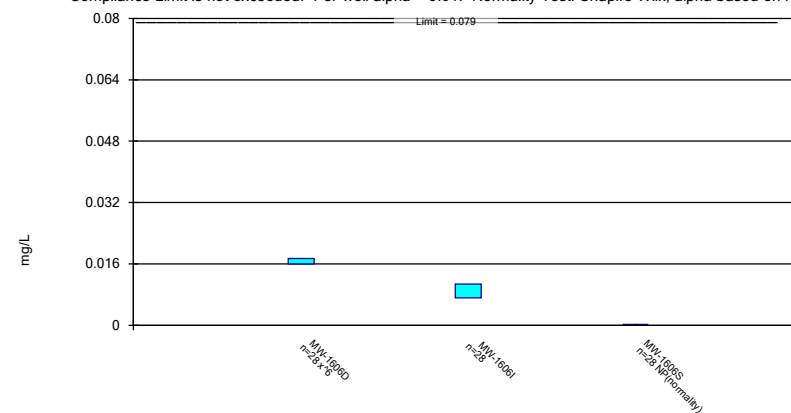

Constituent: Arsenic, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

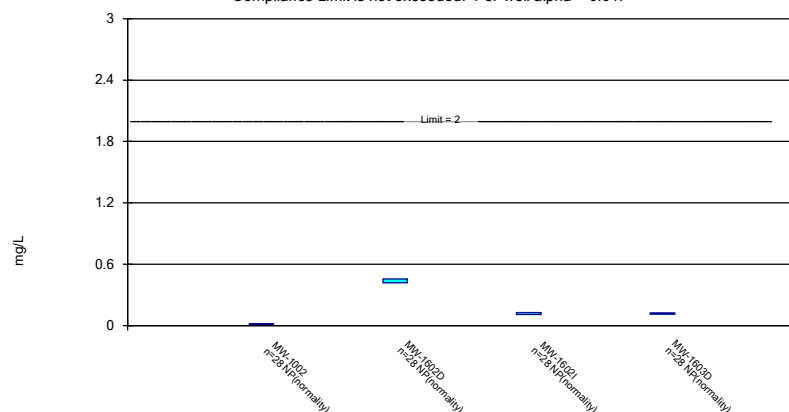

Constituent: Barium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

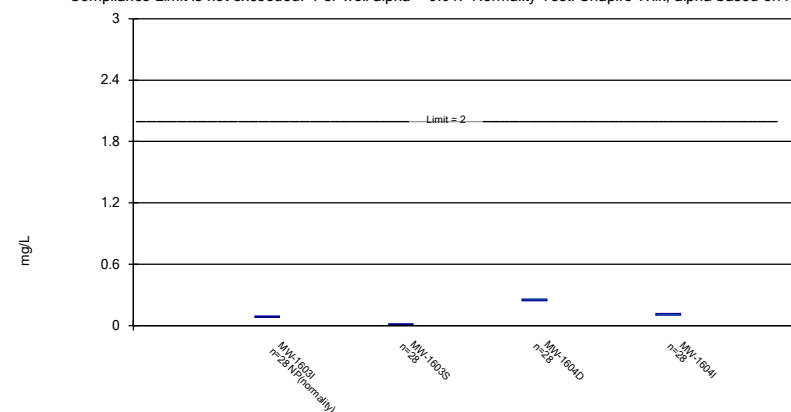

Constituent: Barium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

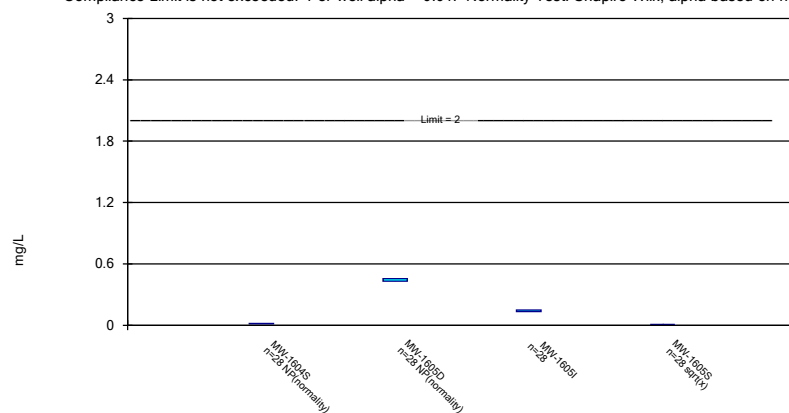


Constituent: Barium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

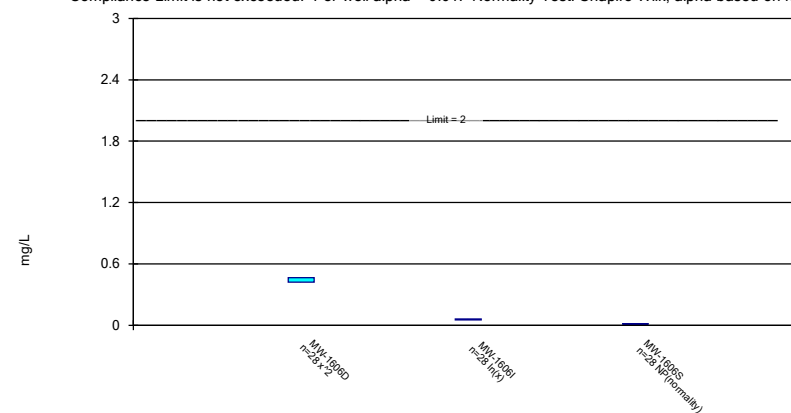


Constituent: Barium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

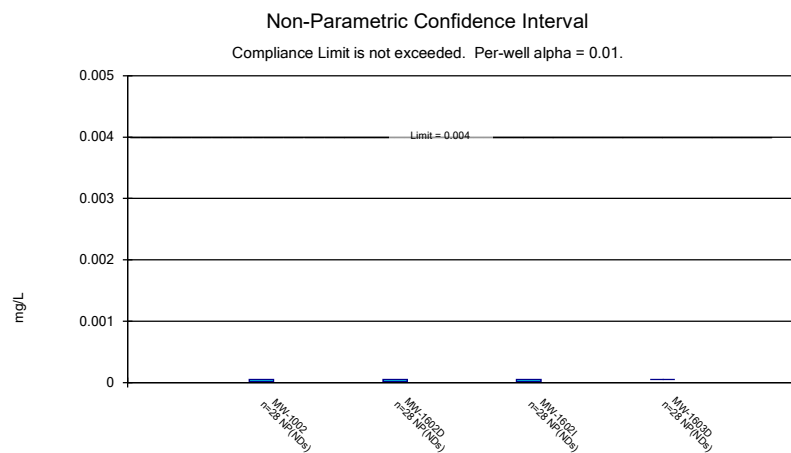


Constituent: Beryllium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

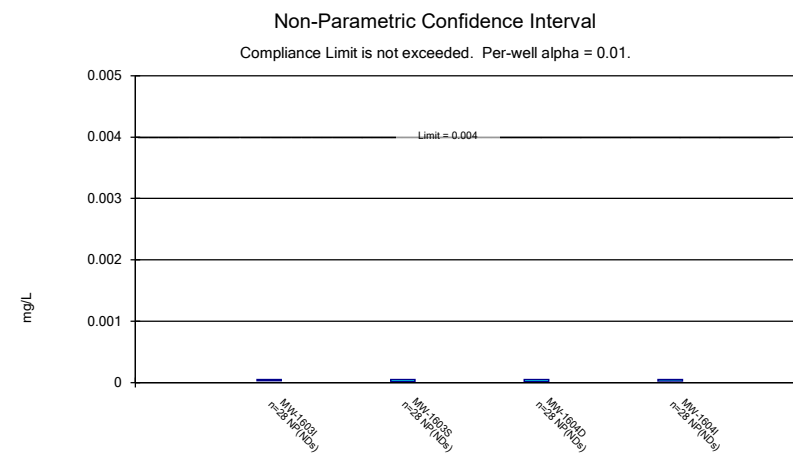


Constituent: Beryllium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

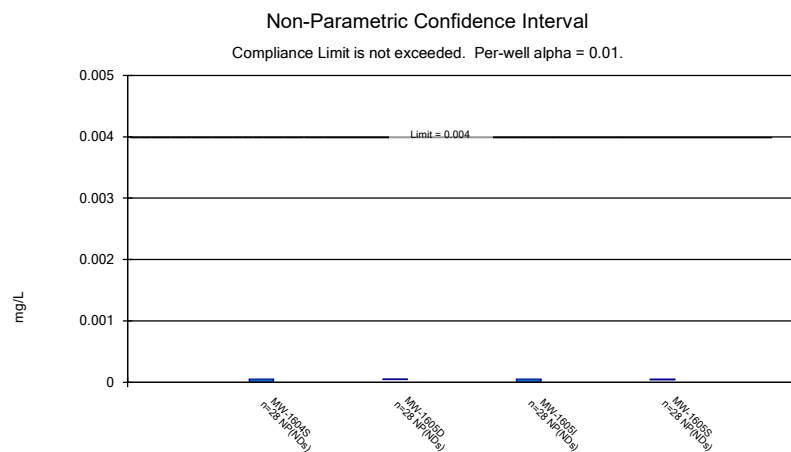


Constituent: Beryllium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

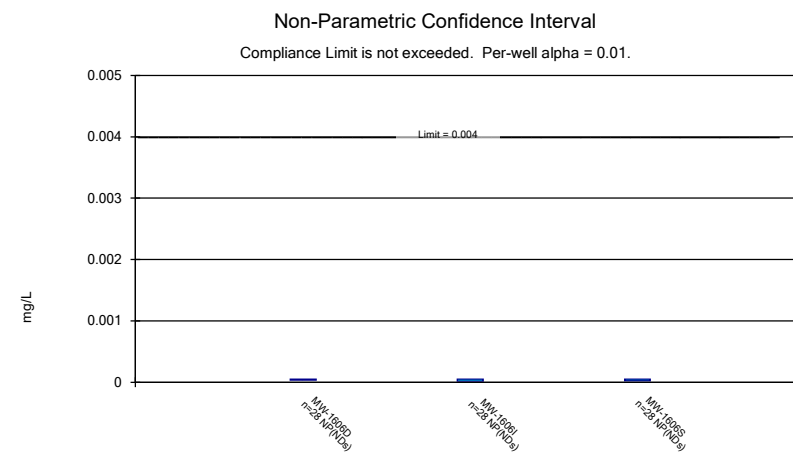


Constituent: Beryllium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

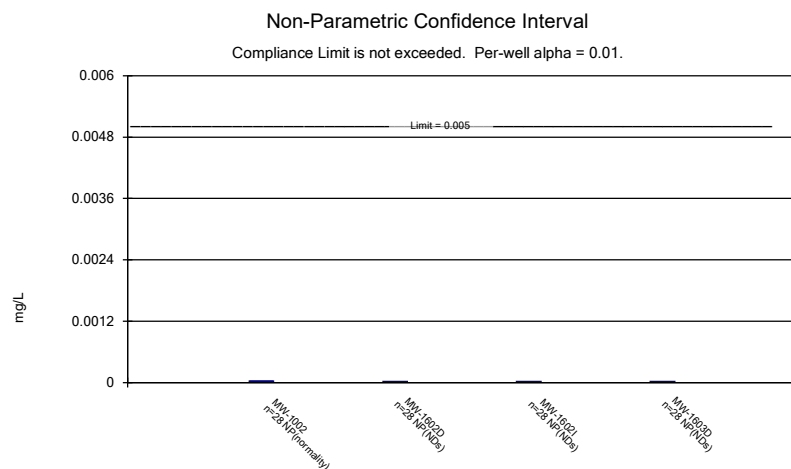


Constituent: Cadmium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

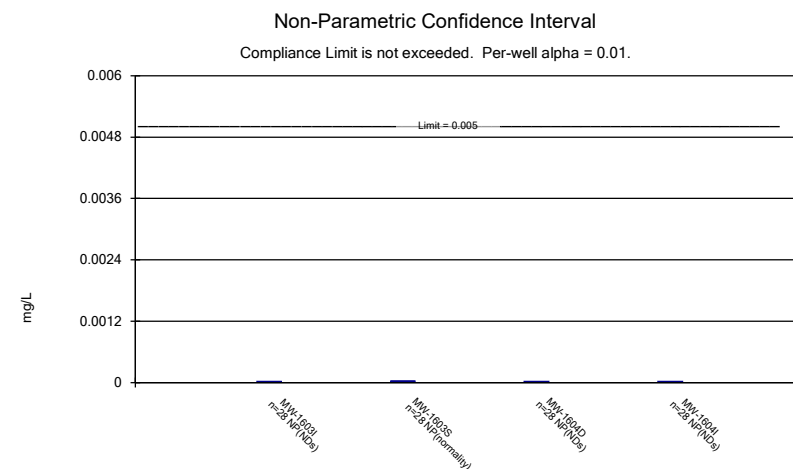

Constituent: Cadmium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

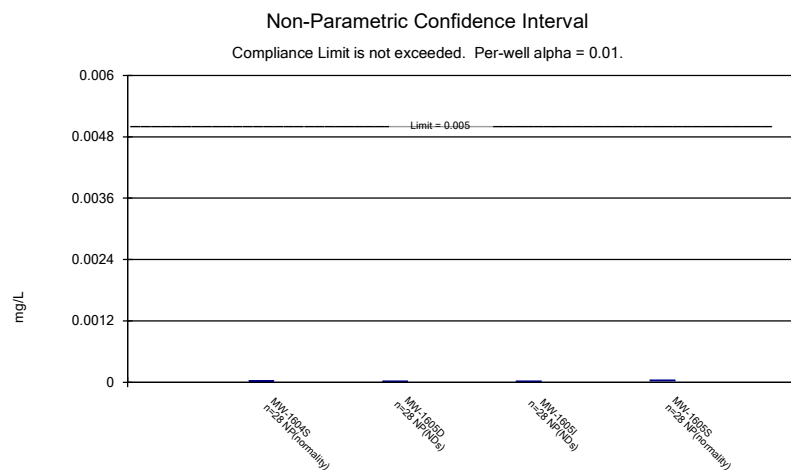


Constituent: Cadmium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

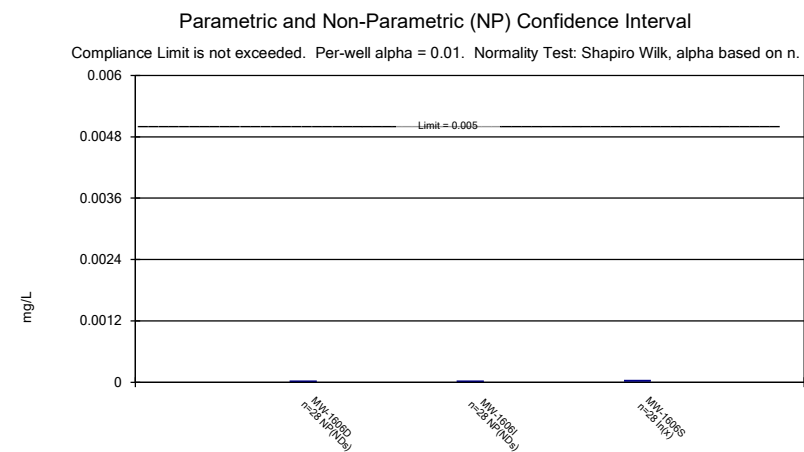

Constituent: Cadmium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

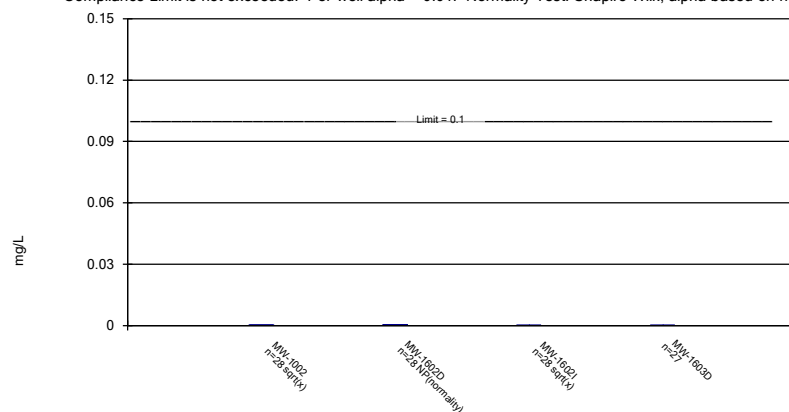

Constituent: Chromium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

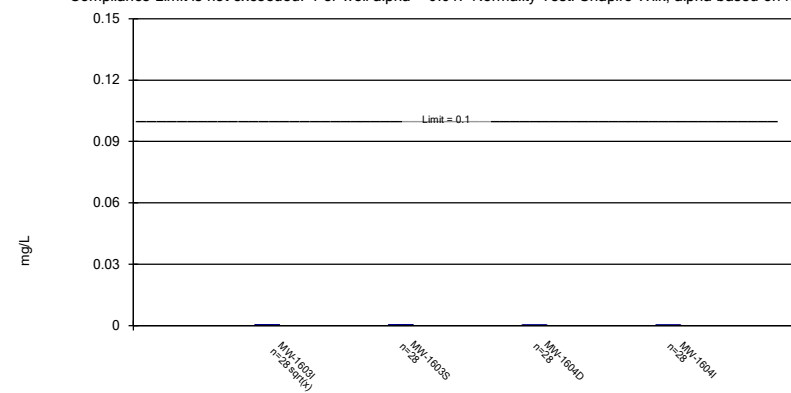

Constituent: Chromium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

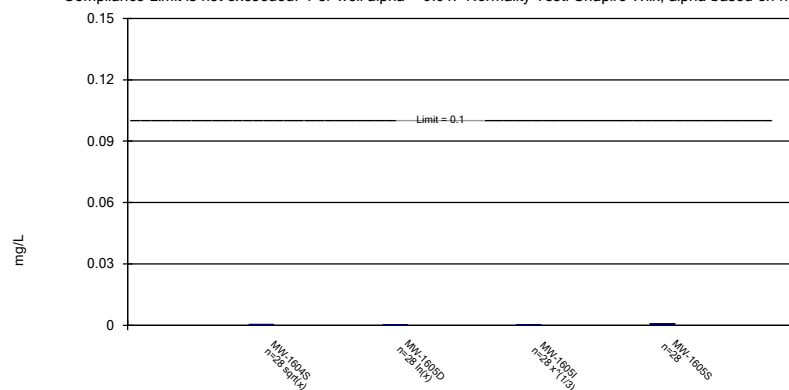

Constituent: Chromium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

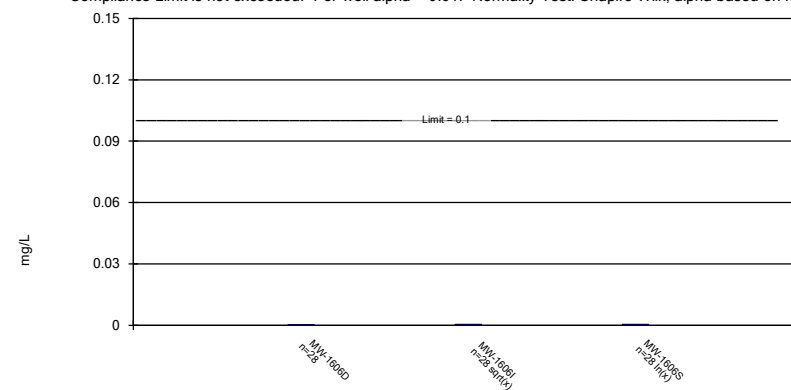

Constituent: Chromium, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

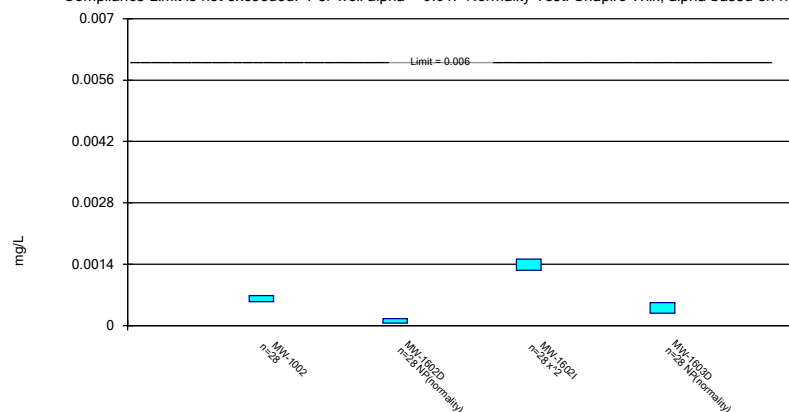

Constituent: Cobalt, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

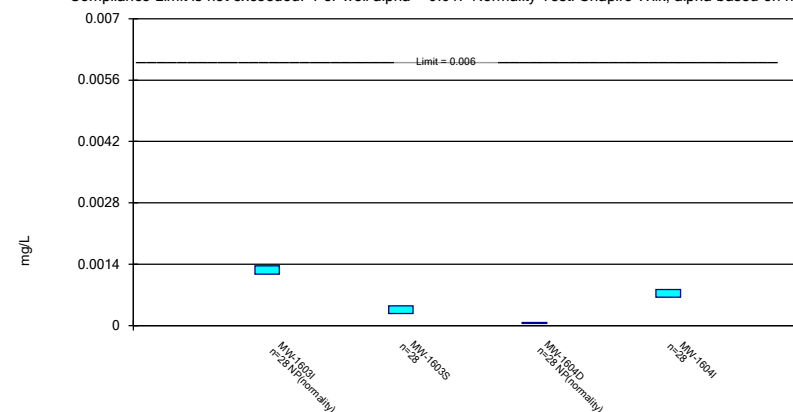

Constituent: Cobalt, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

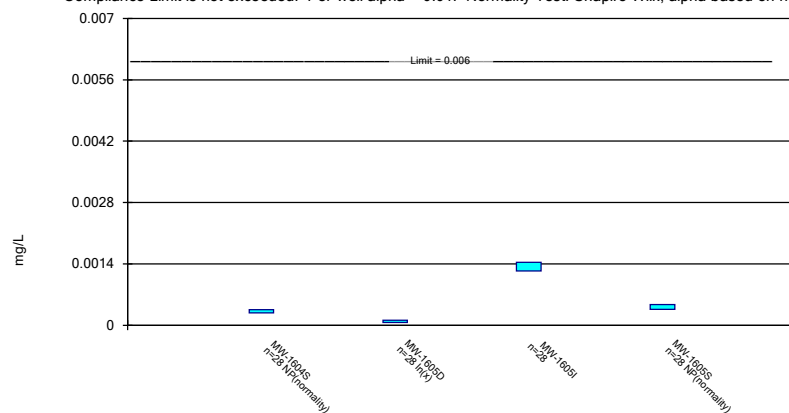

Constituent: Cobalt, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

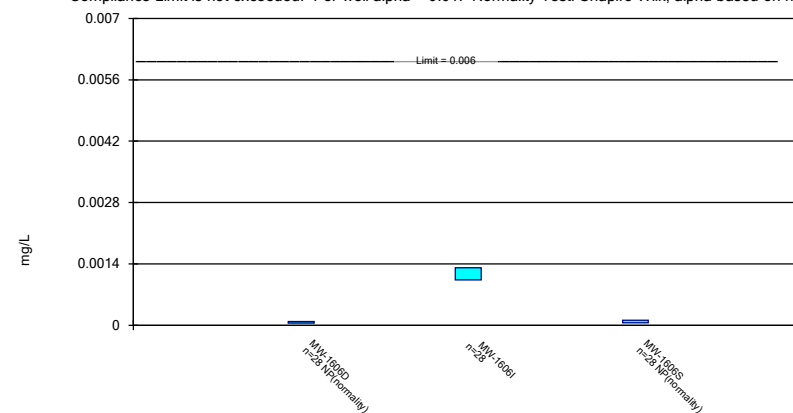

Constituent: Cobalt, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

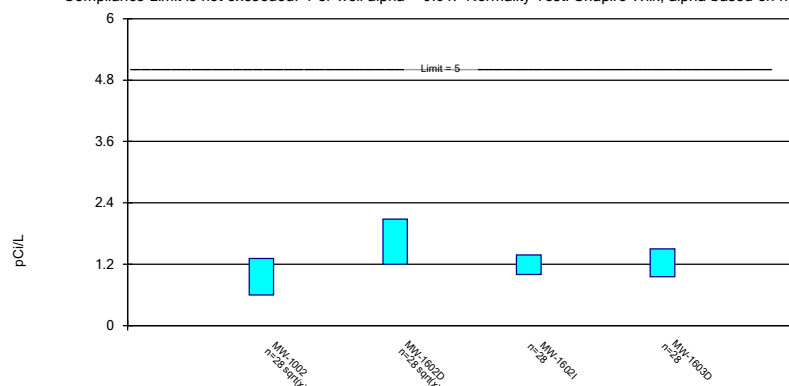

Constituent: Combined Radium 226 + 228 Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

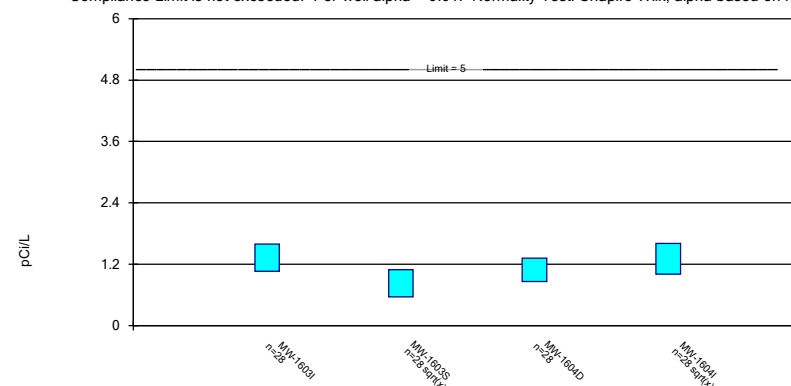

Constituent: Combined Radium 226 + 228 Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

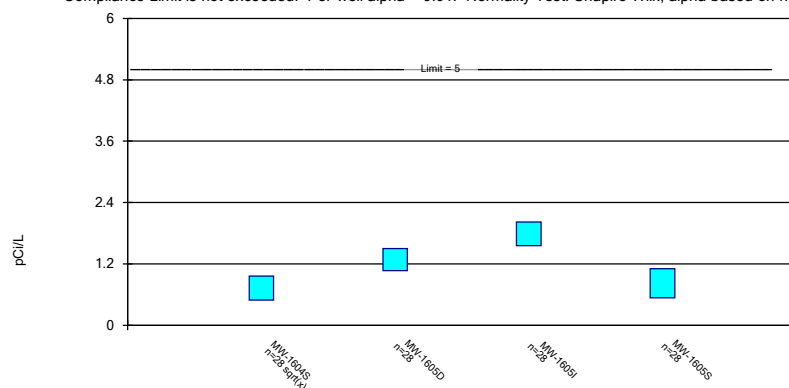

Constituent: Combined Radium 226 + 228 Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

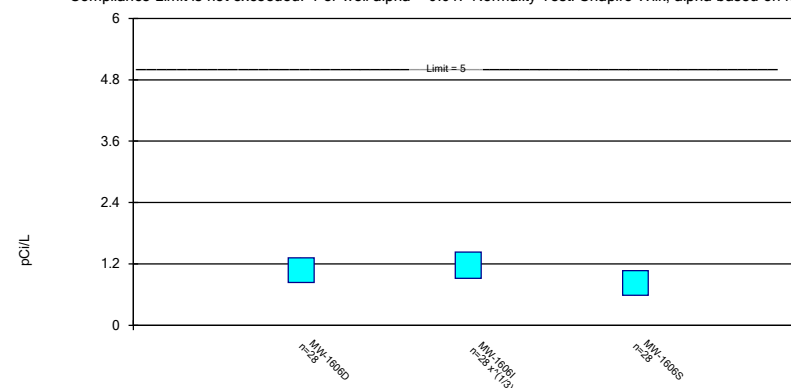

Constituent: Combined Radium 226 + 228 Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

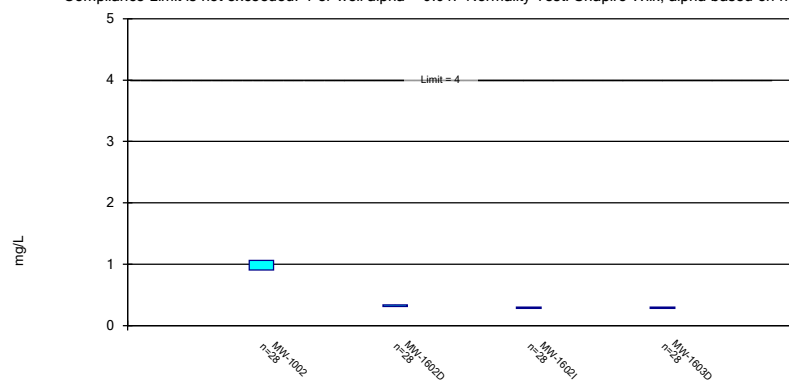

Constituent: Fluoride, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

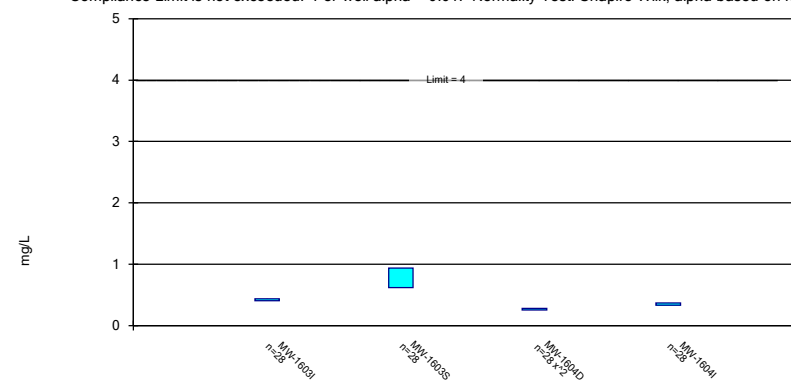

Constituent: Fluoride, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

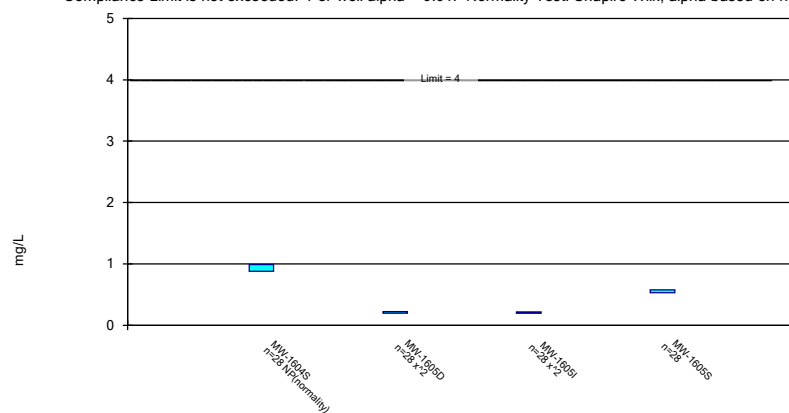

Constituent: Fluoride, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

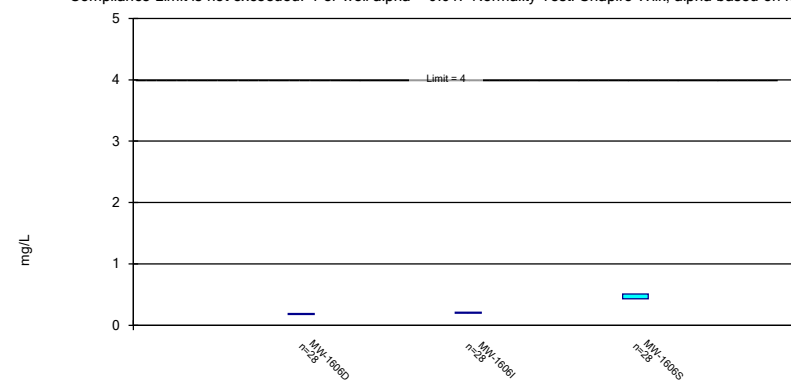

Constituent: Fluoride, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

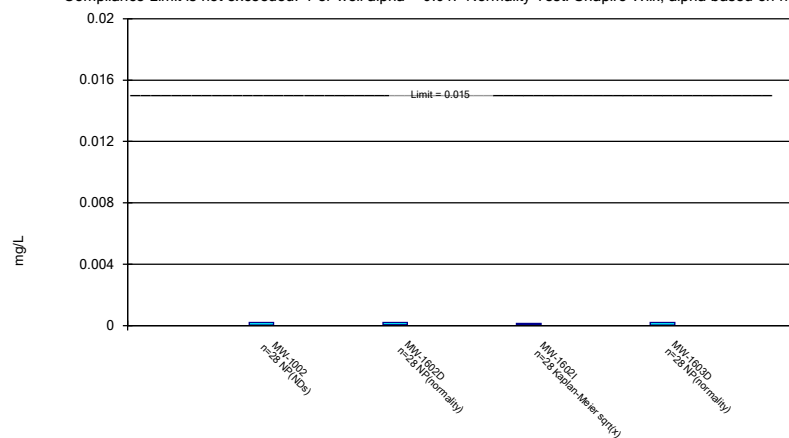

Constituent: Lead, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

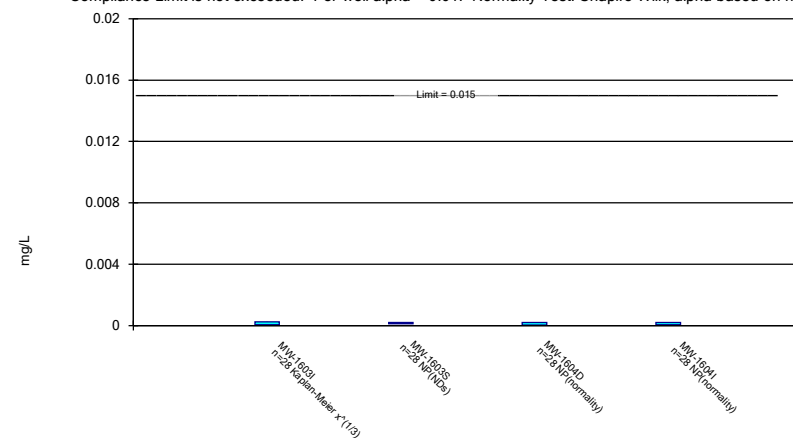

Constituent: Lead, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

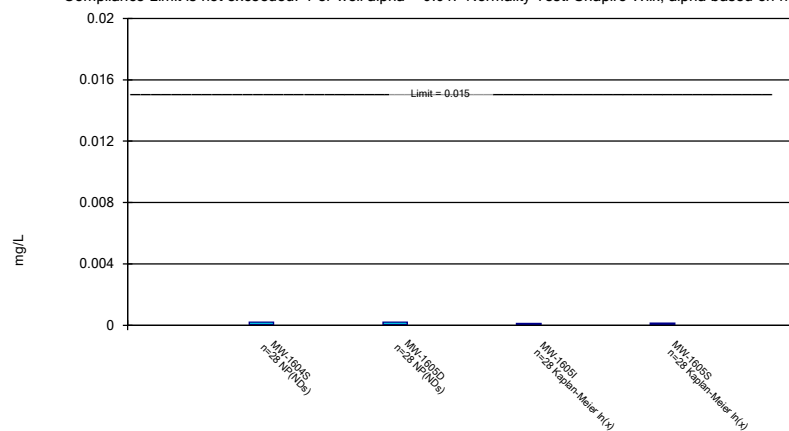

Constituent: Lead, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

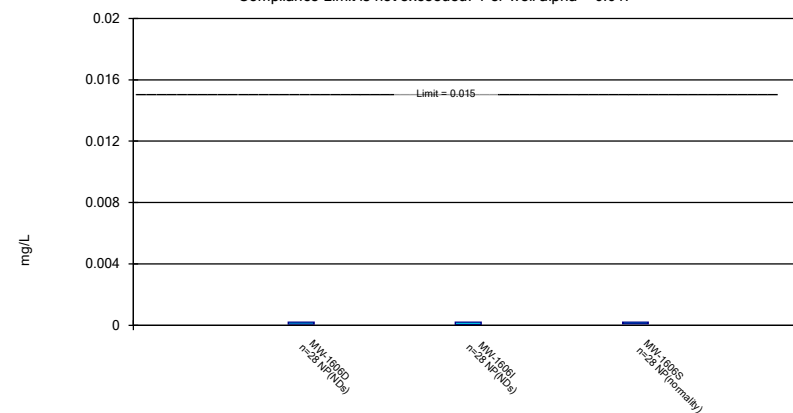

Constituent: Lead, total Analysis Run 1/24/2025 8:59 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

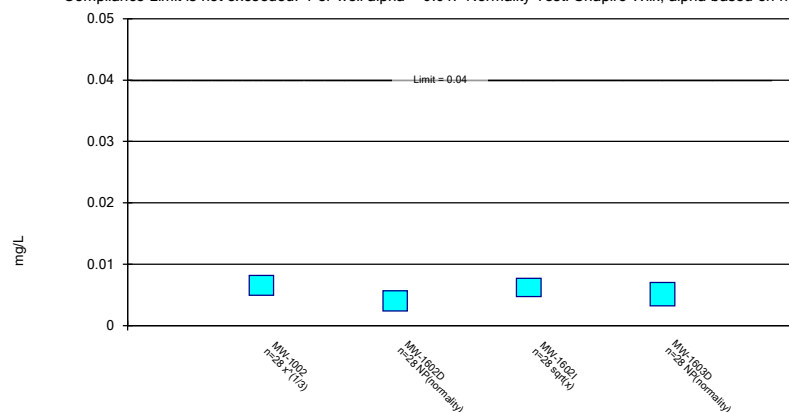

Constituent: Lithium, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

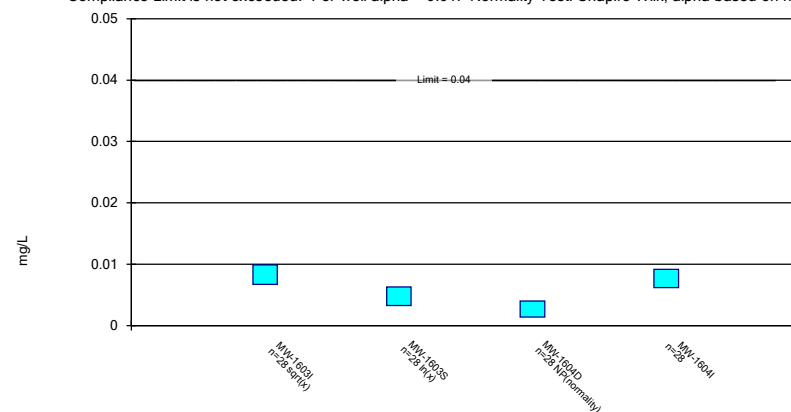

Constituent: Lithium, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

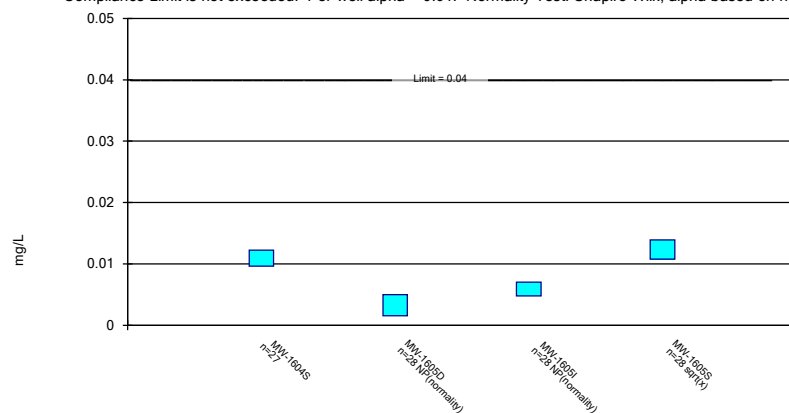


Constituent: Lithium, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

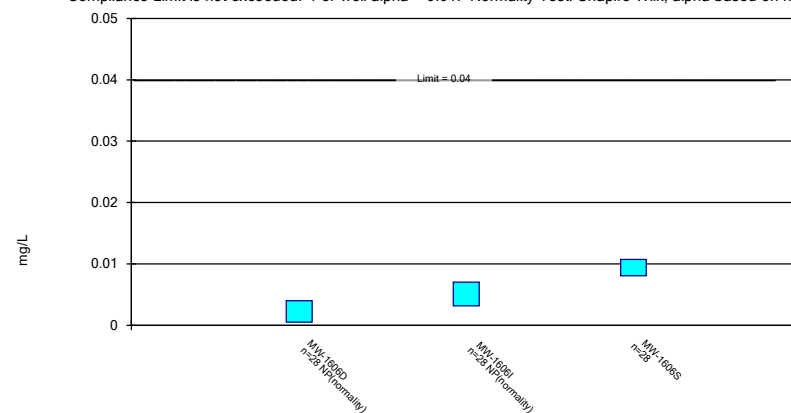


Constituent: Lithium, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

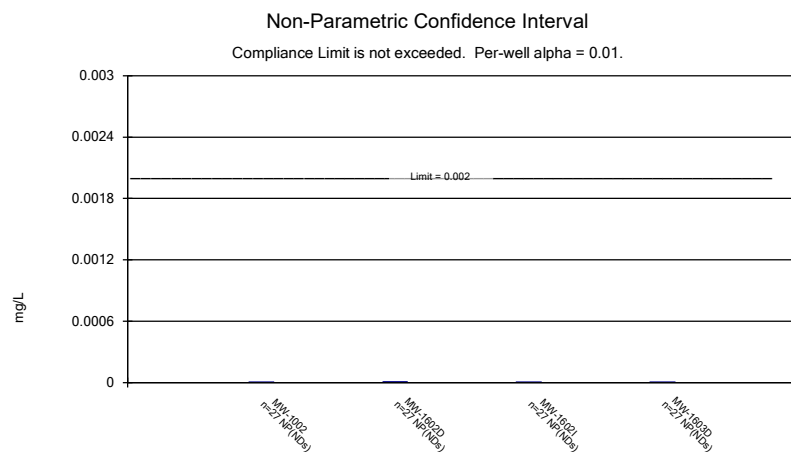


Constituent: Mercury, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

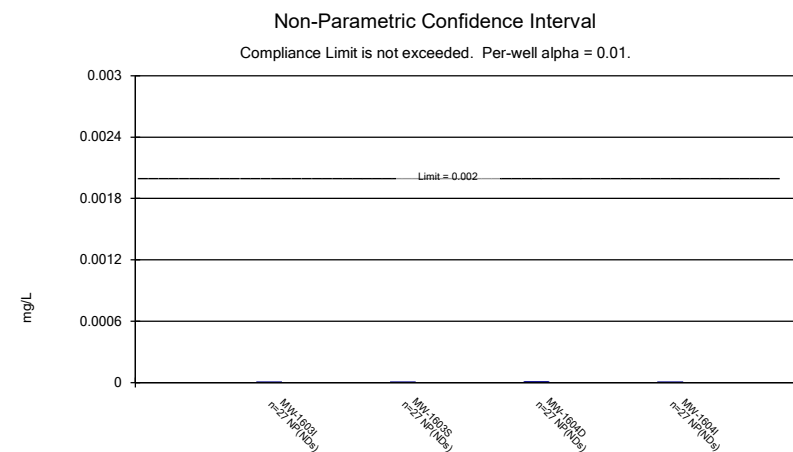

Constituent: Mercury, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

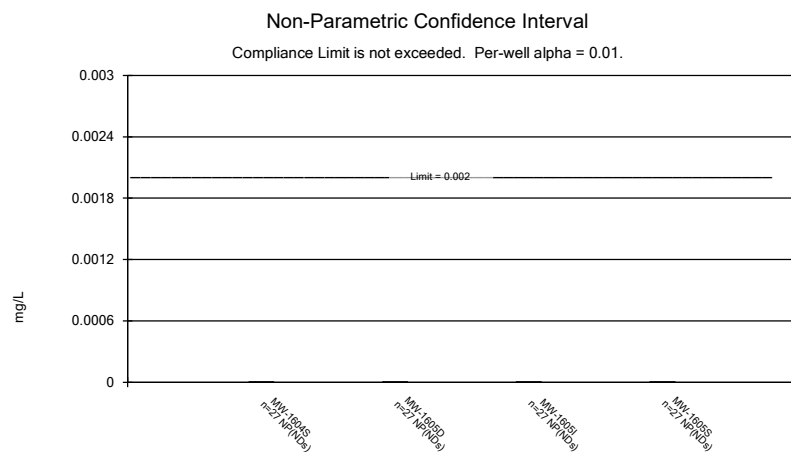


Constituent: Mercury, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

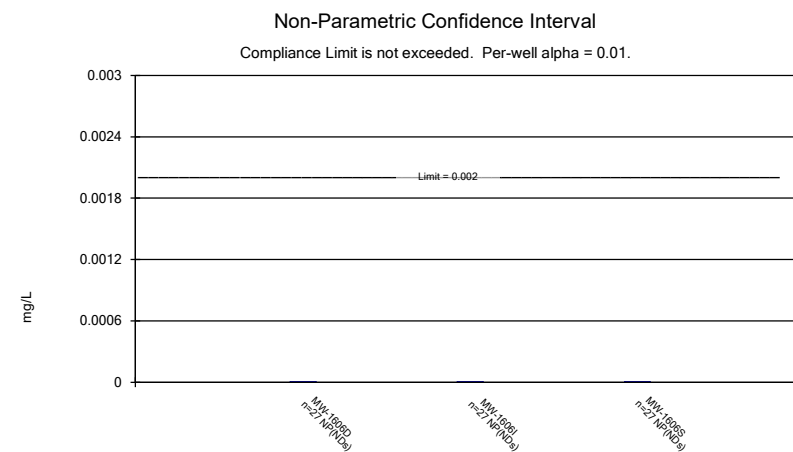

Constituent: Mercury, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

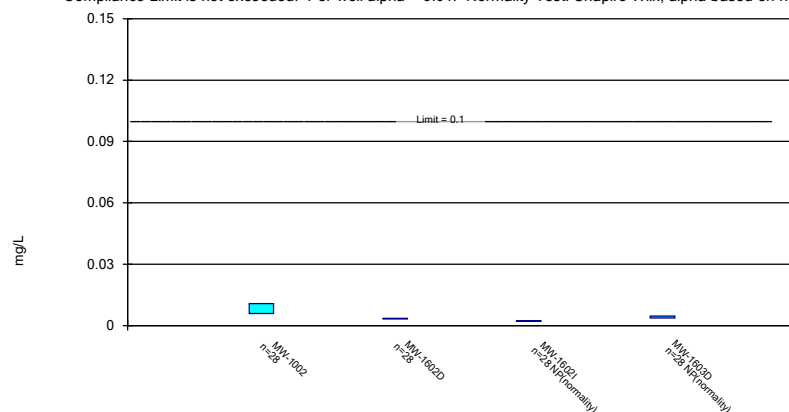

Constituent: Molybdenum, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

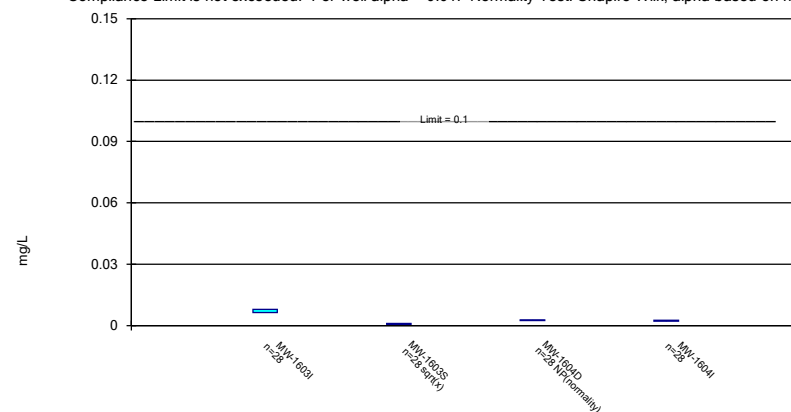

Constituent: Molybdenum, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

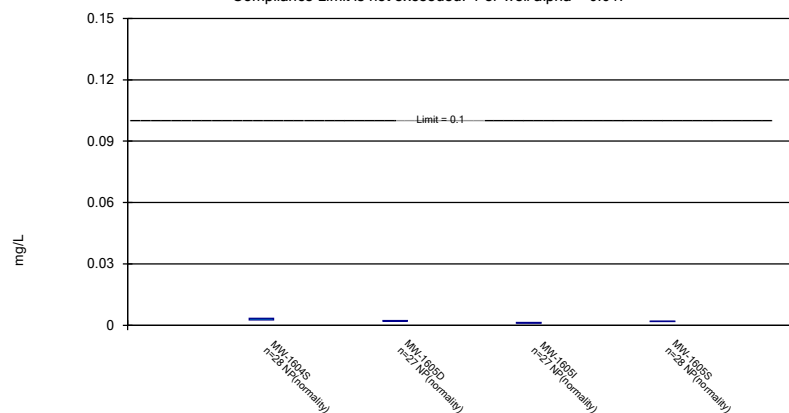


Constituent: Molybdenum, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

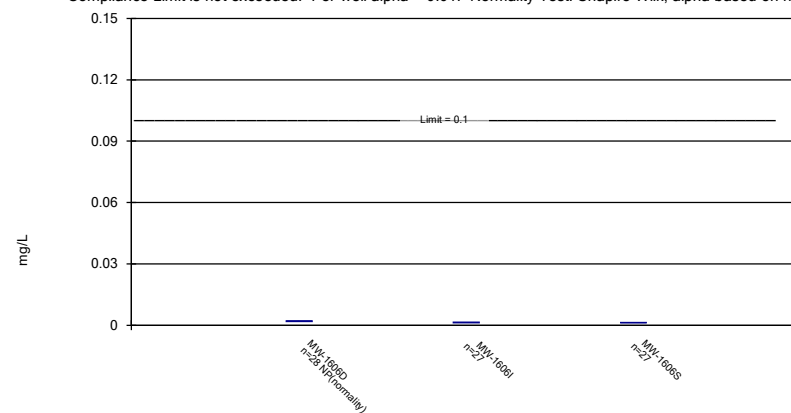


Constituent: Molybdenum, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

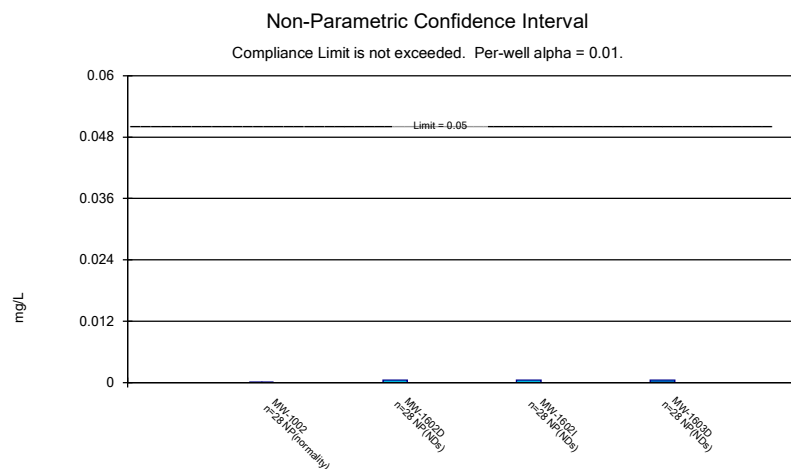


Constituent: Selenium, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

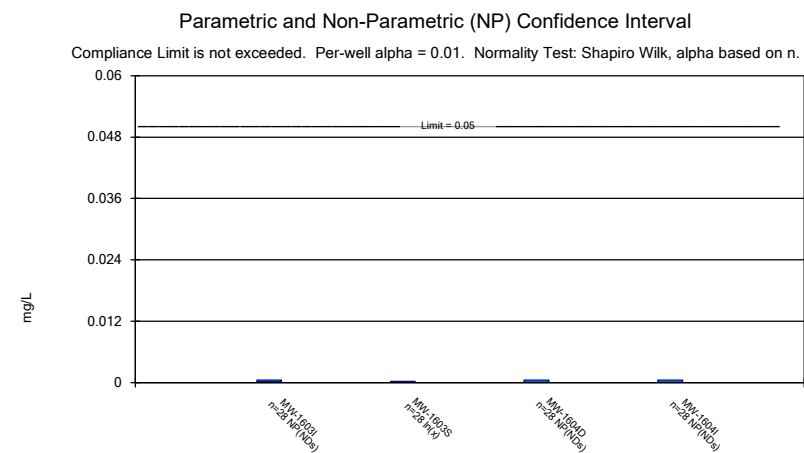


Constituent: Selenium, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

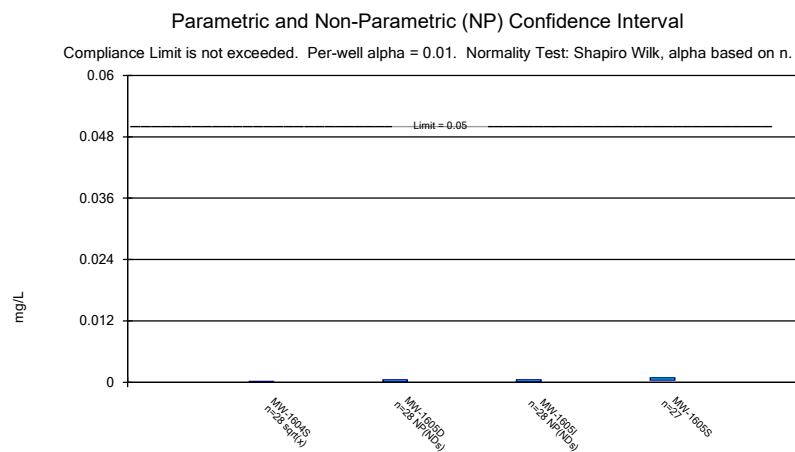


Constituent: Selenium, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

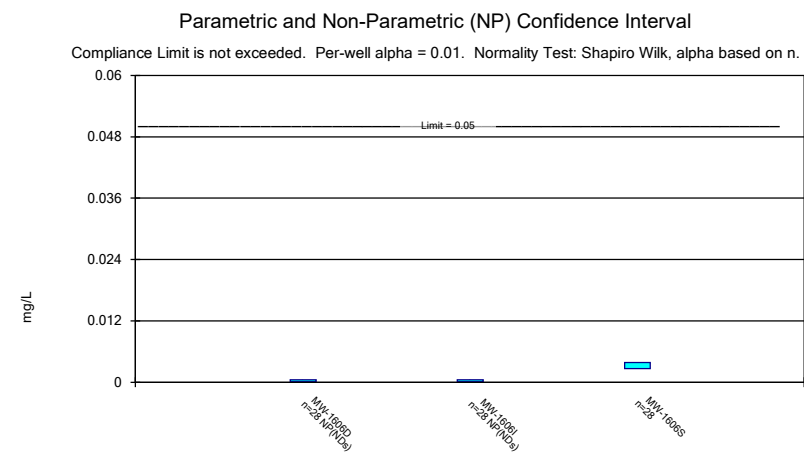


Constituent: Selenium, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

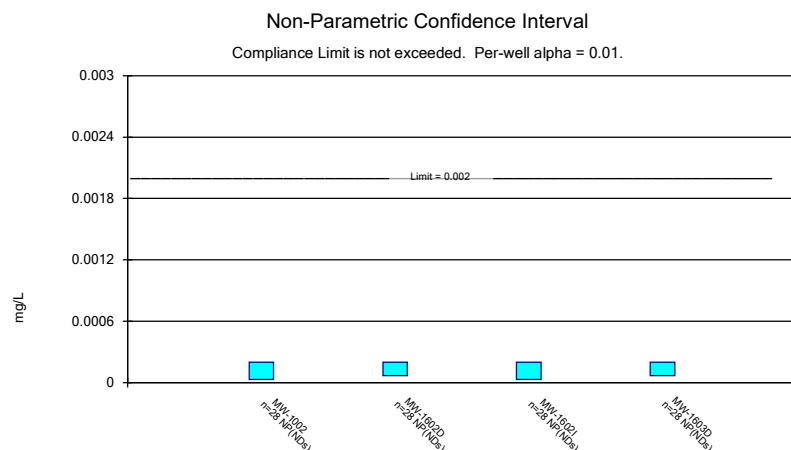


Constituent: Thallium, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

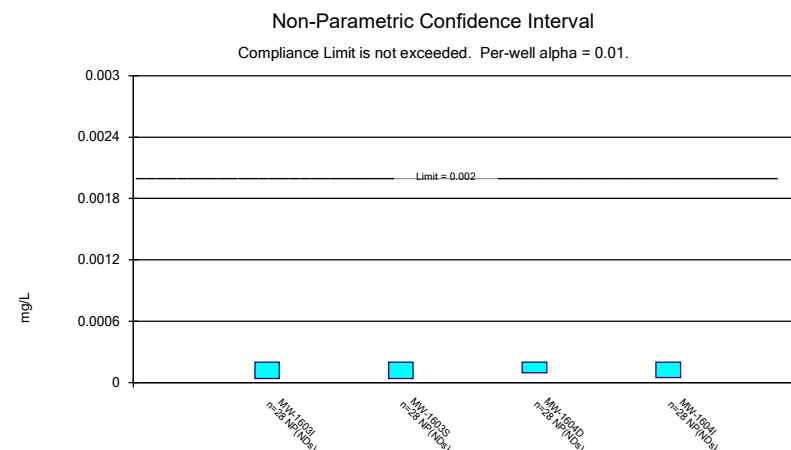

Constituent: Thallium, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

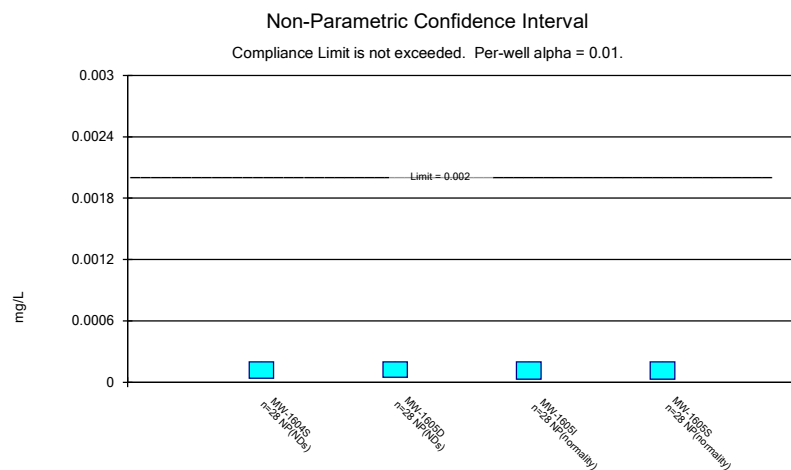

Constituent: Thallium, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

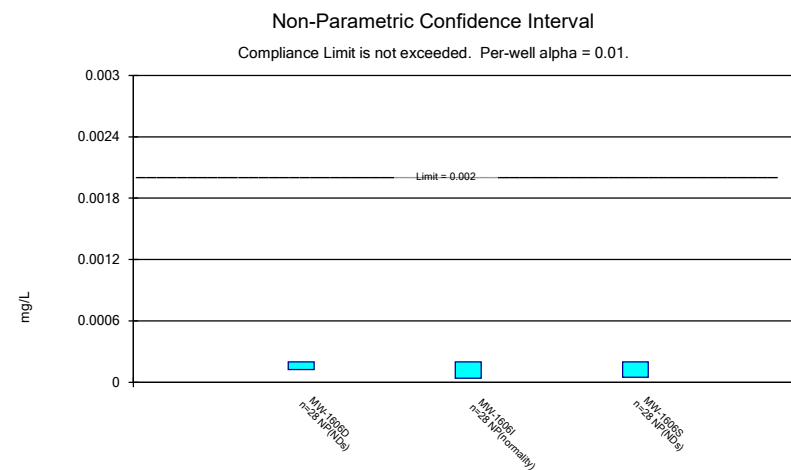

Constituent: Thallium, total Analysis Run 1/24/2025 9:00 AM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

STATISTICAL ANALYSIS SUMMARY, 2025 1ST SEMIANNUAL EVENT EAST AND WEST BOTTOM ASH PONDS

**Rockport Plant
Rockport, Indiana**

Prepared for

American Electric Power
1 Riverside Plaza
Columbus, Ohio 43215-2372

Prepared by

Geosyntec Consultants, Inc.
500 West Wilson Bridge Road, Suite 250
Worthington, Ohio 43085

Project Number: CHA1147G

September 2025

TABLE OF CONTENTS

1. INTRODUCTION	1
2. BOTTOM ASH POND EVALUATION.....	2
2.1 Data Validation and QA/QC	2
2.2 Statistical Analysis	2
2.2.1 Evaluation of Potential Appendix IV SSLs.....	2
2.2.2 Evaluation of Potential Appendix III SSIs	2
2.3 Conclusions	3
3. REFERENCES	4

LIST OF TABLES

Table 1:	Groundwater Data Summary
Table 2:	Appendix IV Groundwater Protection Standards
Table 3:	Appendix III Data Summary

LIST OF ATTACHMENTS

Attachment A:	Certification by Qualified Professional Engineer
Attachment B:	Statistical Analysis Output

ACRONYMS AND ABBREVIATIONS

BAP	Bottom Ash Pond
CCR	coal combustion residuals
CFR	code of federal regulations
GWPS	groundwater protection standard
mg/L	milligrams per liter
QA/QC	quality assurance and quality control
SSI	statistically significant increase
SSL	statistically significant level
TDS	total dissolved solids
UPL	upper prediction limit

1. INTRODUCTION

In accordance with United States Environmental Protection Agency regulations regarding the disposal of coal combustion residuals (CCR) in landfills and surface impoundments (Code of Federal Regulations [CFR] Title 40, Section 257, Subpart D, “CCR rule”), groundwater monitoring has been conducted at the East and West Bottom Ash Ponds (BAP), an existing CCR unit at the Rockport Power Plant in Rockport, Indiana. One groundwater network monitors both of the bottom ash ponds as a single unit as allowed by 40 CFR 257.91(d). Recent groundwater monitoring results were used to identify concentrations of Appendix IV constituents that are above site-specific groundwater protection standards (GWPSs).

Based on detection monitoring conducted in 2017 and 2018, statistically significant increases (SSIs) over background were concluded for boron, chloride, fluoride, sulfate, and total dissolved solids (TDS) at the BAP. An alternative source was not identified at the time; thus, the BAP has been in assessment monitoring since 2018. During the previous assessment monitoring event, conducted in November 2024, Appendix III detections of boron, calcium, chloride, fluoride, sulfate, and TDS were observed above background levels, and the unit remained in assessment monitoring (Geosyntec 2025).

An annual sampling event at the BAP for the Appendix IV parameters, as required by 40 CFR 257.95(b), was completed in February 2025, and a semiannual sampling event for the Appendix III and Appendix IV parameters, as required by 40 CFR 257.95(d)(1), was completed in May 2025. The results of these annual and semiannual assessment monitoring events are documented in this report.

Before the statistical analyses were conducted, the groundwater data underwent several validation tests, including those for completeness, sample tracking accuracy, transcription errors, and consistent use of measurement units. No data quality issues that would impact data usability were identified.

The monitoring data were submitted to Groundwater Stats Consulting, LLC for statistical analysis. Confidence intervals were calculated from the Appendix IV parameter data at the compliance wells to assess whether any were present at statistically significant levels (SSLs) above the previously established GWPS. No SSLs were identified; however, concentrations of Appendix III parameters remained above background. Therefore, the unit will remain in assessment monitoring. Certification of the selected statistical methods by a qualified professional engineer is documented in Attachment A.

2. BOTTOM ASH POND EVALUATION

2.1 Data Validation and QA/QC

Samples were collected for analysis from each upgradient and downgradient well to meet the requirements of 40 CFR 257.95(b) in February 2025 and 40 CFR 257.95(d)(1) in May 2025 as part of the assessment monitoring program. Samples from the May 2025 sampling event were analyzed for all Appendix III and Appendix IV parameters, whereas samples from the February 2025 event were analyzed for Appendix IV parameters only. A summary of data collected during these assessment monitoring events may be found in Table 1.

Chemical analysis was completed by a National Environmental Laboratory Accreditation Program–certified analytical laboratory. The laboratory completed analysis of quality assurance and quality control (QA/QC) samples such as laboratory reagent blanks, continuing calibration verification samples, and laboratory fortified blanks.

The analytical data were imported into a Microsoft Access database, where checks were completed to assess the accuracy of sample location identification and analyte identification. Where necessary, unit conversions were applied to standardize reported units across all sampling events. Exported data files were created for use with the Sanitas™ v.10.0.27 statistics software. The export file was checked against the analytical data for transcription errors and completeness. No QA/QC issues that would impact data usability were noted.

2.2 Statistical Analysis

Statistical analyses for the BAP were conducted in accordance with the October 2020 *Statistical Analysis Plan* (Geosyntec 2020). Time series plots and results for all completed statistical tests are provided in Attachment B. The data obtained in February and May 2025 were screened for potential outliers. No outliers were identified for these events.

2.2.1 Evaluation of Potential Appendix IV SSLs

A confidence interval was constructed for each Appendix IV parameter at each compliance well. Confidence limits were generally calculated parametrically ($\alpha = 0.01$); however, nonparametric confidence limits were calculated in some cases (e.g., when the data were not normally distributed or when the nondetect frequency was too high). An SSL was concluded if the lower confidence limit was above the GWPS (i.e., if the entire confidence interval was above the GWPS). The calculated confidence limits (Attachment B) were compared to the GWPSs provided in Table 2. The GWPSs were reestablished during the previous statistical analysis completed after the second semiannual event of 2024 as either (a) the background concentration or (b) the maximum contaminant level and risk-based levels specified in 40 CFR 257.95(h)(2), whichever was greater (Geosyntec 2025).

No SSLs were identified at the Rockport BAP.

2.2.2 Evaluation of Potential Appendix III SSIs

The Appendix III results were analyzed to assess whether concentrations of Appendix III parameters at the compliance wells were above background concentrations. Data collected during

the May 2025 assessment monitoring event from each compliance well were compared to previously established prediction limits to assess whether the results were statistically above background values (Table 3). The SSIs above the upper prediction limits (UPLs) were noted:

- Boron concentrations were above the interwell UPL of 0.208 milligrams per liter (mg/L) at MW-1002 (1.02 mg/L), MW-1603S (0.894 mg/L), MW-1604I (0.297 mg/L), MW-1604S (0.529 mg/L), MW-1605I (0.249 mg/L), and MW-1605S (0.501 mg/L).
- Calcium concentrations were above the intrawell UPL of 96.1 mg/L at MW-1602I (125 mg/L) and the intrawell UPL of 95.3 mg/L at MW-1603D (109 mg/L).
- The chloride concentration was above the interwell UPL of 46.4 mg/L at MW-1602D (57.4 mg/L).
- Fluoride concentrations exceeded the interwell UPL of 0.700 mg/L at MW-1002 (0.88 mg/L), MW-1603S (1.02 mg/L), and MW-1604S (0.98 mg/L).
- Sulfate concentrations exceeded the interwell UPL of 76.0 mg/L at MW-1602I (378 mg/L), MW-1603D (150 mg/L), MW-1603I (142 mg/L), MW-1603S (93.7 mg/L), MW-1604I (157 mg/L), MW-1604S (154 mg/L), MW-1605I (205 mg/L) and MW-1605S (155 mg/L).
- TDS concentrations exceeded the interwell UPL of 446 mg/L at MW-1002 (450 mg/L), MW-1602I (860 mg/L), MW-1603D (580 mg/L), MW-1603I (560 mg/L), MW-1603S (450 mg/L), MW-1604I (520 mg/L), MW-1604S (510 mg/L), MW-1605I (600 mg/L), and MW-1605S (540 mg/L).

While the prediction limits were calculated for a one-of-two retesting procedure, SSIs were conservatively assumed if the May 2025 sample was above the UPL or, in the case of pH, below the lower prediction limit. Based on this evaluation, concentrations of Appendix III constituents appear to be above background concentrations, and the unit will remain in assessment monitoring.

2.3 Conclusions

Annual and semiannual assessment monitoring events were conducted in accordance with the CCR Rule. The laboratory and field data were reviewed prior to statistical analysis, with no QA/QC issues identified that prevented data usage. A review of outliers identified no potential outliers in the February and May 2025 data. A confidence interval was constructed at each compliance well for each Appendix IV parameter; SSLs were concluded if the entire confidence interval was above the GWPS. No SSLs were identified. Appendix III parameters were compared to prediction limits; concentrations of boron, calcium, chloride, fluoride, sulfate, and TDS were identified above the prediction limits.

Based on this evaluation, the Rockport BAP CCR unit will remain in assessment monitoring.

3. REFERENCES

Geosyntec. 2020. *Statistical Analysis Plan – Rockport Plant*. Geosyntec Consultants, Inc. October.

Geosyntec. 2025. *Statistical Analysis Summary, 2024 2nd Semiannual Event – East and West Bottom Ash Ponds, Rockport Plant, Rockport, Indiana*. Geosyntec Consultants, Inc. March.

TABLES

Table 1. Groundwater Data Summary
Statistical Analysis Summary
Rockport Plant – East and West Bottom Ash Ponds

Parameter	Unit	MW-1002		MW-1600D		MW-1600I			MW-1600S		MW-1601D		MW-1601I	
		2/4/2025	5/13/2025	2/4/2025	5/14/2025	2/4/2025	2/5/2025	5/14/2025	2/4/2025	5/15/2025	2/5/2025	5/15/2025	2/5/2025	5/14/2025
Antimony	µg/L	0.045 J1	0.056 J1	0.1 U1	0.011 J1	--	0.048 J1	0.033 J1	0.5 U1	0.016 J1	0.028 J1	0.1 U1	0.008 J1	0.011 J1
Arsenic	µg/L	0.21	0.23	16.0	13.8	--	22.2	18.3	0.4 J1	0.34	11.4	11.3	17.3	17.9
Barium	µg/L	13.7	10.6	764	758	--	657 M1	664	22.7	17.7	507	471	548	574
Beryllium	µg/L	0.05 U1	0.05 U1	0.05 U1	0.008 J1	--	0.05 U1	0.05 U1	0.25 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1
Boron	mg/L	--	1.02	--	0.018 J1	--	--	0.021 J1	--	0.033 J1	--	0.030 J1	--	0.025 J1
Cadmium	µg/L	0.020	0.011 J1	0.02 U1	0.004 J1	--	0.018 J1	0.005 J1	0.1 U1	0.006 J1	0.033	0.02 U1	0.02 U1	0.006 J1
Calcium	mg/L	--	51.6	--	76.8	--	--	72.6	--	58.5	--	85.1	--	79.7
Chloride	mg/L	--	22.9	--	30.3	--	--	24.5	--	21.8	--	18.1	--	28.3
Chromium	µg/L	0.29 J1	0.28 J1	0.37	0.37	--	0.39	0.40	0.5 J1	0.38	0.38	0.27 J1	0.43	0.27 J1
Cobalt	µg/L	0.450	0.232	0.052	0.082	--	1.31	1.15	0.04 J1	0.030	0.059	0.046	1.13	1.17
Combined Radium	pCi/L	1.45	0.34	1.6	0.98	--	2.42	2.65	0.82	0.59	1.22	1.43	1.08	1.57
Fluoride	mg/L	1.13	0.88	0.25	0.21	--	0.27	0.23	0.42	0.52	0.20	0.17	0.27	0.24
Lead	µg/L	0.2 U1	0.2 U1	0.2 U1	0.10 J1	--	0.28	0.08 J1	1 U1	0.2 U1	0.08 J1	0.2 U1	0.2 U1	0.2 U1
Lithium	mg/L	0.00635	0.00738	0.00577	0.00528	--	0.00671	0.00649	0.0157	0.00951	0.00136	0.00097	0.00639	0.00616
Mercury	µg/L	0.005 U1	0.005 U1	0.005 U1	0.005 U1	--	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1
Molybdenum	µg/L	11.9	9.5	1.8	2.5	--	1.8	1.7	0.5 J1	0.6	3.3	3.4	2.2	2.3
Selenium	µg/L	0.07 J1	0.09 J1	0.5 U1	0.5 U1	--	0.5 U1	0.5 U1	0.8 J1	0.68	0.07 J1	0.5 U1	0.5 U1	0.5 U1
Sulfate	mg/L	--	68.3	--	41.1	--	--	51.9	--	29.1	--	16.9	--	49.1
Thallium	µg/L	0.2 U1	0.02 J1	0.2 U1	0.2 U1	--	0.2 U1	0.2 U1	1 U1	0.2 U1	0.06 J1	0.2 U1	0.2 U1	0.03 J1
Total Dissolved Solids	mg/L	--	450	--	390	--	--	390	--	370	--	420	--	400
pH	SU	7.3	7.5	7.0	6.5	7.3	--	7.2	6.6	6.9	7.2	6.9	7.1	7.1

Notes:
--: not measured
J1: Estimated value. Parameter was detected in concentrations below the reporting limit.
M1: The associated matrix spike (MS) or matrix spike duplicate (MSD) recovery was outside acceptance limits.
mg/L: milligrams per liter
pCi/L: picocuries per liter
S7: Sample did not achieve constant weight.
SU: standard unit
U1: Non-detect value. For statistical analysis, parameters which were not detected were replaced with the reporting limit.
µg/L: micrograms per liter

Table 1. Groundwater Data Summary
Statistical Analysis Summary
Rockport Plant – East and West Bottom Ash Ponds

Parameter	Unit	MW-1601S		MW-1602D		MW-1602I		MW-1603D		MW-1603I		MW-1603S	
		2/4/2025	5/14/2025	2/4/2025	5/14/2025	2/4/2025	5/14/2025	2/6/2025	5/13/2025	2/5/2025	5/13/2025	2/5/2025	5/13/2025
Antimony	µg/L	0.014 J1	0.015 J1	0.010 J1	0.1 U1	0.022 J1	0.022 J1	0.011 J1	0.012 J1	0.018 J1	0.065 J1	0.033 J1	0.033 J1
Arsenic	µg/L	1.96	1.93	9.80	9.23	21.1	21.6	12.6	13.8	14.2	14.1	0.17	0.16
Barium	µg/L	29.4	31.8	454	399	80.0	60.4	167 M1	176	74.0	124	10.6	15.6
Beryllium	µg/L	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.009 J1	0.010 J1	0.05 U1	0.05 U1
Boron	mg/L	--	0.118	--	0.045 J1	--	0.061	--	0.032 J1	--	0.061	--	0.894
Cadmium	µg/L	0.02 U1	0.009 J1	0.02 U1	0.02 U1	0.02 U1	0.02 U1	0.02 U1	0.02 U1	0.007 J1	0.008 J1	0.034	0.042
Calcium	mg/L	--	68.5	--	64.1	--	125	--	109	--	83.0 M1	--	75.3
Chloride	mg/L	--	44.5	--	57.4	--	28.1	--	34.8	--	33.6	--	25.6
Chromium	µg/L	0.38	0.22 J1	0.36	0.36	0.36	0.29 J1	0.35	0.30	0.55	0.57	0.37	0.31
Cobalt	µg/L	0.050	0.008 J1	0.060	0.023	1.62	1.77	0.286	0.295	0.426	1.20	0.322	0.356
Combined Radium	pCi/L	0.43	0.53	2.42	1.85	2.55	1.55	1.1	0.74	1.25	1.41	0.8	0.62
Fluoride	mg/L	0.40	0.37	0.36	0.33	0.31	0.25	0.30	0.25	0.38	0.39	1.10	1.02
Lead	µg/L	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.26	0.35	0.2 U1	0.2 U1
Lithium	mg/L	0.00601	0.00560	0.00245	0.00204	0.00633	0.00583	0.00398	0.00349	0.00428	0.00690	0.00441	0.00557
Mercury	µg/L	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1
Molybdenum	µg/L	1.6	1.8	3.3	3.4	2.6	2.3	3.0	3.6	4.4	6.1	1.6	2.3
Selenium	µg/L	1.42	0.77	0.5 U1	0.5 U1	0.08 J1	0.5 U1	0.5 U1	0.5 U1	0.5 U1	0.05 J1	0.13 J1	0.11 J1
Sulfate	mg/L	--	41.6	--	22.1	--	378	--	150	--	142	--	93.7
Thallium	µg/L	0.2 U1	0.04 J1	0.2 U1	0.2 U1	0.02 J1	0.02 J1	0.2 U1	0.2 U1	0.2 U1	0.03 J1	0.2 U1	0.06 J1
Total Dissolved Solids	mg/L	--	410	--	400	--	860	--	580	--	560	--	450
pH	SU	7.5	7.3	7.4	7.2	7.4	7.3	7.2	7.2	7.4	7.3	7.1	7.1

Notes:
--: not measured
J1: Estimated value. Parameter was detected in concentrations below the reporting limit.
M1: The associated matrix spike (MS) or matrix spike duplicate (MSD) recovery was outside acceptance limits.
mg/L: milligrams per liter
pCi/L: picocuries per liter
S7: Sample did not achieve constant weight.
SU: standard unit
U1: Non-detect value. For statistical analysis, parameters which were not detected were replaced with the reporting limit.
µg/L: micrograms per liter

Table 1. Groundwater Data Summary
Statistical Analysis Summary
Rockport Plant – East and West Bottom Ash Ponds

Parameter	Unit	MW-1604D		MW-1604I		MW-1604S		MW-1605D		MW-1605I		MW-1605S		
		2/5/2025	5/14/2025	2/5/2025	5/15/2025	2/5/2025	5/15/2025	2/5/2025	5/14/2025	2/5/2025	5/14/2025	2/4/2025	2/5/2025	5/13/2025
Antimony	µg/L	0.1 U1	0.010 J1	0.024 J1	0.023 J1	0.053 J1	0.053 J1	0.1 U1	0.031 J1	0.030 J1	0.028 J1	0.038 J1	--	0.121
Arsenic	µg/L	17.5	17.3	16.8	15.6	0.15	0.14	20.0	19.8	16.2	15.5	0.46	--	0.54
Barium	µg/L	267	215	119	106	13.3	13.6	438	437	156	150	5.86	--	10.6
Beryllium	µg/L	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1	--	0.013 J1
Boron	mg/L	--	0.019 J1	--	0.297	--	0.529	--	0.016 J1	--	0.249	--	--	0.501
Cadmium	µg/L	0.02 U1	0.032	0.02 U1	0.043	0.022	0.036	0.02 U1	0.02 U1	0.004 J1	0.005 J1	0.044	--	0.110
Calcium	mg/L	--	67.1	--	72.1	--	70.9	--	78.4	--	89.5	--	--	67.3
Chloride	mg/L	--	16.2	--	35.0	--	40.8	--	25.4	--	42.2	--	--	38.0
Chromium	µg/L	0.34	0.34	0.25 J1	0.21 J1	0.25 J1	0.45	0.22 J1	0.20 J1	0.23 J1	0.18 J1	0.51	--	1.21
Cobalt	µg/L	0.048	0.026	0.892	0.936	0.290	0.388	0.042	0.034	1.47	1.48	0.320	--	0.584
Combined Radium	pCi/L	0.91	0.65	1.24	1.23	1.05	0.6	1.03	1.74	3.33	2.32	0.88	--	0.86
Fluoride	mg/L	0.30	0.26	0.40	0.37	0.93	0.98	0.23	0.20	0.23	0.19	0.66	--	0.62
Lead	µg/L	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.08 J1	0.2 U1	0.2 U1	--	5.39
Lithium	mg/L	0.00149	0.00128	0.00815	0.00742	0.0120	0.0112	0.00153	0.00141	0.00575	0.00629	0.0113	--	0.00934
Mercury	µg/L	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	--	0.005 U1
Molybdenum	µg/L	2.7	2.3	1.7	1.6	3.6	3.4	1.9	2.0	1.3	1.2	1.7	--	2.0
Selenium	µg/L	0.5 U1	0.5 U1	0.5 U1	0.5 U1	0.5 U1	0.06 J1	0.5 U1	0.5 U1	0.10 J1	0.08 J1	0.08 J1	--	0.23 J1
Sulfate	mg/L	--	20.1	--	157	--	154	--	44.6	--	205	--	--	155
Thallium	µg/L	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.2 U1	0.03 J1	0.05 J1	0.03 J1	--	0.04 J1
Total Dissolved Solids	mg/L	--	310	--	520	--	510	--	360	--	600	--	--	540
pH	SU	7.3	7.3	7.5	7.3	7.5	7.3	6.8	6.8	6.9	7.2	--	7.1	7.4

Notes:
--: not measured
J1: Estimated value. Parameter was detected in concentrations below the reporting limit.
M1: The associated matrix spike (MS) or matrix spike duplicate (MSD) recovery was outside acceptance limits.
mg/L: milligrams per liter
pCi/L: picocuries per liter
S7: Sample did not achieve constant weight.
SU: standard unit
U1: Non-detect value. For statistical analysis, parameters which were not detected were replaced with the reporting limit.
µg/L: micrograms per liter

Table 1. Groundwater Data Summary
Statistical Analysis Summary
Rockport Plant – East and West Bottom Ash Ponds

Parameter	Unit	MW-1606D			MW-1606I		MW-1606S			MW-1701D		MW-1701I	
		2/5/2025	5/13/2025	5/14/2025	2/5/2025	5/13/2025	2/5/2025	5/13/2025	5/14/2025	2/4/2025	5/13/2025	2/4/2025	5/13/2025
Antimony	µg/L	0.009 J1	--	0.010 J1	0.018 J1	0.018 J1	0.031 J1	--	0.036 J1	0.016 J1	0.011 J1	0.023 J1	0.067 J1
Arsenic	µg/L	16.3	--	16.5	15.8	13.0	0.14	--	0.14	8.75	9.36	9.38	34.4
Barium	µg/L	430	--	461	51.8	57.2	12.2	--	10.3	57.3	61.0	38.4	40.6
Beryllium	µg/L	0.05 U1	--	0.05 U1	0.05 U1	0.05 U1	0.05 U1	--	0.05 U1	0.05 U1	0.05 U1	0.05 U1	0.05 U1
Boron	mg/L	--	--	0.018 J1	--	0.015 J1	--	--	0.021 J1	--	0.019 J1	--	0.017 J1
Cadmium	µg/L	0.02 U1	--	0.02 U1	0.004 J1	0.02 U1	0.029	--	0.049	0.023	0.005 J1	0.004 J1	0.006 J1
Calcium	mg/L	--	--	78.1	--	66.8	--	--	51.8	--	66.8	--	64.8
Chloride	mg/L	--	--	32.7	--	15.1	--	--	33.8	--	15.2	--	16.3
Chromium	µg/L	0.35	--	0.21 J1	0.34	0.53	0.24 J1	--	0.30	0.26 J1	0.18 J1	0.25 J1	0.50
Cobalt	µg/L	0.040	--	0.016 J1	1.09	1.09	0.066	--	0.087	1.41	1.50	1.13	1.51
Combined Radium	pCi/L	0.86	--	0.99	2.27	1.17	1.7	--	0.67	1.03	0.41	0.53	1.35
Fluoride	mg/L	0.21	--	0.17	0.22	0.18	0.54	--	0.43	0.39	0.32	0.47	0.43
Lead	µg/L	0.2 U1	--	0.2 U1	0.2 U1	0.2 U1	0.2 U1	--	0.2 U1	0.2 U1	0.07 J1	0.2 U1	0.13 J1
Lithium	mg/L	0.00057	--	0.00071	0.00336	0.00315	0.00789	--	0.00746	0.00680	0.00533	0.00599	0.00530
Mercury	µg/L	0.005 U1	--	0.005 U1	0.005 U1	0.005 U1	0.005 U1	--	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1
Molybdenum	µg/L	1.7	--	1.8	1.1	1.1	1.5	--	1.7	1.3	1.5	1.1	1.2
Selenium	µg/L	0.5 U1	--	0.5 U1	0.5 U1	0.5 U1	1.91	--	1.98	0.5 U1	0.5 U1	0.5 U1	0.5 U1
Sulfate	mg/L	--	--	28.0	--	44.3	--	--	41.0	--	29.7	--	26.4
Thallium	µg/L	0.2 U1	--	0.2 U1	0.03 J1	0.03 J1	0.2 U1	--	0.2 U1	0.2 U1	0.02 J1	0.2 U1	0.2 U1
Total Dissolved Solids	mg/L	--	--	360	--	330	--	--	400 S7	--	350	--	330
pH	SU	6.8	7.1	--	7.0	7.1	6.6	7.0	--	7.4	7.1	7.5	7.0

Notes:
--: not measured
J1: Estimated value. Parameter was detected in concentrations below the reporting limit.
M1: The associated matrix spike (MS) or matrix spike duplicate (MSD) recovery was outside acceptance limits.
mg/L: milligrams per liter
pCi/L: picocuries per liter
S7: Sample did not achieve constant weight.
SU: standard unit
U1: Non-detect value. For statistical analysis, parameters which were not detected were replaced with the reporting limit.
µg/L: micrograms per liter

Table 1. Groundwater Data Summary
Statistical Analysis Summary
Rockport Plant – East and West Bottom Ash Ponds

Parameter	Unit	MW-1701S		MW-1702D		MW-1702I		MW-1702S	
		2/4/2025	5/13/2025	2/5/2025	5/13/2025	2/5/2025	5/14/2025	2/5/2025	5/14/2025
Antimony	µg/L	0.08 J1	0.06 J1	0.054 J1	0.223	0.117	0.070 J1	0.096 J1	0.032 J1
Arsenic	µg/L	0.5	0.4 J1	19.6	20.2	58.3	34.1	0.44	0.27
Barium	µg/L	6.8	6.4	189	126	109	102	4.29	4.56
Beryllium	µg/L	0.25 U1	0.25 U1	0.05 U1	0.012 J1	0.05 U1	0.05 U1	0.05 U1	0.05 U1
Boron	mg/L	--	0.25 U1	--	0.022 J1	--	0.014 J1	--	0.032 J1
Cadmium	µg/L	0.07 J1	0.1 U1	0.016 J1	0.025	0.071	0.107	0.050	0.021
Calcium	mg/L	--	60.6	--	46.7	--	70.3	--	38.7
Chloride	mg/L	--	23.3	--	24.0	--	32.3	--	18.3
Chromium	µg/L	1.5 U1	0.4 J1	0.28 J1	0.39	0.34	0.22 J1	0.54	0.28 J1
Cobalt	µg/L	0.09 J1	0.1 U1	0.472	0.506	1.39	1.21	0.035	0.02 U1
Combined Radium	pCi/L	0.51	0.43	1.44	0.89	2.11	1.04	1.01	0.85
Fluoride	mg/L	0.41	0.35	0.22	0.17	0.27	0.23	0.60	0.56
Lead	µg/L	1 U1	1 U1	0.21	0.29	0.06 J1	0.2 U1	0.14 J1	0.2 U1
Lithium	mg/L	0.0054	0.0052	0.00431	0.00422	0.00436	0.00416	0.00177	0.00160
Mercury	µg/L	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1	0.005 U1
Molybdenum	µg/L	0.7 J1	0.8 J1	2.0	2.1	2.1	2.1	1.7	1.5
Selenium	µg/L	0.6 J1	0.6 J1	0.5 U1	0.26 J1	0.5 U1	0.5 U1	2.24	4.26
Sulfate	mg/L	--	16.4	--	87.8	--	42.5	--	23.0
Thallium	µg/L	1 U1	1 U1	0.2 U1	0.2 U1	0.03 J1	0.03 J1	0.03 J1	0.2 U1
Total Dissolved Solids	mg/L	--	310 S7	--	400	--	370	--	280
pH	SU	7.7	6.9	7.2	6.8	7.3	6.9	7.6	7.3

Notes:
--: not measured
J1: Estimated value. Parameter was detected in concentrations below the reporting limit.
M1: The associated matrix spike (MS) or matrix spike duplicate (MSD) recovery was outside acceptance limits.
mg/L: milligrams per liter
pCi/L: picocuries per liter
S7: Sample did not achieve constant weight.
SU: standard unit
U1: Non-detect value. For statistical analysis, parameters which were not detected were replaced with the reporting limit.
µg/L: micrograms per liter

Table 2. Appendix IV Groundwater Protection Standards
Statistical Analysis Summary
Rockport Plant – East and West Bottom Ash Ponds

Geosyntec Consultants, Inc.

Constituent Name	MCL	CCR Rule-Specified	Calculated UTL	GWPS
Antimony, Total (mg/L)	0.00600		0.000440	0.00600
Arsenic, Total (mg/L)	0.0100		0.0791	0.0791
Barium, Total (mg/L)	2.00		1.20	2.00
Beryllium, Total (mg/L)	0.00400		0.000106	0.00400
Cadmium, Total (mg/L)	0.00500		0.000280	0.00500
Chromium, Total (mg/L)	0.100		0.00205	0.100
Cobalt, Total (mg/L)	n/a	0.00600	0.00334	0.00600
Combined Radium, Total (pCi/L)	5.00		2.79	5.00
Fluoride, Total (mg/L)	4.00		0.700	4.00
Lead, Total (mg/L)	n/a	0.0150	0.00497	0.0150
Lithium, Total (mg/L)	n/a	0.0400	0.0380	0.0400
Mercury, Total (mg/L)	0.00200		0.00000500	0.00200
Molybdenum, Total (mg/L)	n/a	0.100	0.00867	0.100
Selenium, Total (mg/L)	0.0500		0.00437	0.0500
Thallium, Total (mg/L)	0.00200		0.000200	0.00200

Notes:

1. Calculated UTL (upper tolerance limit) represents site-specific background values.
2. Grey cells indicate the GWPS is based on the calculated UTL, which is higher than the MCL or CCR Rule-specified value.

CCR: coal combustion residuals

GWPS: groundwater protection standard

MCL: maximum contaminant level

mg/L: milligrams per liter

n/a: not applicable

pCi/L: picocuries per liter

Table 3. Appendix III Data Summary
Statistical Analysis Summary
Rockport Plant – Bottom Ash Pond

Analyte	Unit	Description	MW-1002	MW-1602D	MW-1602I	MW-1603D	MW-1603I	MW-1603S	MW-1604D	MW-1604I	MW-1604S
			5/13/2025	5/14/2025	5/14/2025	5/13/2025	5/13/2025	5/13/2025	5/14/2025	5/15/2025	5/15/2025
Boron	mg/L	Interwell Background Value (UPL)	0.208								
		Analytical Result	1.02	0.045	0.061	0.032	0.061	0.894	0.019	0.297	0.529
Calcium	mg/L	Intrawell Background Value (UPL)	80.7	81.2	96.1	95.3	104	89.5	77.9	87.6	111
		Analytical Result	51.6	64.1	125	109	83.0	75.3	67.1	72.1	70.9
Chloride	mg/L	Interwell Background Value (UPL)	46.4								
		Analytical Result	22.9	57.4	28.1	34.8	33.6	25.6	16.2	35.0	40.8
Fluoride	mg/L	Interwell Background Value (UPL)	0.700								
		Analytical Result	0.88	0.33	0.25	0.25	0.39	1.02	0.26	0.37	0.98
pH	SU	Intrawell Background Value (UPL)	8.2	8.1	7.9	8.1	8.1	7.8	7.7	7.9	8.0
		Intrawell Background Value (LPL)	5.5	6.5	6.5	6.0	5.8	5.8	6.5	6.7	6.7
		Analytical Result	7.5	7.2	7.3	7.2	7.3	7.1	7.3	7.3	7.3
Sulfate	mg/L	Interwell Background Value (UPL)	76.0								
		Analytical Result	68.3	22.1	378	150	142	93.7	20.1	157	154
Total Dissolved Solids	mg/L	Interwell Background Value (UPL)	446								
		Analytical Result	450	400	860	580	560	450	310	520	510

Analyte	Unit	Description	MW-1605D	MW-1605I	MW-1605S	MW-1606D*	MW-1606I	MW-1606S*
			5/14/2025	5/14/2025	5/13/2025	5/14/2025	5/13/2025	5/14/2025
Boron	mg/L	Interwell Background Value (UPL)	0.208					
		Analytical Result	0.016	0.249	0.501	0.018	0.015	0.021
Calcium	mg/L	Intrawell Background Value (UPL)	96.3	105	91.3	91.6	87.9	68.3
		Analytical Result	78.4	89.5	67.3	78.1	66.8	51.8
Chloride	mg/L	Interwell Background Value (UPL)	46.4					
		Analytical Result	25.4	42.2	38.0	32.7	15.1	33.8
Fluoride	mg/L	Interwell Background Value (UPL)	0.700					
		Analytical Result	0.20	0.19	0.62	0.17	0.18	0.43
pH	SU	Intrawell Background Value (UPL)	7.5	7.7	7.6	8.4	8.3	7.9
		Intrawell Background Value (LPL)	6.7	6.7	6.6	6.4	6.5	6.1
		Analytical Result	6.8	7.2	7.4	7.1	7.1	7.0
Sulfate	mg/L	Interwell Background Value (UPL)	76.0					
		Analytical Result	44.6	205	155	28.0	44.3	41.0
Total Dissolved Solids	mg/L	Interwell Background Value (UPL)	446					
		Analytical Result	360	600	540	360	330	400

Notes:

1. Bold values exceed the background value.

2. Background values are shaded gray.

*: well purged dry and sampled next day. pH value taken on 05/13/25.

LPL: lower prediction limit

mg/L: milligrams per liter

SU: standard units

UPL: upper prediction limit

ATTACHMENT A

Certification by Qualified Professional Engineer

Certification by Qualified Professional Engineer

I certify that selected and above described statistical method is appropriate for evaluating the groundwater monitoring data for the Rockport East and West Bottom Ash Ponds CCR management area and that the requirements of 40 CFR 257.93(f) have been met.

David Anthony Miller

Printed Name of Licensed Professional Engineer

David Anthony Miller

Signature



11700730

License Number

Indiana

Licensing State

09.10.2025

Date


ATTACHMENT B

Statistical Analysis Output

GROUNDWATER STATS CONSULTING

August 7, 2025

Geosyntec Consultants
Attn: Ms. Allison Kreinberg
500 W. Wilson Bridge, Ste. #250
Worthington, OH 43085

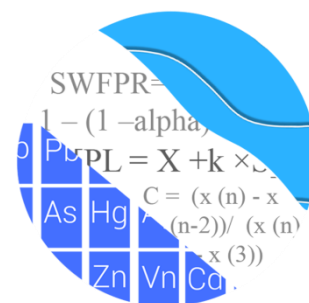

Re: Rockport Bottom Ash Pond
February & May 2025 Assessment Monitoring Analysis

Dear Ms. Kreinberg,

Groundwater Stats Consulting (GSC), formerly the statistical consulting division of Sanitas Technologies, is pleased to provide the statistical evaluation of groundwater data for the February & May 2025 Assessment Monitoring events at American Electric Power Inc.'s Rockport Bottom Ash Pond. The analysis complies with the federal rule for the Disposal of Coal Combustion Residuals from Electric Utilities (CCR Rule, 2015) as well as with the United States Environmental Protection Agency (USEPA) Unified Guidance (2009).

Sampling began at the site for the Coal Combustion Residuals (CCR) program in 2016. The monitoring well network, as provided by Geosyntec Consultants, consists of the following:

- **Upgradient wells:** MW-1600D, MW-1600I, MW-1600S, MW-1601D, MW-1601I, MW-1601S; MW-1701S, MW-1702D, MW-1702I, MW-1702S, MW-1701D, and MW-1701I
- **Downgradient wells:** MW-1002, MW-1602D, MW-1602I, MW-1603D, MW-1603I, MW-1603S, MW-1604D, MW-1604I, MW-1604S, MW-1605D, MW-1605I, MW-1605S, MW-1606D, MW-1606I, and MW-1606S

Data were sent electronically to Groundwater Stats Consulting, and the statistical analysis was reviewed by Dr. Jim Loftis, Civil & Environmental Engineering professor emeritus at Colorado State University and Senior Advisor to Groundwater Stats Consulting. The

statistical analysis was conducted according to the January 2018 screening evaluation prepared by GSC and approved by Dr. Kirk Cameron.

The CCR program consists of the following constituents:

- **Appendix IV** (Assessment Monitoring) – antimony, arsenic, barium, beryllium, cadmium, chromium, cobalt, combined radium 226 + 228, fluoride, lead, lithium, mercury, molybdenum, selenium, and thallium

Time series plots for all well/constituent pairs are provided and are particularly useful for screening parameters detected in downgradient wells which require statistical analyses (Figure A). Additionally, a separate section of box plots is included for all constituents at both upgradient and downgradient wells (Figure B). The time series plots are used to initially screen for suspected outliers and trends, while the box plots provide visual representation of variation within individual wells and between all wells. Values in background which have been flagged as outliers may be seen in a lighter font and as a disconnected symbol on the graphs.

Due to varying detection limits in background data sets resulting from improved laboratory practices, a substitution of the most recent reporting limit is used for all non-detects. In some cases, the reporting limit provided by the laboratory contained varying limits for a given parameter; therefore, the substitution may differ from well to well. The computed statistical limits, both background and compliance limits, were not adversely affected by these substitutions.

Summary of Statistical Methods

Assessment monitoring for Appendix IV parameters involves the comparison of a confidence interval for each parameter at downgradient wells against the corresponding Groundwater Protection Standard (GWPS). The GWPS is determined for each parameter as the highest limit of the Maximum Contaminant Levels (MCLs) or background limits determined from tolerance limits constructed from pooled upgradient well data.

Prior to computing tolerance limits on upgradient well data or confidence intervals on downgradient well data, the distribution of data is tested using the Shapiro-Wilk/Shapiro-Francia test for normality. After testing for normality and performing any adjustments as discussed below (US EPA, 2009), data are analyzed using either parametric or non-parametric tolerance limits and confidence intervals as appropriate, based on the following criteria.

- No statistical analyses are required on wells and analytes containing 100% non-detects (USEPA Unified Guidance, 2009, Chapter 6).
- When data contain <15% non-detects, simple substitution of one-half the reporting limit is utilized in the statistical analysis. The reporting limit utilized for non-detects is the most practical quantification limit (PQL) as reported by the laboratory.
- When data contain between 15-50% non-detects, the Kaplan-Meier non-detect adjustment is applied to the background data for parametric limits. This technique adjusts the mean and standard deviation of the historical concentrations to account for concentrations below the reporting limit.
- Nonparametric tolerance limits and confidence intervals are used on data containing greater than 50% non-detects or data sets which do not follow a normal or transformed-normal distribution.

Summary of Background Update – Conducted in Fall 2024

Proposed background data from upgradient wells were screened as described below prior to construction of upper tolerance limits for Appendix IV constituents for the November 2024 analysis. These limits are compared to the MCLs for the purpose of establishing GWPS which are updated annually.

Upgradient well data are screened through both visual screening and Tukey's outlier test for potential outliers and extreme trending patterns that would lead to artificially elevated statistical limits. Tukey's test and visual screening with time series graphs confirmed previously flagged outliers. All flagged values may be seen on the Outlier Summary following this letter (Figure C).

Tukey's outlier test on pooled upgradient well data through November 2024 identified outliers for arsenic, barium, combined radium 226 + 228, fluoride, and lithium. Most values identified by Tukey's test were either similar to other concentrations upgradient of the facility or were lower than the respective MCL, with the exception of a high value for lithium in well MW-1600S, which was flagged during the update. All previously flagged values in upgradient wells were confirmed by Tukey's outlier test or visual screening.

Additionally, downgradient well data through November 2024 were screened through visual screening using time series graphs. Since the downgradient well data are used to construct confidence intervals, values that are marginally high relative to the rest of the data are retained unless there is a particular justification for excluding them. One high value for lithium in downgradient well MW-1604S was flagged during the update as it was significantly higher than remaining measurements within this well. Previously flagged

values for cobalt in MW-1606D and lead in wells MW-1603D, 1604S, and 1606S were unflagged as the measurements were found to be similar to surrounding concentrations.

Interwell Upper Tolerance Limits

Interwell upper tolerance limits were used to calculate the site-specific background limits from pooled upgradient well data through November 2024 for Appendix IV parameters (Figure D). These limits are updated on an annual basis and will be updated again during the Fall 2025 sample event report. Parametric tolerance limits are used when data follow a normal or transformed-normal distribution and use a target of 95% confidence and 95% coverage. The confidence and coverage levels for nonparametric tolerance limits are dependent upon the number of background samples. When data contained greater than 50% non-detects or did not follow a normal or transformed-normal distribution, non-parametric tolerance limits were used. Time series for the upgradient wells are included with the upper tolerance limits results.

Groundwater Protection Standards

These background limits were compared to the MCLs as shown in the GWPS table following this letter to determine the highest limit for use as the GWPS in the confidence interval comparisons (Figure E).

Evaluation of Appendix IV Parameters – February & May 2025

Time series plots were used to visually identify potential outliers in downgradient wells through the February & May 2025 sample events. When suspected outliers are identified, Tukey's outlier test may be used to formally test whether measurements are statistically significant. As mentioned above, high outliers are cautiously flagged in the downgradient wells when measurements are clearly much different from remaining data within a given well. Although flagging high values will also reduce the mean and thus lower the entire interval, the intent is to reduce the variance and thus reduce the width of parametric confidence intervals to better represent the actual downgradient mean. No additional suspected outliers were identified.

Confidence Intervals

Confidence intervals were then constructed using all available data through February & May 2025 on downgradient wells for each of the Appendix IV parameters using the highest limit of the MCL, CCR-Rule specified, or background limit as the GWPS, as discussed above (Figure F). These intervals were constructed as either parametric or

nonparametric confidence intervals depending on the data distribution and percentage of non-detects. When data followed a normal or transformed-normal distribution, parametric confidence intervals were used for Appendix IV parameters. Nonparametric confidence intervals were constructed when data did not follow a normal or transformed-normal distribution or when there were greater than 50% non-detects. The lower confidence limit, which is constructed with 99% confidence for parametric confidence intervals, is compared to the GWPS prepared as described above. The confidence level associated with nonparametric confidence intervals is dependent upon the number samples available.

Only when the entire confidence interval is above a GWPS is the well/constituent pair considered to exceed its respective standard. If there is an exceedance of the GWPS, a statistically significant level (SSL) exceedance is identified. No confidence interval exceedances were found for any of the downgradient wells. A summary of the confidence interval results follows this letter.

Trend Test Evaluation

When confidence interval exceedances are identified in downgradient wells, data are further evaluated using the Sen's Slope/Mann Kendall trend test to determine whether concentrations are statistically increasing, decreasing, or stable at the 95% confidence level. The 95% confidence level rapidly identifies statistically significant trends and is recommended in cases with limited sample sizes as well as new downgradient wells. Upgradient wells are included in the trend analyses for all parameters found to exceed their confidence interval in downgradient wells. When similar patterns exist upgradient of the site, it is an indication of variability in groundwater which may be unrelated to practices at the site. Since no exceedances were identified, no trend tests were required.

Thank you for the opportunity to assist you in the statistical analysis of groundwater quality for the Rockport Bottom Ash Pond. If you have any questions or comments, please feel free to contact us.

For Groundwater Stats Consulting,



Abdul Diane
Groundwater Analyst




Andrew T. Collins
Project Manager


FIGURE A

Time Series


Time Series

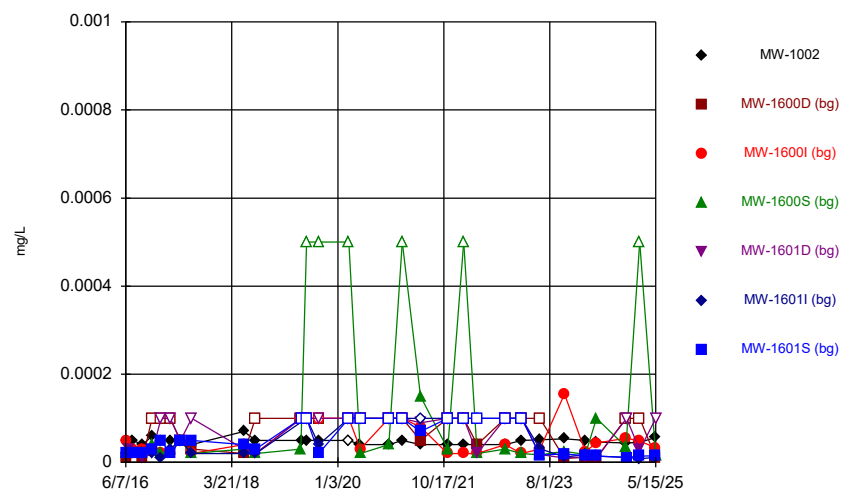


Time Series

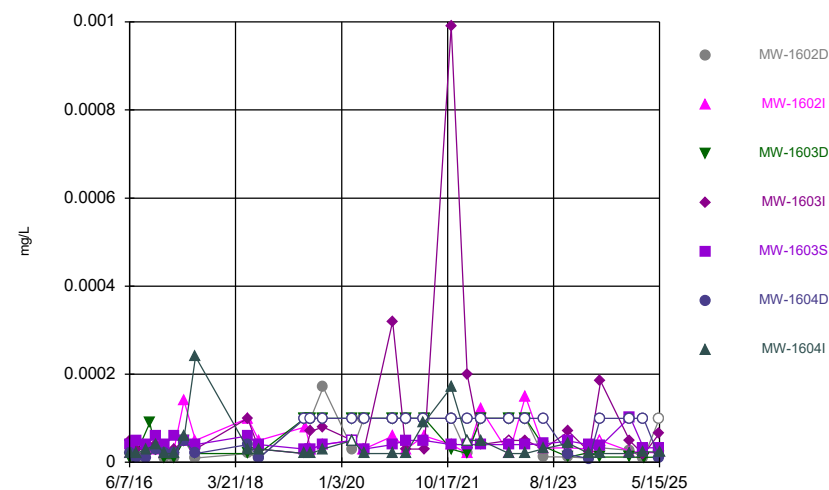


Time Series

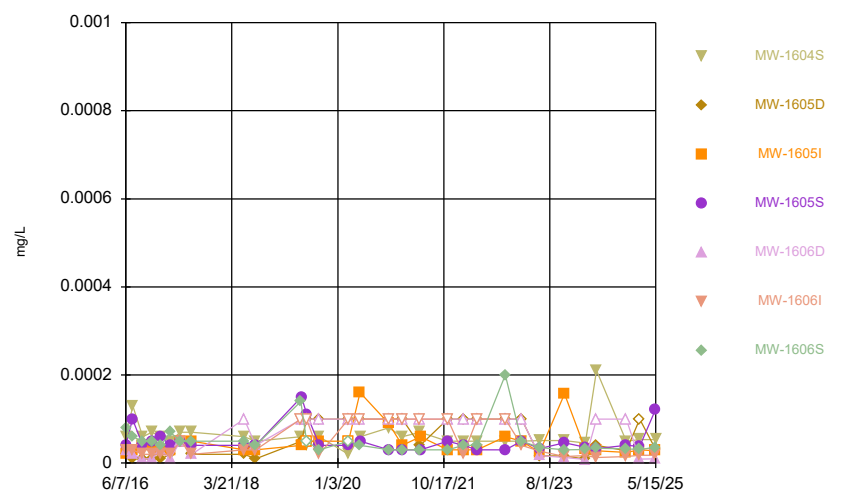


Time Series

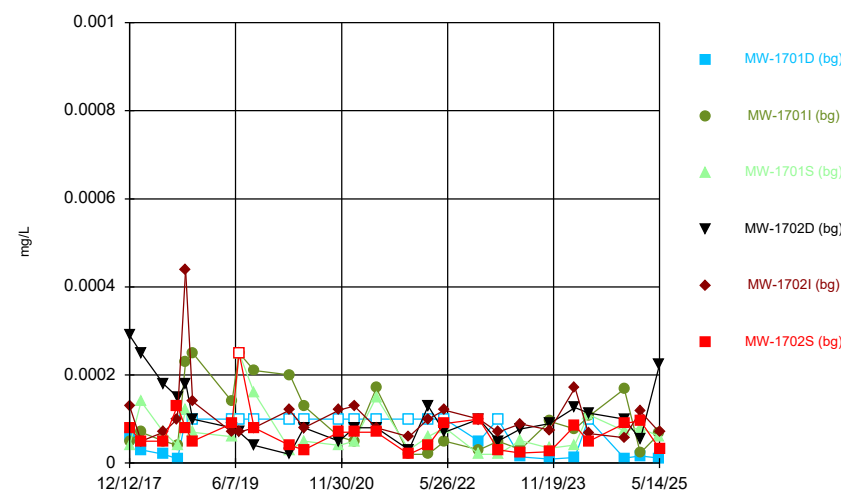


Time Series

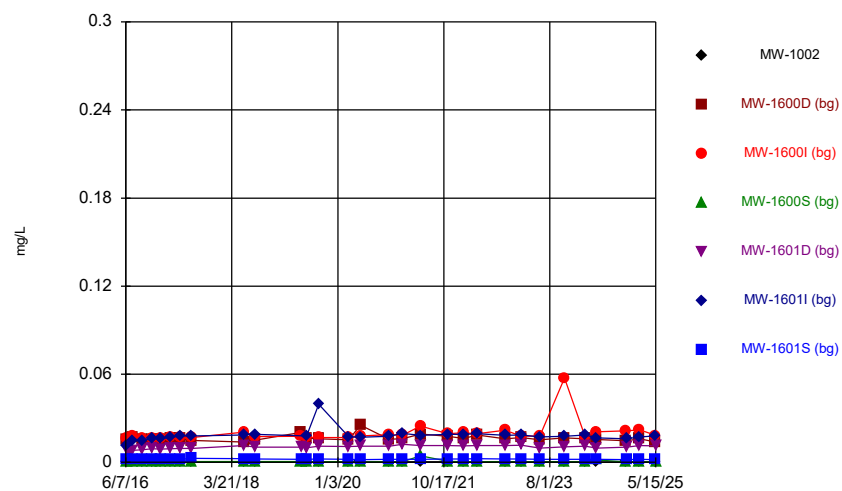


Time Series

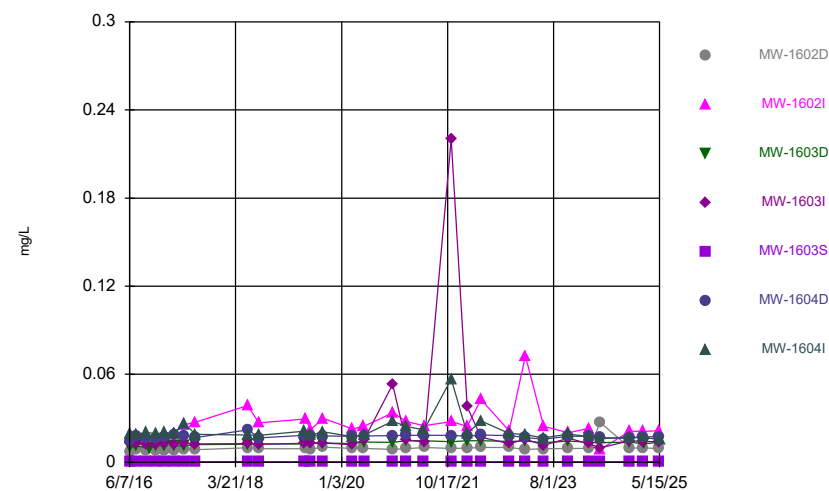


Time Series

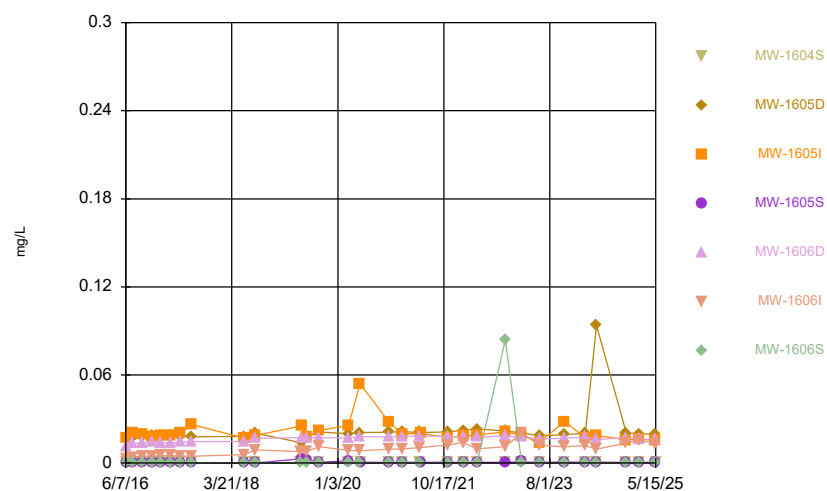

Time Series

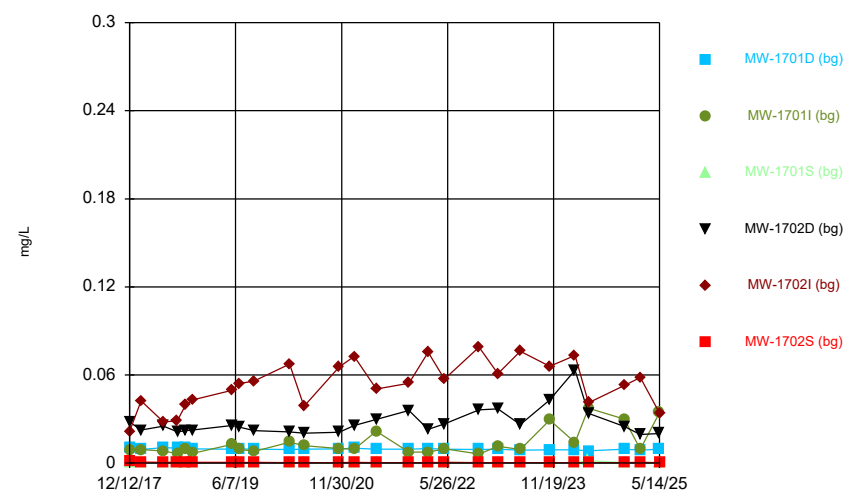


Time Series

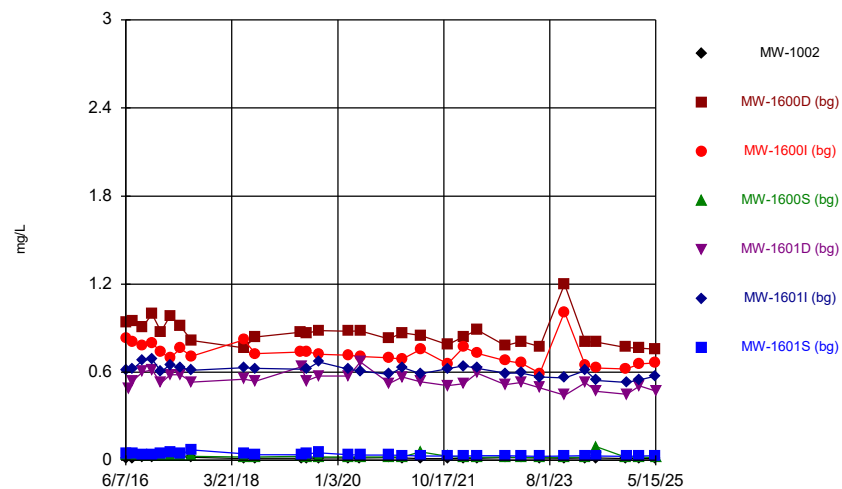


Constituent: Barium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

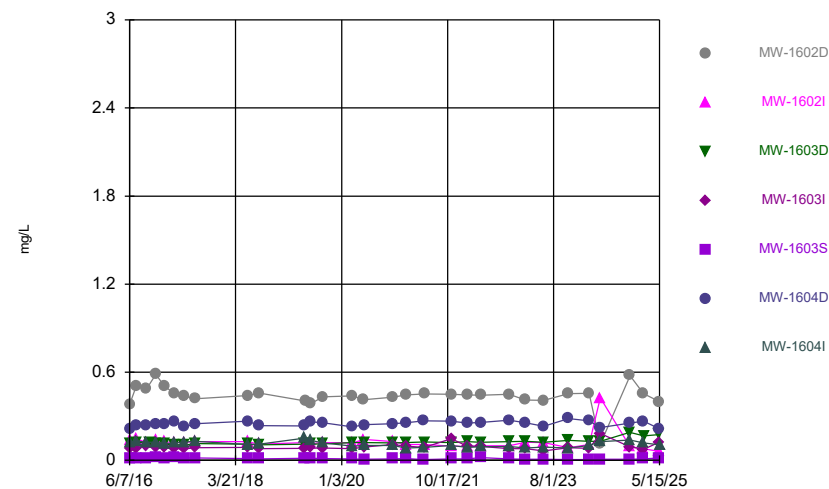


Constituent: Barium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

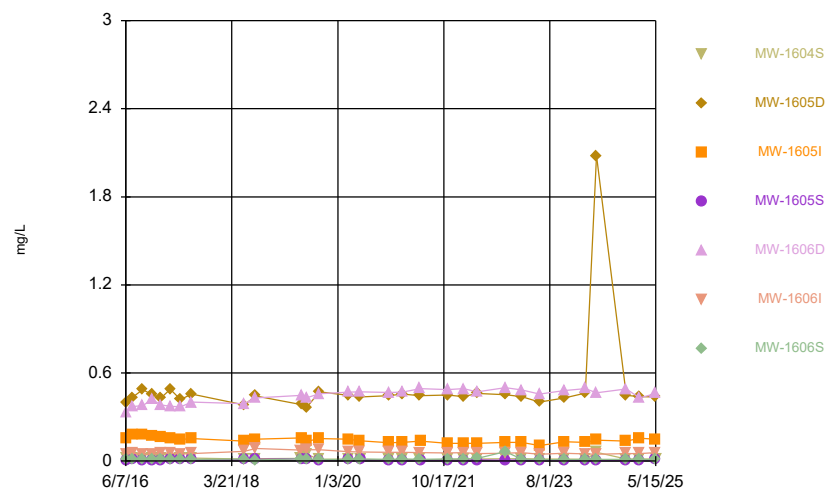


Constituent: Barium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

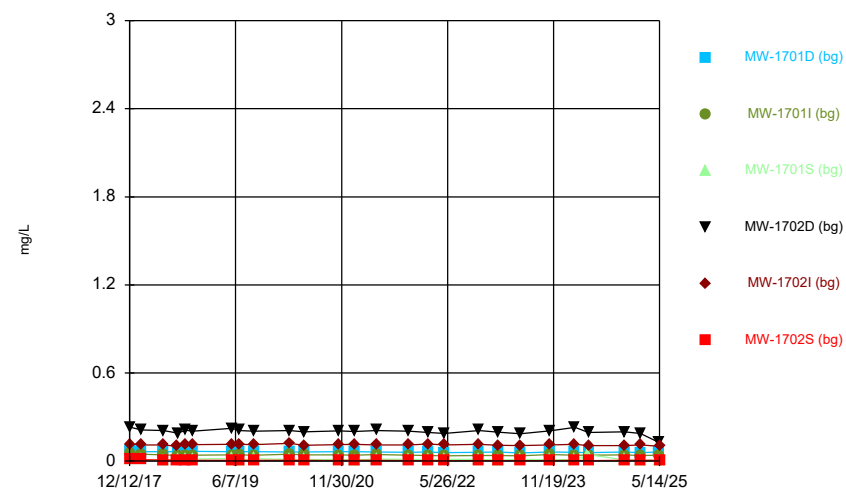


Constituent: Barium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

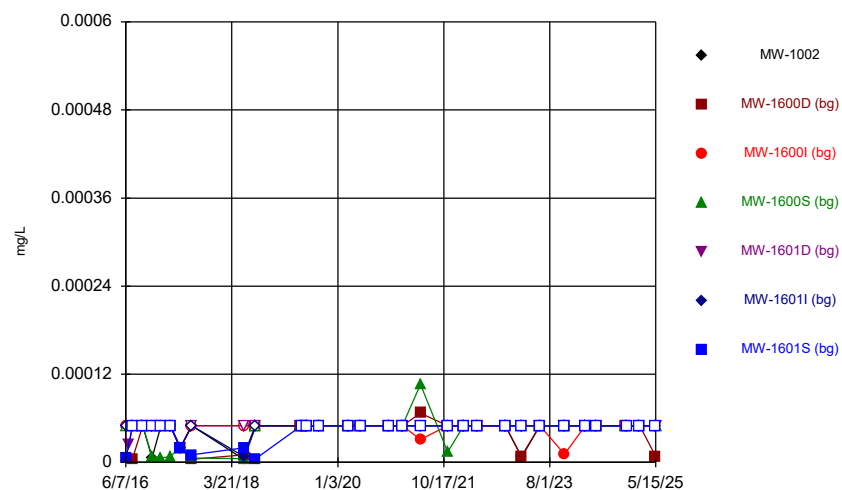


Constituent: Beryllium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

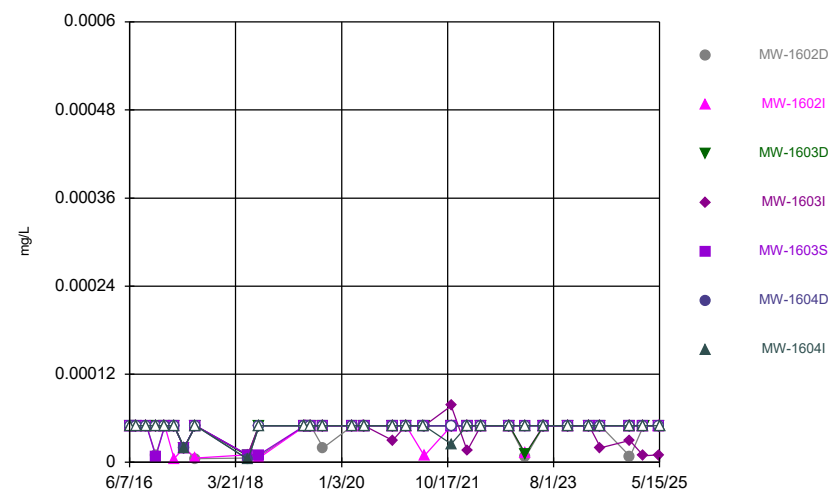


Constituent: Beryllium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

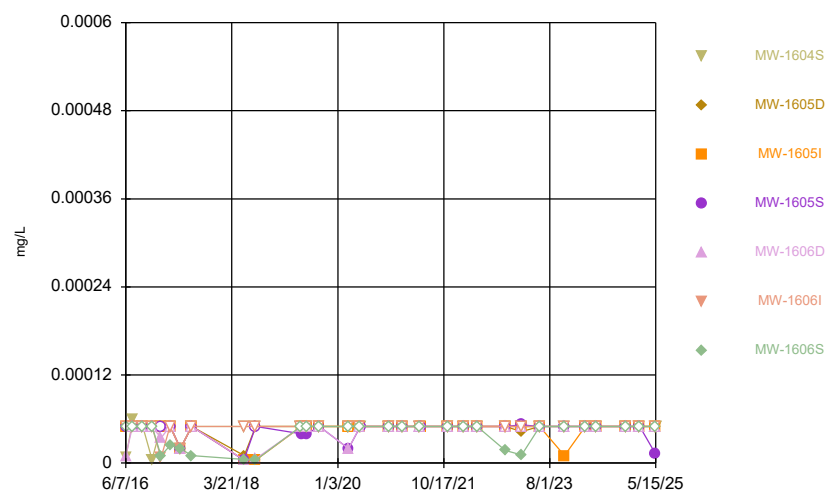


Constituent: Beryllium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

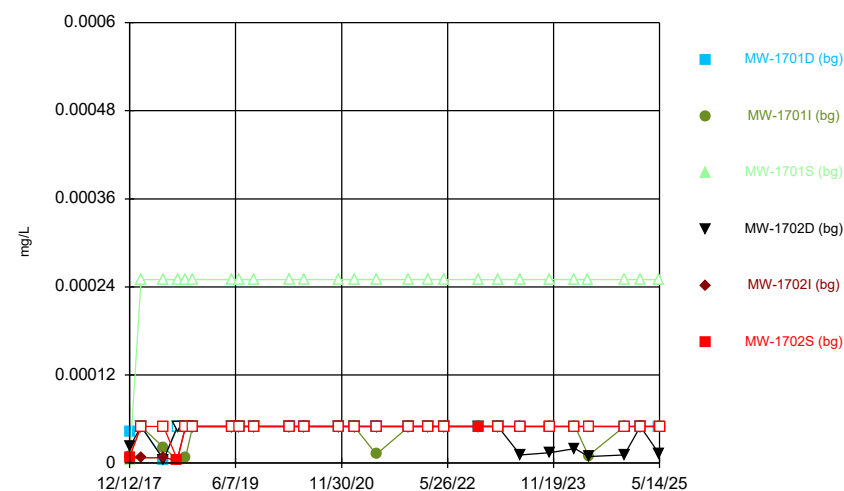


Constituent: Beryllium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

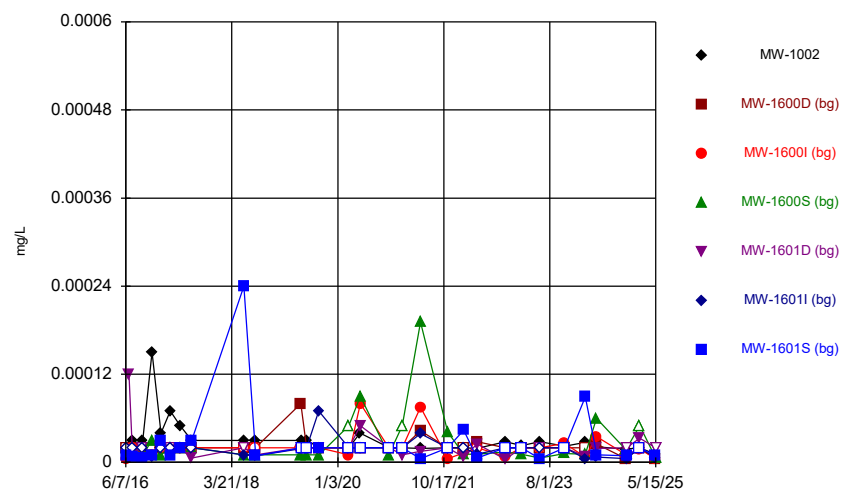


Constituent: Cadmium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

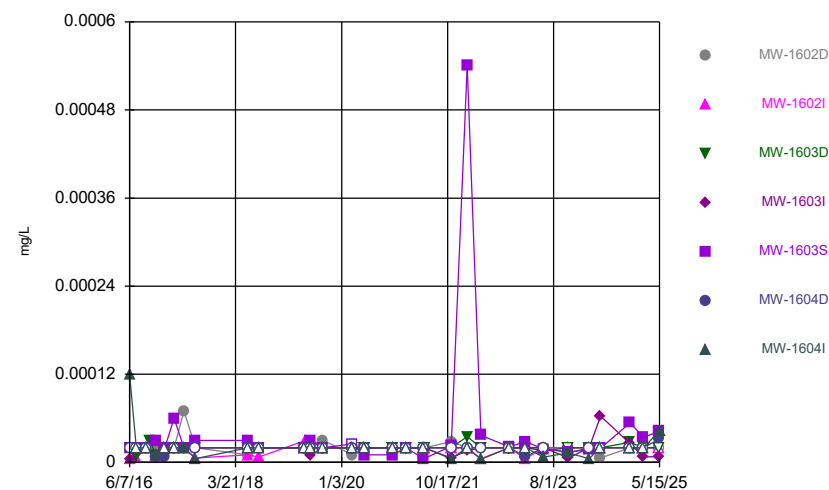


Constituent: Cadmium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

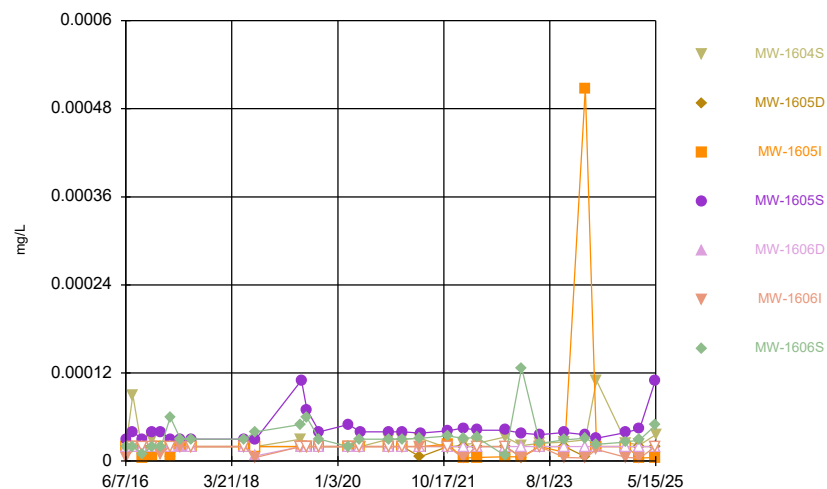


Constituent: Cadmium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

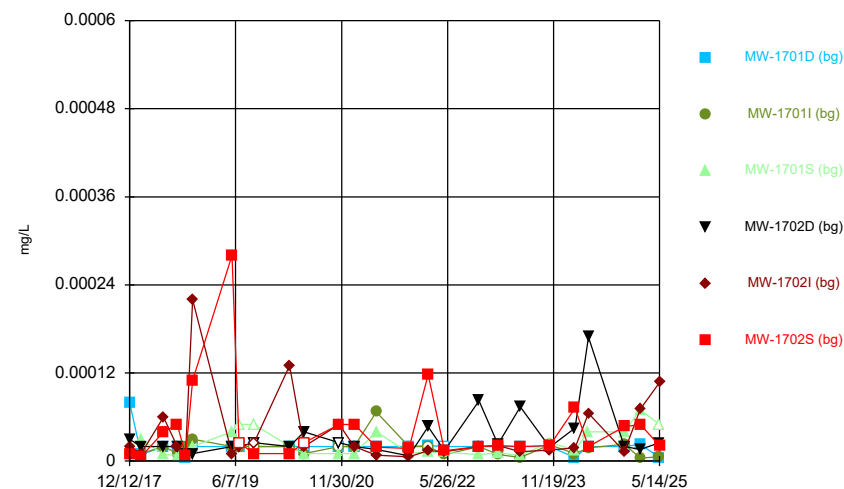


Constituent: Cadmium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

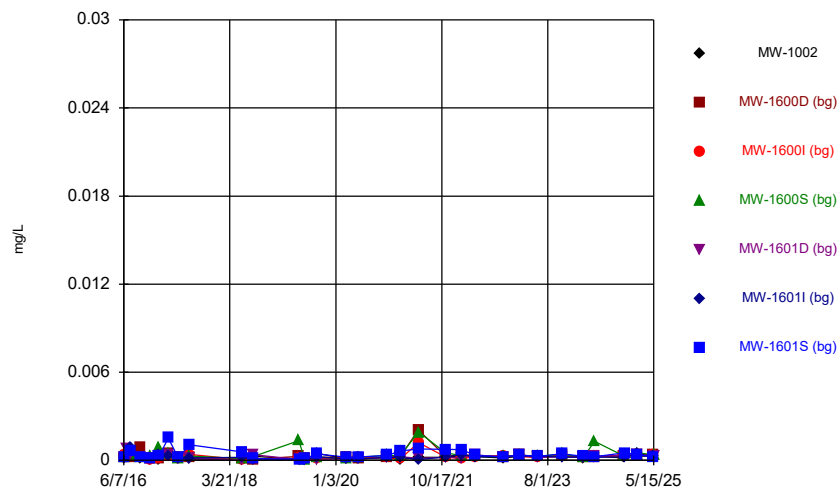


Constituent: Chromium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

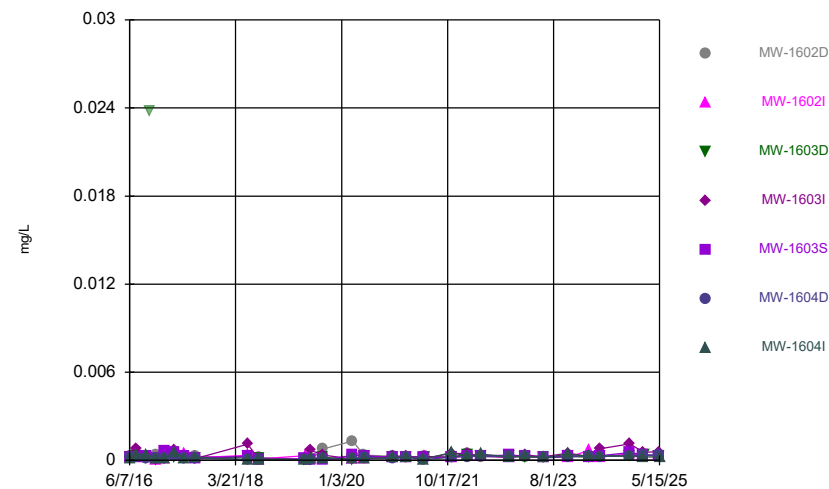


Constituent: Chromium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

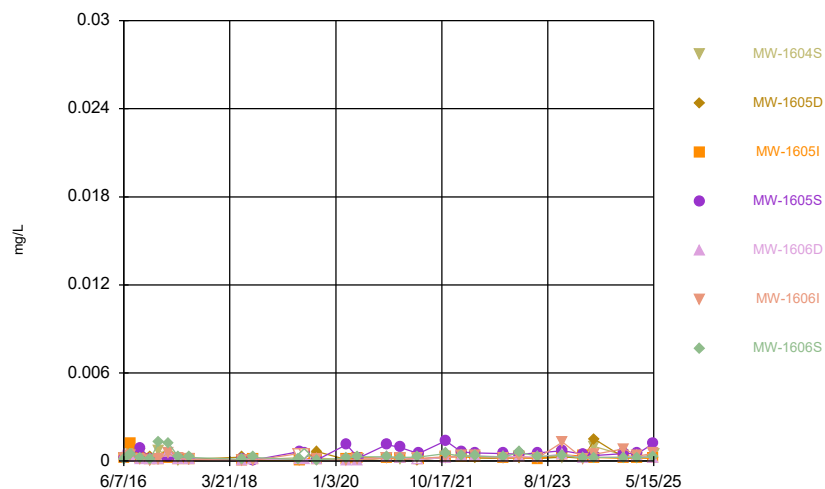


Constituent: Chromium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

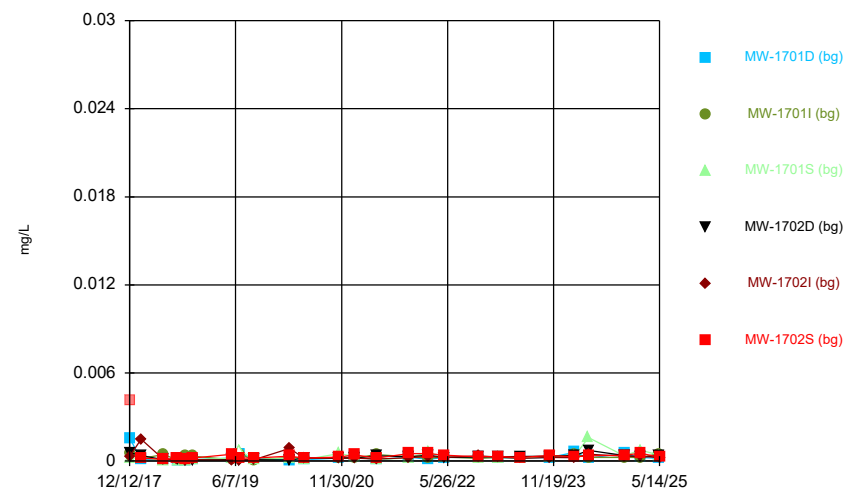


Constituent: Chromium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

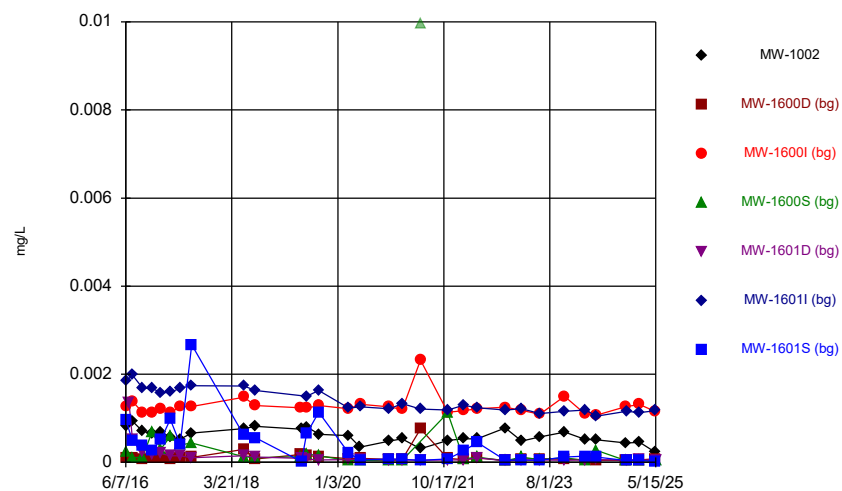


Constituent: Cobalt, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

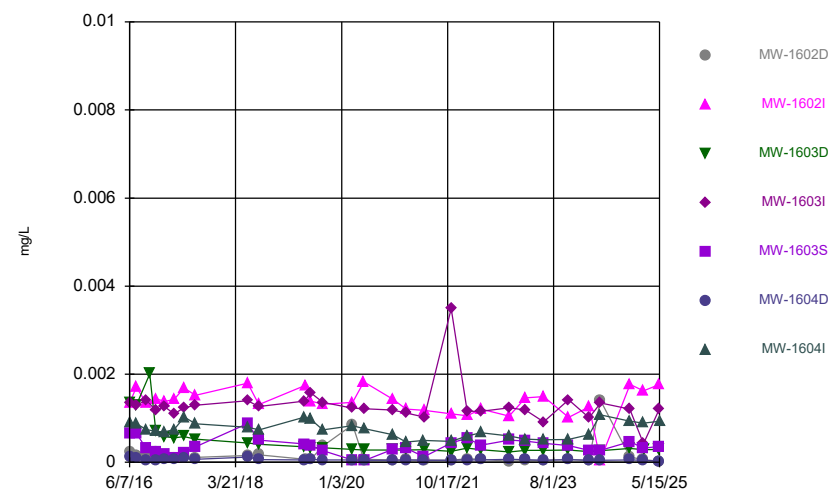


Constituent: Cobalt, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

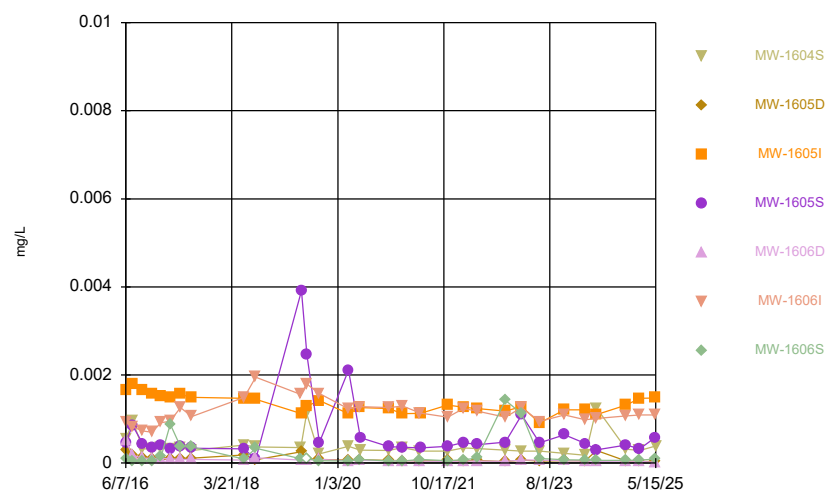


Constituent: Cobalt, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

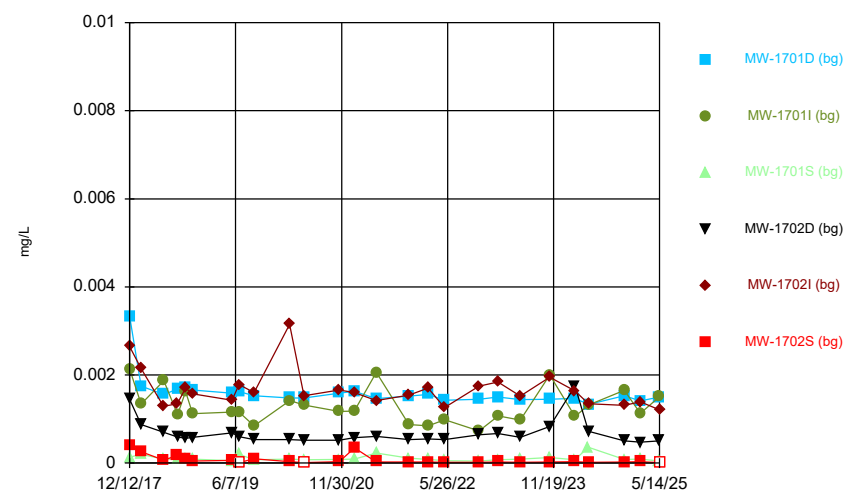


Constituent: Cobalt, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

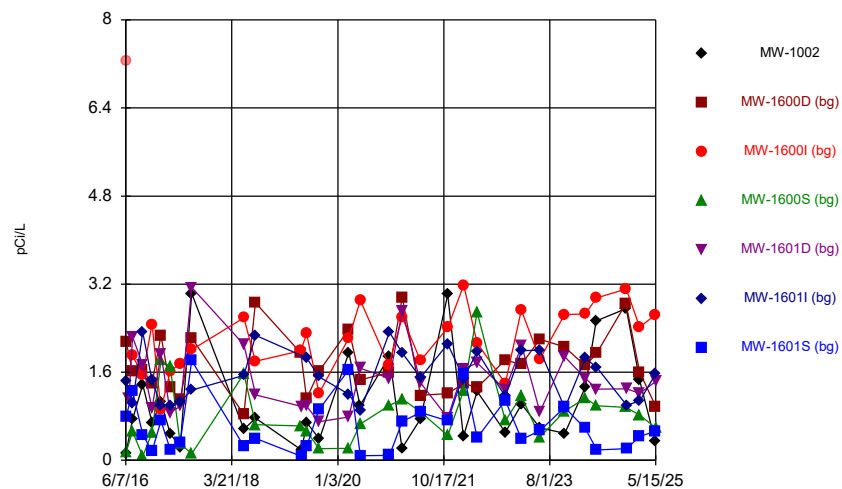


Constituent: Combined Radium 226 + 228 Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

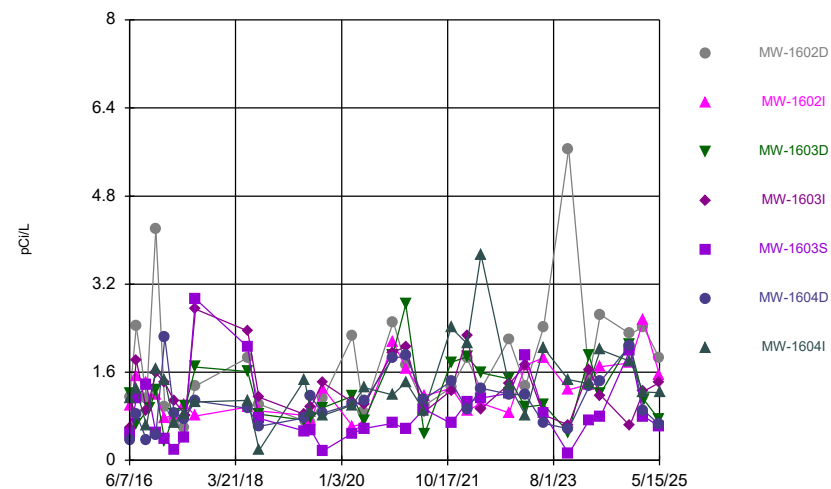


Constituent: Combined Radium 226 + 228 Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

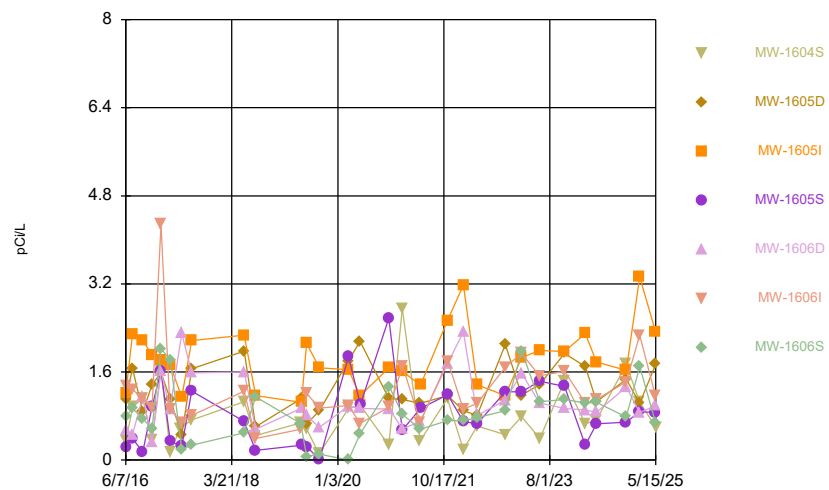


Constituent: Combined Radium 226 + 228 Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

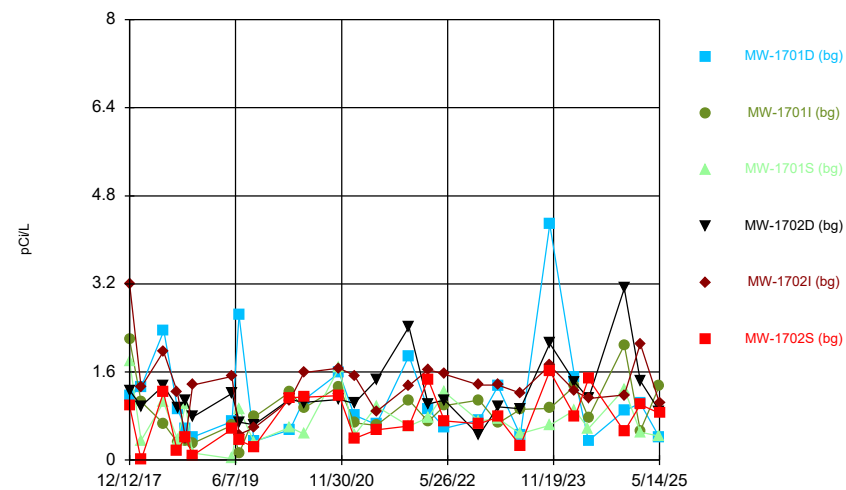


Constituent: Combined Radium 226 + 228 Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Time Series

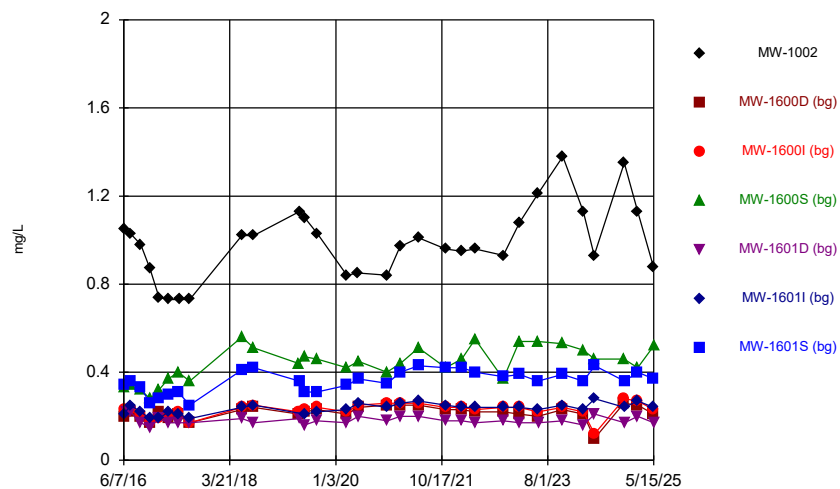


Time Series

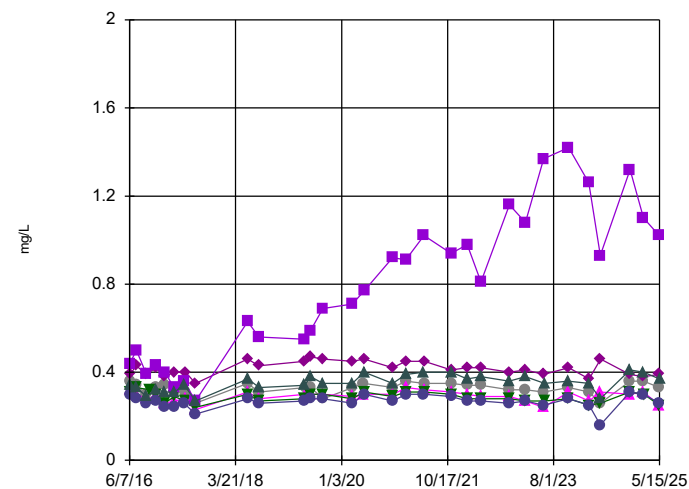


Time Series

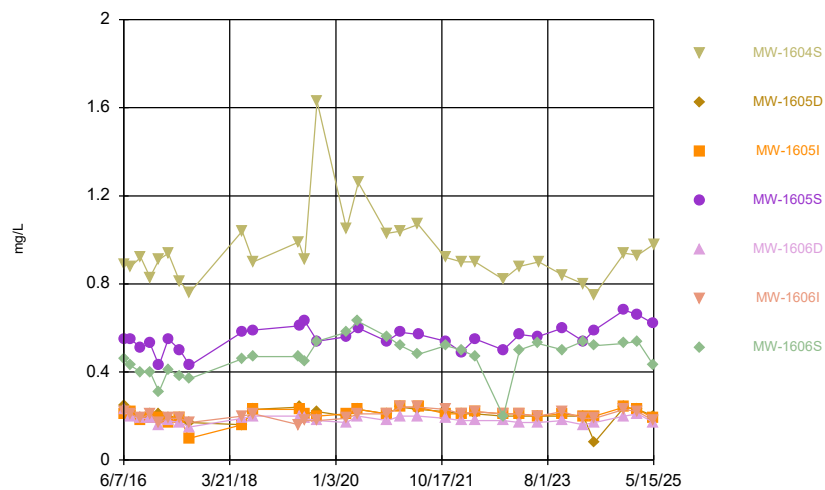

Time Series

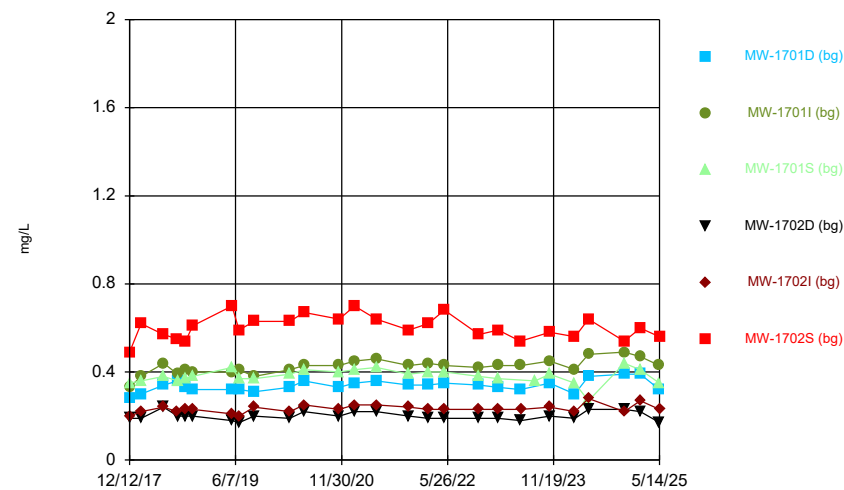


Time Series

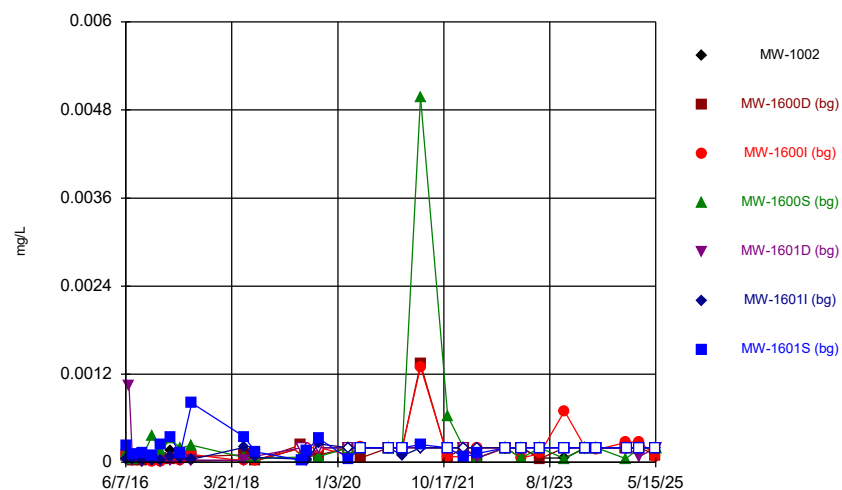


Constituent: Lead, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

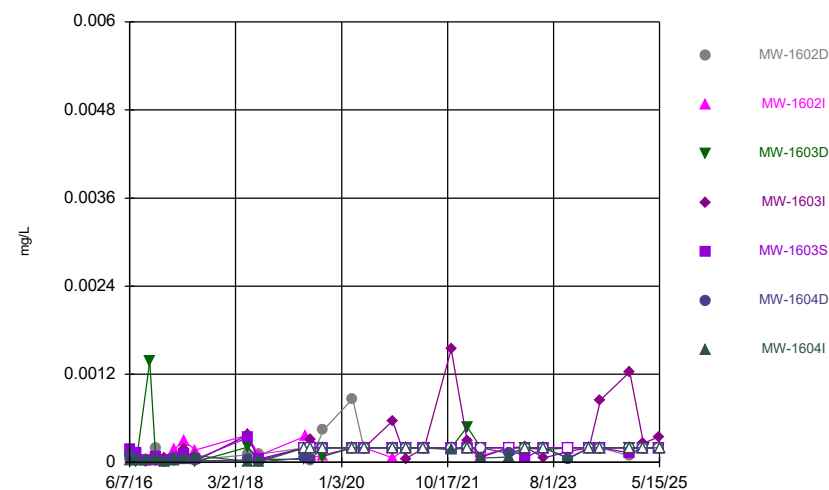


Constituent: Lead, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

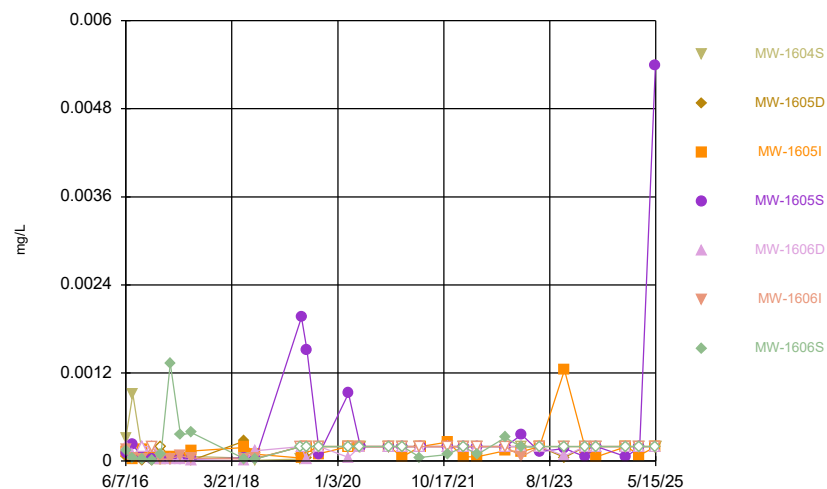


Constituent: Lead, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

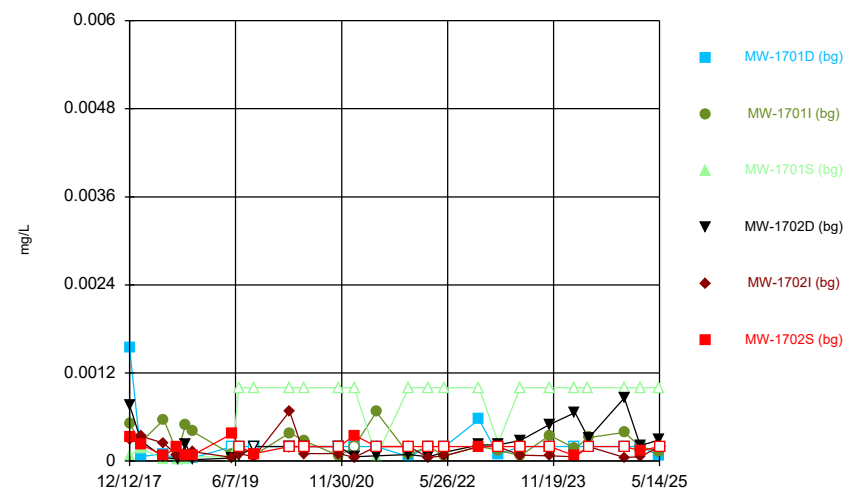


Constituent: Lead, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

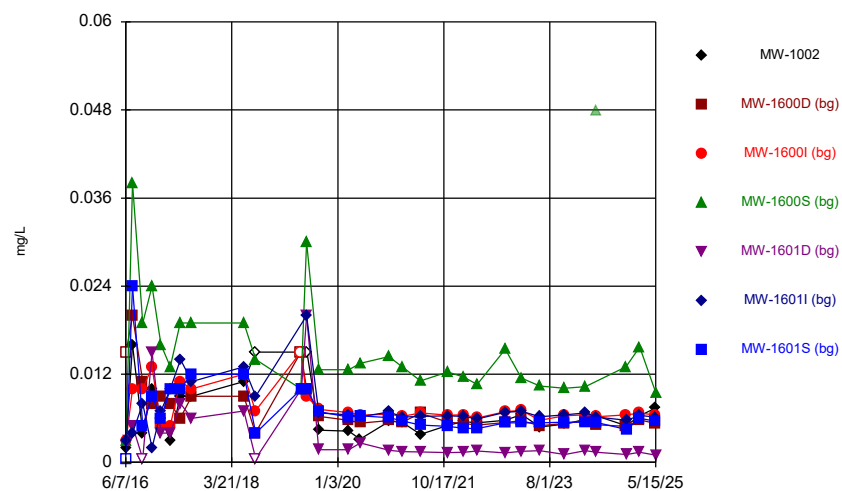


Constituent: Lithium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

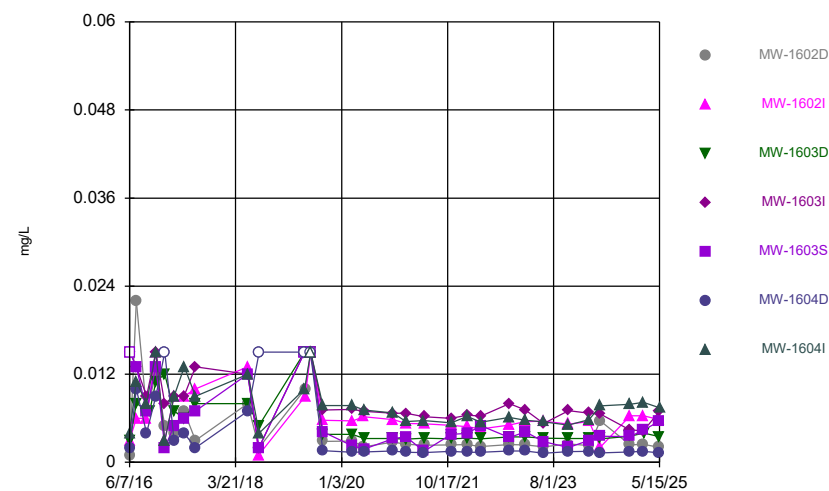


Constituent: Lithium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

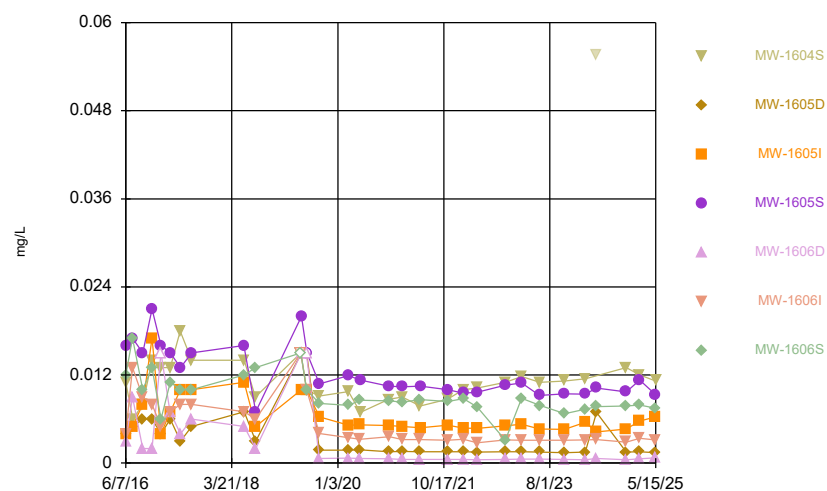


Constituent: Lithium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

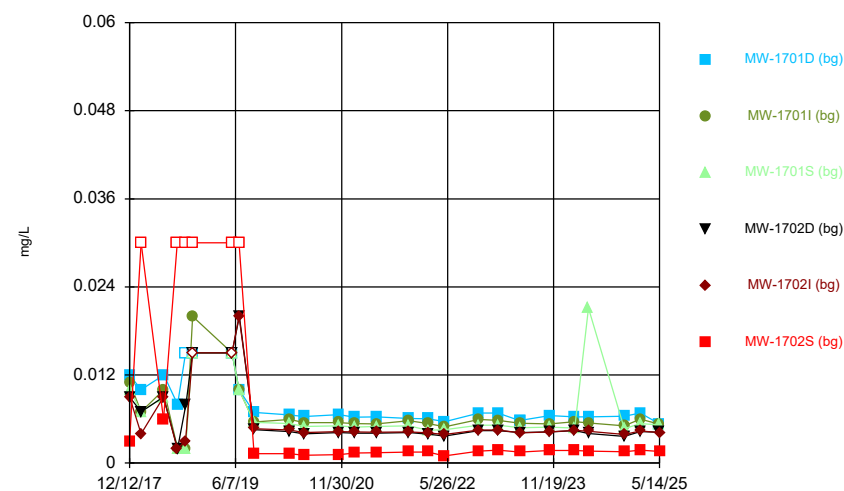


Constituent: Lithium, total Analysis Run 7/28/2025 11:48 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Time Series

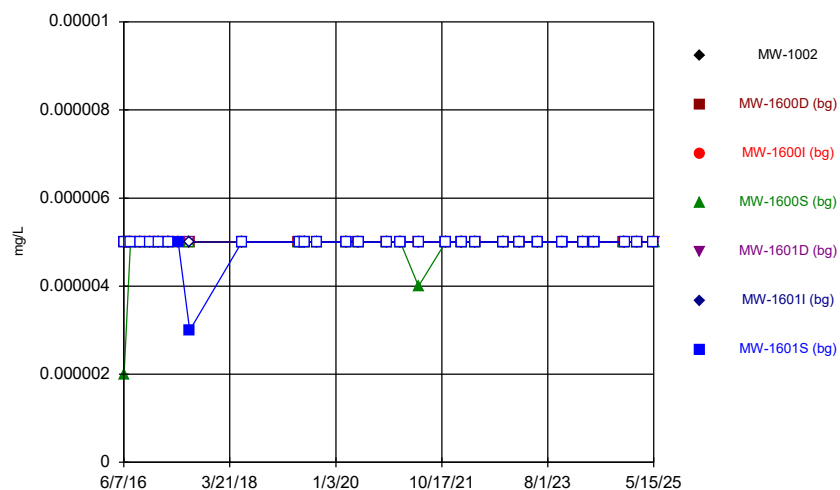


Time Series

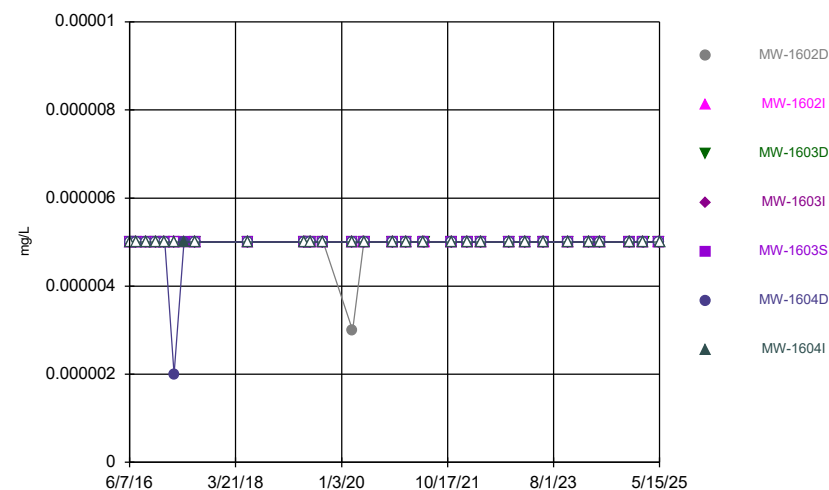


Time Series

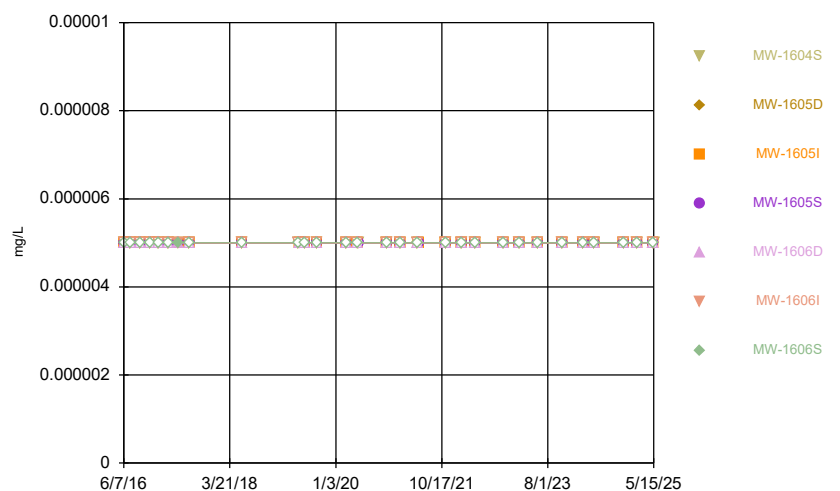


Time Series

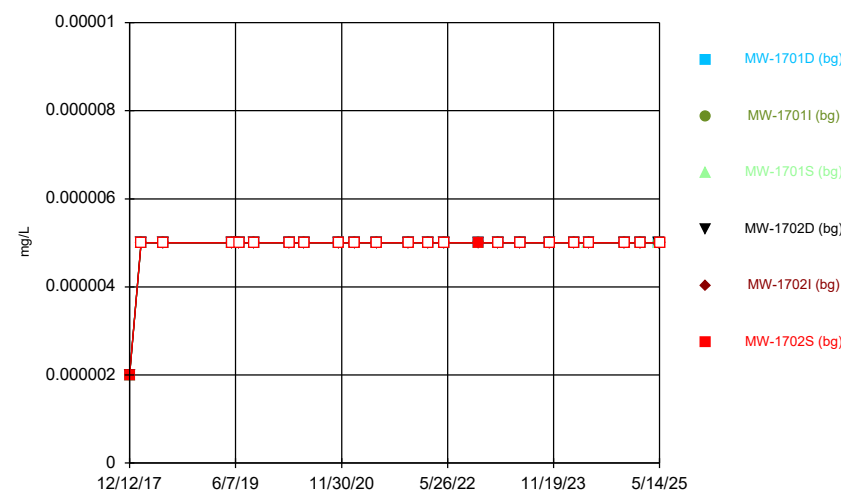


Time Series

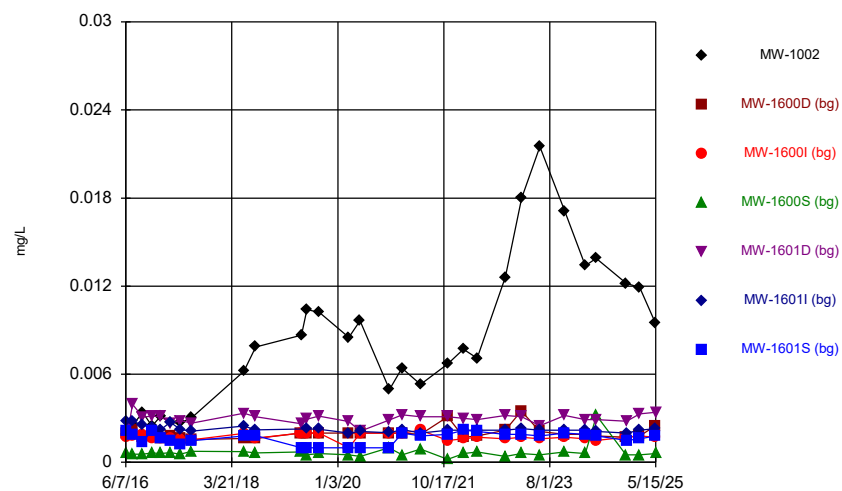


Time Series

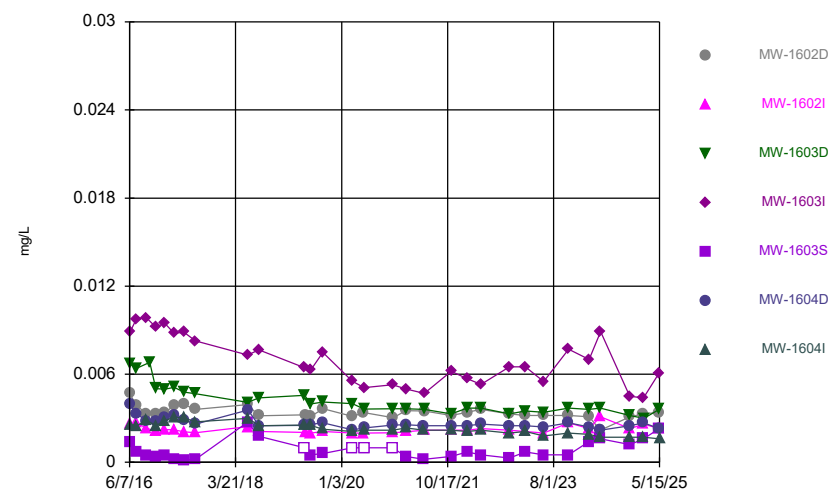


Time Series

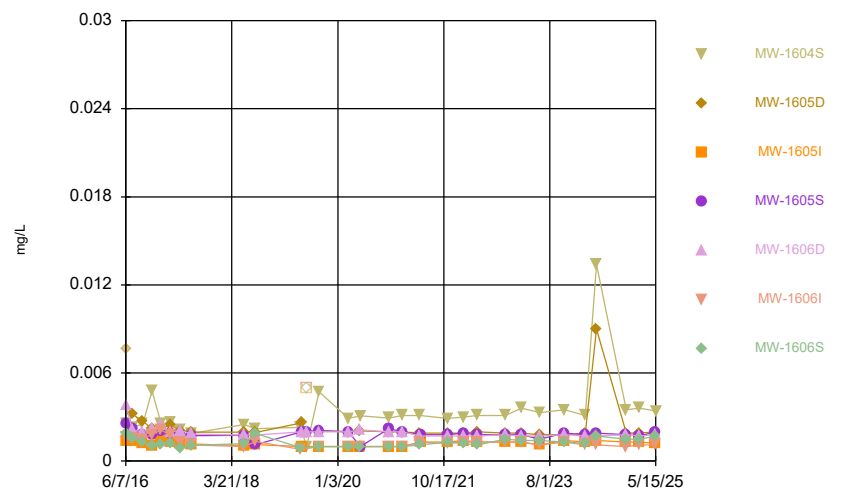

Time Series

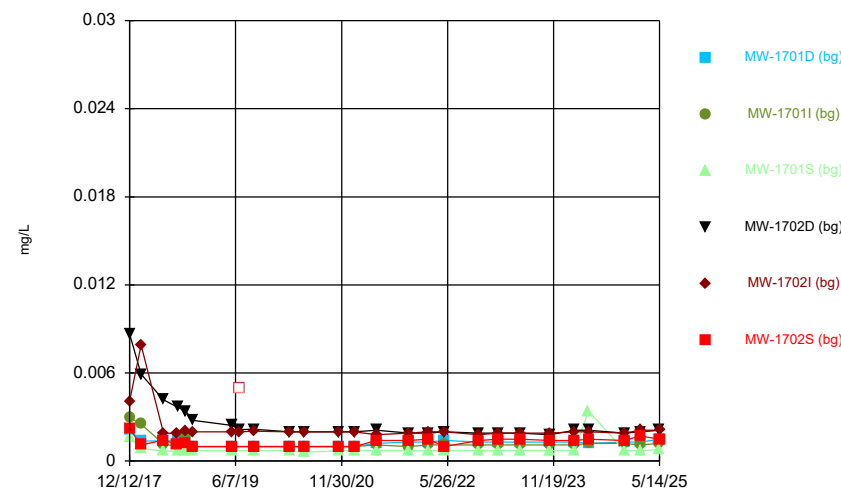


Time Series

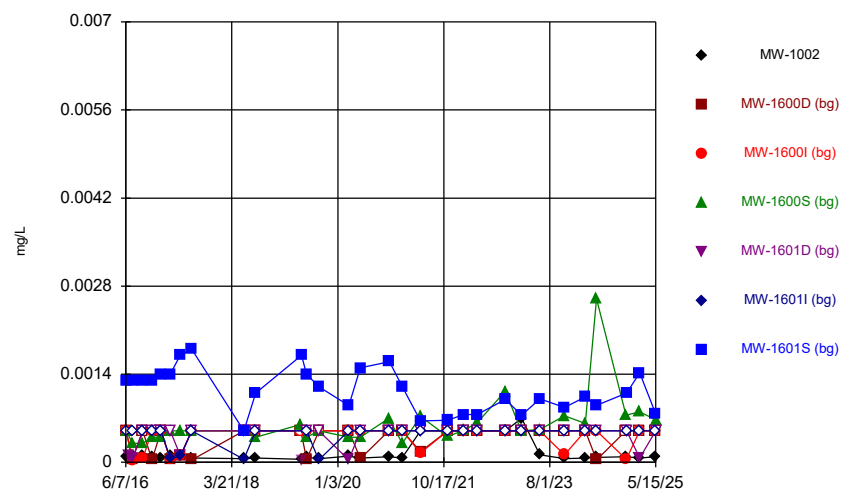


Constituent: Seleniun, total Analysis Run 7/28/2025 11:49 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

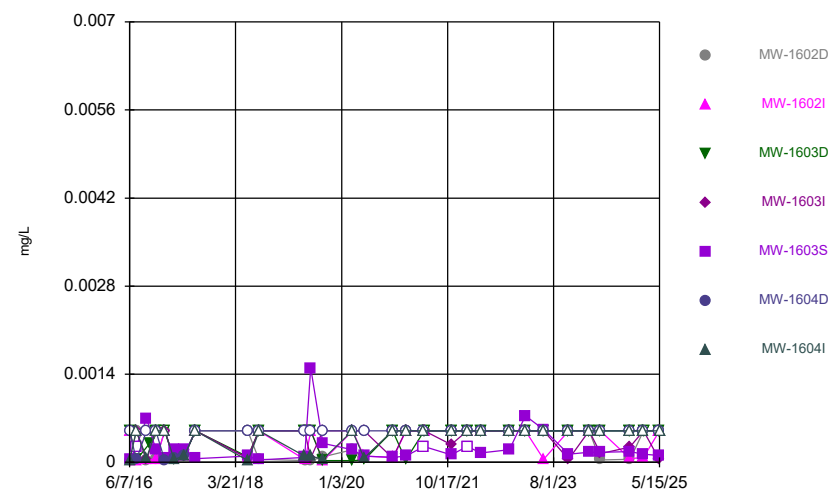


Constituent: Seleniun, total Analysis Run 7/28/2025 11:49 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

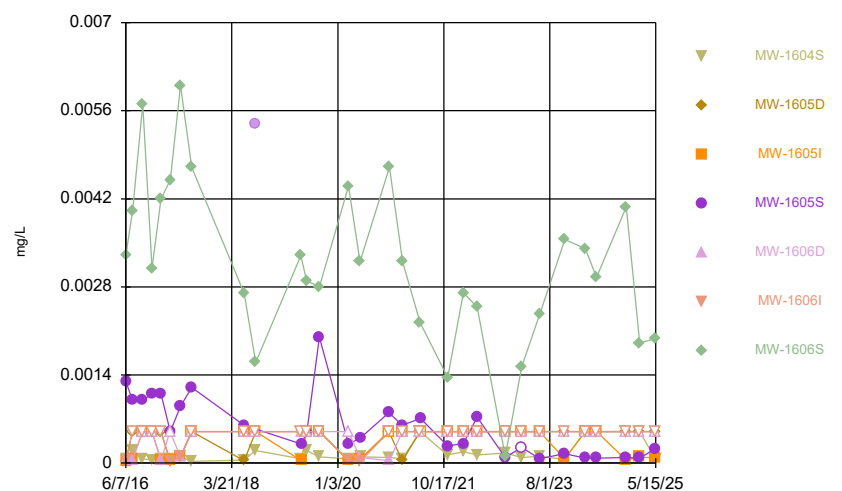


Constituent: Seleniun, total Analysis Run 7/28/2025 11:49 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

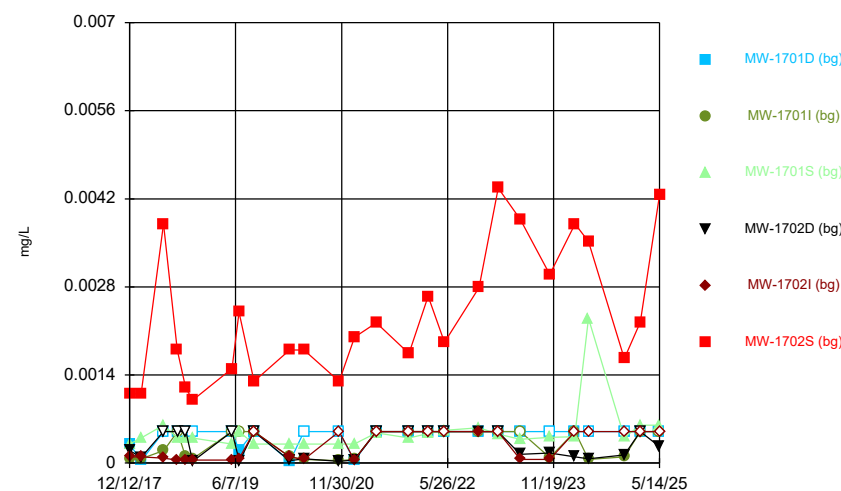


Constituent: Seleniun, total Analysis Run 7/28/2025 11:49 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

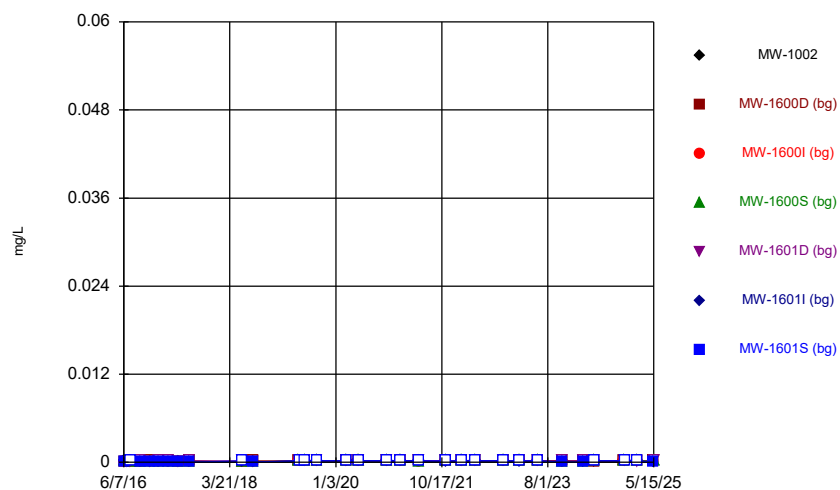


Constituent: Thallium, total Analysis Run 7/28/2025 11:49 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

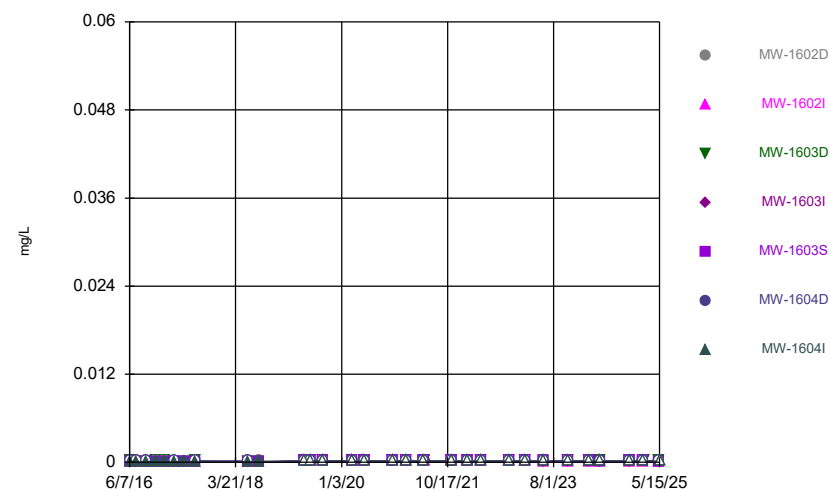


Constituent: Thallium, total Analysis Run 7/28/2025 11:49 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

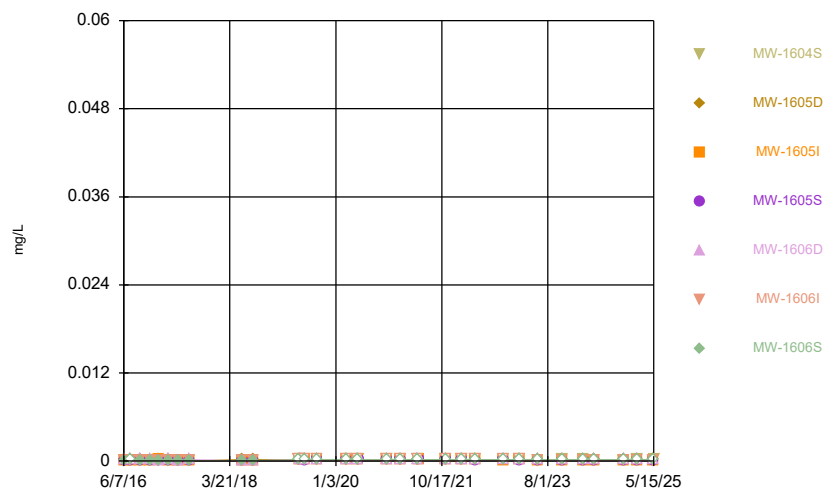

Constituent: Thallium, total Analysis Run 7/28/2025 11:49 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Time Series

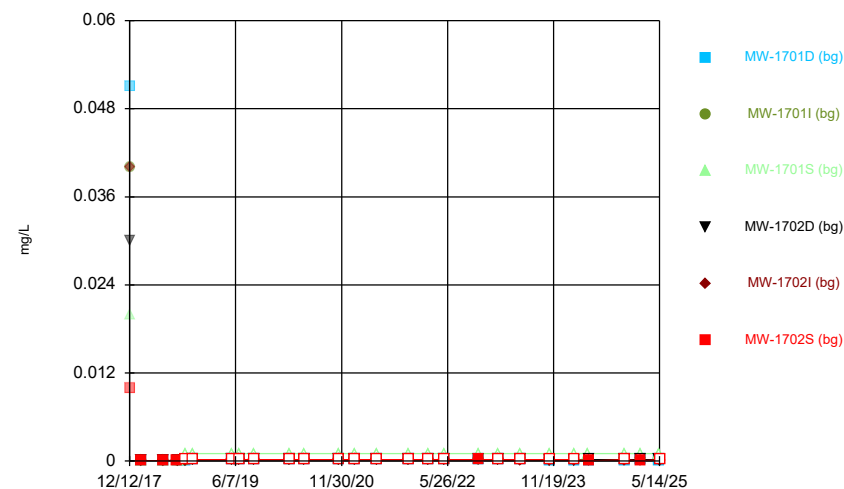


Constituent: Thallium, total Analysis Run 7/28/2025 11:49 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

FIGURE B


Box Plots

Box & Whiskers Plot

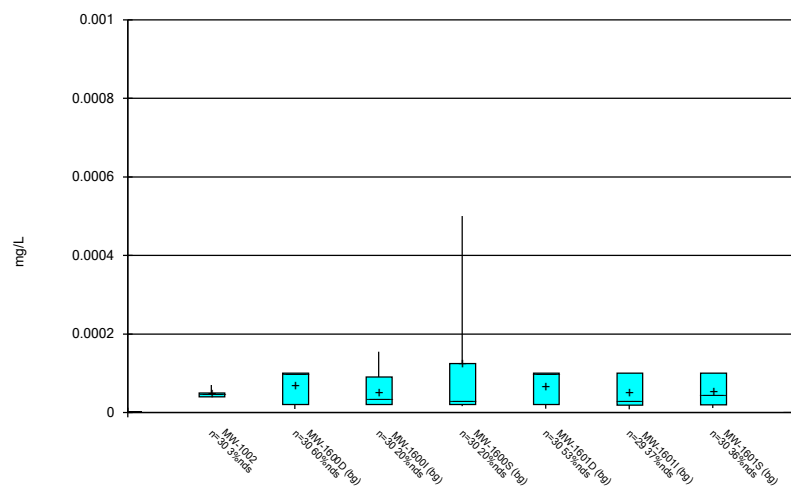


Constituent: Antimony, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

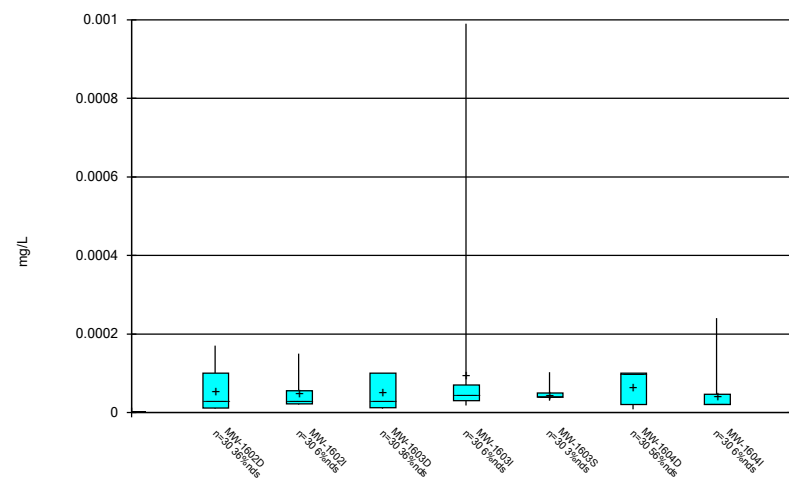


Constituent: Antimony, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

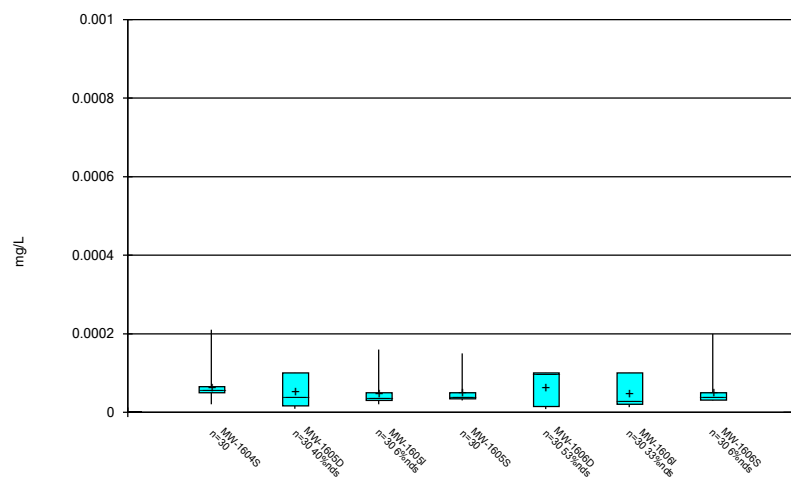


Constituent: Antimony, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

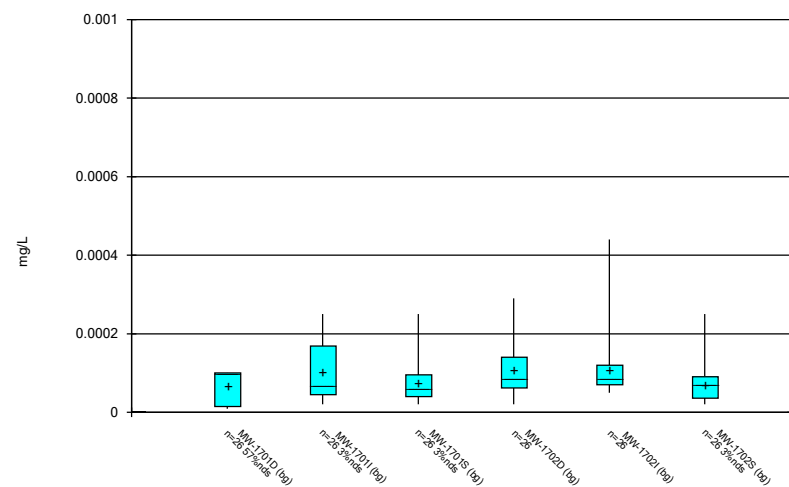


Constituent: Antimony, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

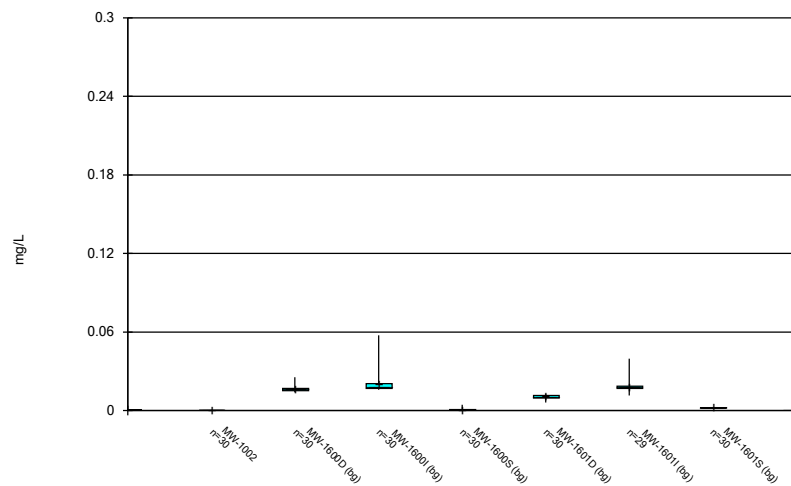


Constituent: Arsenic, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

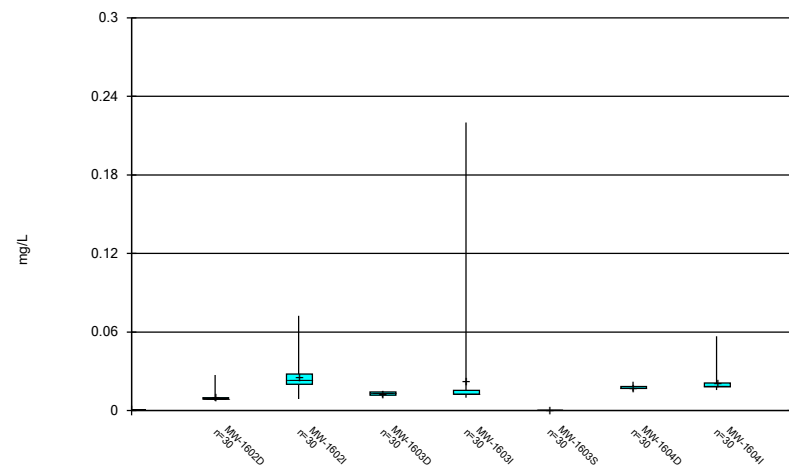


Constituent: Arsenic, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

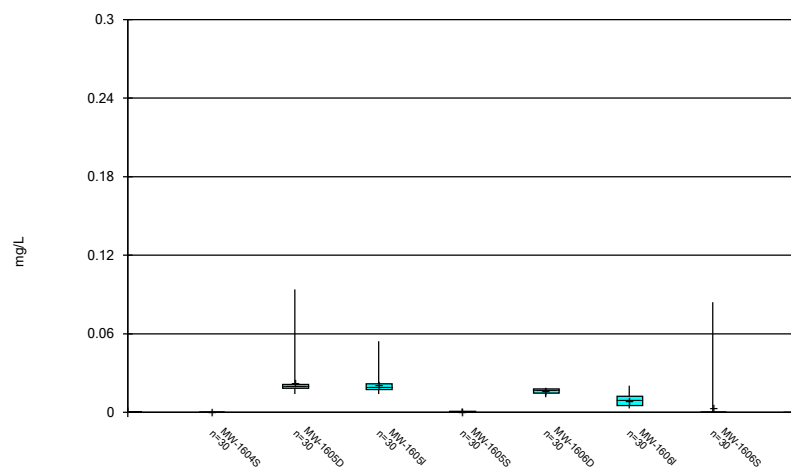


Constituent: Arsenic, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

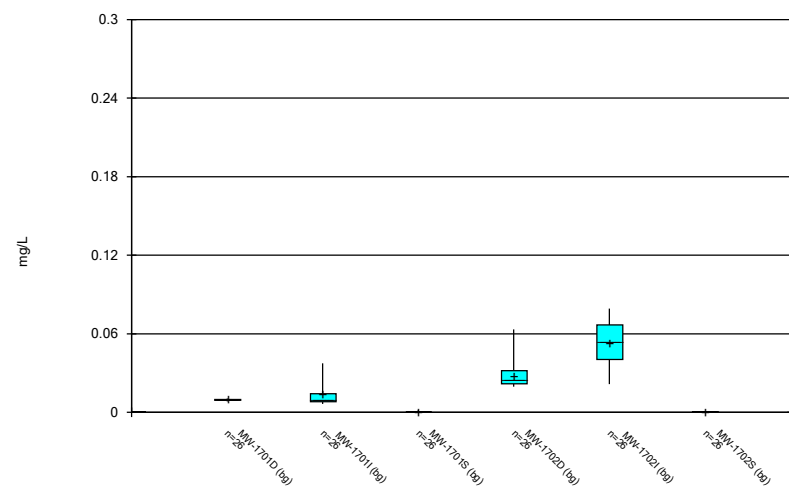


Constituent: Arsenic, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

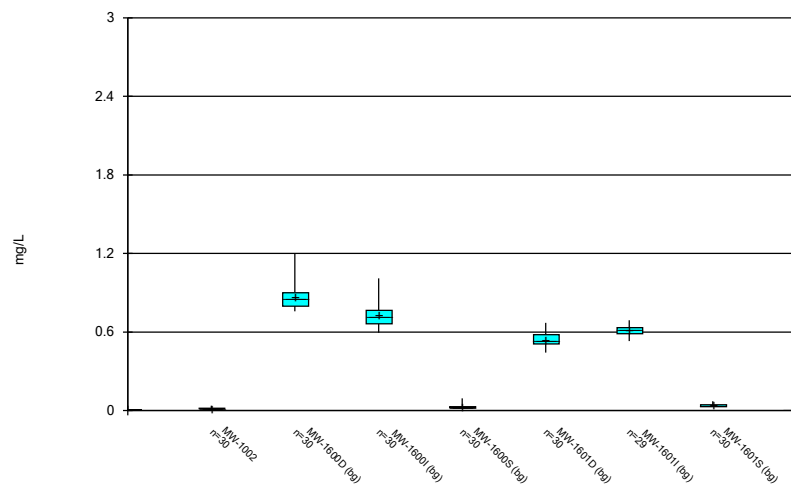


Constituent: Barium, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

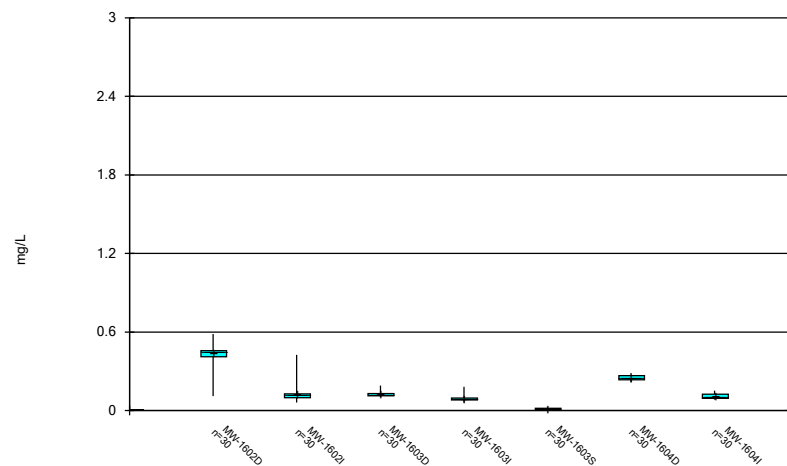


Constituent: Barium, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

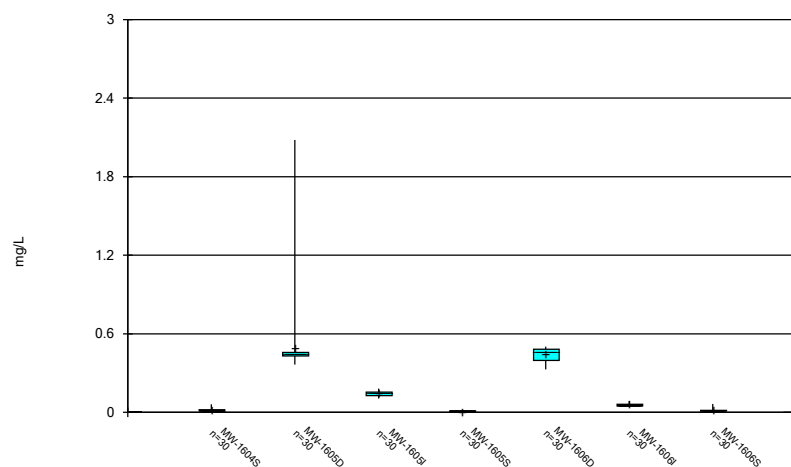


Constituent: Barium, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

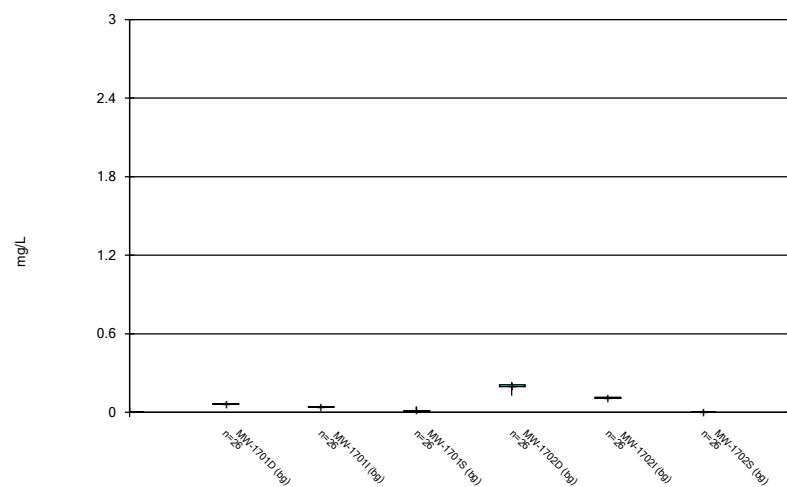


Constituent: Barium, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

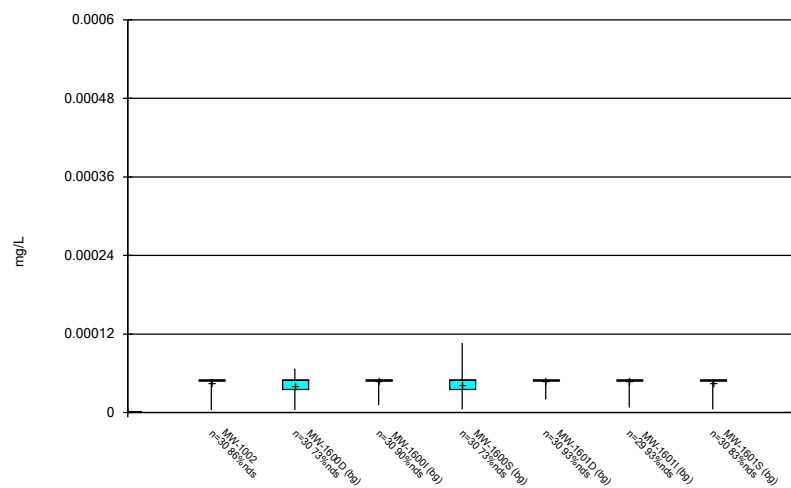


Constituent: Beryllium, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

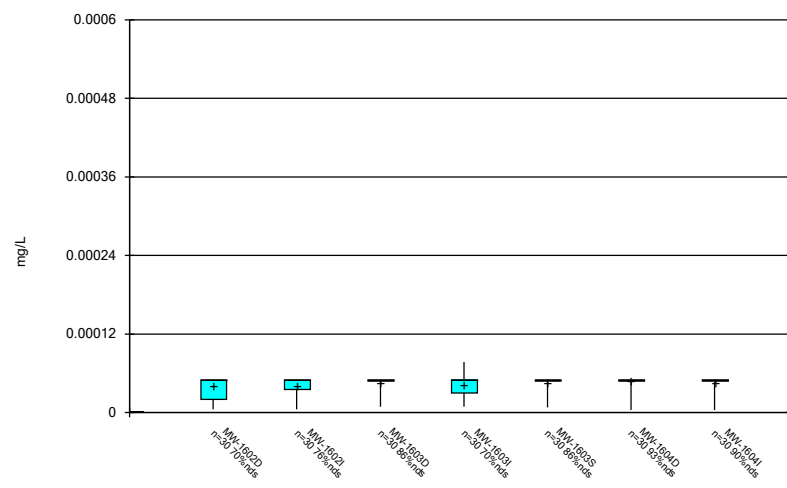


Constituent: Beryllium, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

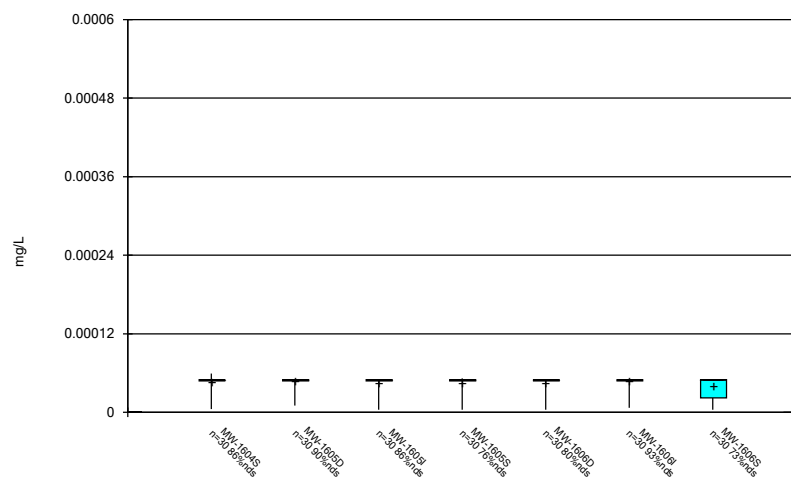


Constituent: Beryllium, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

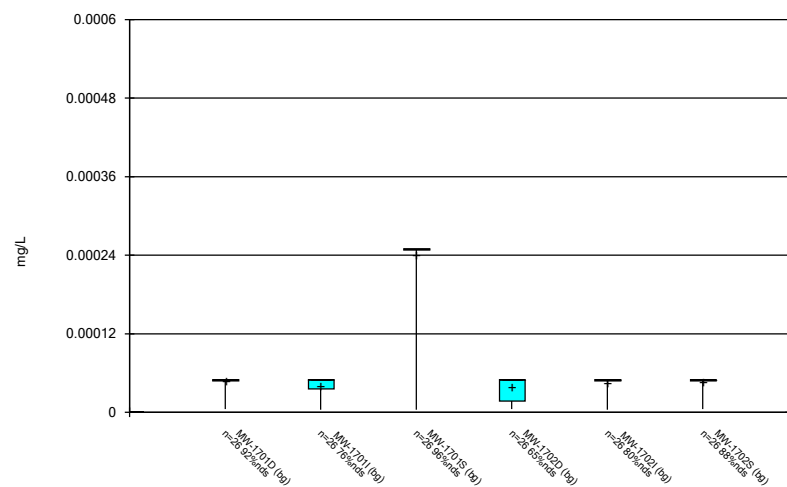


Constituent: Beryllium, total Analysis Run 7/28/2025 11:56 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP


Box & Whiskers Plot

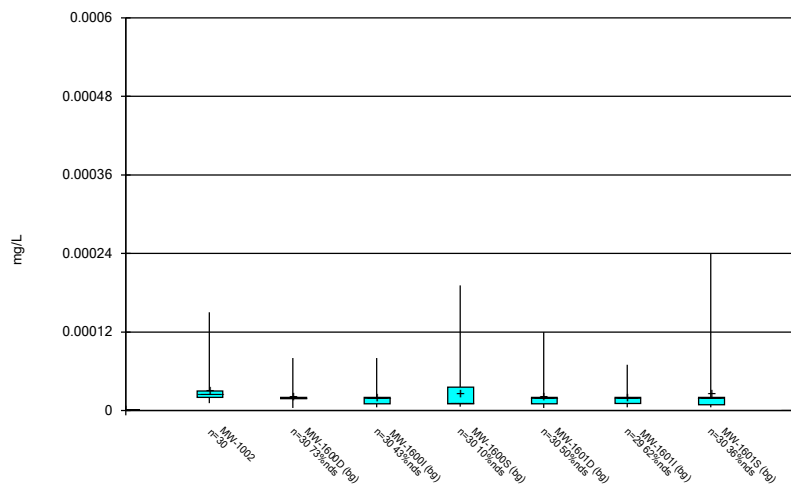


Box & Whiskers Plot

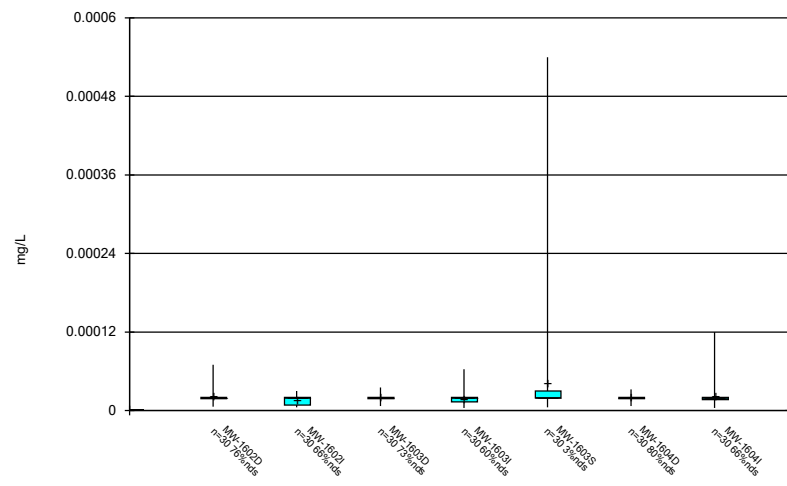


Box & Whiskers Plot

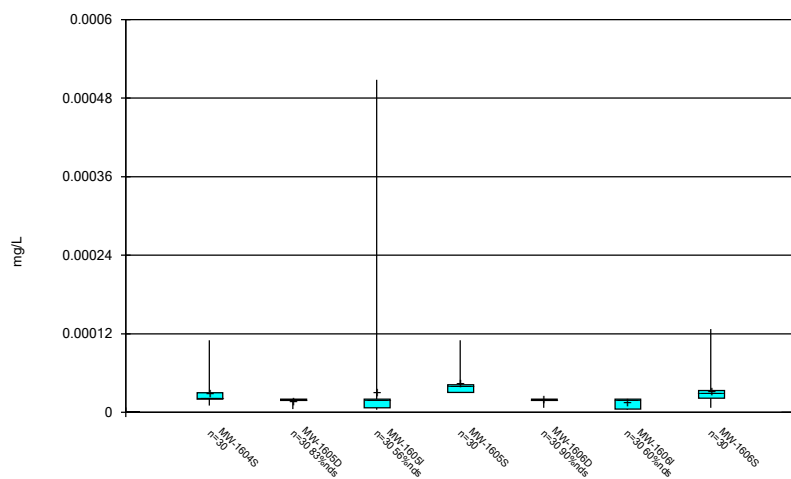


Box & Whiskers Plot

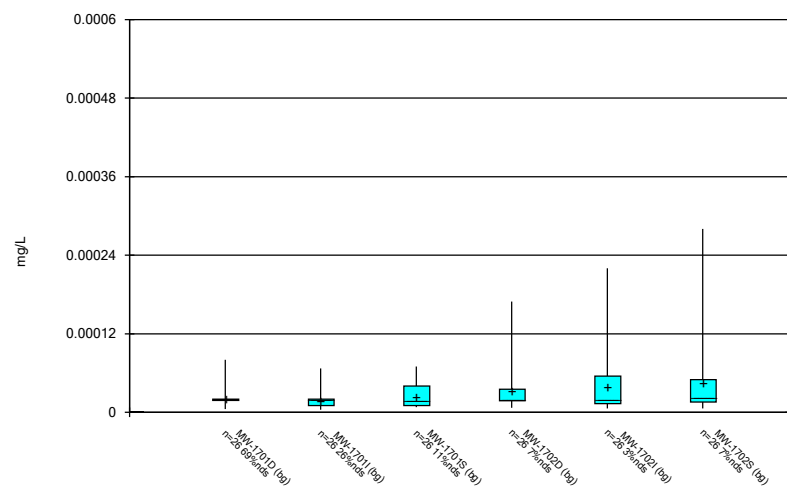


Box & Whiskers Plot

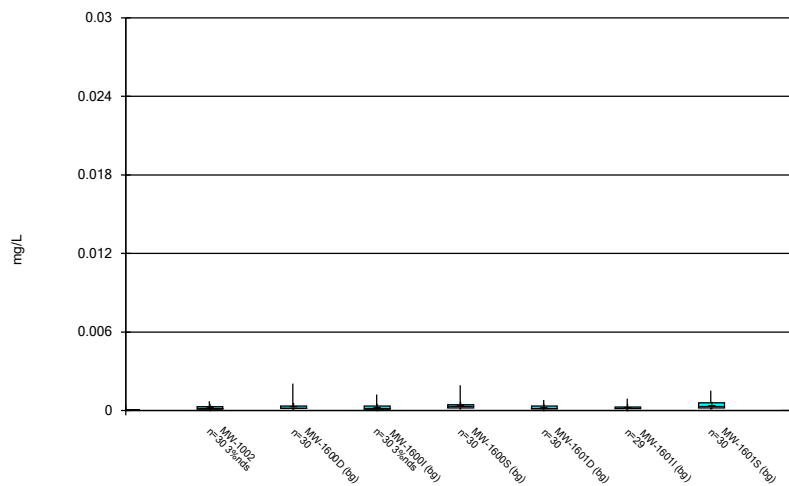


Box & Whiskers Plot

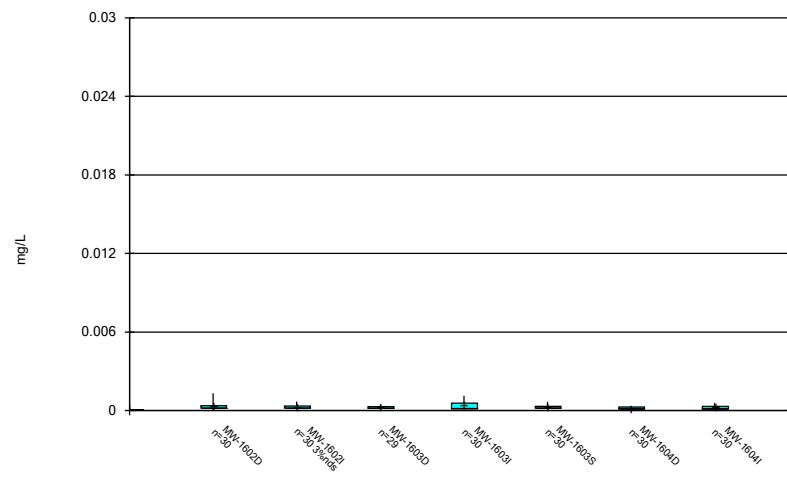


Box & Whiskers Plot

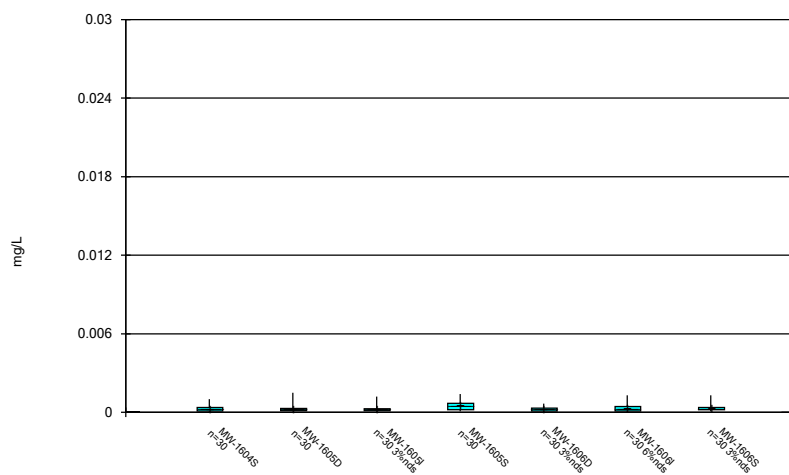


Box & Whiskers Plot

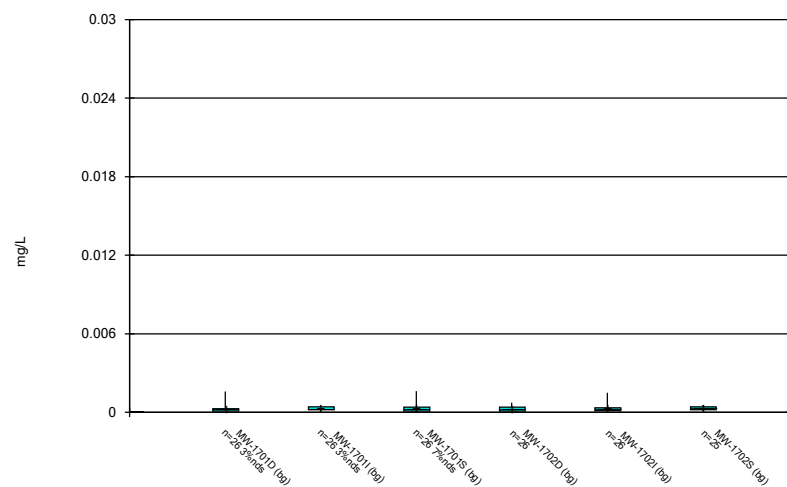


Box & Whiskers Plot

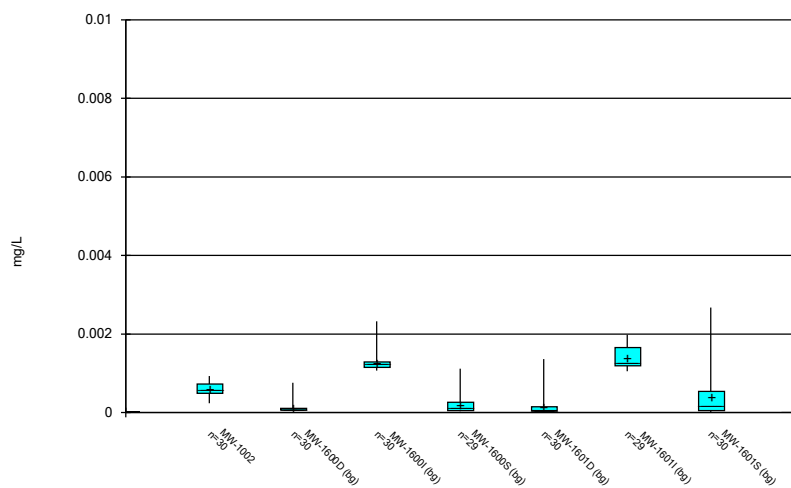


Box & Whiskers Plot

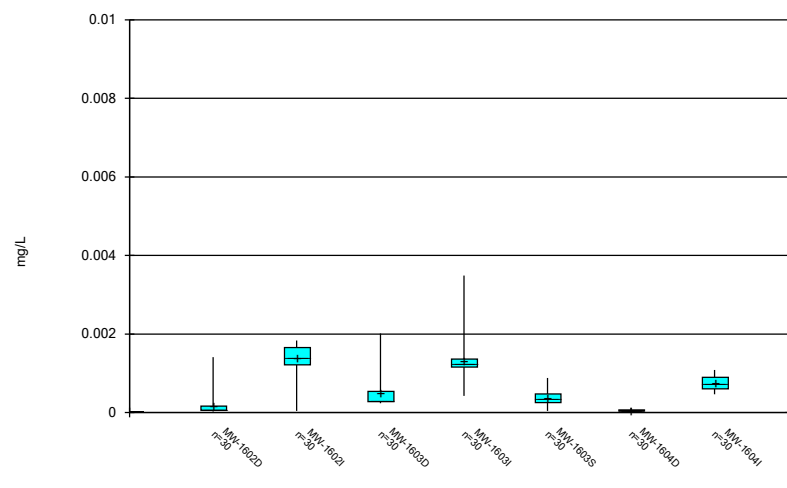


Box & Whiskers Plot

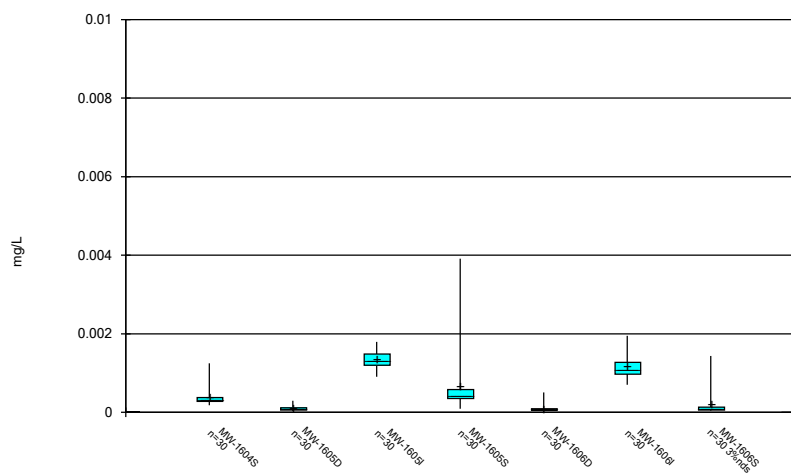

Box & Whiskers Plot

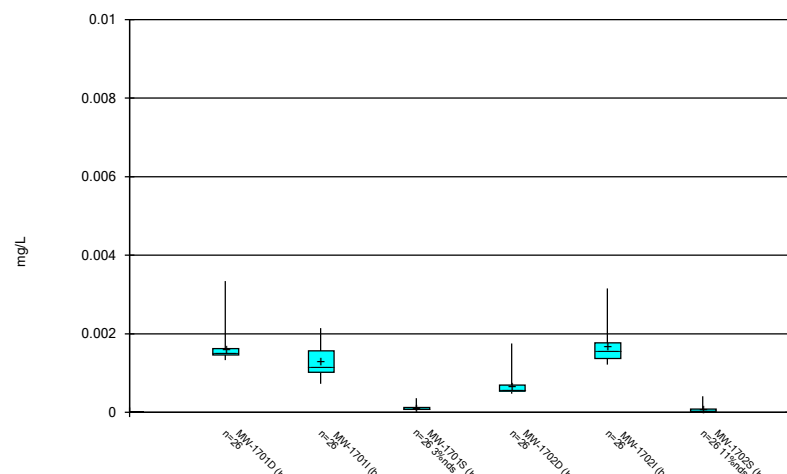


Box & Whiskers Plot

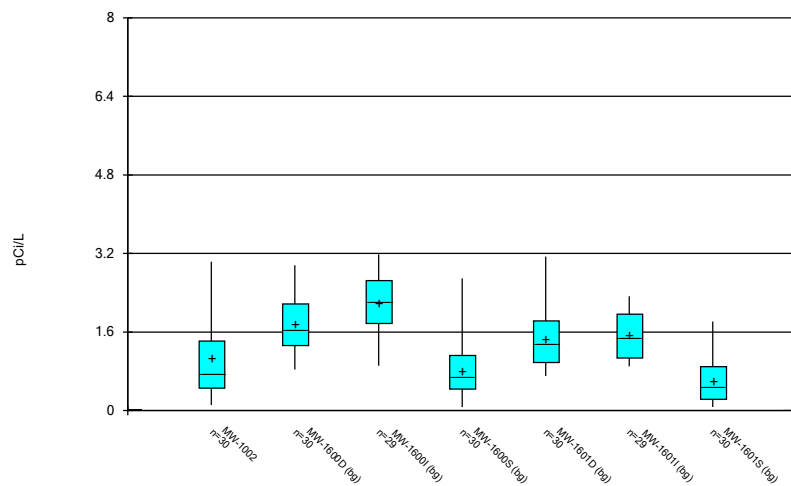


Constituent: Combined Radium 226 + 228 Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

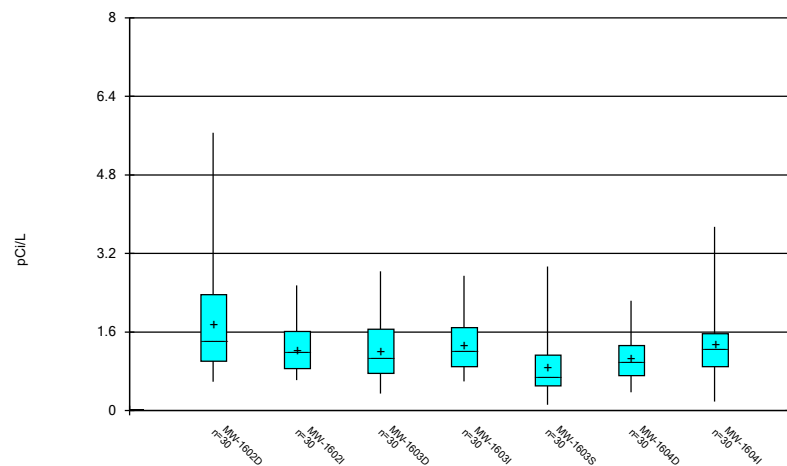


Constituent: Combined Radium 226 + 228 Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

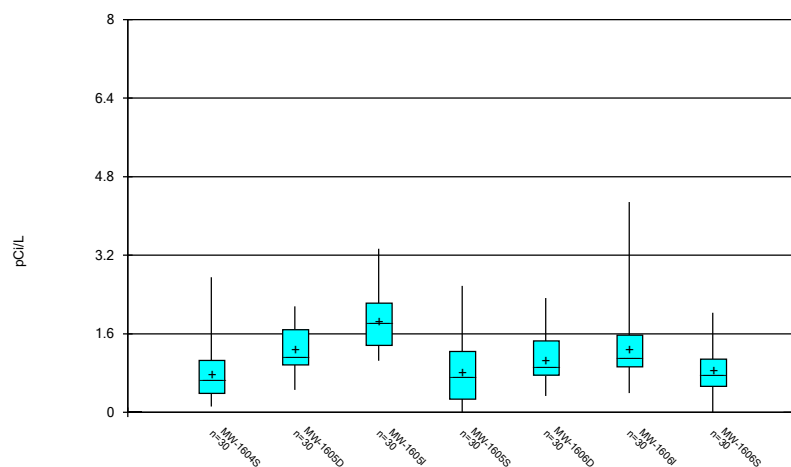


Constituent: Combined Radium 226 + 228 Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

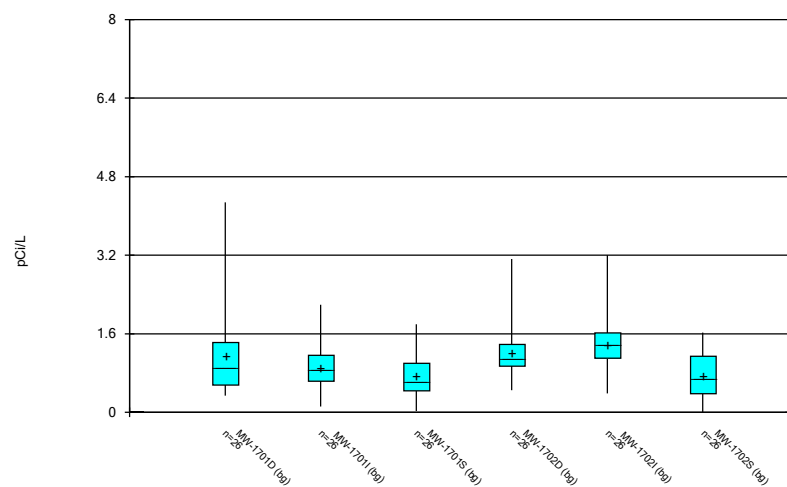


Constituent: Combined Radium 226 + 228 Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

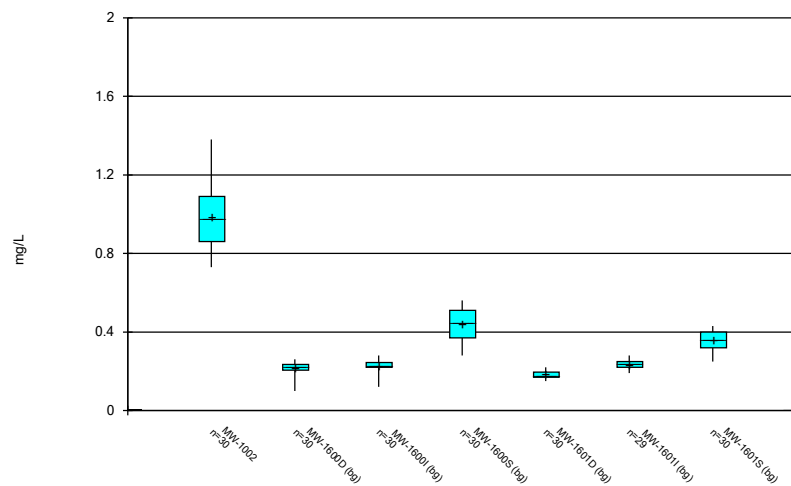


Constituent: Fluoride, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

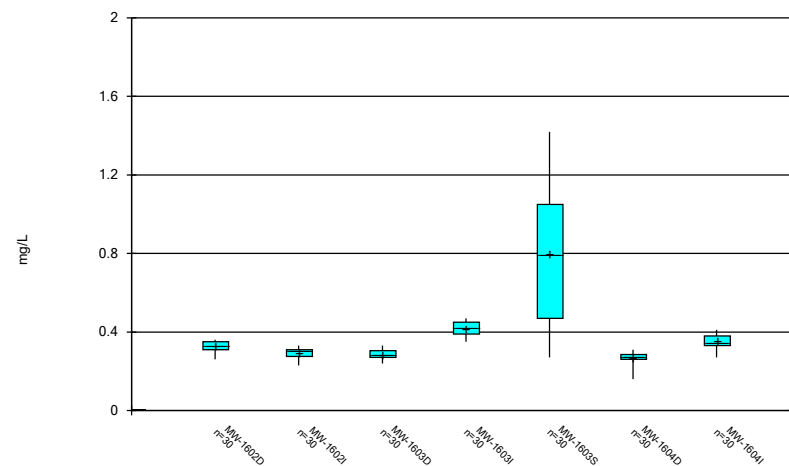


Constituent: Fluoride, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

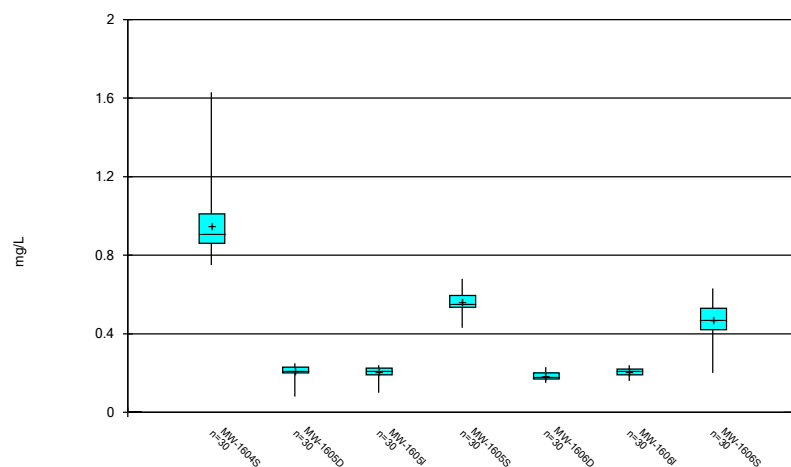


Constituent: Fluoride, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

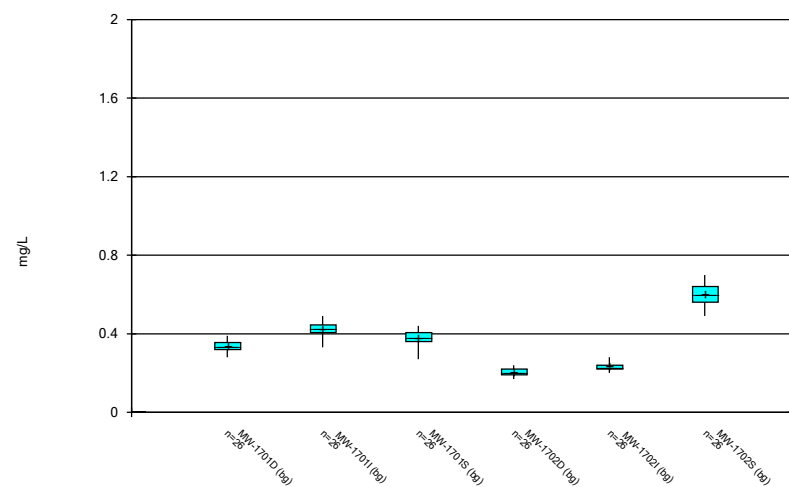


Constituent: Fluoride, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

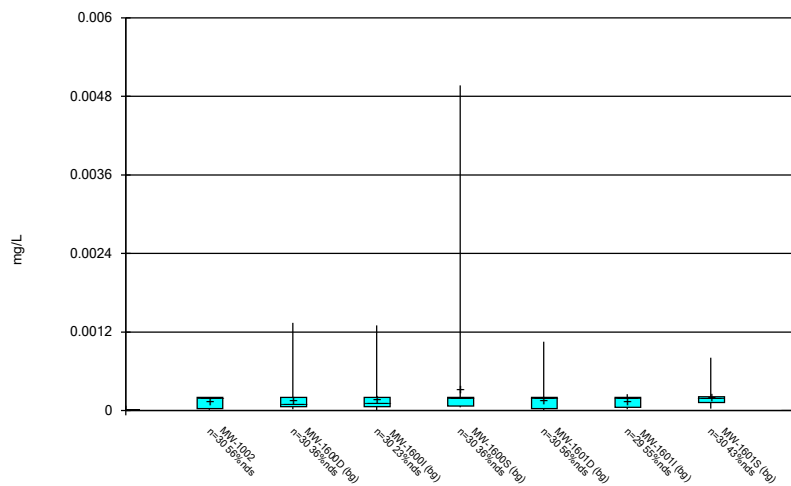


Constituent: Lead, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

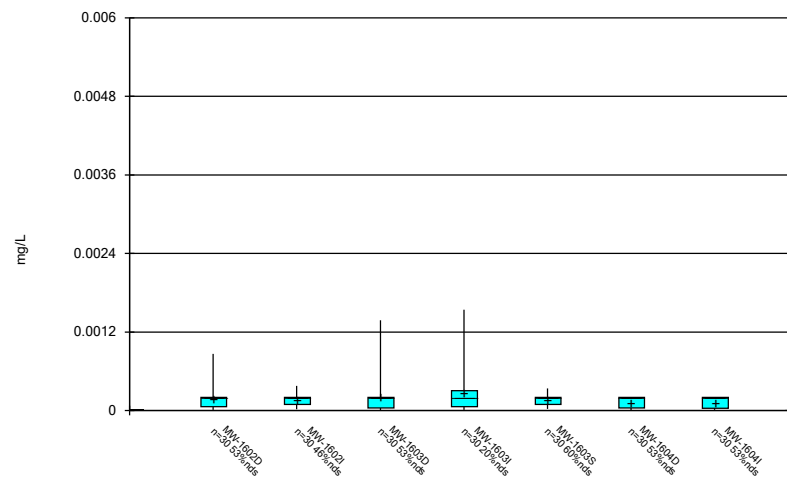


Constituent: Lead, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

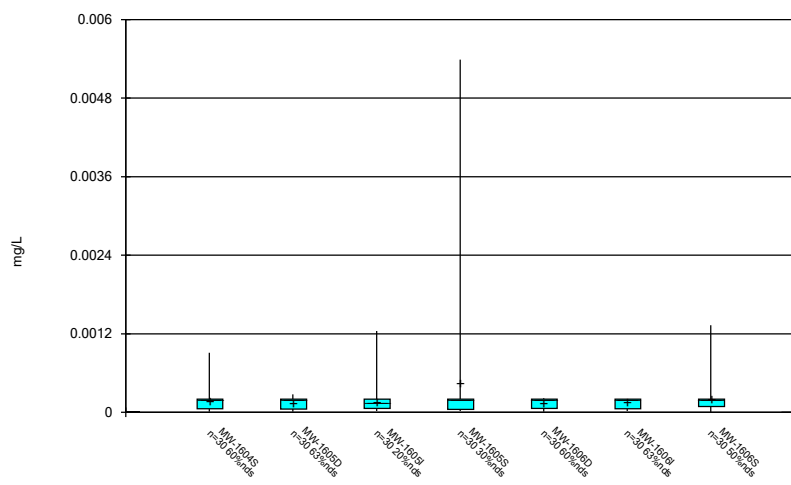


Constituent: Lead, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

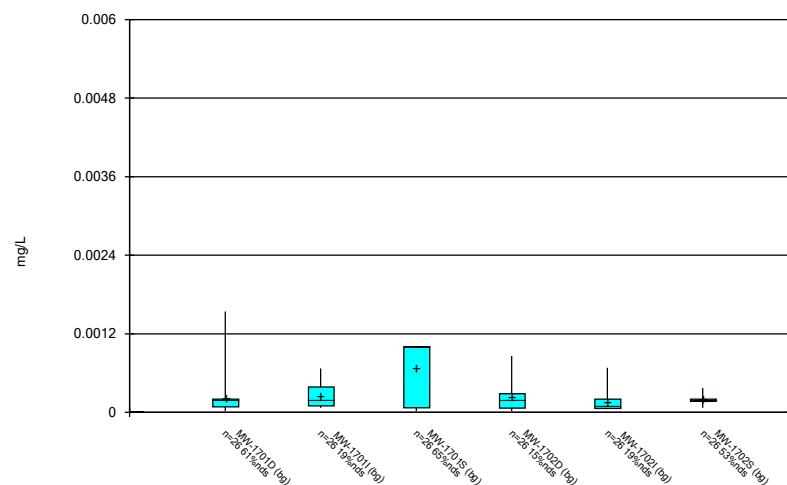


Constituent: Lead, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

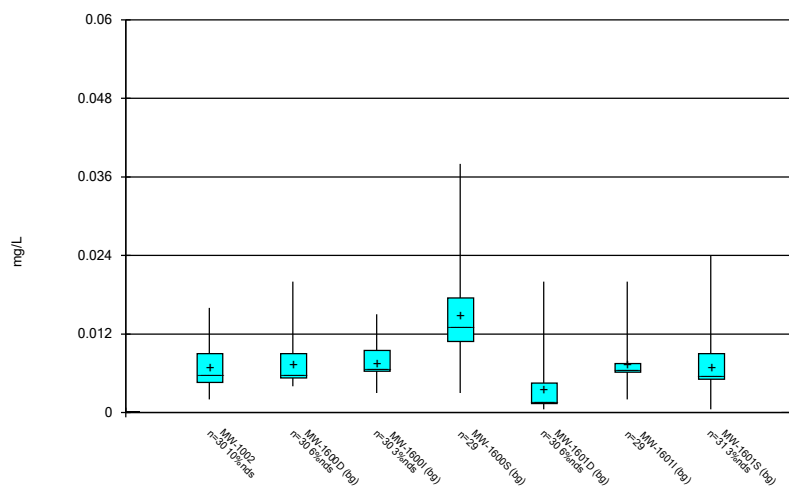


Constituent: Lithium, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

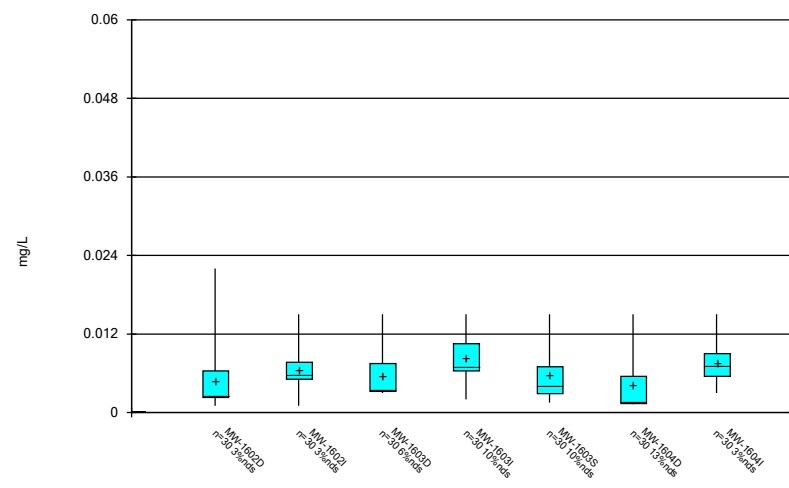


Constituent: Lithium, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

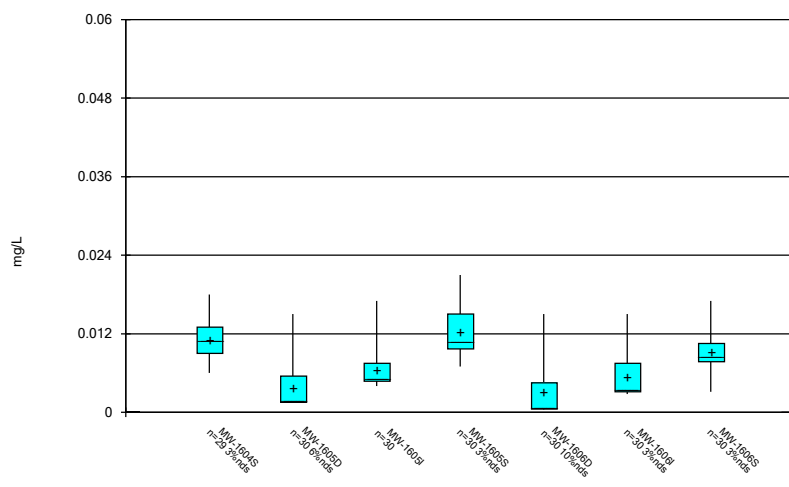


Constituent: Lithium, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

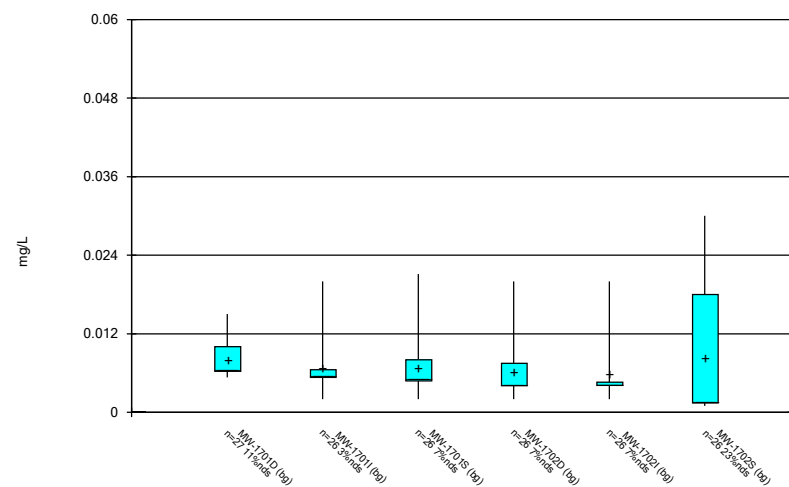


Constituent: Lithium, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

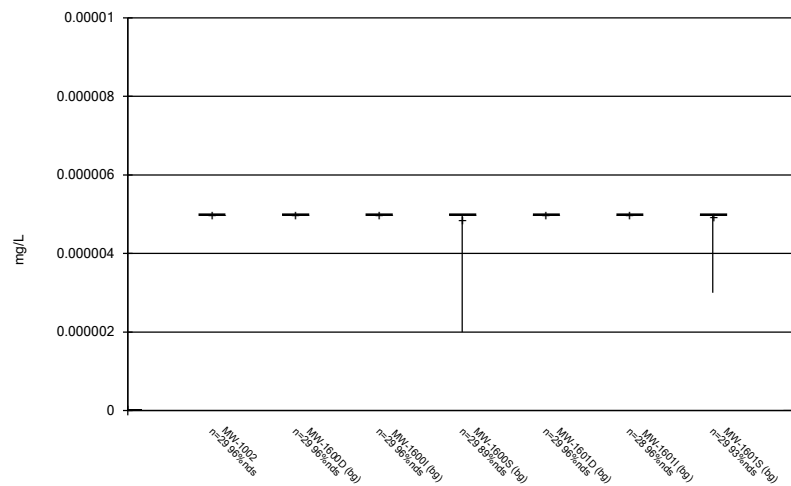


Constituent: Mercury, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

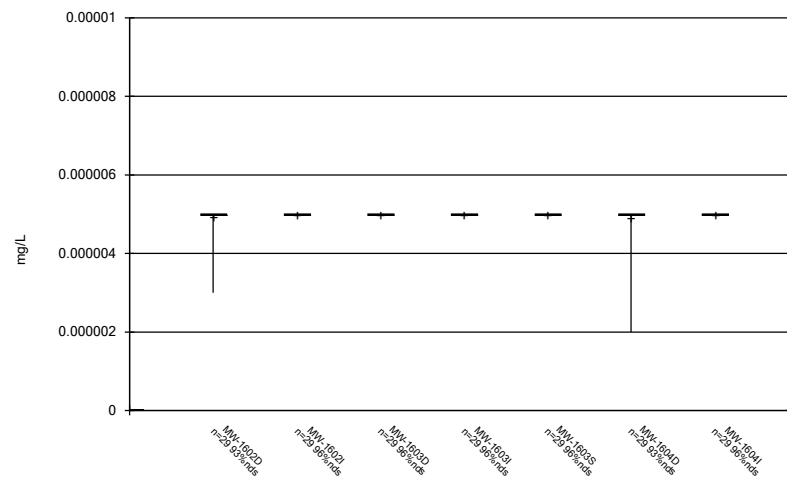


Constituent: Mercury, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

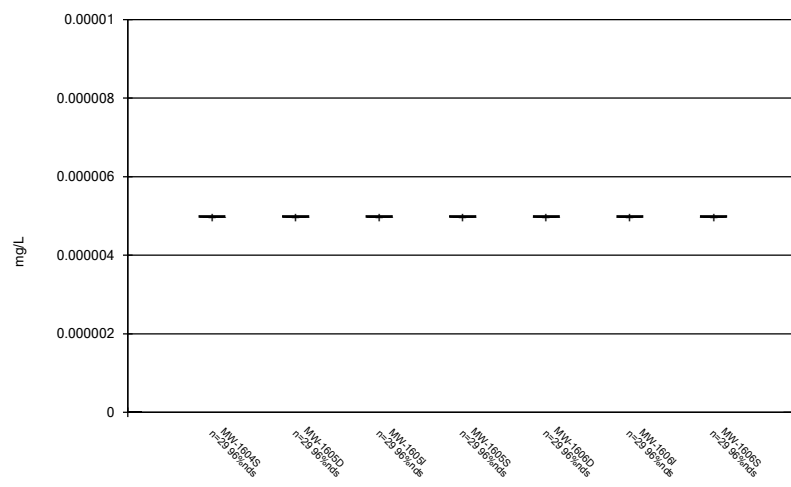


Constituent: Mercury, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

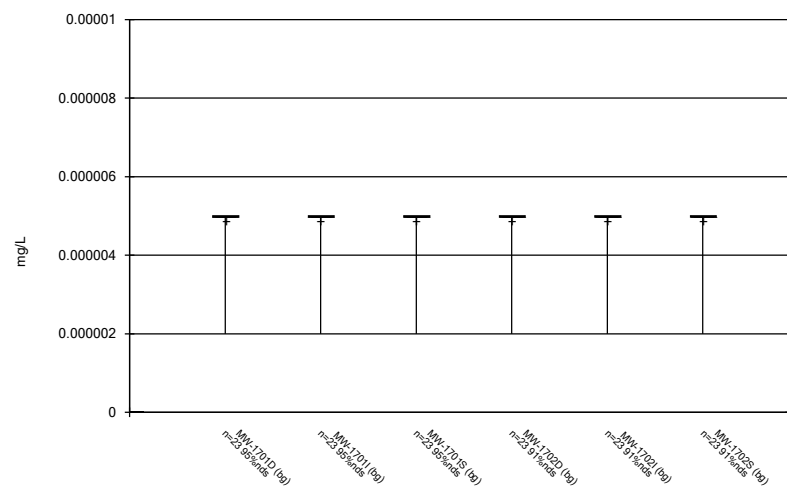


Constituent: Mercury, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

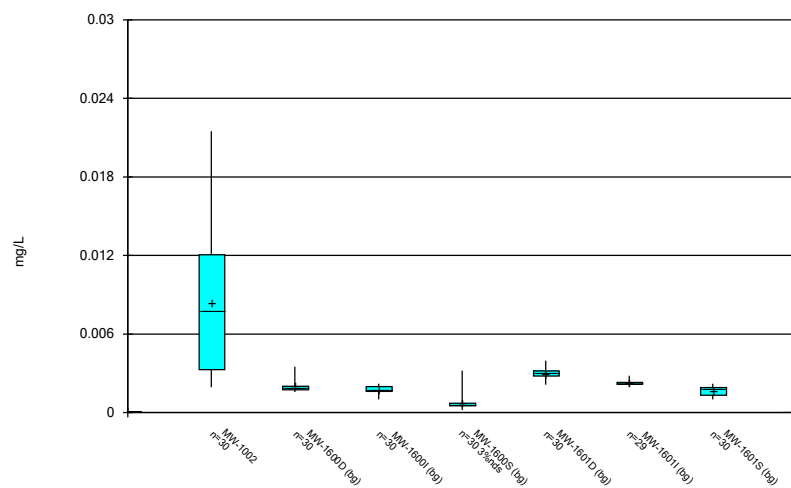


Constituent: Molybdenum, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

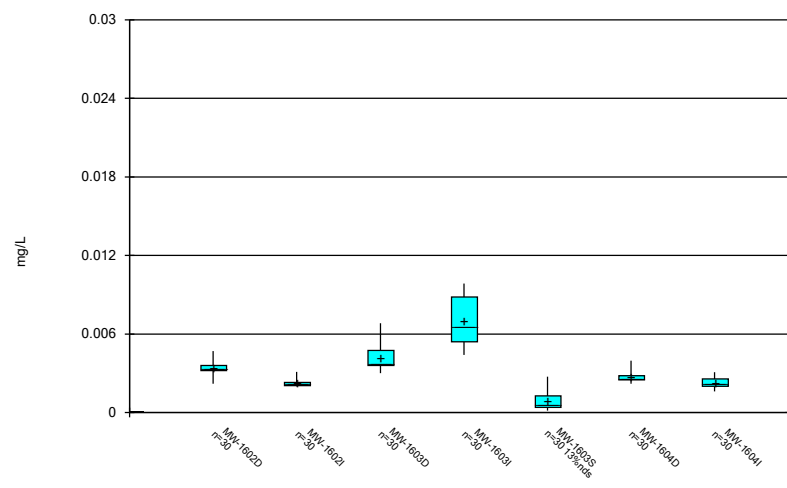


Constituent: Molybdenum, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

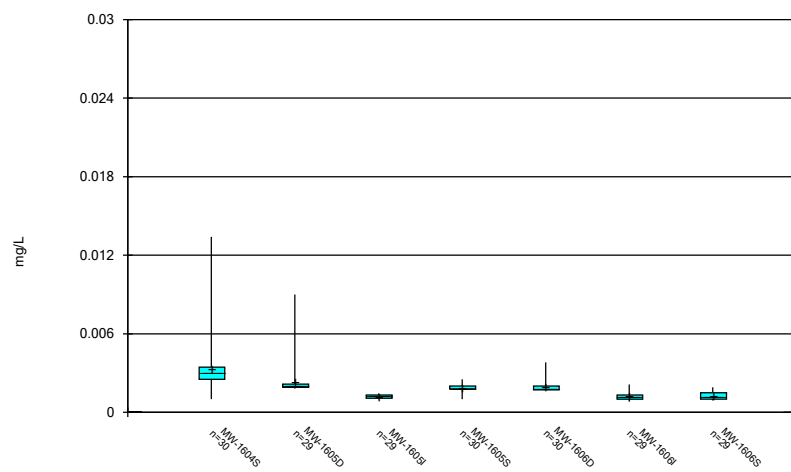


Constituent: Molybdenum, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

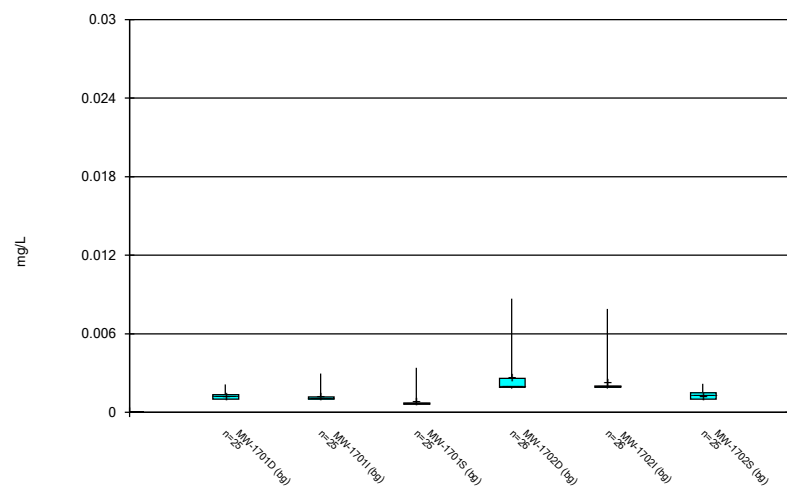


Constituent: Molybdenum, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

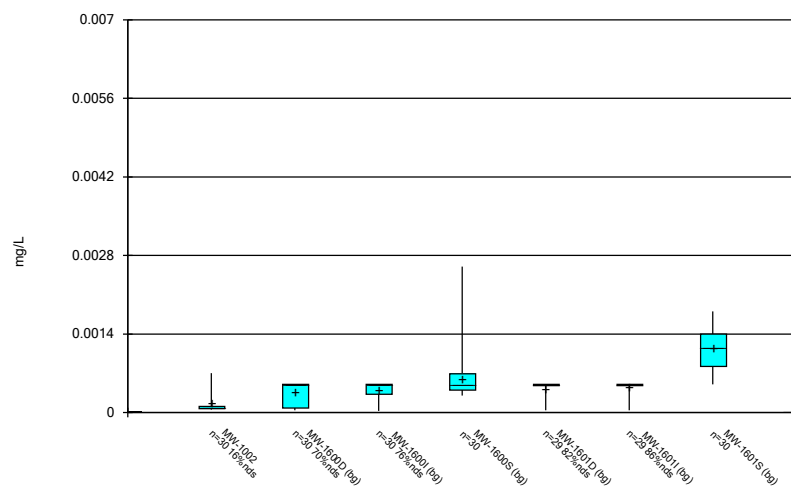


Constituent: Selenium, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

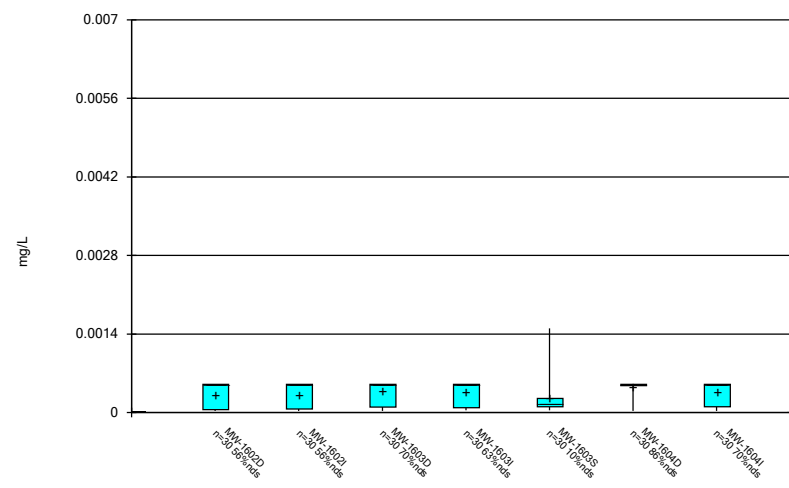


Constituent: Selenium, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

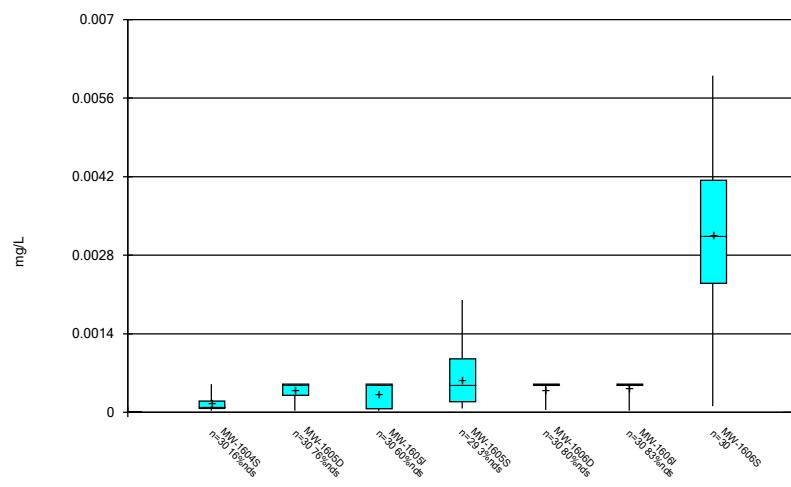


Constituent: Selenium, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

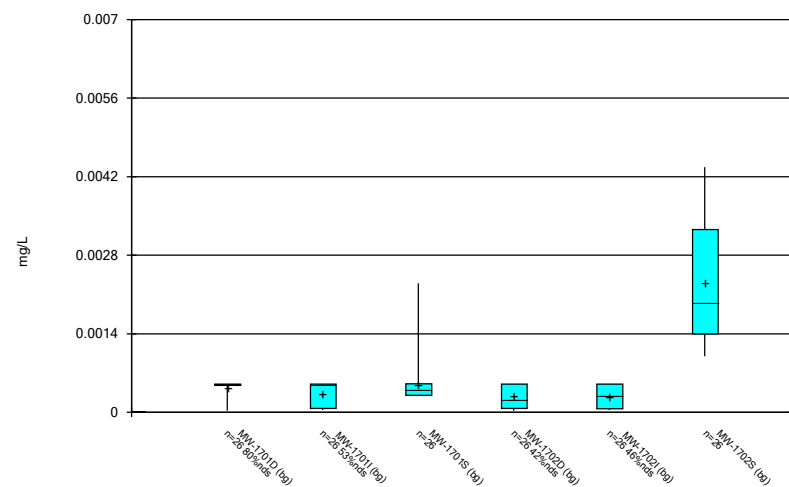


Constituent: Selenium, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

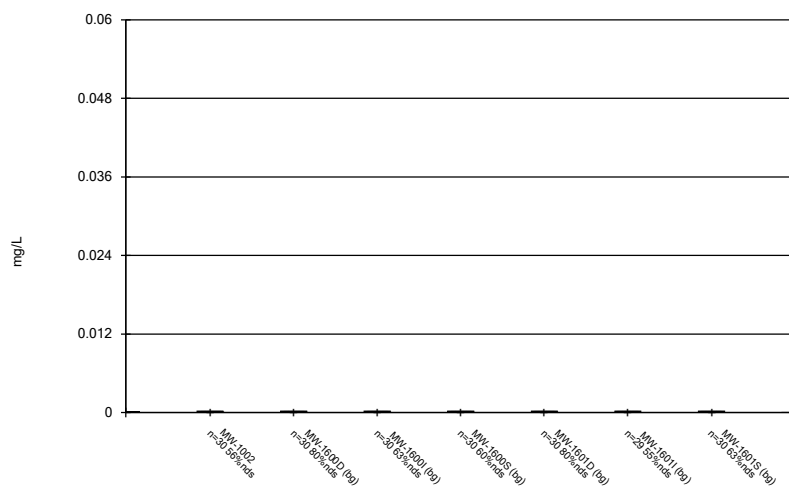


Constituent: Thallium, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

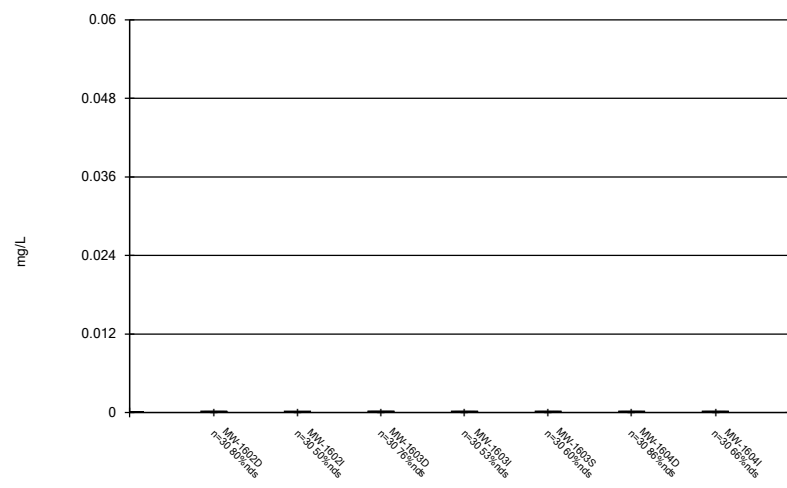


Constituent: Thallium, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

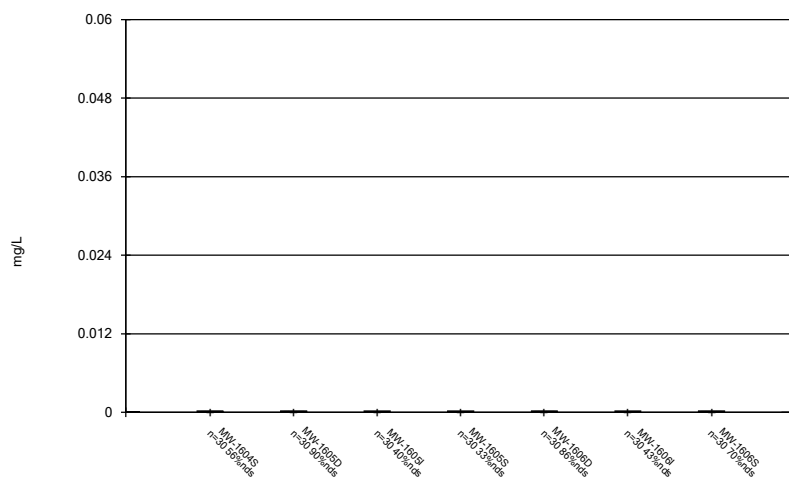

Constituent: Thallium, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Box & Whiskers Plot

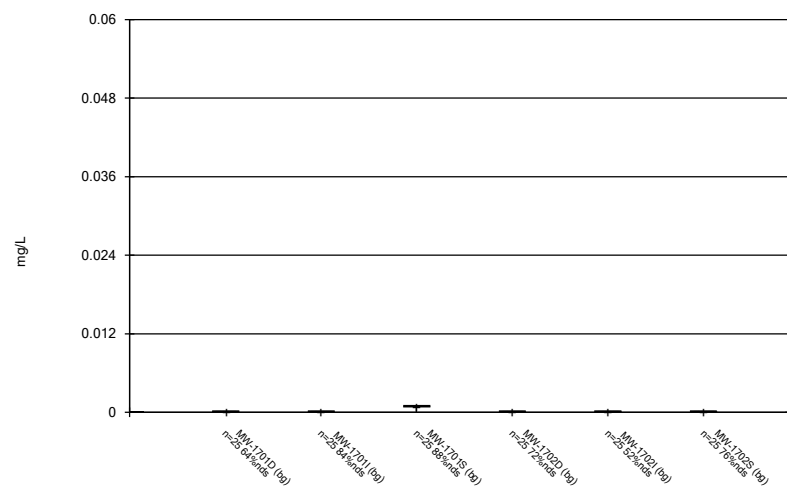

Constituent: Thallium, total Analysis Run 7/28/2025 11:57 AM
Rockport BAP Client: Geosyntec Data: Rockport_BAP

FIGURE C

Outlier Summary

Outlier Summary

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 7/28/2025, 12:01 PM

	MW-1603D Chromium, total (mg/L)	MW-1702S Chromium, total (mg/L)	MW-1600S Cobalt, total (mg/L)	MW-1600I Combined Radium 226 + 228 (pCi/L)	MW-1600S Lithium, total (mg/L)	MW-1604S Lithium, total (mg/L)	MW-1605D Molybdenum, total (mg/L)	MW-1605I Molybdenum, total (mg/L)	MW-1606I Molybdenum, total (mg/L)	MW-1606S Molybdenum, total (mg/L)
6/7/2016							0.00765 (o)			
6/8/2016			7.25 (o)							
10/10/2016	0.0238 (o)									
12/12/2017		0.00413 (o)								
8/15/2018										
5/24/2019										
6/25/2019							<0.01 (o)	<0.01 (o)	<0.01 (o)	
5/27/2021		0.00995 (o)								
5/15/2024				0.0479 (o)	0.0556 (o)					

	MW-1701D Molybdenum, total (mg/L)	MW-1701I Molybdenum, total (mg/L)	MW-1701S Molybdenum, total (mg/L)	MW-1702S Molybdenum, total (mg/L)	MW-1601D Selenium, total (mg/L)	MW-1605S Selenium, total (mg/L)	MW-1701D Thallium, total (mg/L)	MW-1701I Thallium, total (mg/L)	MW-1701S Thallium, total (mg/L)	MW-1702D Thallium, total (mg/L)
6/7/2016										
6/8/2016										
10/10/2016										
12/12/2017						0.051 (o)	0.04 (o)	0.02 (o)	0.03 (o)	
8/15/2018					0.0054 (o)					
5/24/2019				3E-05 (Jo)						
6/25/2019	<0.01 (o)	<0.01 (o)	<0.01 (o)	<0.01 (o)						
5/27/2021										
5/15/2024										

	MW-1702I Thallium, total (mg/L)	MW-1702S Thallium, total (mg/L)
6/7/2016		
6/8/2016		
10/10/2016		
12/12/2017	0.04 (o)	0.01 (o)
8/15/2018		
5/24/2019		
6/25/2019		
5/27/2021		
5/15/2024		

FIGURE D

UTLs


Upper Tolerance Limits

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 1/16/2025, 12:34 PM

<u>Constituent</u>	<u>Upper Lim.</u>	<u>Date</u>	<u>Observ.</u>	<u>Sig.</u>	<u>Bg N</u>	<u>%NDs</u>	<u>Transform</u>	<u>Alpha</u>	<u>Method</u>
Antimony, total (mg/L)	0.00044	n/a	n/a	n/a	311	26.69	n/a	NaN	NP Inter(normality)
Arsenic, total (mg/L)	0.0791	n/a	n/a	n/a	311	0	n/a	NaN	NP Inter(normality)
Barium, total (mg/L)	1.2	n/a	n/a	n/a	311	0	n/a	NaN	NP Inter(normality)
Beryllium, total (mg/L)	0.000106	n/a	n/a	n/a	311	83.28	n/a	NaN	NP Inter(NDs)
Cadmium, total (mg/L)	0.00028	n/a	n/a	n/a	311	35.05	n/a	NaN	NP Inter(normality)
Chromium, total (mg/L)	0.00205	n/a	n/a	n/a	310	1.29	n/a	NaN	NP Inter(normality)
Cobalt, total (mg/L)	0.00334	n/a	n/a	n/a	310	0.6452	n/a	NaN	NP Inter(normality)
Combined Radium 226 + 228 (pCi/L)	2.785	n/a	n/a	n/a	310	0	sqrt(x)	0.05	Inter
Fluoride, total (mg/L)	0.7	n/a	n/a	n/a	311	0	n/a	NaN	NP Inter(normality)
Lead, total (mg/L)	0.00497	n/a	n/a	n/a	311	39.23	n/a	NaN	NP Inter(normality)
Lithium, total (mg/L)	0.038	n/a	n/a	n/a	312	7.051	n/a	NaN	NP Inter(normality)
Mercury, total (mg/L)	0.000005	n/a	n/a	n/a	287	93.73	n/a	NaN	NP Inter(NDs)
Molybdenum, total (mg/L)	0.00867	n/a	n/a	n/a	307	0.3257	n/a	NaN	NP Inter(normality)
Selenium, total (mg/L)	0.00437	n/a	n/a	n/a	310	44.19	n/a	NaN	NP Inter(normality)
Thallium, total (mg/L)	0.0002	n/a	n/a	n/a	305	69.51	n/a	NaN	NP Inter(NDs)

Tolerance Limit

Interwell Non-parametric

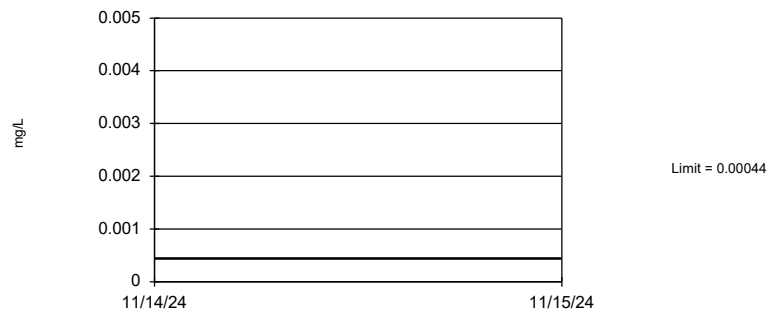

Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 311 background values. 26.69% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Antimony, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric



Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 311 background values. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Arsenic, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric



Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 311 background values. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Barium, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric



Non-parametric test used in lieu of parametric tolerance limit because censored data exceeded 50%. Limit is highest of 311 background values. 83.28% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Beryllium, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric




Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 311 background values. 35.05% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Cadmium, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric

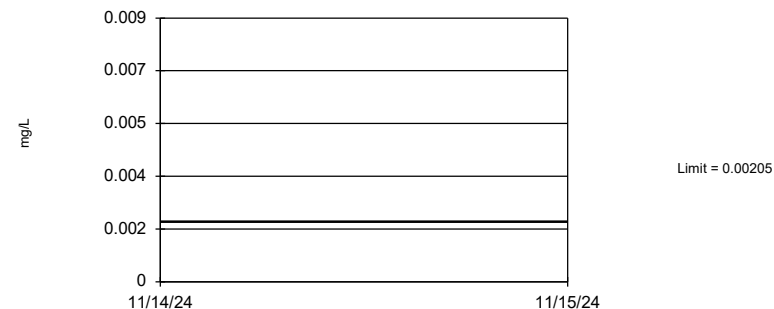


Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 310 background values. 1.29% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Chromium, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric

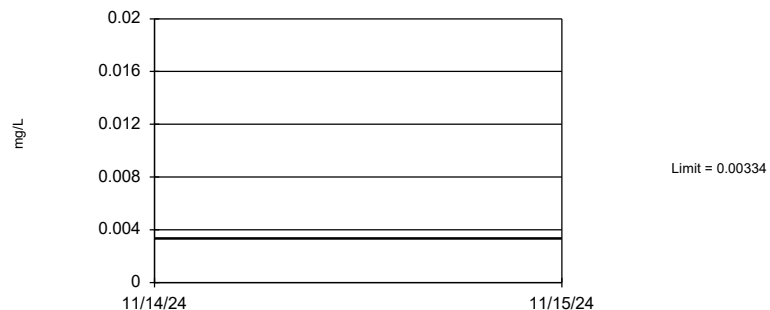


Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 310 background values. 0.6452% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Cobalt, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Parametric

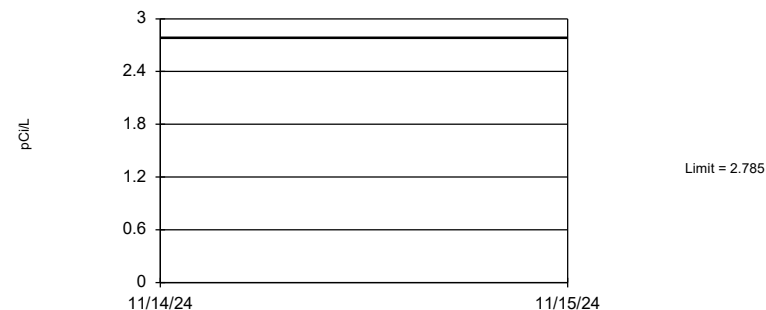

95% coverage. Background Data Summary (based on square root transformation): Mean=1.053, Std. Dev.=0.343, n=310. Normality test: Chi Squared @alpha = 0.01, calculated = 3.226, critical = 14.07. Report alpha = 0.05.

Constituent: Combined Radium 226 + 228 Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric




Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 311 background values. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Fluoride, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric

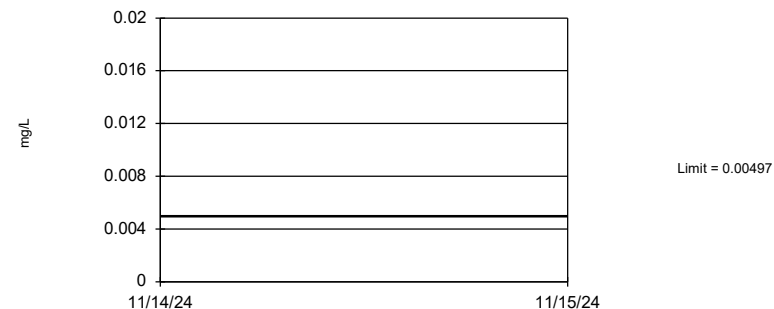


Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 311 background values. 39.23% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Lead, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric

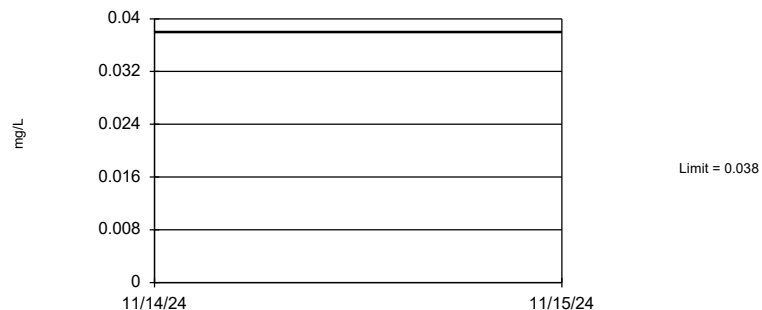

Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 312 background values. 7.051% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Lithium, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric




Non-parametric test used in lieu of parametric tolerance limit because censored data exceeded 50%. Limit is highest of 287 background values. 93.73% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Mercury, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric

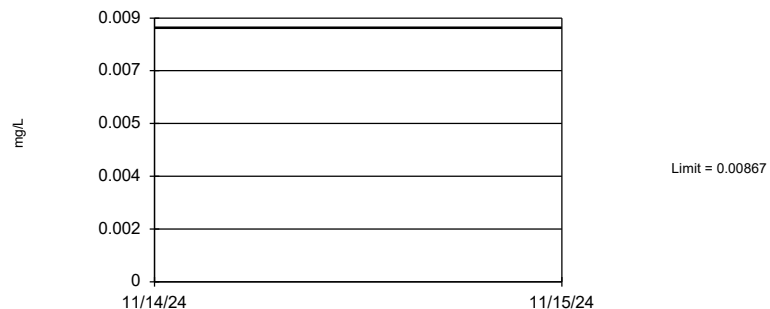

Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 307 background values. 0.3257% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Molybdenum, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric



Non-parametric test used in lieu of parametric tolerance limit because the Chi Squared normality test showed the data to be non-normal at the 0.01 alpha level. Limit is highest of 310 background values. 44.19% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Selenium, total Analysis Run 1/16/2025 12:31 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Tolerance Limit

Interwell Non-parametric



Non-parametric test used in lieu of parametric tolerance limit because censored data exceeded 50%. Limit is highest of 305 background values. 69.51% NDs. 99.8% coverage at alpha=0.01; 99.8% coverage at alpha=0.05; 99.8% coverage at alpha=0.5. Report alpha < 0.0001.

Constituent: Thallium, total Analysis Run 1/16/2025 12:32 PM View: UTLs
Rockport BAP Client: Geosyntec Data: Rockport_BAP

FIGURE E
GWPS

ROCKPORT BAP GWPS				
Constituent Name	MCL	CCR Rule Specified	Background Limit	GWPS
Antimony, Total (mg/L)	0.006		0.00044	0.006
Arsenic, Total (mg/L)	0.01		0.079	0.079
Barium, Total (mg/L)	2		1.2	2
Beryllium, Total (mg/L)	0.004		0.00011	0.004
Cadmium, Total (mg/L)	0.005		0.00028	0.005
Chromium, Total (mg/L)	0.1		0.0021	0.1
Cobalt, Total (mg/L)		0.006	0.0033	0.006
Combined Radium, Total (pCi/L)	5		2.79	5
Fluoride, Total (mg/L)	4		0.7	4
Lead, Total (mg/L)	0.015		0.005	0.015
Lithium, Total (mg/L)		0.04	0.038	0.04
Mercury, Total (mg/L)	0.002		0.000005	0.002
Molybdenum, Total (mg/L)		0.1	0.0087	0.1
Selenium, Total (mg/L)	0.05		0.0044	0.05
Thallium, Total (mg/L)	0.002		0.0002	0.002

**Grey cell indicates background is higher than MCL or CCR Rule Specified Level*

**MCL = Maximum Contaminant Level*

**CCR = Coal Combustion Residual*

**GWPS = Groundwater Protection Standard*

FIGURE F

Confidence Intervals

Confidence Intervals - All Results (No Significant)

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 7/28/2025, 12:13 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig.	N	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Antimony, total (mg/L)	MW-1002	0.00005	0.000044	0.006	No	30	0.000006904	3.333	None	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1602D	0.0001	0.000013	0.006	No	30	0.00004575	36.67	None	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1602I	0.00005	0.000025	0.006	No	30	0.00003582	6.667	None	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1603D	0.0001	0.000012	0.006	No	30	0.00004043	36.67	None	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1603I	0.000065	0.00003	0.006	No	30	0.000181	6.667	None	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1603S	0.00005	0.000037	0.006	No	30	0.00001381	3.333	None	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1604D	0.0001	0.00002	0.006	No	30	0.00004092	56.67	None	No	0.01	NP (NDs)
Antimony, total (mg/L)	MW-1604I	0.00004	0.00002	0.006	No	30	0.00004791	6.667	None	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1604S	0.00006	0.00005	0.006	No	30	0.0000328	0	None	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1605D	0.0001	0.000016	0.006	No	30	0.00003993	40	None	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1605I	0.00005	0.00003	0.006	No	30	0.00003357	6.667	None	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1605S	0.00005	0.000038	0.006	No	30	0.00002945	0	None	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1606D	0.0001	0.000017	0.006	No	30	0.00004163	53.33	None	No	0.01	NP (NDs)
Antimony, total (mg/L)	MW-1606I	0.00005	0.00002	0.006	No	30	0.00003735	33.33	None	No	0.01	NP (normality)
Antimony, total (mg/L)	MW-1606S	0.00005	0.000032	0.006	No	30	0.00003552	6.667	None	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1002	0.00026	0.00022	0.079	No	30	0.00004684	0	None	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1602D	0.00962	0.00889	0.079	No	30	0.003349	0	None	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1602I	0.02824	0.02045	0.079	No	30	0.01108	0	None	ln(x)	0.01	Param.
Arsenic, total (mg/L)	MW-1603D	0.01358	0.01234	0.079	No	30	0.001381	0	None	No	0.01	Param.
Arsenic, total (mg/L)	MW-1603I	0.0148	0.0126	0.079	No	30	0.03828	0	None	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1603S	0.0002101	0.000168	0.079	No	30	0.00005462	0	None	ln(x)	0.01	Param.
Arsenic, total (mg/L)	MW-1604D	0.0182	0.0169	0.079	No	30	0.001262	0	None	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1604I	0.0204	0.0185	0.079	No	30	0.00741	0	None	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1604S	0.00024	0.00017	0.079	No	30	0.0001526	0	None	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1605D	0.0209	0.0186	0.079	No	30	0.01368	0	None	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1605I	0.0212	0.0178	0.079	No	30	0.007244	0	None	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1605S	0.00059	0.00046	0.079	No	30	0.00058	0	None	No	0.01	NP (normality)
Arsenic, total (mg/L)	MW-1606D	0.01728	0.01586	0.079	No	30	0.001857	0	None	x^4	0.01	Param.
Arsenic, total (mg/L)	MW-1606I	0.01111	0.007529	0.079	No	30	0.003978	0	None	No	0.01	Param.
Arsenic, total (mg/L)	MW-1606S	0.00023	0.00017	0.079	No	30	0.0153	0	None	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1002	0.0179	0.0137	2	No	30	0.005371	0	None	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1602D	0.455	0.419	2	No	30	0.07725	0	None	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1602I	0.126	0.0992	2	No	30	0.05992	0	None	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1603D	0.128	0.112	2	No	30	0.02	0	None	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1603I	0.0919	0.0811	2	No	30	0.02279	0	None	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1603S	0.01377	0.009752	2	No	30	0.004468	0	None	No	0.01	Param.
Barium, total (mg/L)	MW-1604D	0.2575	0.2412	2	No	30	0.01808	0	None	No	0.01	Param.
Barium, total (mg/L)	MW-1604I	0.1185	0.1021	2	No	30	0.01833	0	None	No	0.01	Param.
Barium, total (mg/L)	MW-1604S	0.0173	0.0132	2	No	30	0.01029	0	None	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1605D	0.453	0.434	2	No	30	0.3011	0	None	No	0.01	NP (normality)
Barium, total (mg/L)	MW-1605I	0.1501	0.1341	2	No	30	0.01778	0	None	No	0.01	Param.
Barium, total (mg/L)	MW-1605S	0.008741	0.006711	2	No	30	0.002424	0	None	sqrt(x)	0.01	Param.
Barium, total (mg/L)	MW-1606D	0.4648	0.424	2	No	30	0.04739	0	None	x^2	0.01	Param.
Barium, total (mg/L)	MW-1606I	0.06099	0.05276	2	No	30	0.01002	0	None	ln(x)	0.01	Param.
Barium, total (mg/L)	MW-1606S	0.0136	0.0111	2	No	30	0.009719	0	None	No	0.01	NP (normality)
Beryllium, total (mg/L)	MW-1002	0.00005	0.00002	0.004	No	30	0.00001428	86.67	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1602D	0.00005	0.00002	0.004	No	30	0.00001801	70	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1602I	0.00005	0.00002	0.004	No	30	0.00001749	76.67	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1603D	0.00005	0.000049	0.004	No	30	0.00001128	86.67	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1603I	0.00005	0.00003	0.004	No	30	0.00001622	70	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1603S	0.00005	0.00002	0.004	No	30	0.00001325	86.67	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1604D	0.00005	0.00002	0.004	No	30	0.000009867	93.33	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1604I	0.00005	0.000025	0.004	No	30	0.00001067	90	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1604S	0.00005	0.00002	0.004	No	30	0.0000124	86.67	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1605D	0.00005	0.000043	0.004	No	30	0.000009005	90	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1605I	0.00005	0.00002	0.004	No	30	0.00001421	86.67	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1605S	0.00005	0.00004	0.004	No	30	0.00001263	76.67	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1606D	0.00005	0.000034	0.004	No	30	0.00001473	80	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1606I	0.00005	0.00002	0.004	No	30	0.000009416	93.33	None	No	0.01	NP (NDs)
Beryllium, total (mg/L)	MW-1606S	0.00005	0.000024	0.004	No	30	0.00001717	73.33	None	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1002	0.00003	0.00002	0.005	No	30	0.00002513	0	None	No	0.01	NP (normality)
Cadmium, total (mg/L)	MW-1602D	0.00002	0.00001	0.005	No	30	0.00001021	76.67	None	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1602I	0.00002	0.00001	0.005	No	30	0.000006692	66.67	None	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1603D	0.00002	0.000016	0.005	No	30	0.000005182	73.33	None	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1603I	0.00002	0.000016	0.005	No	30	0.00001027	60	None	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1603S	0.00003	0.000019	0.005	No	30	0.000009482	3.333	None	No	0.01	NP (normality)
Cadmium, total (mg/L)	MW-1604D	0.00002	0.000013	0.005	No	30	0.000004608	80	None	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1604I	0.00002	0.000013	0.005	No	30	0.00002014	66.67	None	No	0.01	NP (NDs)

Confidence Intervals - All Results (No Significant)

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 7/28/2025, 12:13 PM

Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig.	N	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Cadmium, total (mg/L)	MW-1604S	0.00003	0.00002	0.005	No	30	0.00002053	0	None	No	0.01	NP (normality)
Cadmium, total (mg/L)	MW-1605D	0.00002	0.000006	0.005	No	30	0.00000493	83.33	None	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1605I	0.00002	0.000008	0.005	No	30	0.00009019	56.67	None	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1605S	0.000041	0.000031	0.005	No	30	0.00001977	0	None	No	0.01	NP (normality)
Cadmium, total (mg/L)	MW-1606D	0.00002	0.00002	0.005	No	30	0.000002373	90	None	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1606I	0.00002	0.00001	0.005	No	30	0.000006961	60	None	No	0.01	NP (NDs)
Cadmium, total (mg/L)	MW-1606S	0.00003685	0.00002304	0.005	No	30	0.00002139	0	None	ln(x)	0.01	Param.
Chromium, total (mg/L)	MW-1002	0.0002565	0.0001411	0.1	No	30	0.0001406	3.333	None	sqrt(x)	0.01	Param.
Chromium, total (mg/L)	MW-1602D	0.000354	0.000232	0.1	No	30	0.0002316	0	None	No	0.01	NP (normality)
Chromium, total (mg/L)	MW-1602I	0.0003185	0.0001973	0.1	No	30	0.0001348	3.333	None	No	0.01	Param.
Chromium, total (mg/L)	MW-1603D	0.0002612	0.0001785	0.1	No	29	0.00009024	0	None	No	0.01	Param.
Chromium, total (mg/L)	MW-1603I	0.0004604	0.0002205	0.1	No	30	0.0002978	0	None	sqrt(x)	0.01	Param.
Chromium, total (mg/L)	MW-1603S	0.00033	0.0002042	0.1	No	30	0.0001399	0	None	No	0.01	Param.
Chromium, total (mg/L)	MW-1604D	0.0002264	0.0001411	0.1	No	30	0.00009492	0	None	No	0.01	Param.
Chromium, total (mg/L)	MW-1604I	0.0002927	0.0001633	0.1	No	30	0.0001439	0	None	No	0.01	Param.
Chromium, total (mg/L)	MW-1604S	0.0003254	0.0001668	0.1	No	30	0.0002104	0	None	sqrt(x)	0.01	Param.
Chromium, total (mg/L)	MW-1605D	0.0002718	0.0001541	0.1	No	30	0.0002597	0	None	ln(x)	0.01	Param.
Chromium, total (mg/L)	MW-1605I	0.0002717	0.0001463	0.1	No	30	0.0002089	3.333	None	x^(1/3)	0.01	Param.
Chromium, total (mg/L)	MW-1605S	0.0006824	0.0003585	0.1	No	30	0.0003603	0	None	No	0.01	Param.
Chromium, total (mg/L)	MW-1606D	0.0002969	0.0001659	0.1	No	30	0.0001456	3.333	None	No	0.01	Param.
Chromium, total (mg/L)	MW-1606I	0.000362	0.0001712	0.1	No	30	0.0002631	6.667	None	sqrt(x)	0.01	Param.
Chromium, total (mg/L)	MW-1606S	0.0003706	0.0002088	0.1	No	30	0.0002804	3.333	None	ln(x)	0.01	Param.
Cobalt, total (mg/L)	MW-1002	0.0006694	0.000522	0.006	No	30	0.0001639	0	None	No	0.01	Param.
Cobalt, total (mg/L)	MW-1602D	0.0001482	0.00006505	0.006	No	30	0.000281	0	None	ln(x)	0.01	Param.
Cobalt, total (mg/L)	MW-1602I	0.001536	0.001288	0.006	No	30	0.0003449	0	None	x^2	0.01	Param.
Cobalt, total (mg/L)	MW-1603D	0.000441	0.00028	0.006	No	30	0.000398	0	None	No	0.01	NP (normality)
Cobalt, total (mg/L)	MW-1603I	0.00135	0.00117	0.006	No	30	0.0004619	0	None	No	0.01	NP (normality)
Cobalt, total (mg/L)	MW-1603S	0.0004445	0.0002786	0.006	No	30	0.0001845	0	None	No	0.01	Param.
Cobalt, total (mg/L)	MW-1604D	0.000064	0.00005	0.006	No	30	0.00002003	0	None	No	0.01	NP (normality)
Cobalt, total (mg/L)	MW-1604I	0.0008269	0.0006655	0.006	No	30	0.0001796	0	None	No	0.01	Param.
Cobalt, total (mg/L)	MW-1604S	0.000365	0.000285	0.006	No	30	0.0002544	0	None	No	0.01	NP (normality)
Cobalt, total (mg/L)	MW-1605D	0.0001054	0.00006152	0.006	No	30	0.00007079	0	None	ln(x)	0.01	Param.
Cobalt, total (mg/L)	MW-1605I	0.001437	0.001254	0.006	No	30	0.0002031	0	None	No	0.01	Param.
Cobalt, total (mg/L)	MW-1605S	0.000472	0.000361	0.006	No	30	0.0007886	0	None	No	0.01	NP (normality)
Cobalt, total (mg/L)	MW-1606D	0.000085	0.000049	0.006	No	30	0.00008629	0	None	No	0.01	NP (normality)
Cobalt, total (mg/L)	MW-1606I	0.001296	0.001038	0.006	No	30	0.0002862	0	None	No	0.01	Param.
Cobalt, total (mg/L)	MW-1606S	0.000108	0.00006	0.006	No	30	0.0003371	3.333	None	No	0.01	NP (normality)
Combined Radium 226 + 228 (pCi/L)	MW-1002	1.28	0.6064	5	No	30	0.851	0	None	sqrt(x)	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1602D	2.088	1.25	5	No	30	1.081	0	None	sqrt(x)	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1602I	1.46	1.038	5	No	30	0.4699	0	None	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1603D	1.463	0.9527	5	No	30	0.5679	0	None	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1603I	1.572	1.08	5	No	30	0.5471	0	None	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1603S	1.063	0.5679	5	No	30	0.6296	0	None	sqrt(x)	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1604D	1.282	0.8507	5	No	30	0.4794	0	None	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1604I	1.575	1.02	5	No	30	0.6606	0	None	sqrt(x)	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1604S	0.9521	0.5087	5	No	30	0.5564	0	None	sqrt(x)	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1605D	1.496	1.087	5	No	30	0.4555	0	None	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1605I	2.107	1.601	5	No	30	0.5626	0	None	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1605S	1.088	0.5601	5	No	30	0.5867	0	None	No	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1606D	1.237	0.8184	5	No	30	0.4969	0	None	sqrt(x)	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1606I	1.488	0.9536	5	No	30	0.7124	0	None	sqrt(x)	0.01	Param.
Combined Radium 226 + 228 (pCi/L)	MW-1606S	1.088	0.6138	5	No	30	0.5269	0	None	No	0.01	Param.
Fluoride, total (mg/L)	MW-1002	1.059	0.9114	4	No	30	0.1645	0	None	No	0.01	Param.
Fluoride, total (mg/L)	MW-1602D	0.339	0.316	4	No	30	0.0267	0	None	x^2	0.01	Param.
Fluoride, total (mg/L)	MW-1602I	0.301	0.2797	4	No	30	0.02371	0	None	No	0.01	Param.
Fluoride, total (mg/L)	MW-1603D	0.2967	0.2766	4	No	30	0.02233	0	None	No	0.01	Param.
Fluoride, total (mg/L)	MW-1603I	0.4315	0.4031	4	No	30	0.03162	0	None	No	0.01	Param.
Fluoride, total (mg/L)	MW-1603S	0.9464	0.6443	4	No	30	0.3361	0	None	No	0.01	Param.
Fluoride, total (mg/L)	MW-1604D	0.2812	0.2568	4	No	30	0.02979	0	None	x^2	0.01	Param.
Fluoride, total (mg/L)	MW-1604I	0.3692	0.3361	4	No	30	0.03676	0	None	No	0.01	Param.
Fluoride, total (mg/L)	MW-1604S	0.98	0.88	4	No	30	0.1659	0	None	No	0.01	NP (normality)
Fluoride, total (mg/L)	MW-1605D	0.2202	0.1964	4	No	30	0.03146	0	None	x^2	0.01	Param.
Fluoride, total (mg/L)	MW-1605I	0.2173	0.1951	4	No	30	0.02801	0	None	x^2	0.01	Param.
Fluoride, total (mg/L)	MW-1605S	0.5837	0.5329	4	No	30	0.05651	0	None	No	0.01	Param.
Fluoride, total (mg/L)	MW-1606D	0.1923	0.177	4	No	30	0.01697	0	None	No	0.01	Param.
Fluoride, total (mg/L)	MW-1606I	0.212	0.1934	4	No	30	0.02067	0	None	No	0.01	Param.
Fluoride, total (mg/L)	MW-1606S	0.5084	0.4316	4	No	30	0.08546	0	None	No	0.01	Param.
Lead, total (mg/L)	MW-1002	0.0002	0.000034	0.015	No	30	0.0000836	56.67	None	No	0.01	NP (NDs)

Confidence Intervals - All Results (No Significant)

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 7/28/2025, 12:13 PM


Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig.	N	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Lead, total (mg/L)	MW-1602D	0.0002	0.00009	0.015	No	30	0.0001594	53.33	None	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1602I	0.0002	0.000096	0.015	No	30	0.00008588	46.67	None	No	0.01	NP (normality)
Lead, total (mg/L)	MW-1603D	0.0002	0.000068	0.015	No	30	0.0002458	53.33	None	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1603I	0.0002483	0.00007133	0.015	No	30	0.0003513	20	Kaplan-Meier	x^(1/3)	0.01	Param.
Lead, total (mg/L)	MW-1603S	0.0002	0.000116	0.015	No	30	0.00007457	60	Kaplan-Meier	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1604D	0.0002	0.000043	0.015	No	30	0.00008266	53.33	Kaplan-Meier	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1604I	0.0002	0.000045	0.015	No	30	0.00008324	53.33	Kaplan-Meier	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1604S	0.0002	0.000064	0.015	No	30	0.0001604	60	None	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1605D	0.0002	0.000051	0.015	No	30	0.00008283	63.33	None	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1605I	0.00012	0.00005511	0.015	No	30	0.000214	20	Kaplan-Meier	ln(x)	0.01	Param.
Lead, total (mg/L)	MW-1605S	0.0001691	0.00004529	0.015	No	30	0.001031	30	Kaplan-Meier	ln(x)	0.01	Param.
Lead, total (mg/L)	MW-1606D	0.0002	0.000086	0.015	No	30	0.0000785	60	None	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1606I	0.0002	0.000071	0.015	No	30	0.0000754	63.33	None	No	0.01	NP (NDs)
Lead, total (mg/L)	MW-1606S	0.0002	0.000097	0.015	No	30	0.0002323	50	None	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1002	0.00823	0.005136	0.04	No	30	0.003831	10	None	sqrt(x)	0.01	Param.
Lithium, total (mg/L)	MW-1602D	0.005	0.00236	0.04	No	30	0.004638	3.333	None	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1602I	0.007591	0.004815	0.04	No	30	0.003284	3.333	None	sqrt(x)	0.01	Param.
Lithium, total (mg/L)	MW-1603D	0.007	0.00326	0.04	No	30	0.003541	6.667	None	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1603I	0.009607	0.006569	0.04	No	30	0.003506	10	None	sqrt(x)	0.01	Param.
Lithium, total (mg/L)	MW-1603S	0.0062	0.003365	0.04	No	30	0.004357	10	None	ln(x)	0.01	Param.
Lithium, total (mg/L)	MW-1604D	0.004	0.0014	0.04	No	30	0.004847	13.33	None	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1604I	0.009034	0.006308	0.04	No	30	0.003032	3.333	None	No	0.01	Param.
Lithium, total (mg/L)	MW-1604S	0.01216	0.009754	0.04	No	29	0.00263	3.448	None	No	0.01	Param.
Lithium, total (mg/L)	MW-1605D	0.005	0.00153	0.04	No	30	0.003595	6.667	None	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1605I	0.00629	0.00482	0.04	No	30	0.002865	0	None	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1605S	0.01366	0.01071	0.04	No	30	0.003431	3.333	None	sqrt(x)	0.01	Param.
Lithium, total (mg/L)	MW-1606D	0.003	0.00051	0.04	No	30	0.004581	10	None	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1606I	0.007	0.00316	0.04	No	30	0.003202	3.333	None	No	0.01	NP (normality)
Lithium, total (mg/L)	MW-1606S	0.01052	0.008044	0.04	No	30	0.002758	3.333	None	No	0.01	Param.
Mercury, total (mg/L)	MW-1002	0.000005	0.000005	0.002	No	29	2.3e-14	96.55	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1602D	0.000005	0.000005	0.002	No	29	3.7e-7	93.1	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1602I	0.000005	0.000005	0.002	No	29	2.3e-14	96.55	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1603D	0.000005	0.000005	0.002	No	29	2.3e-14	96.55	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1603I	0.000005	0.000005	0.002	No	29	2.3e-14	96.55	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1603S	0.000005	0.000005	0.002	No	29	2.3e-14	96.55	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1604D	0.000005	0.000005	0.002	No	29	5.6e-7	93.1	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1604I	0.000005	0.000005	0.002	No	29	2.3e-14	96.55	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1604S	0.000005	0.000005	0.002	No	29	2.3e-14	96.55	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1605D	0.000005	0.000005	0.002	No	29	2.3e-14	96.55	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1605I	0.000005	0.000005	0.002	No	29	2.3e-14	96.55	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1605S	0.000005	0.000005	0.002	No	29	2.3e-14	96.55	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1606D	0.000005	0.000005	0.002	No	29	2.3e-14	96.55	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1606I	0.000005	0.000005	0.002	No	29	2.3e-14	96.55	None	No	0.01	NP (NDs)
Mercury, total (mg/L)	MW-1606S	0.000005	0.000005	0.002	No	29	2.3e-14	96.55	None	No	0.01	NP (NDs)
Molybdenum, total (mg/L)	MW-1002	0.01066	0.006113	0.1	No	30	0.005061	0	None	No	0.01	Param.
Molybdenum, total (mg/L)	MW-1602D	0.00351	0.0032	0.1	No	30	0.0004165	0	None	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1602I	0.0023	0.00209	0.1	No	30	0.0002599	0	None	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1603D	0.00456	0.0036	0.1	No	30	0.001001	0	None	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1603I	0.007703	0.006175	0.1	No	30	0.001701	0	None	No	0.01	Param.
Molybdenum, total (mg/L)	MW-1603S	0.00104	0.0005293	0.1	No	30	0.0006419	13.33	None	sqrt(x)	0.01	Param.
Molybdenum, total (mg/L)	MW-1604D	0.0028	0.0025	0.1	No	30	0.0003931	0	None	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1604I	0.002486	0.00211	0.1	No	30	0.000418	0	None	No	0.01	Param.
Molybdenum, total (mg/L)	MW-1604S	0.0033	0.00257	0.1	No	30	0.00205	0	None	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1605D	0.00208	0.0019	0.1	No	29	0.00132	0	None	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1605I	0.00133	0.00107	0.1	No	29	0.0001514	0	None	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1605S	0.001983	0.001745	0.1	No	30	0.0002833	0	None	x^2	0.01	Param.
Molybdenum, total (mg/L)	MW-1606D	0.002	0.00177	0.1	No	30	0.0004	0	None	No	0.01	NP (normality)
Molybdenum, total (mg/L)	MW-1606I	0.001374	0.001114	0.1	No	29	0.0002987	0	None	sqrt(x)	0.01	Param.
Molybdenum, total (mg/L)	MW-1606S	0.001407	0.001145	0.1	No	29	0.0002855	0	None	No	0.01	Param.
Selenium, total (mg/L)	MW-1002	0.0001	0.00007	0.05	No	30	0.0001882	16.67	None	No	0.01	NP (normality)
Selenium, total (mg/L)	MW-1602D	0.0005	0.00005	0.05	No	30	0.0002223	56.67	None	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1602I	0.0005	0.00007	0.05	No	30	0.0002219	56.67	None	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1603D	0.0005	0.0003	0.05	No	30	0.0002015	70	None	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1603I	0.0005	0.00014	0.05	No	30	0.0001993	63.33	None	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1603S	0.0002391	0.0001137	0.05	No	30	0.0002922	10	None	ln(x)	0.01	Param.
Selenium, total (mg/L)	MW-1604D	0.0005	0.0001	0.05	No	30	0.0001533	86.67	None	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1604I	0.0005	0.0001	0.05	No	30	0.0002025	70	None	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1604S	0.00018	0.00007	0.05	No	30	0.0001582	16.67	None	No	0.01	NP (normality)

Confidence Intervals - All Results (No Significant)


Page 4

Rockport BAP Client: Geosyntec Data: Rockport_BAP Printed 7/28/2025, 12:13 PM


Constituent	Well	Upper Lim.	Lower Lim.	Compliance	Sig.	N	Std. Dev.	%NDs	ND Adj.	Transform	Alpha	Method
Selenium, total (mg/L)	MW-1605D	0.0005	0.0001	0.05	No	30	0.0001951	76.67	None	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1605I	0.0005	0.00007	0.05	No	30	0.0002197	60	None	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1605S	0.0007025	0.000303	0.05	No	29	0.0004736	3.448	None	sqrt(x)	0.01	Param.
Selenium, total (mg/L)	MW-1606D	0.0005	0.0001	0.05	No	30	0.000178	80	None	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1606I	0.0005	0.0001	0.05	No	30	0.0001701	83.33	None	No	0.01	NP (NDs)
Selenium, total (mg/L)	MW-1606S	0.003748	0.002583	0.05	No	30	0.001295	0	None	No	0.01	Param.
Thallium, total (mg/L)	MW-1002	0.0002	0.00003	0.002	No	30	0.00008592	56.67	None	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1602D	0.0002	0.000066	0.002	No	30	0.00006788	80	None	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1602I	0.0002	0.00003	0.002	No	30	0.00008879	50	None	No	0.01	NP (normality)
Thallium, total (mg/L)	MW-1603D	0.0002	0.000068	0.002	No	30	0.00006888	76.67	None	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1603I	0.0002	0.00004	0.002	No	30	0.00008436	53.33	None	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1603S	0.0002	0.00005	0.002	No	30	0.00008192	60	None	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1604D	0.0002	0.000095	0.002	No	30	0.0000554	86.67	None	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1604I	0.0002	0.000052	0.002	No	30	0.00008245	66.67	None	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1604S	0.0002	0.00004	0.002	No	30	0.00008091	56.67	None	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1605D	0.0002	0.00005	0.002	No	30	0.00005214	90	None	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1605I	0.0002	0.00003	0.002	No	30	0.00008416	40	None	No	0.01	NP (normality)
Thallium, total (mg/L)	MW-1605S	0.0001	0.00003	0.002	No	30	0.00007819	33.33	None	No	0.01	NP (normality)
Thallium, total (mg/L)	MW-1606D	0.0002	0.000124	0.002	No	30	0.00005203	86.67	None	No	0.01	NP (NDs)
Thallium, total (mg/L)	MW-1606I	0.0002	0.00003	0.002	No	30	0.00008279	43.33	None	No	0.01	NP (normality)
Thallium, total (mg/L)	MW-1606S	0.0002	0.000078	0.002	No	30	0.00008016	70	None	No	0.01	NP (NDs)

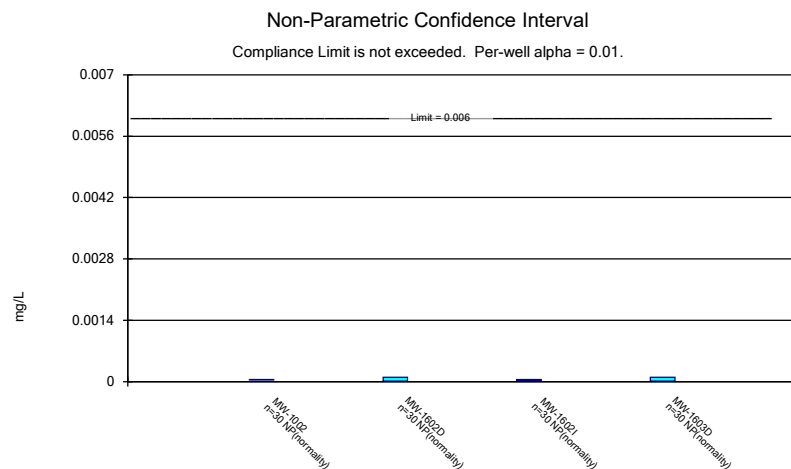


Constituent: Antimony, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

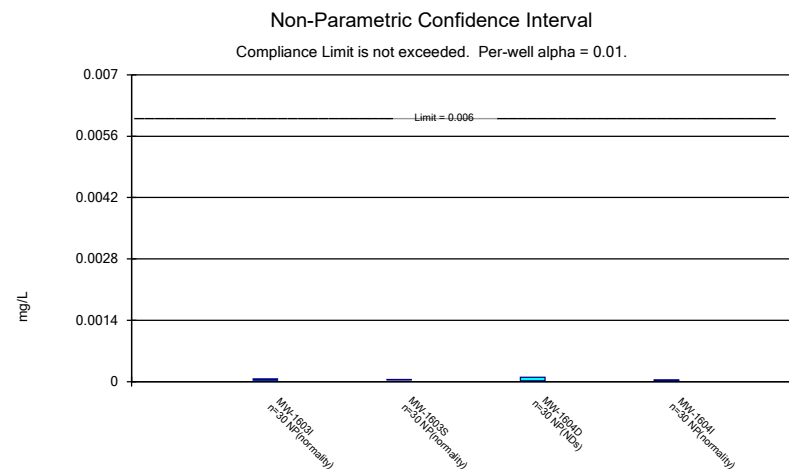

Constituent: Antimony, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

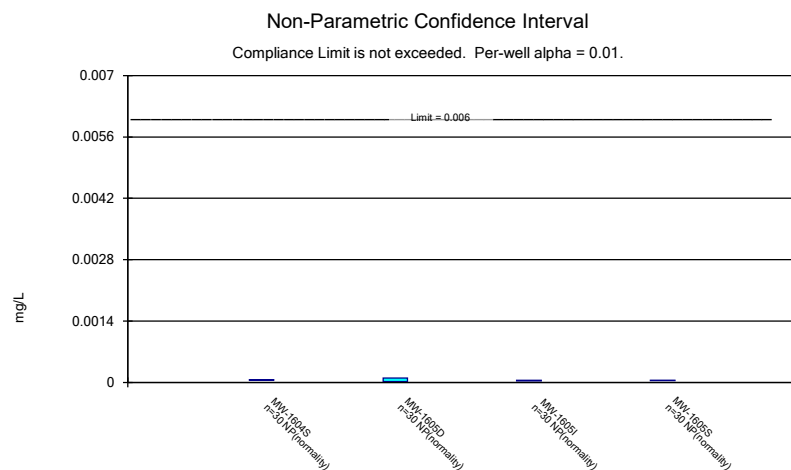


Constituent: Antimony, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

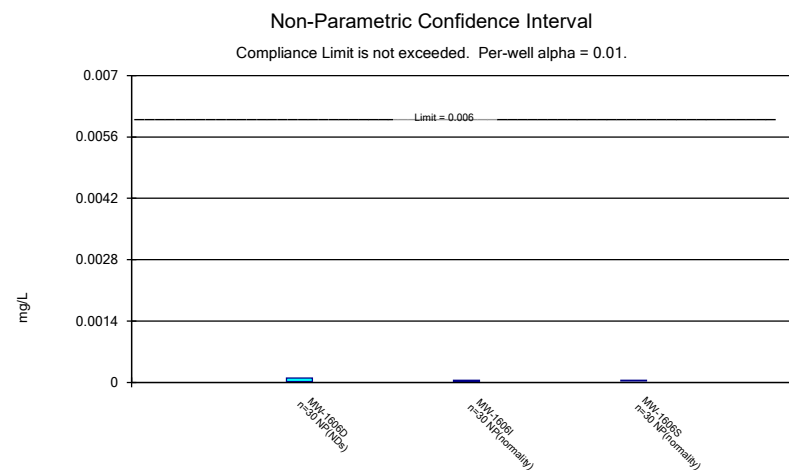

Constituent: Antimony, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

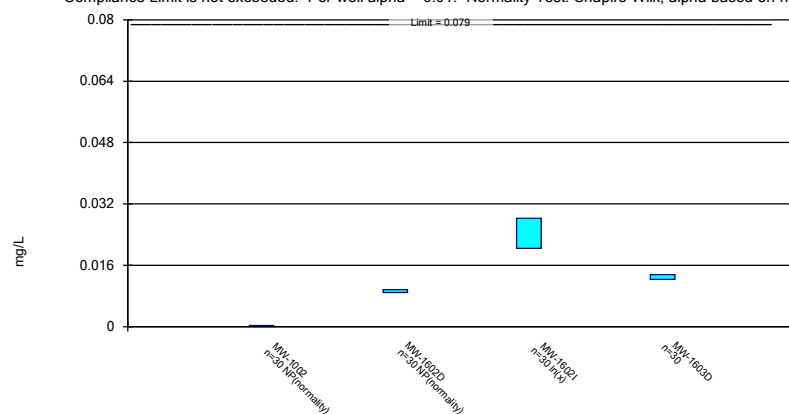

Constituent: Arsenic, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

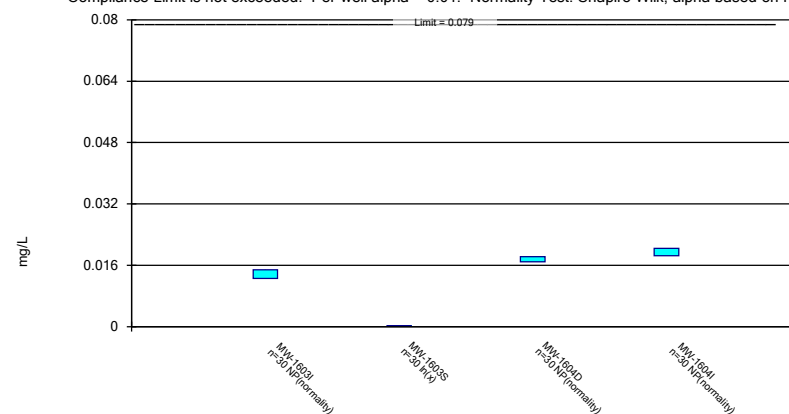

Constituent: Arsenic, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

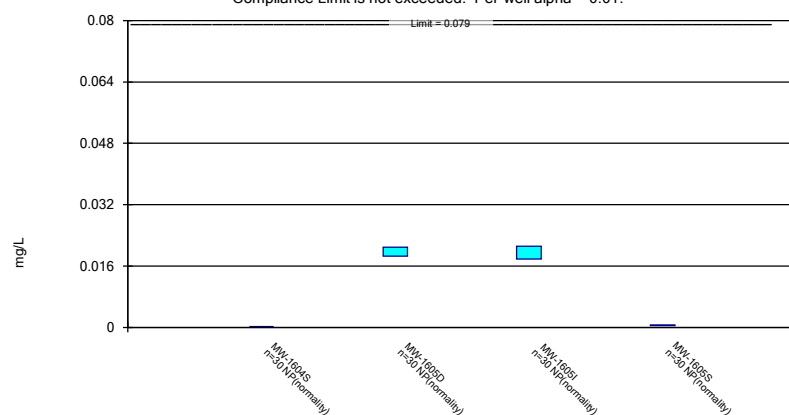

Constituent: Arsenic, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

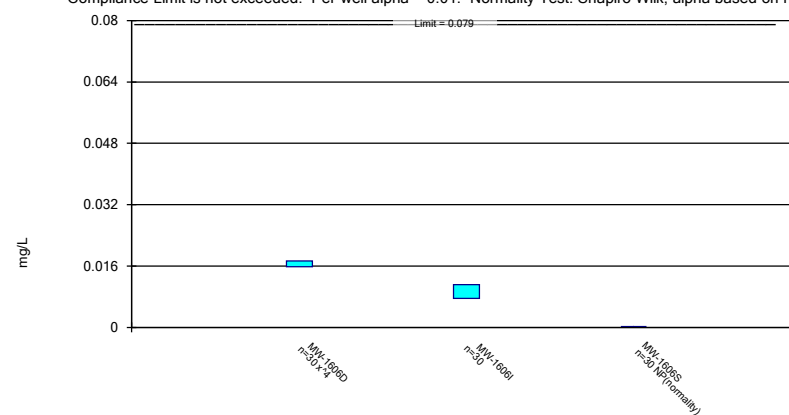

Constituent: Arsenic, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

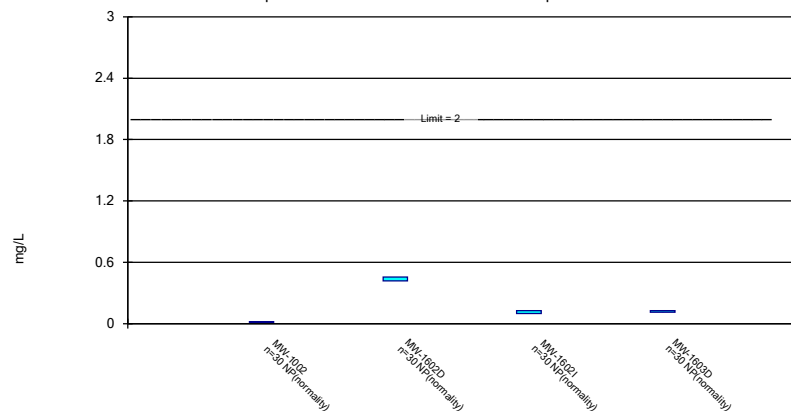

Constituent: Barium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

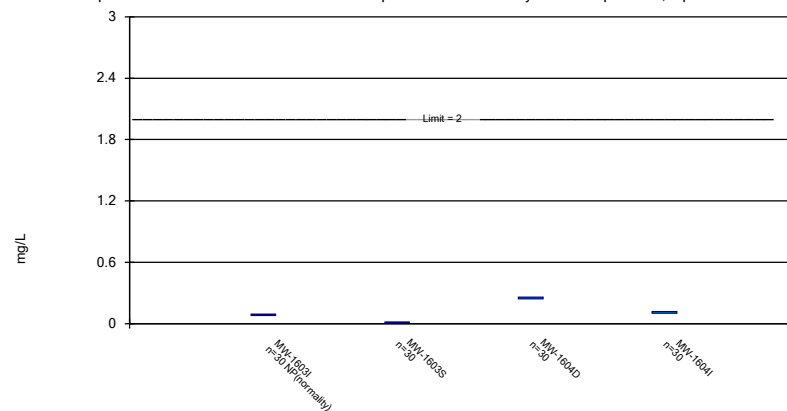

Constituent: Barium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

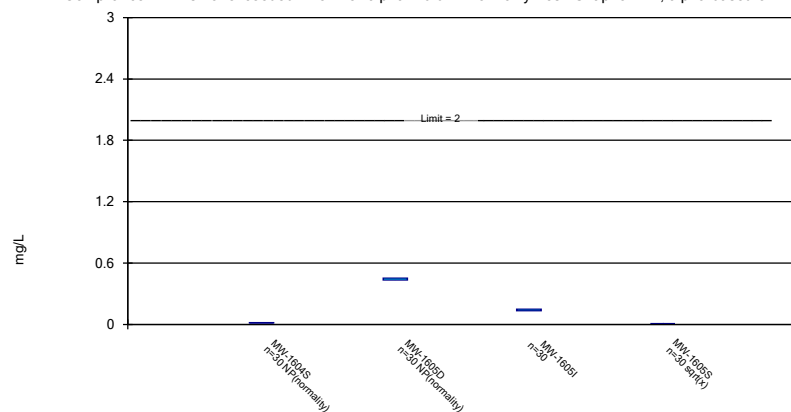


Constituent: Barium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

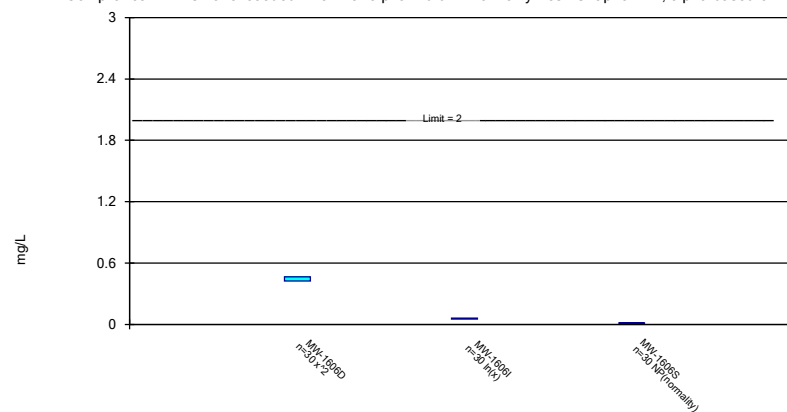


Constituent: Barium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

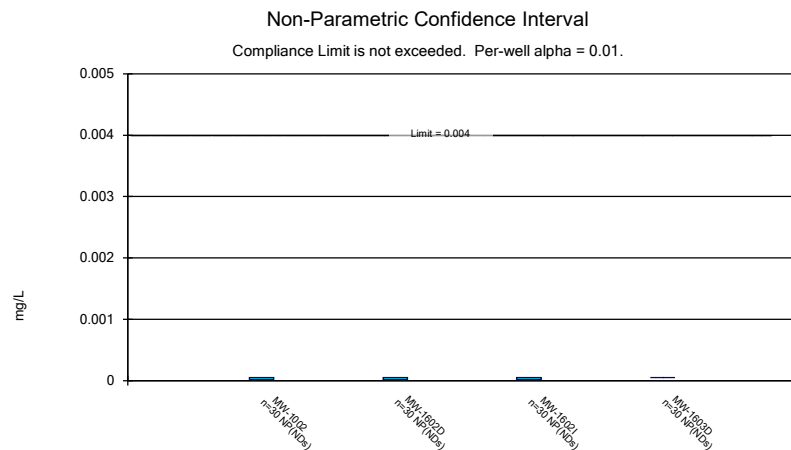


Constituent: Beryllium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

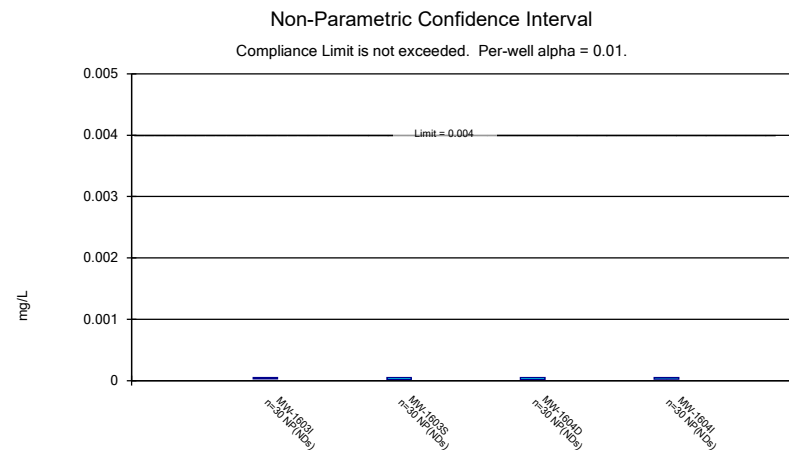


Constituent: Beryllium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

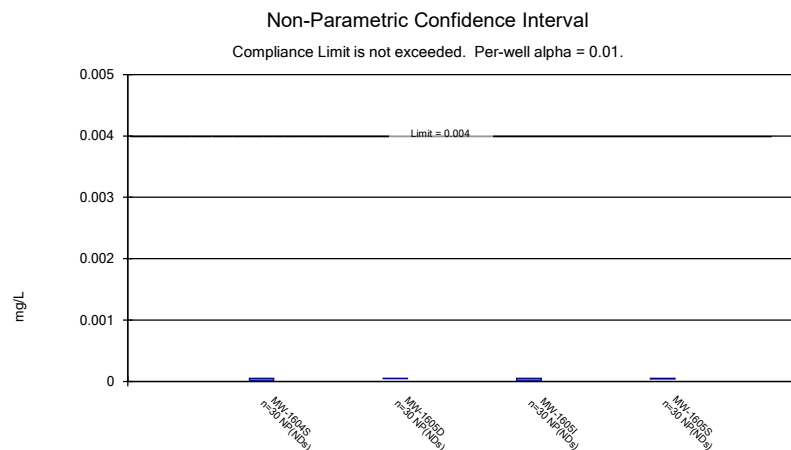


Constituent: Beryllium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

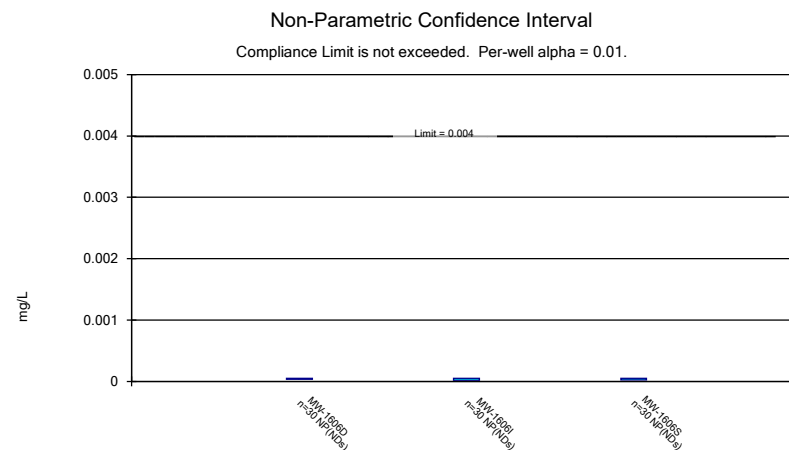


Constituent: Beryllium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

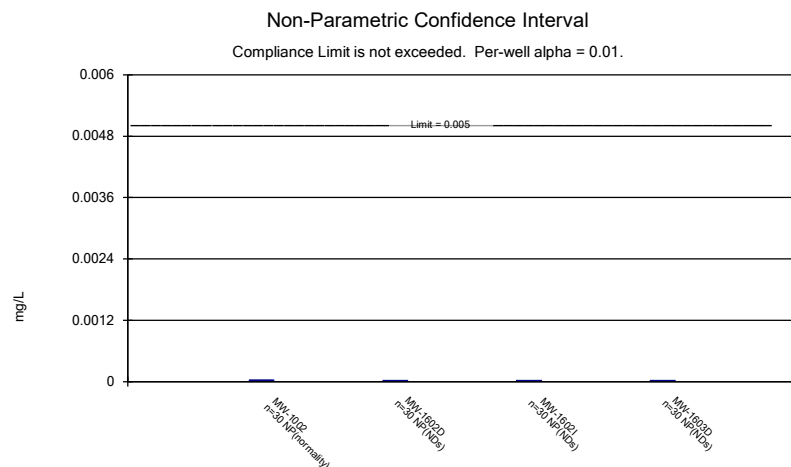


Constituent: Cadmium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

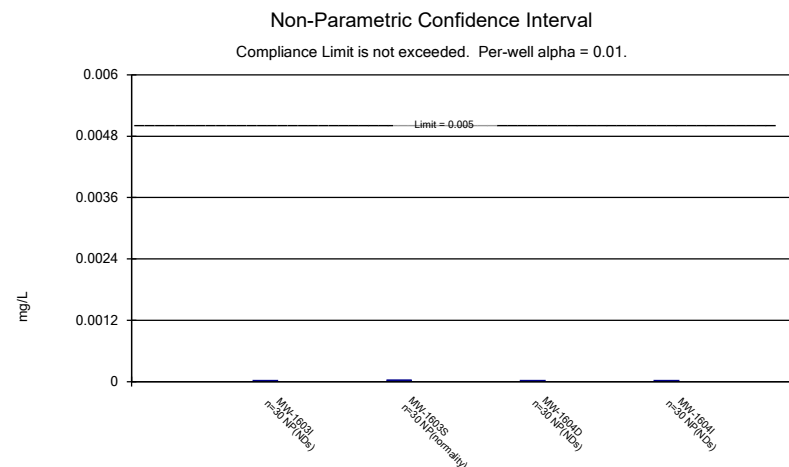

Constituent: Cadmium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

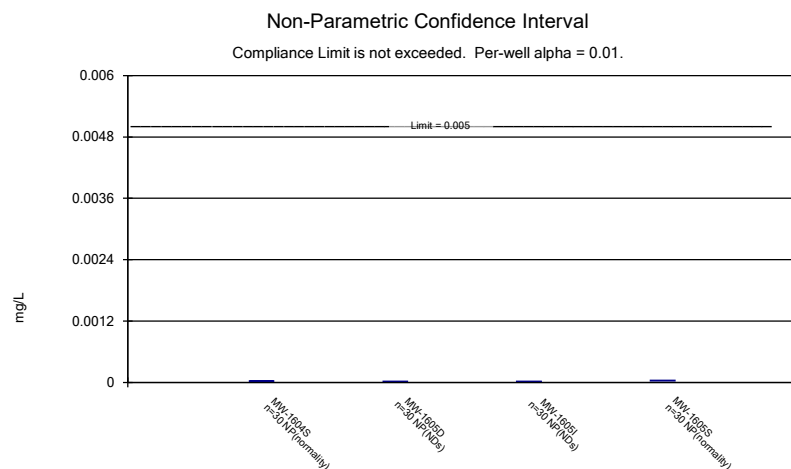


Constituent: Cadmium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

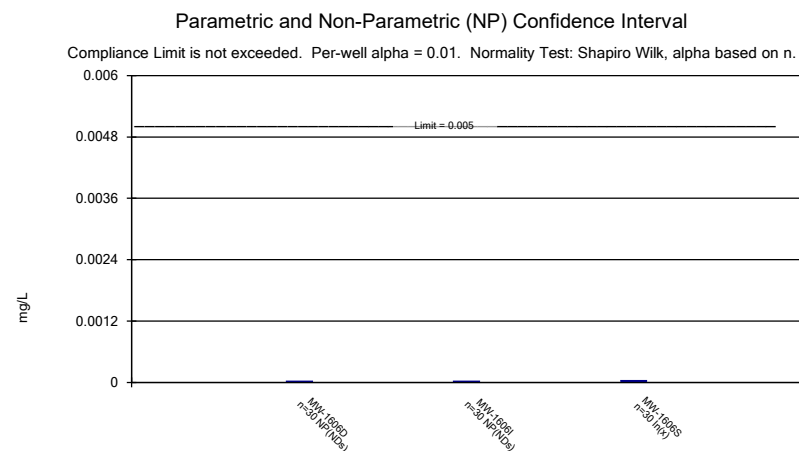

Constituent: Cadmium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

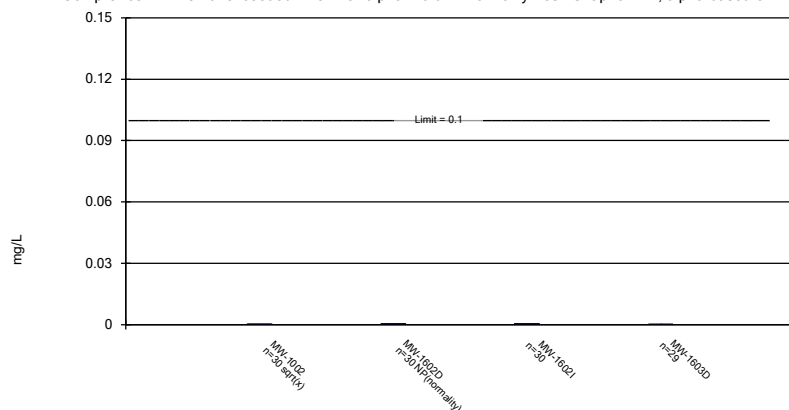

Constituent: Chromium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

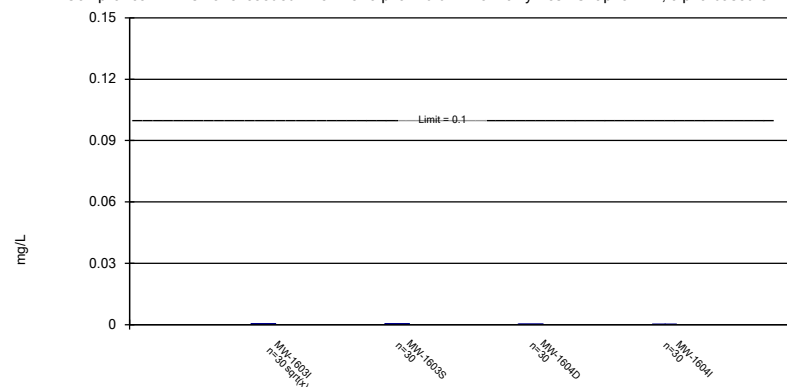

Constituent: Chromium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

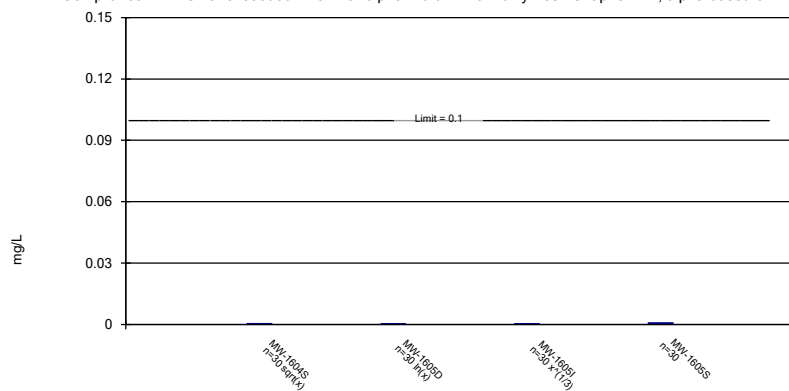

Constituent: Chromium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

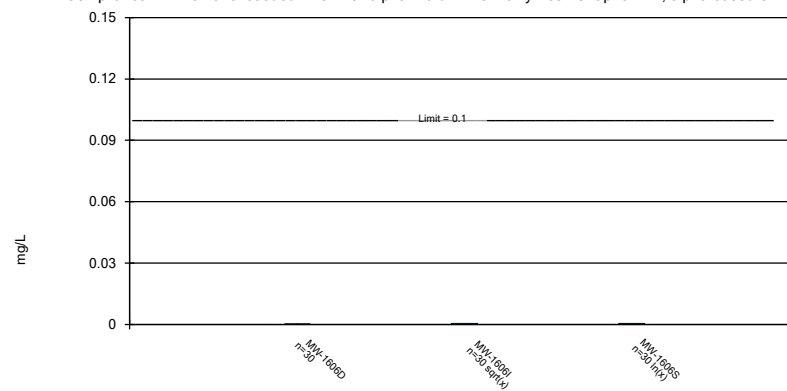

Constituent: Chromium, total Analysis Run 7/28/2025 12:11 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

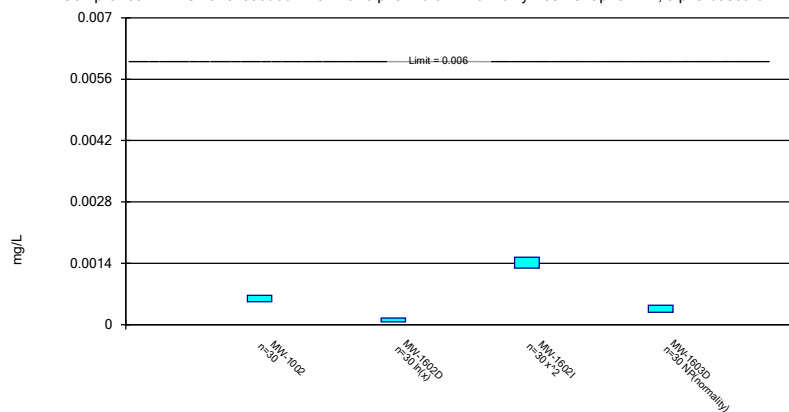

Constituent: Cobalt, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

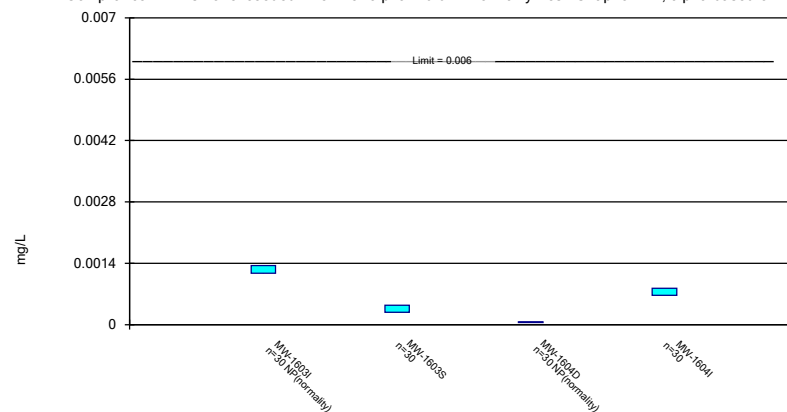

Constituent: Cobalt, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

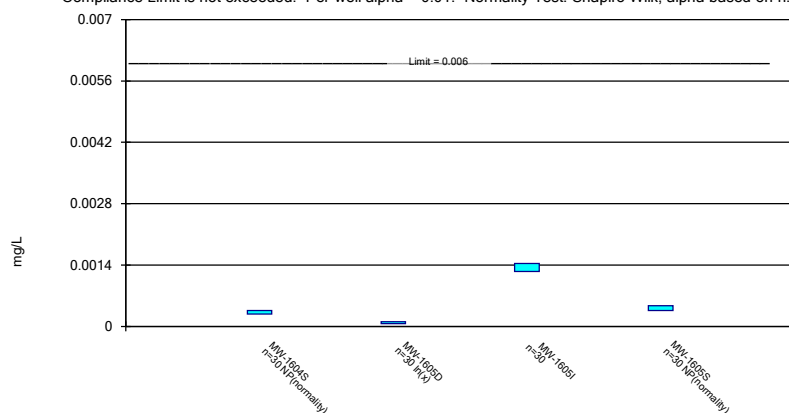

Constituent: Cobalt, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

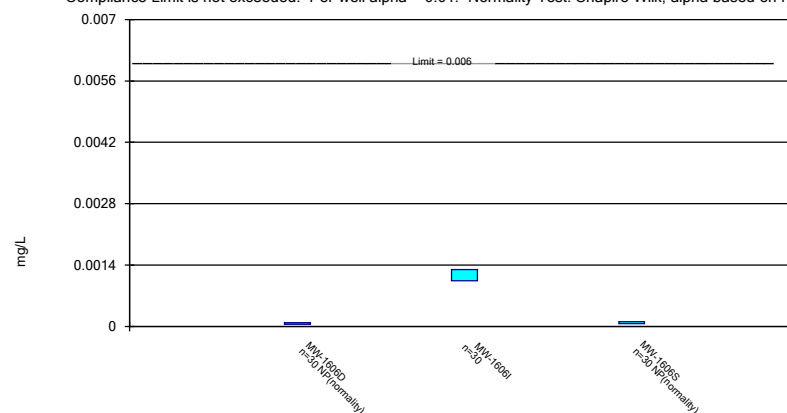

Constituent: Cobalt, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

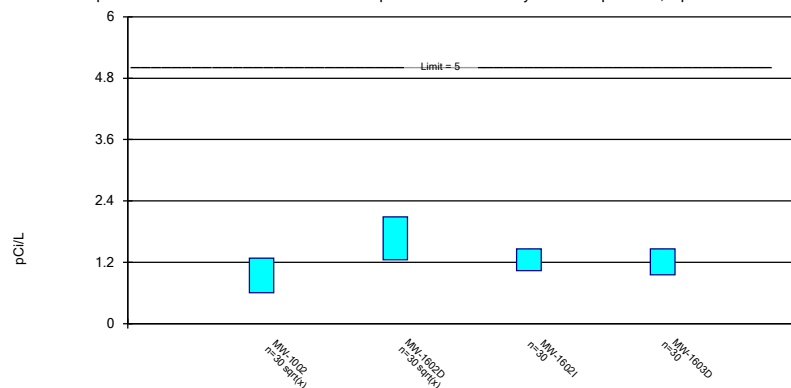

Constituent: Combined Radium 226 + 228 Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

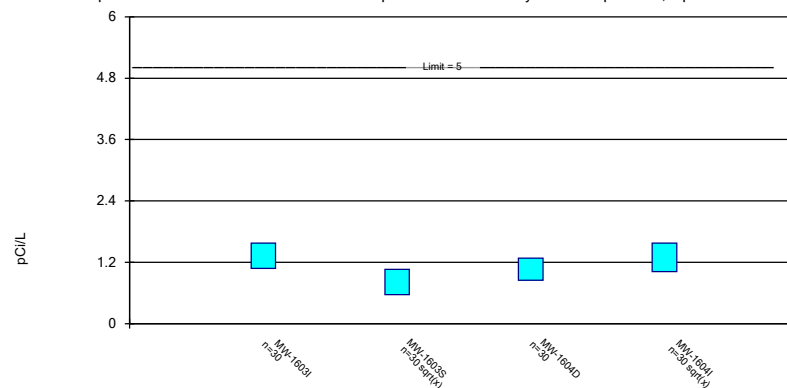

Constituent: Combined Radium 226 + 228 Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

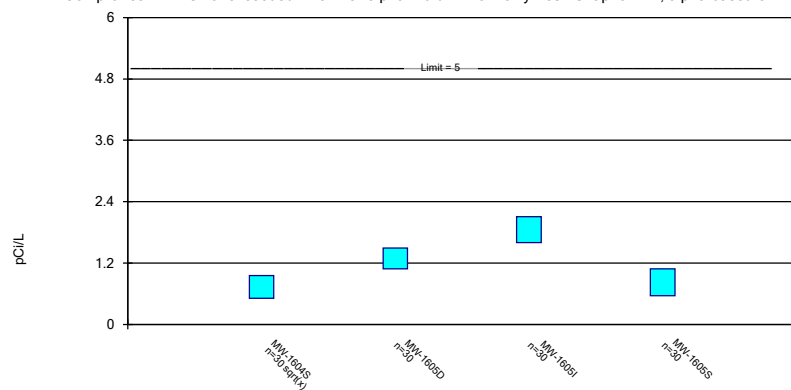

Constituent: Combined Radium 226 + 228 Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

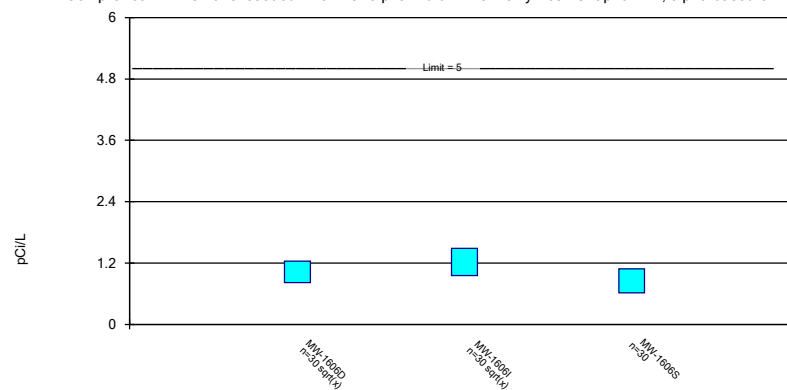

Constituent: Combined Radium 226 + 228 Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

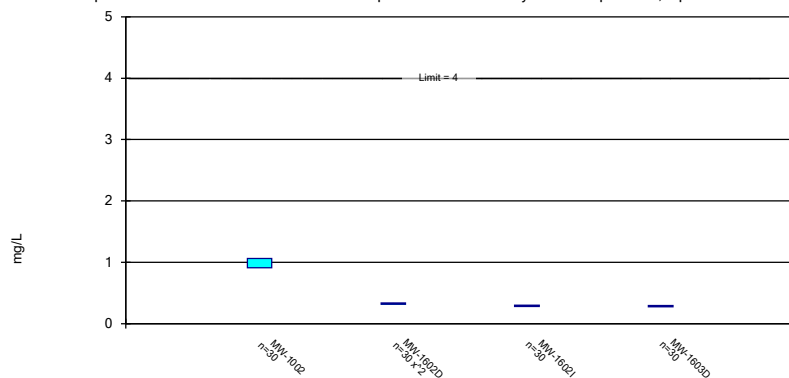

Constituent: Fluoride, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

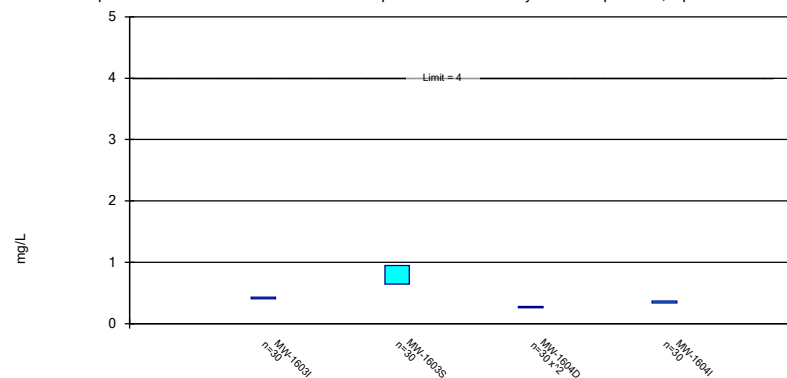

Constituent: Fluoride, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

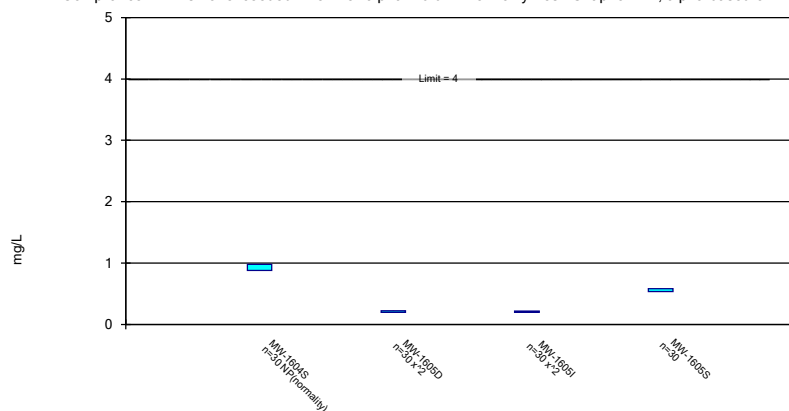

Constituent: Fluoride, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

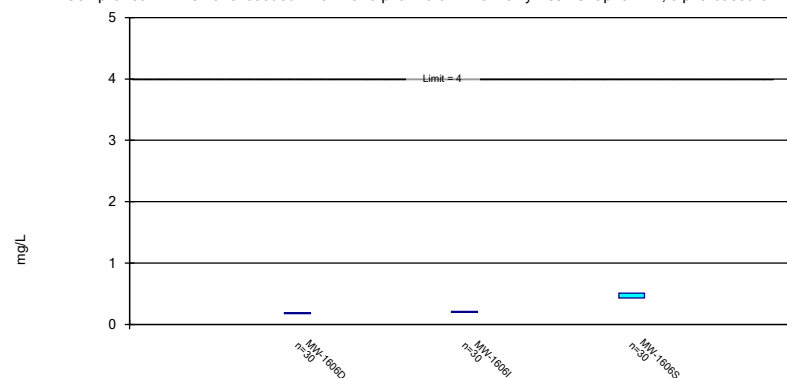

Constituent: Fluoride, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

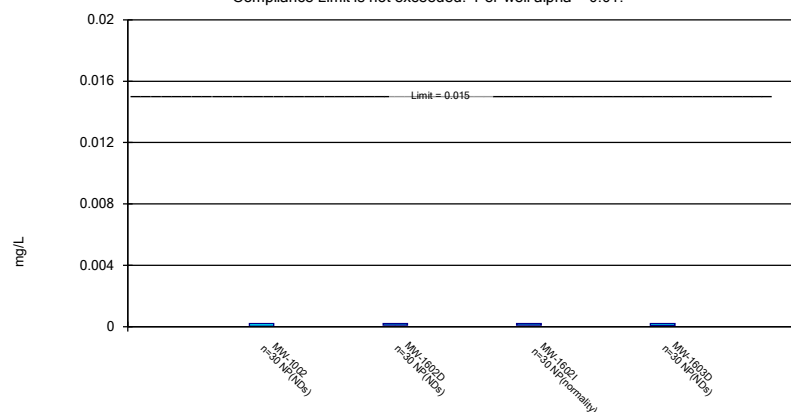

Constituent: Lead, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

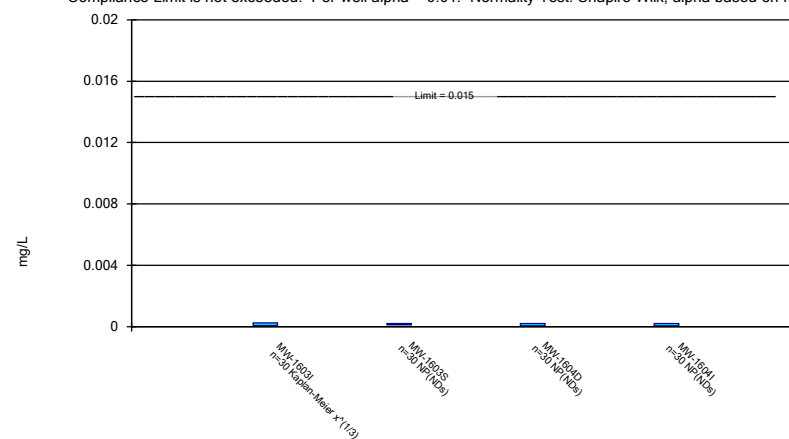

Constituent: Lead, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

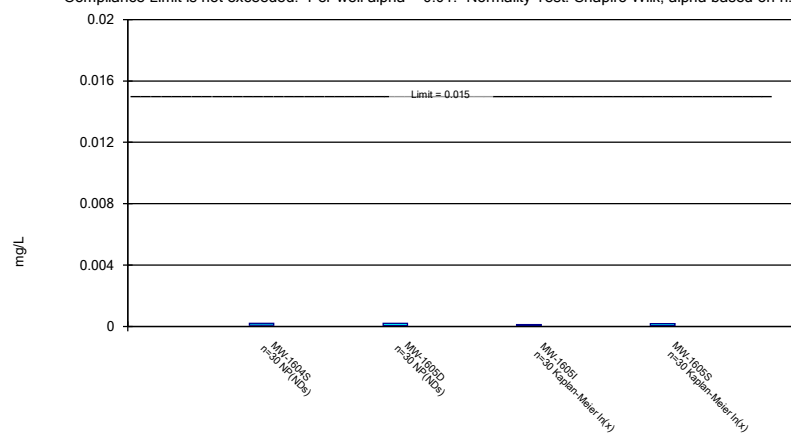

Constituent: Lead, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

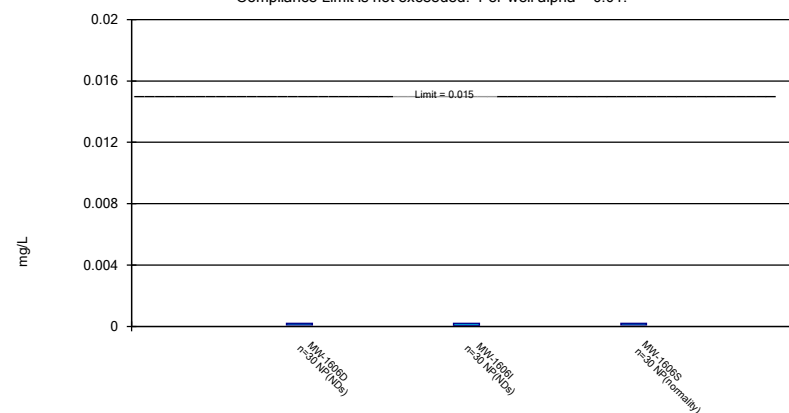

Constituent: Lead, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

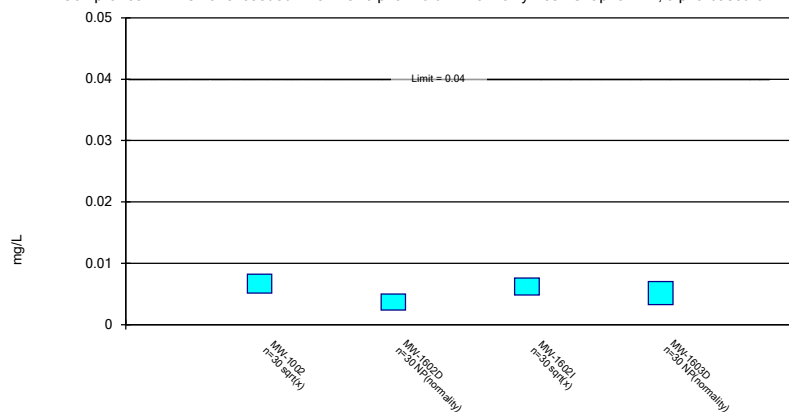

Constituent: Lithium, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

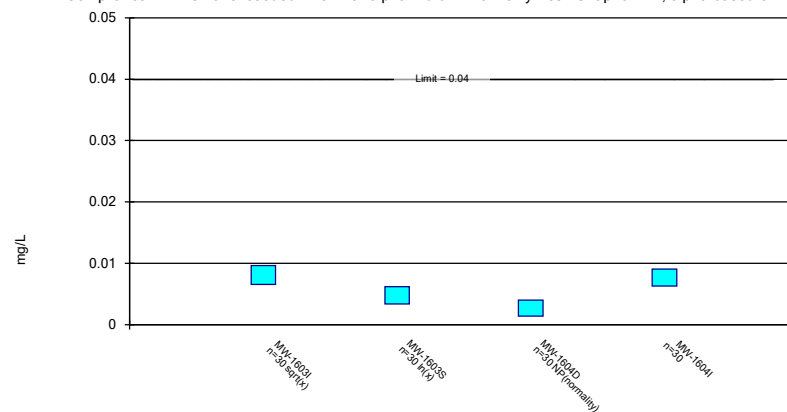

Constituent: Lithium, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

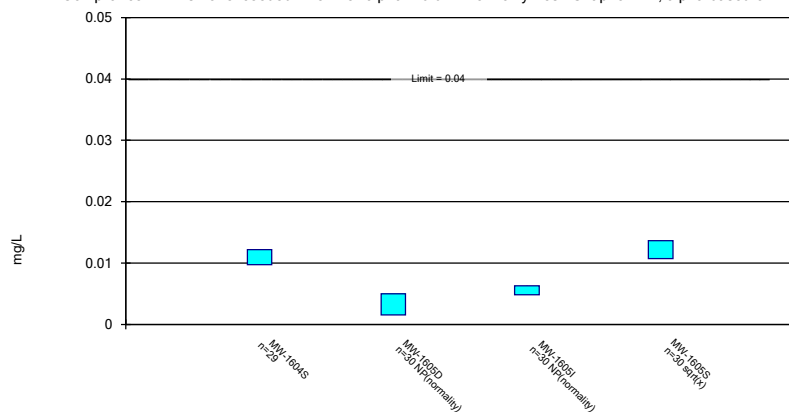


Constituent: Lithium, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

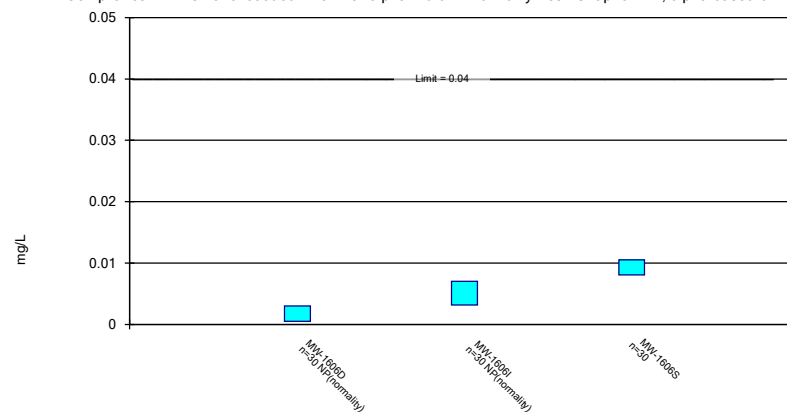


Constituent: Lithium, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

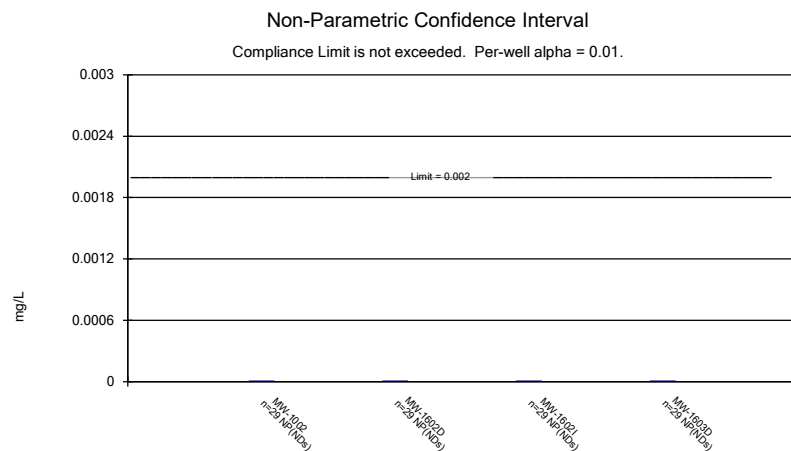


Constituent: Mercury, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

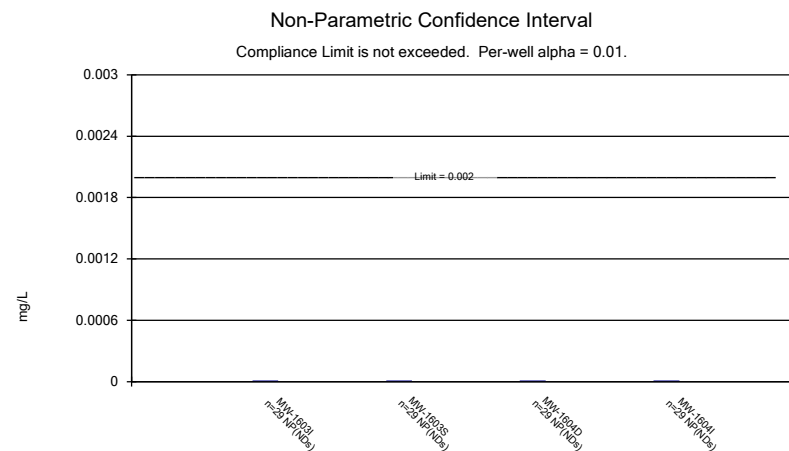

Constituent: Mercury, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

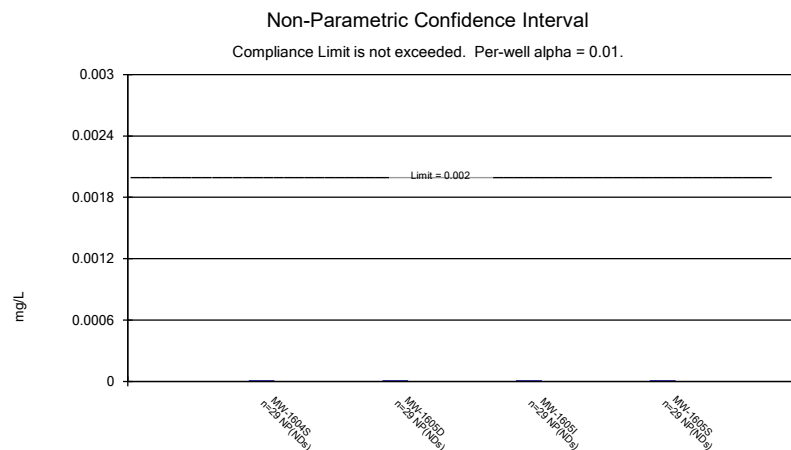


Constituent: Mercury, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

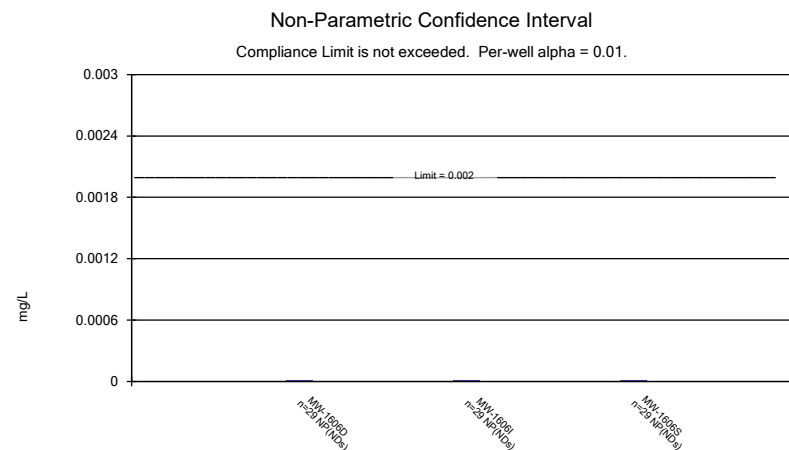

Constituent: Mercury, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

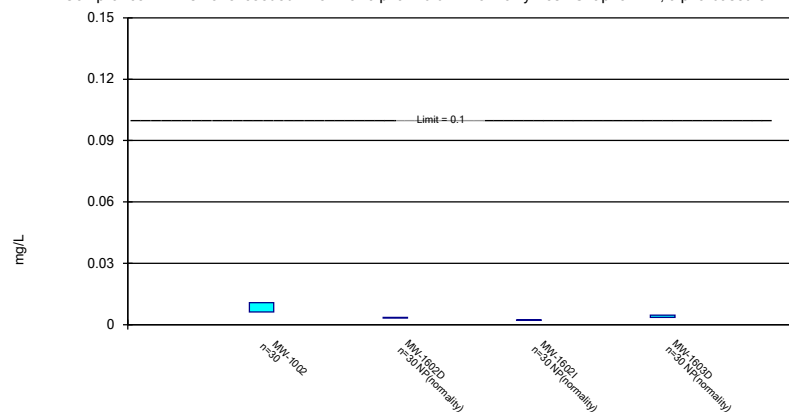

Constituent: Molybdenum, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

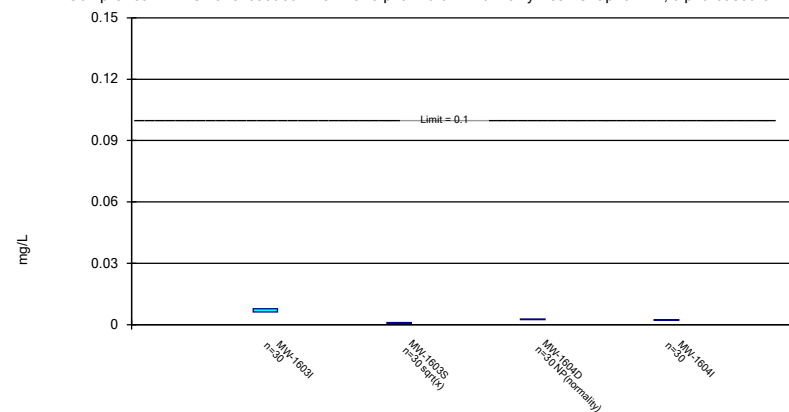

Constituent: Molybdenum, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

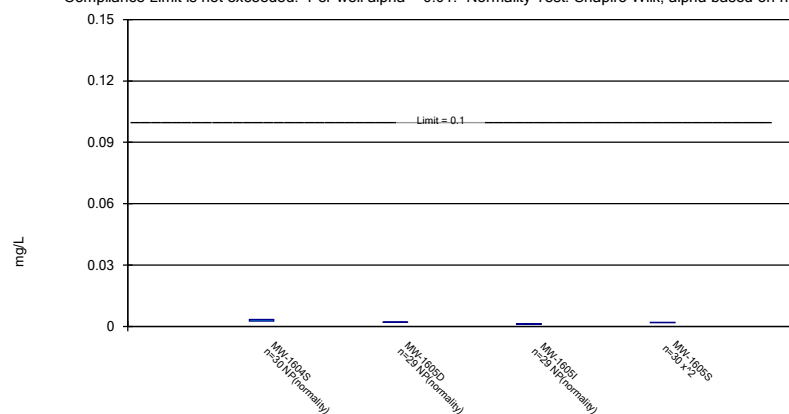

Constituent: Molybdenum, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

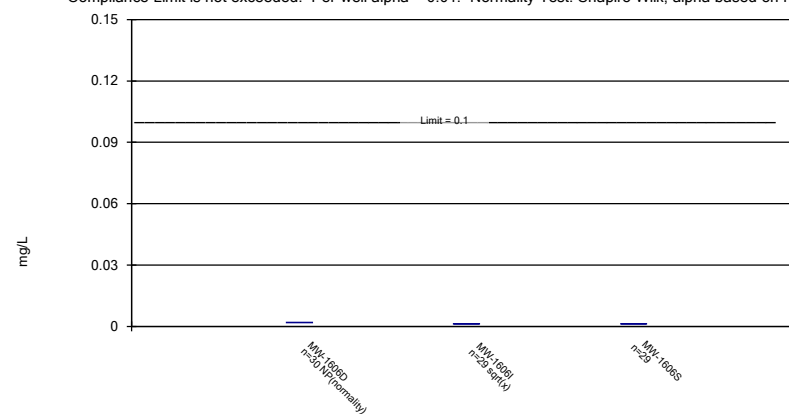

Constituent: Molybdenum, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Non-Parametric Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01.

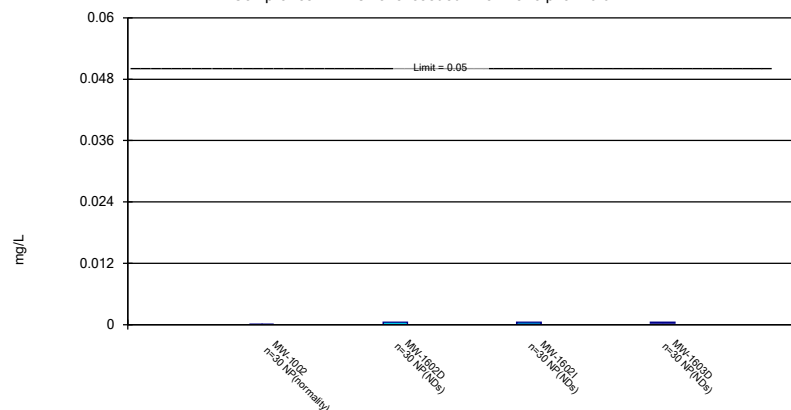

Constituent: Selenium, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

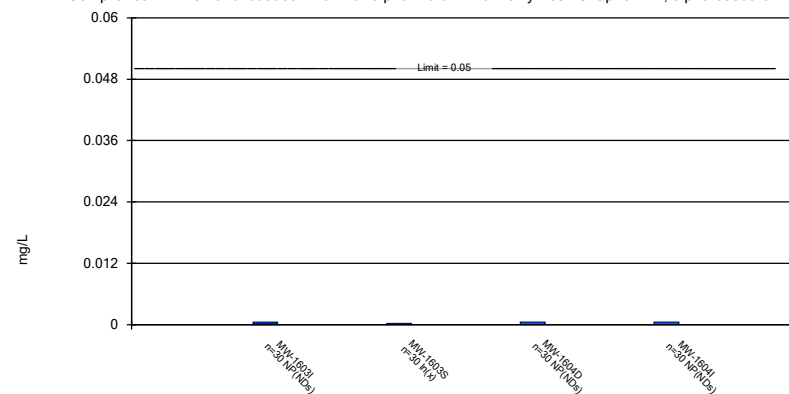

Constituent: Selenium, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

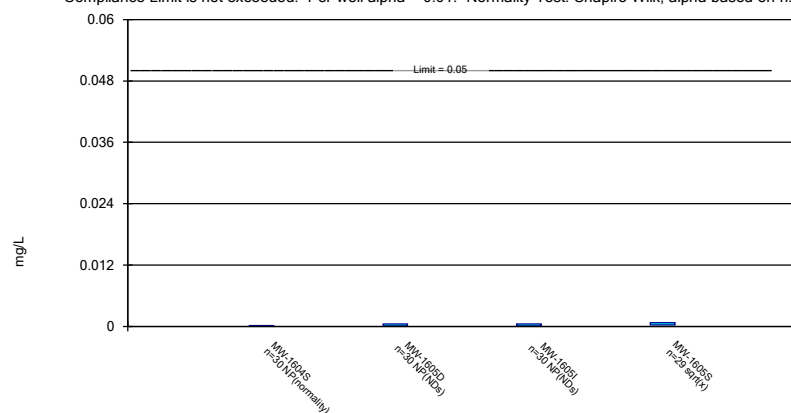


Constituent: Selenium, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

Parametric and Non-Parametric (NP) Confidence Interval


Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

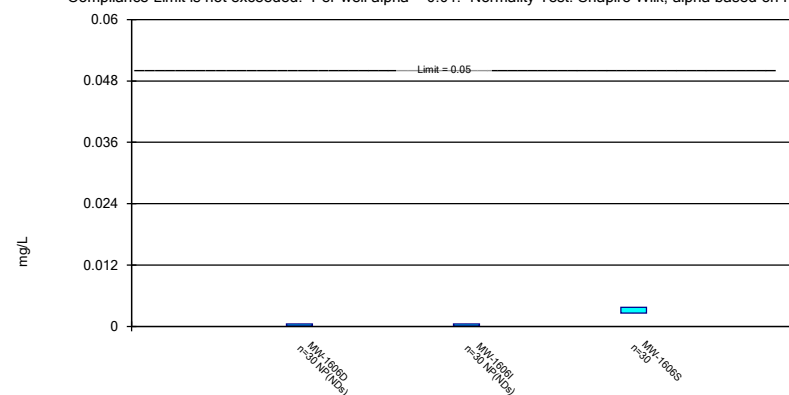


Constituent: Selenium, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

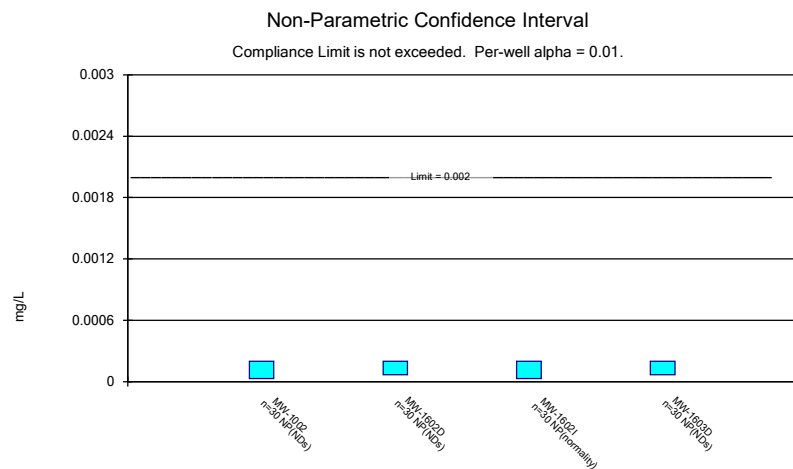


Constituent: Thallium, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

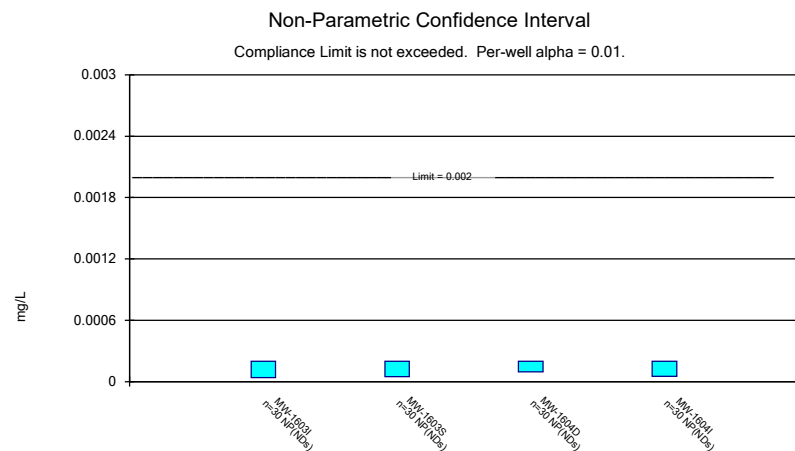

Constituent: Thallium, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

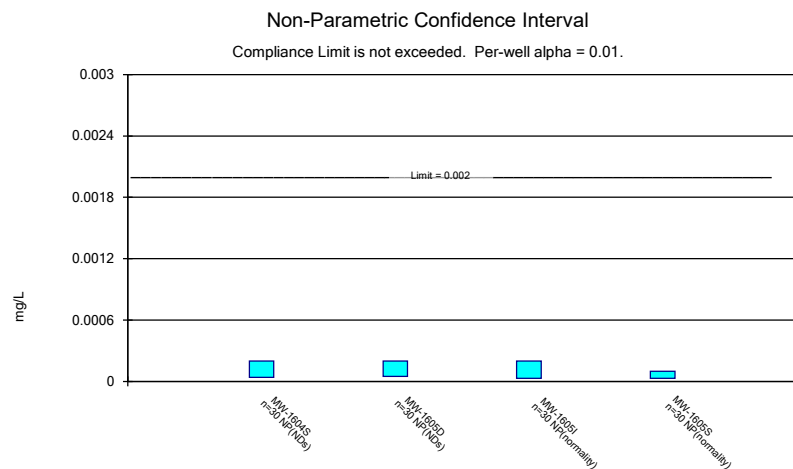

Constituent: Thallium, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

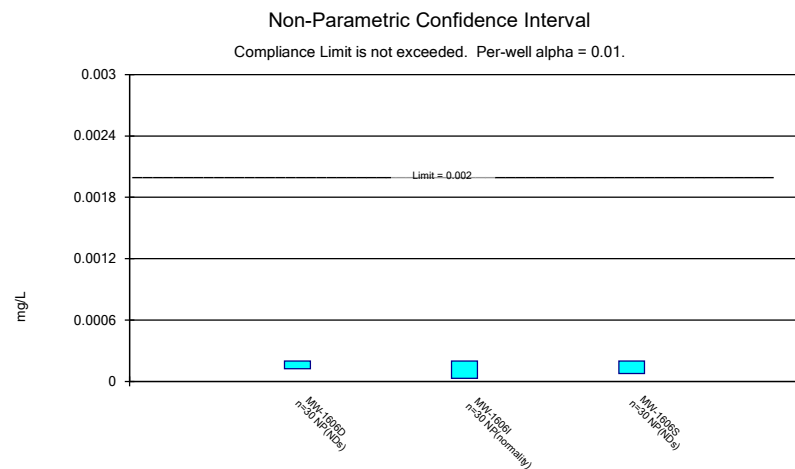

Constituent: Thallium, total Analysis Run 7/28/2025 12:12 PM View: Confidence Intervals
Rockport BAP Client: Geosyntec Data: Rockport_BAP

APPENDIX 3 – Alternate Source Demonstrations

No new alternate source demonstrations have been completed as of January 31, 2026.

APPENDIX 4 – Notices for Monitoring Program Transitions
--

The notification that an assessment monitoring program was initiated follows.

Rockport Plant Bottom Ash Pond

Notice of Assessment Monitoring Initiation

On January 15, 2018, it was determined that the Rockport Plant's Bottom Ash Pond Complex had statistically significant increases over background for the Appendix III parameters of boron, chloride, fluoride, pH, TDS, and sulfate. An alternative source demonstration was not successful within the 90 day period as allowed for in 257.94(e)(2). Therefore, an assessment monitoring program was established at Rockport's bottom ash pond complex on April 15, 2018 and this notice is being placed in Rockport's operating record in accordance with the requirement in 257.94 (e)(3).

APPENDIX 5 – Well Installation/Decommissioning Logs
--

There were no wells installed or decommissioned during the reporting period.